

ACR Fuel Channel Design



Livia Dimitrov
Section Head, ACR Reactor Engineering
Meeting with the USNRC and CNSC
2002 December





Outline

- **CANDU Fuel Channels**
- **ACR Fuel Channel Design Overview**
 - Fuel Channel Major Design Requirements
 - Fuel Channel Components Description
- **Interfaces between Fuel Channels and other Systems**
- **Discussion**




CANDU Reactor Core

- **In a CANDU reactor, the high pressure coolant and fuel is contained in several hundred small diameter horizontal channels (Fuel Channels)**
- **The Fuel Channels are insulated from the moderator by the gas in the annulus formed between the pressure tube and the concentric calandria tube**
- **The calandria tubes are part of the calandria vessel pressure boundary that is the container for the low pressure, low temperature, heavy water moderator.**
- **Any local failure of the moderator boundary will not result in the failure of the reactor coolant system boundary**



Fuel Channel Arrangement (CANDU-6)

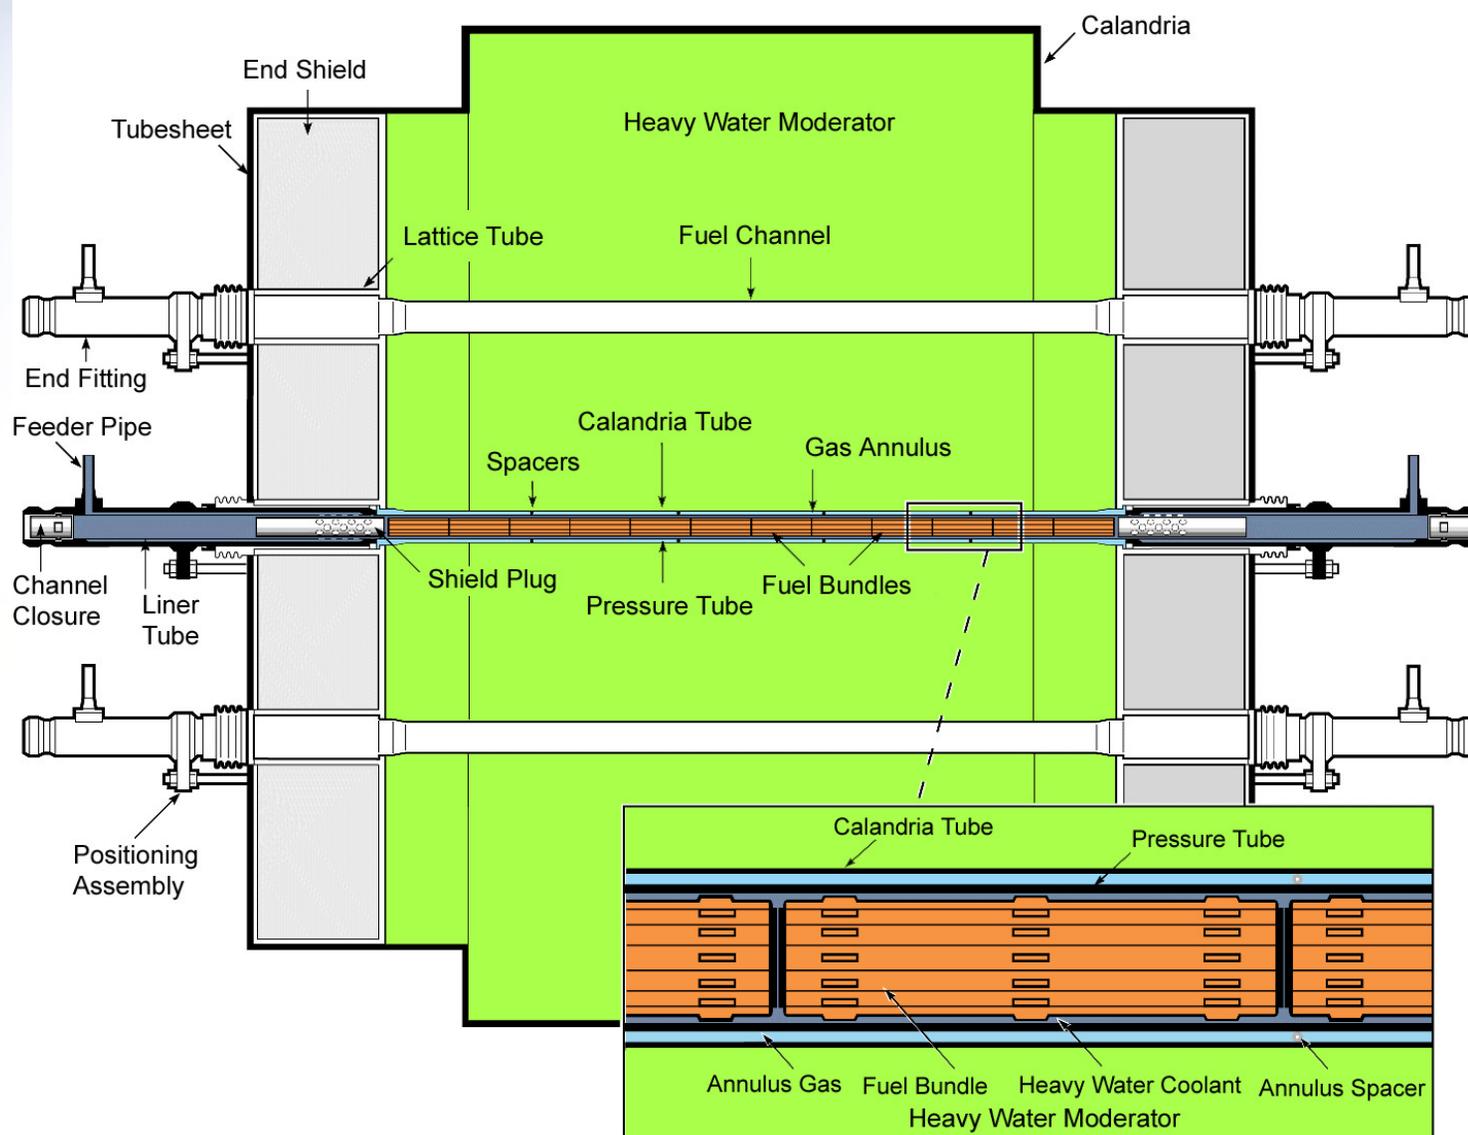



Fuel Channel Design Requirements

- Supports twelve fuel bundles and positions them axially in the core
- Allows on-power refuelling
- Directs flow of coolant through fuel bundle string
- Accommodates dimensional and material changes during operating life
- Permits pressure tube inspection and fuel channel replacement, if necessary (Single-Channel and Large-Scale Retubing)
- Pressure tube has high fracture toughness
- Failure of a pressure tube does not lead to failure propagation through the core.
- Pressure boundary consists of closure plugs (2), end fittings (2), and pressure tube




Fuel Channel Components

- **Components**
 - Pressure tube
 - End fittings with liner tube
 - Joint between pressure tube and end fitting
 - Shield Plug
 - Spacers in annulus between pressure tube and calandria tube
 - Calandria tube (not part of the fuel channel pressure boundary)

- **Components that interface with other systems**
 - Feeder connections
 - Restraint
 - Bellows and connection to annulus gas system
 - Closure Plug



CANDU 6 Fuel Channel Assembly

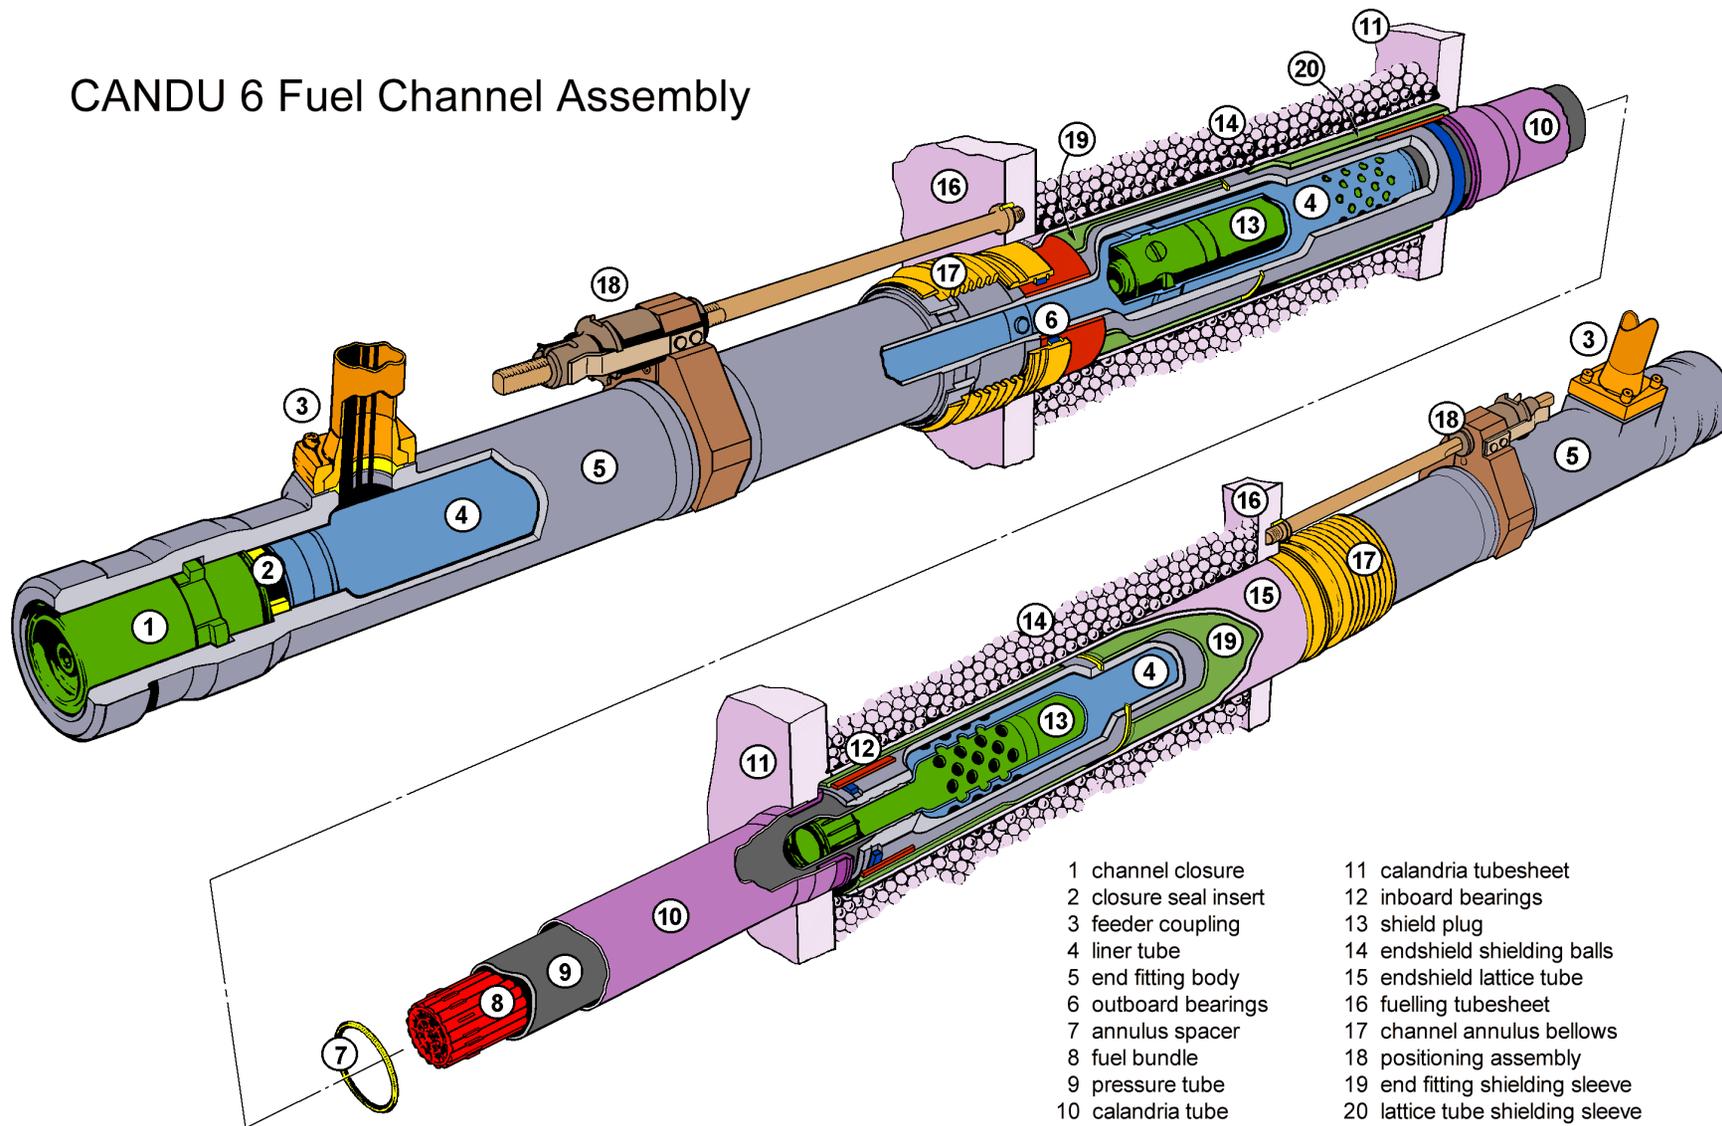

- 1 channel closure
- 2 closure seal insert
- 3 feeder coupling
- 4 liner tube
- 5 end fitting body
- 6 outboard bearings
- 7 annulus spacer
- 8 fuel bundle
- 9 pressure tube
- 10 calandria tube
- 11 calandria tubesheet
- 12 inboard bearings
- 13 shield plug
- 14 endshield shielding balls
- 15 endshield lattice tube
- 16 fuelling tubesheet
- 17 channel annulus bellows
- 18 positioning assembly
- 19 end fitting shielding sleeve
- 20 lattice tube shielding sleeve



ACR Fuel Channel

- **The ACR FC design is evolutionary, making use of features and materials successfully proven on other CANDU reactors, modified as necessary to suit ACR requirements.**
- **Compared to existing CANDU 6, ACR design has**
 - **slightly increased operating temperature, increased pressure**
 - **different fast neutron flux distribution**
 - **smaller lattice pitch**
 - **longer operating life**




Fuel Channel Design

	CANDU 6	ACR-700
No. of Fuel Channels	380	284
Overall FC Length	10804 mm (425.35")	11616 mm (457.32")
Lattice pitch	286 mm (11.25")	220 mm (8.66")
PT material	Zirconium 2.5wt% Niobium alloy	Zirconium 2.5wt% Niobium alloy
PT wall thickness	4.2 mm (0.165")	6.5 mm (0.256")
PT max. operating temperature	311 °C (592 F)	325 °C (617 F)
PT max. operating pressure	11 MPa (1595 psi)	13 MPa (1886 psi)
PT max. operating flux (for E>1MeV) (n/m²/s)	3.7x10¹⁷	4.1x10¹⁷ (for 7.5MW channel power)
Calandria tube material	Zircaloy-2	Zircaloy-4
Calandria tube wall thickness	1.4 mm (0.054")	2.5 mm (0.098")
PT/CT Gap	8 mm (0.31")	16.5 mm (0.65")
Fuel channel operating life	30 years at 80% capacity	30 years at 90% capacity



ACR Fuel Channel

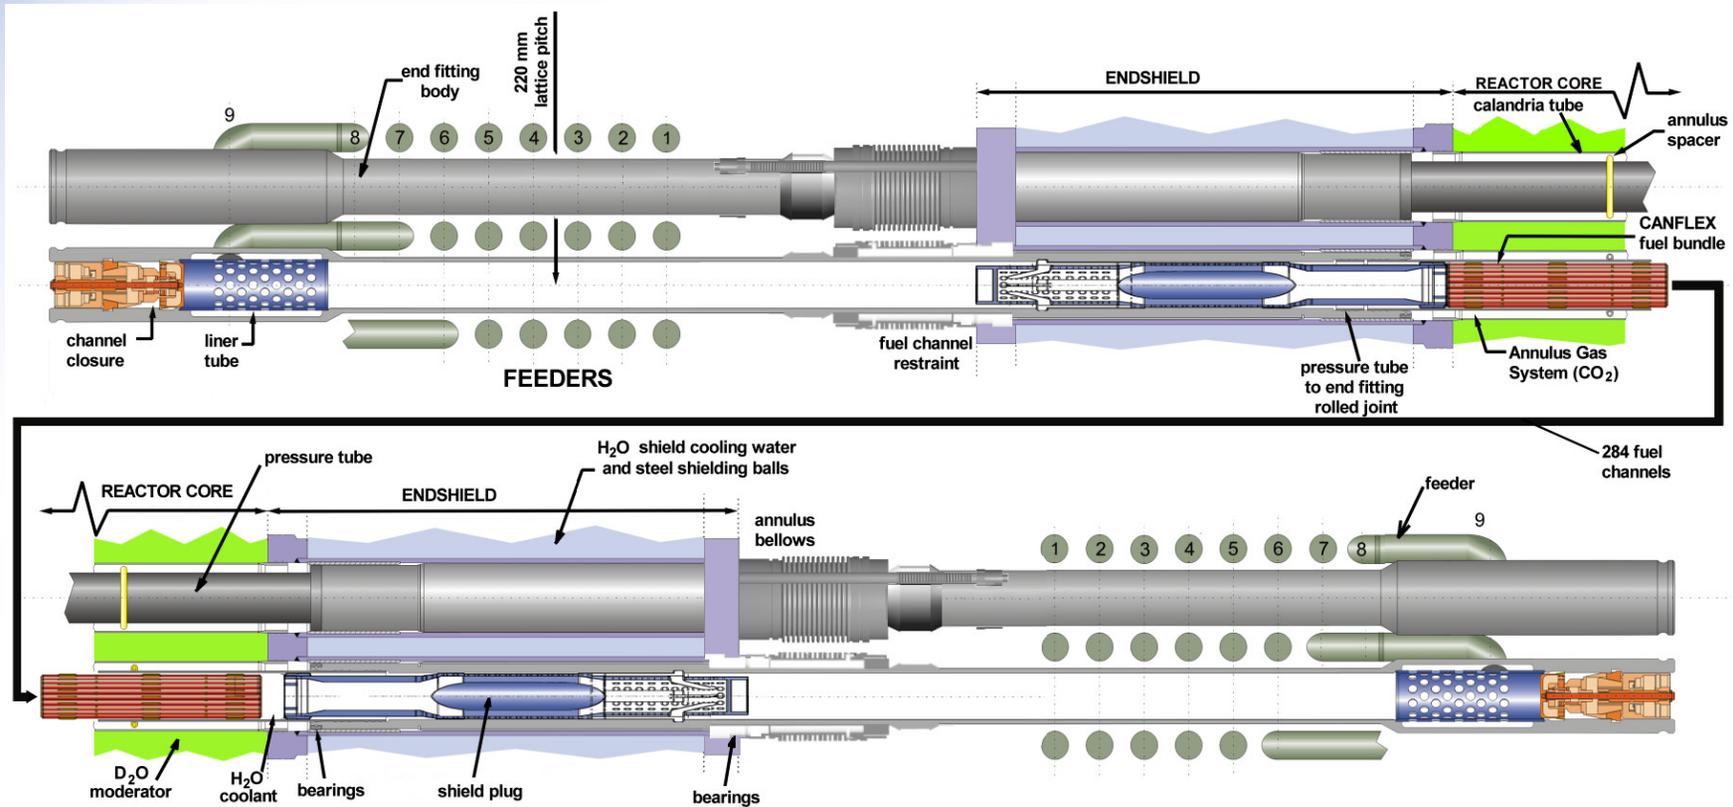



Pressure Tube (PT)

- **Designed in accordance with the Class 1C requirements of CSA Standards N285.0 and CAN/CSA-N285.2, with reference to Section III Subsection NB of the ASME Boiler and Pressure Vessel Code**
- **PT stresses are evaluated for both beginning of life and end of operating life conditions to account for pressure tube dimensional changes that occur over the PT life**
- **ACR stresses are reduced relative to CANDU-6 design**



ACR Pressure Tube (PT)

- The ACR PT is an extruded and drawn (cold worked) tube made of a zirconium 2.5wt% niobium alloy, per CSA Standard N285.6.1, the same material as all recent CANDU reactors
- Design stress values are covered by CSA Standard CAN/CSA- N285.6.7, Table 7.1, not an ASME Class 1 material
- The amount of cold work is about 27%, same as for other CANDU reactors
- The material chemistry is optimized to achieve the best in-reactor performance (fracture toughness, resistance to Delayed Hydride Cracking, deformation, H ingress)
- Prototype pressure tubes have been manufactured
- Testing of the prototype is underway
- The end of tube that exits the extrusion press first is to be installed at the outlet end of the fuel channel, to limit diametral strain due to creep and growth (same as the latest CANDU design)



Assessments of ACR Pressure Tube Aging

- **Assessments of PT deformation, H ingress, fracture and DHC are based on existing models and data**
 - Extrapolated to 30 years and ACR conditions
 - Assume highest power channel, largest material variability
 - Conservative estimates of benefits of improvements to PT (compared with historical data on which models are based)
- **Effects of deformation and H ingress will be acceptable over 30 years at 90% capacity**
- **Fracture behavior will also be acceptable**
- **Testing will be performed to confirm assessment results**



End Fitting (EF)

- **EFs are attached to the pressure tube ends as an out-of-core extension of the PT and contain shielding and coolant flow features**
- **The EF provides connection to feeder pipes at both ends (part of the Reactor Coolant System)**
- **The EFs are sealed by removable channel closure plugs which provide access for the fueling machines**
- **Each EF contains a shield plug which locates the fuel bundles**
- **The liner tube inside each end fitting diffuses flow at feeder entrance/exit**



End Fitting (EF)

- **EF material is a combination of high strength (required for the pressure tube rolled joint area to assure a strong, leak- tight connection) and good corrosion resistance (to prevent deterioration of the various seal faces)**
- **Material – modified Type 403 stainless steel to the requirements of CSA Standard N285.6.8, not an ASME Class 1 material**
- **The EFs are forged in one piece, heat treated and then machined to the finished size**
- **The EF is designed in accordance with the Class 1 requirements of CSA Standards N285.0, with reference to Section III, Subsection NB of the ASME Boiler and Pressure Vessel Code**




ACR Liner Tube

- **410 stainless steel (same as recent CANDU designs)**
- **Design objectives for liner tube:**
 - perforations provide adequate flow area so that the coolant pressure drop across the liner tube is minimised
 - accommodates passage of ACR shield plug and fuel bundles during refueling




Shield Plug

- The ACR shield plug is based on a flow through design
- The shield plug is attached in the bore of the end fitting to locate the fuel bundles and to provide shielding

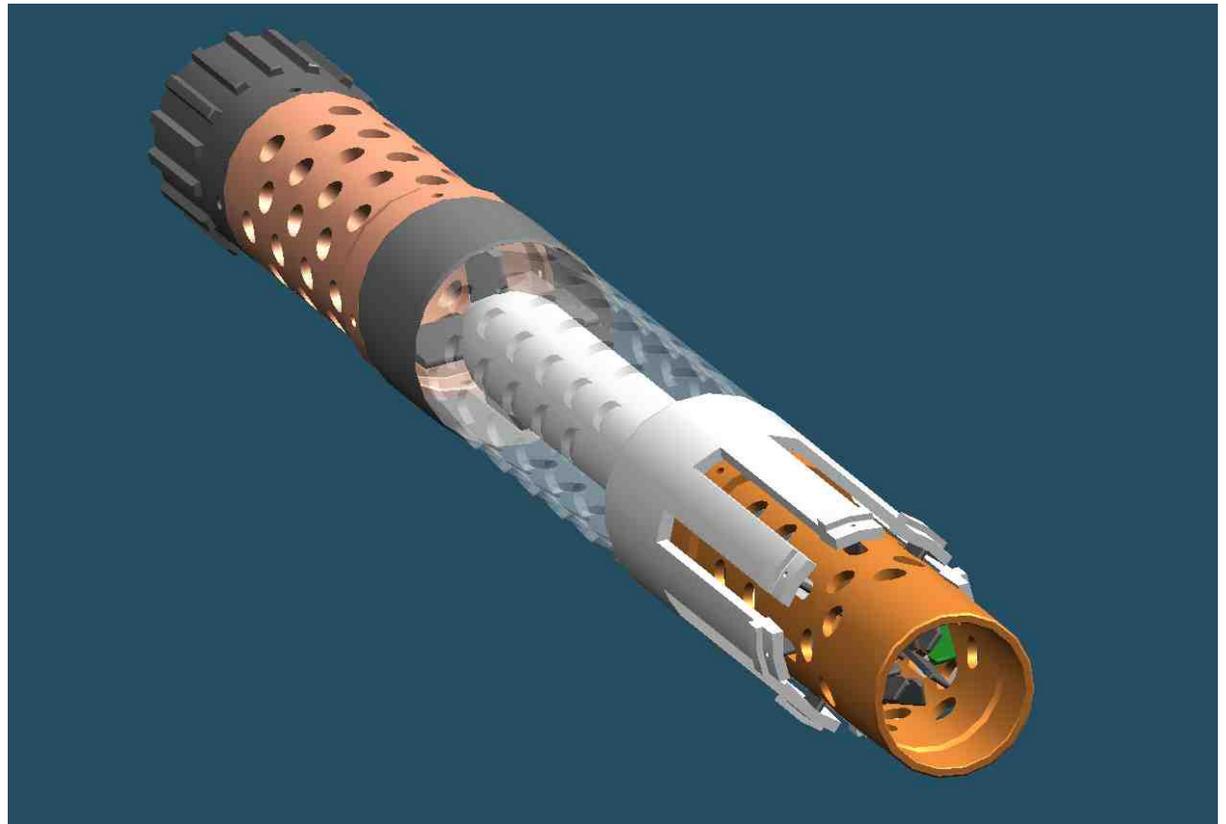



ACR Channel Closure

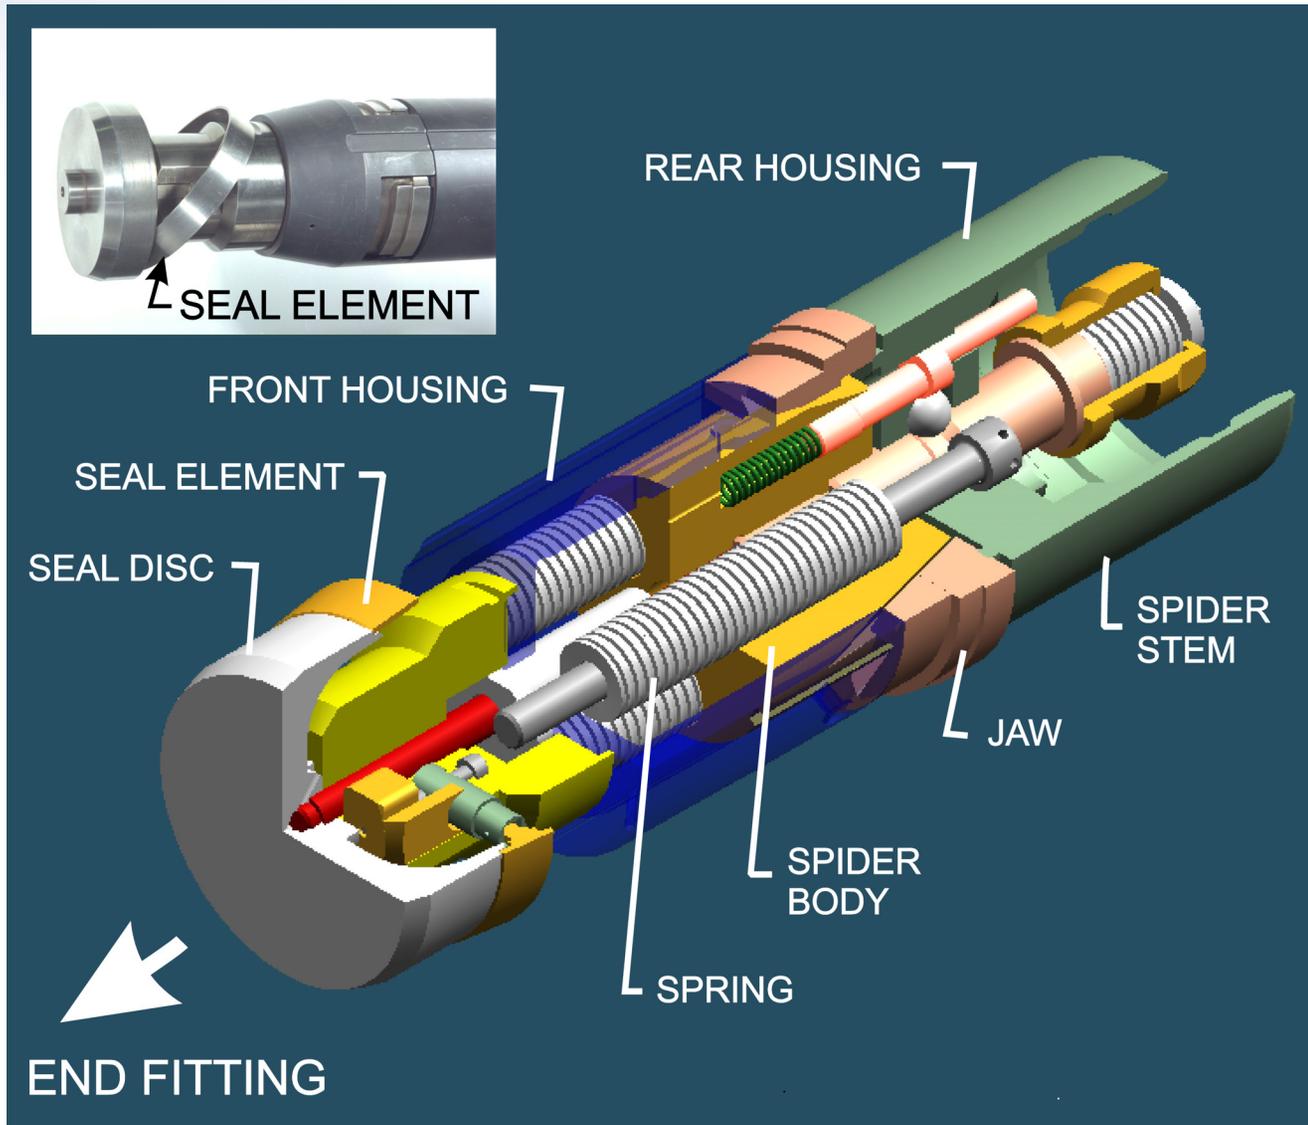



ACR Channel Closure

- **Removable pressure boundary component to permit fuel changing designed in accordance with the Class 1C requirements of CSA Standards N285.0, with additional requirements provided in CAN/CSA-N285.2, with reference to Section III, Subsection NB of the ASME Boiler and Pressure Vessel Code**
- **The basis of the channel closure design is a flexible metallic ring that makes a face seal against an edge in the end fitting**
- **The design relies on reactor coolant pressure to assist in the sealing operation**
- **A safety lock is incorporated into the latching mechanism to prevent inadvertent removal of the channel closure**



Pressure Tube Rolled Joint

- Each end of the PT is roll expanded into an end fitting
- When the rolled joint is being made the PT undergoes a wall reduction and the material extrudes both radially into grooves in the EF (producing local ridges on the outside of the PT) and axially as well
- The material extruded into the grooves is responsible for the axial strength of the joint
- The parameters monitored during testing are:
 - helium leak rate
 - residual stress distribution in the PT and EF material
 - pull- out strength
 - stress relaxation effects
- Excellent performance of over 20,000 rolled joints in service provide confidence that the rolled joints in the ACR-700 reactor will perform well




Pressure Tube Rolled Joint

- **The rules, which the rolled joint must meet, are covered in CSA Standard CAN/CSA- N285.2**
- **Finite element stress analysis is used to confirm that the stresses in the rolled joint region meet the allowable limits specified by Section III Subsection NB of the ASME Boiler and Pressure Vessel Code**



ACR Pressure Tube Rolled Joint


- Groove number, spacing, and geometry same as CANDU 6
- Zero-clearance rolled joint is used to limit the tensile residual stresses resulted from rolling process (same as CANDU 6)
- EFs at both ends of FC have double sets of rolling grooves to facilitate retention of EFs during retubing

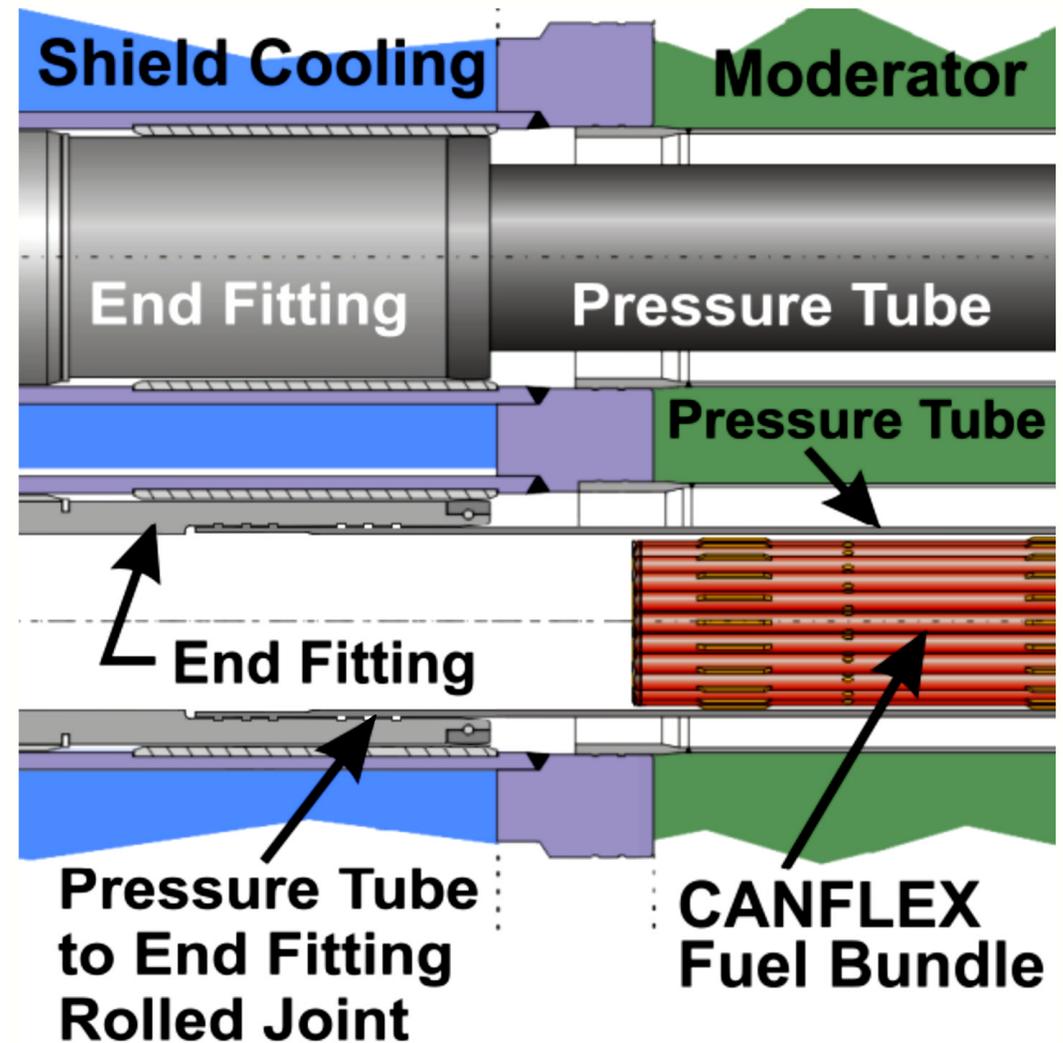




ACR Feeder Connection

Inconel alloy 625
feeder elbow
factory-welded to
the extruded
feeder port

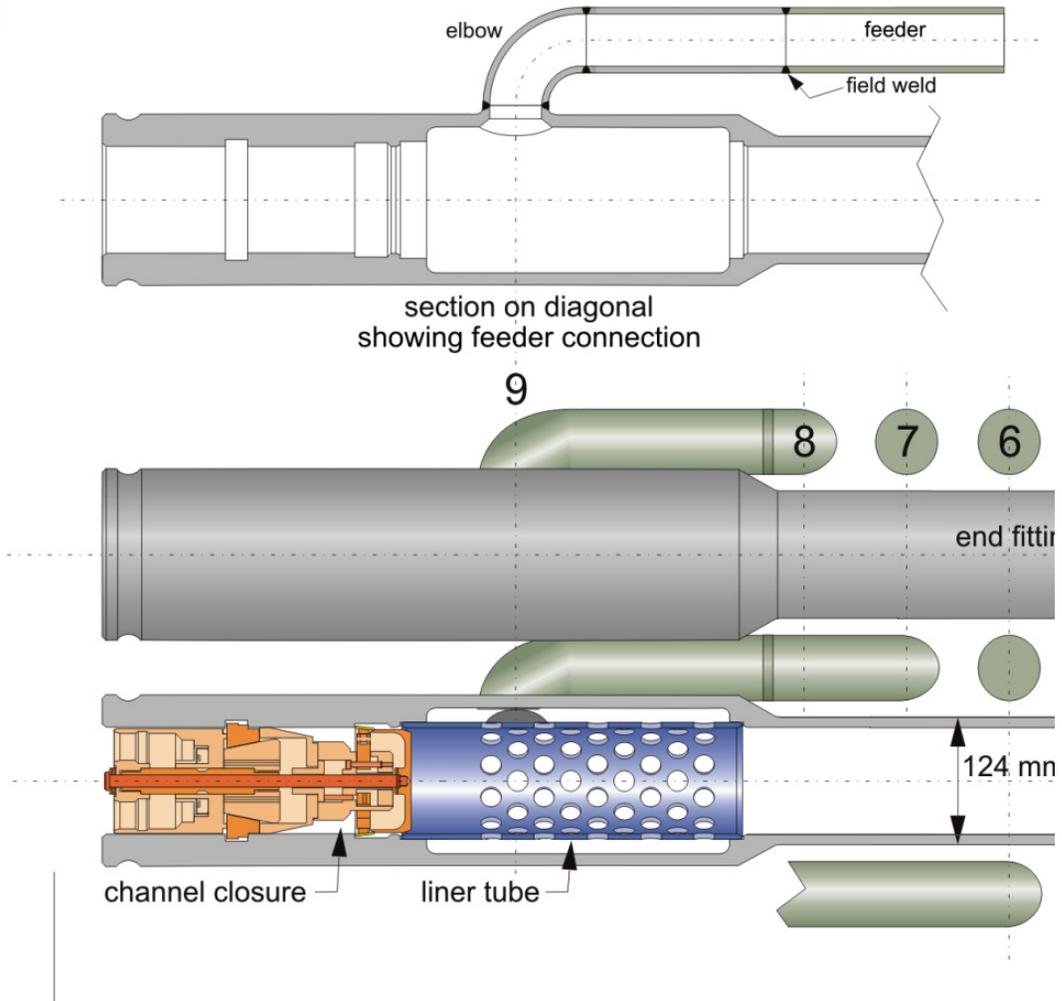



ACR Feeder Arrangement

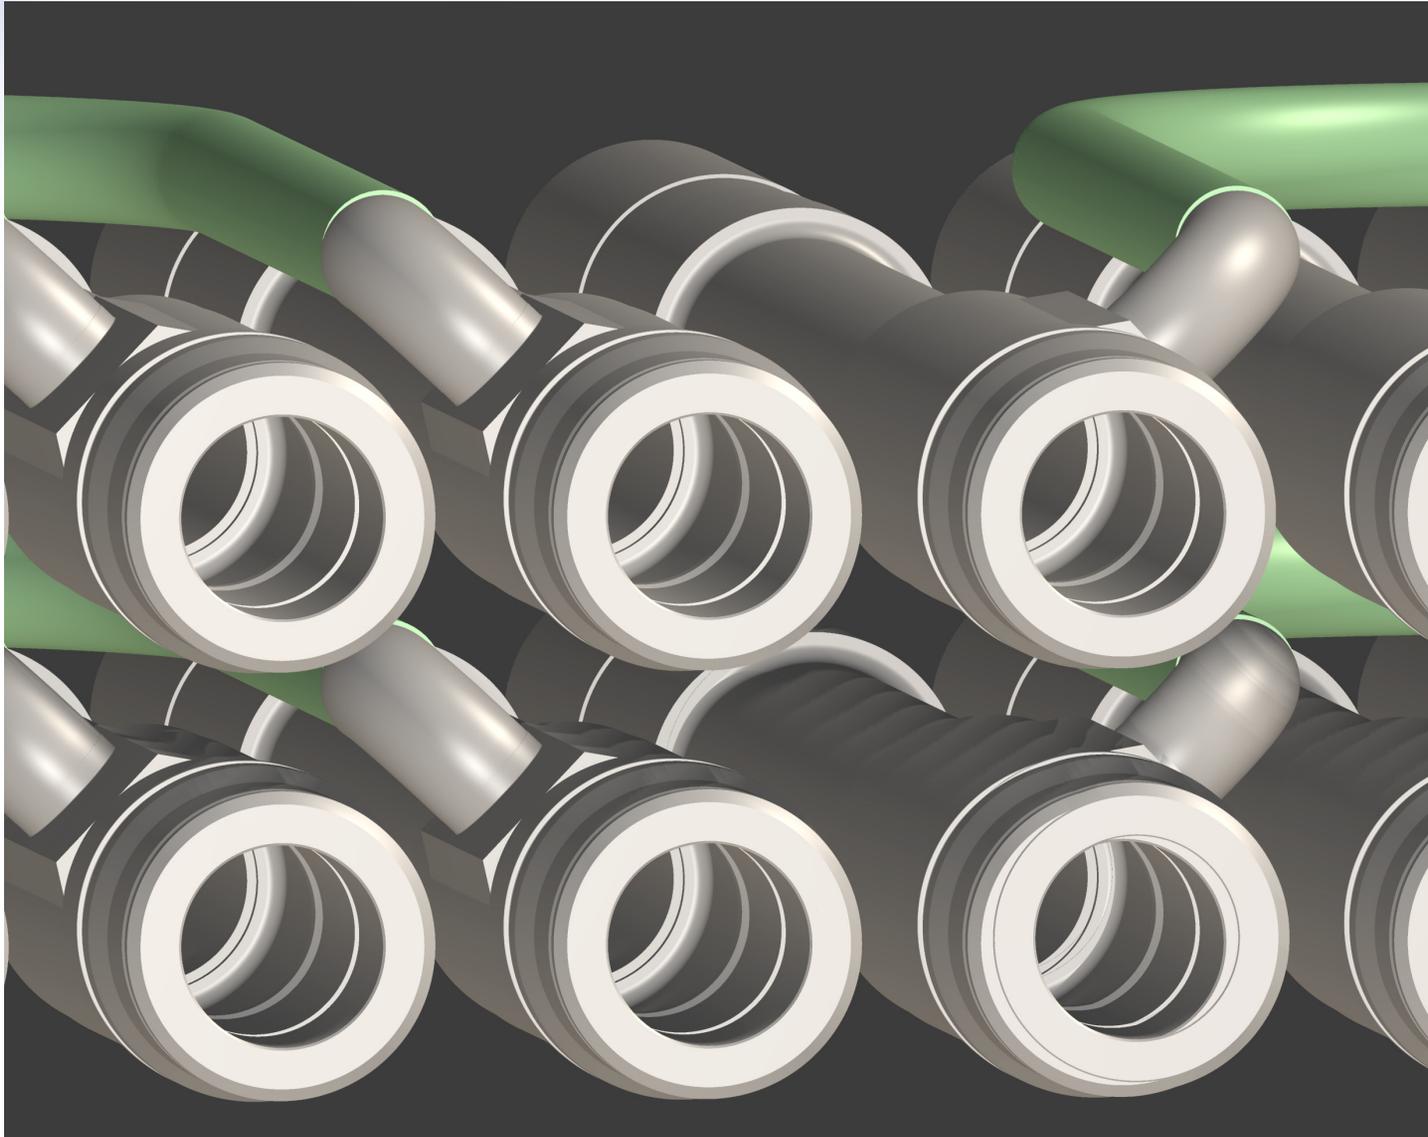





Fuel Channel Restraint

- **Double-stud and yoke design positioning assembly design**
- **Quick lock/unlock mechanism at ~15 yrs so that fuel channel elongation is shared between both sides of the reactor**
- **Double stud design will provide sufficient strength for DBE loads while keeping components small enough to ensure installability, efficient locking/unlocking, and replaceability**
- **Note CANDU 6 used a single stud design**



ACR Fuel Channel Restraint

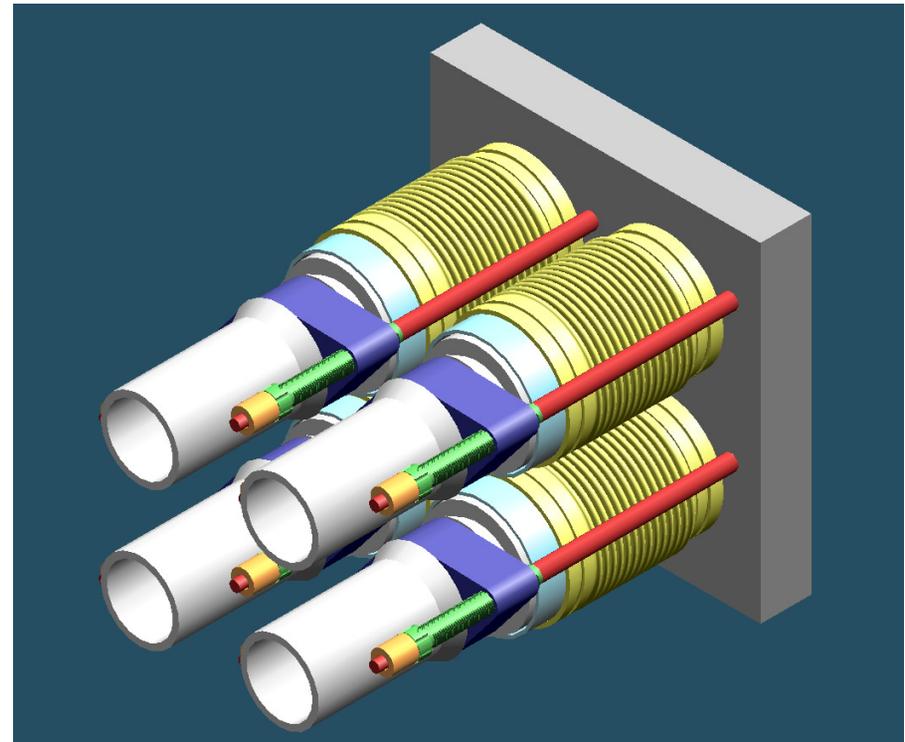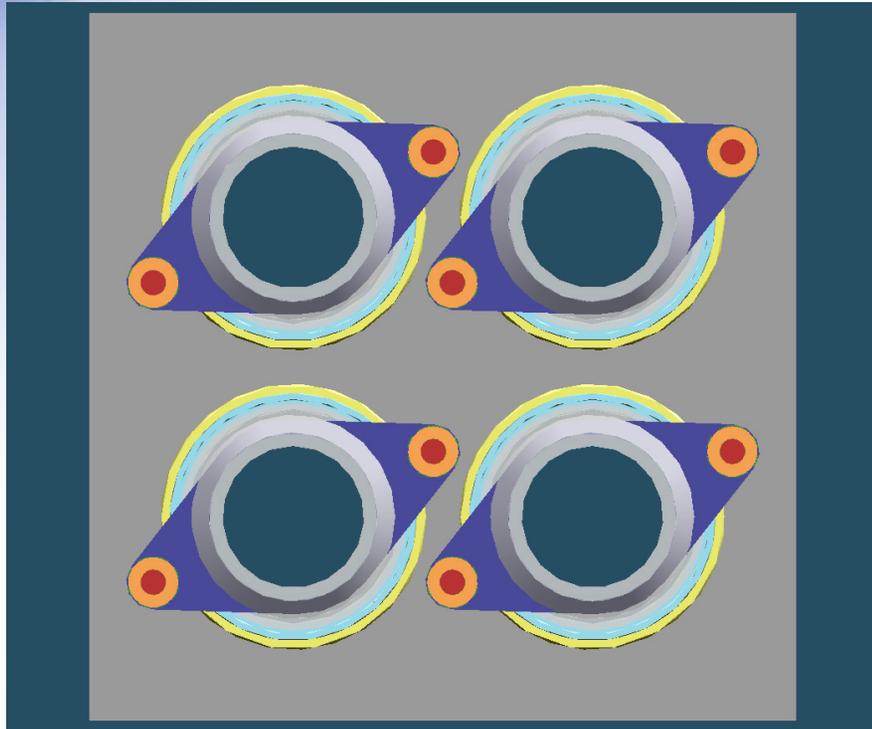



Annulus Bellows

- Each end of the annulus between a calandria tube and a pressure tube is sealed by an Inconel bellows
- The bellows allows axial motion of the channels and also supports the torque of the end fitting from the feeder piping
- The ACR bellows is similar in design to the CANDU 6 bellows and is similarly installed
- The material (Inconel 600) is the same as CANDU 6
- A small diameter tube welded to the bellows connects the sealed annulus that surrounds each fuel channel to the annulus gas system




Annulus Spacer

- **Four annulus spacers keep each pressure tube separated from the calandria tube, preventing direct contact between the tubes during all operating conditions**
- **They allow calandria tube to provide support for the pressure tube**
- **They are positioned about a meter apart so that pressure tube sag will not result in contact with the calandria tube surrounding it**
- **ACR design uses a tight-fitting garter spring, similar to the recent CANDU 6 designs, only bigger diameter due to the bigger annulus**
- **It features a welded coil (for structural integrity) around a girdle wire**
- **The material is the same as recent CANDU designs — Inconel X-750 for the coil and Zircaloy-4 for the girdle wire**



Annulus Spacer

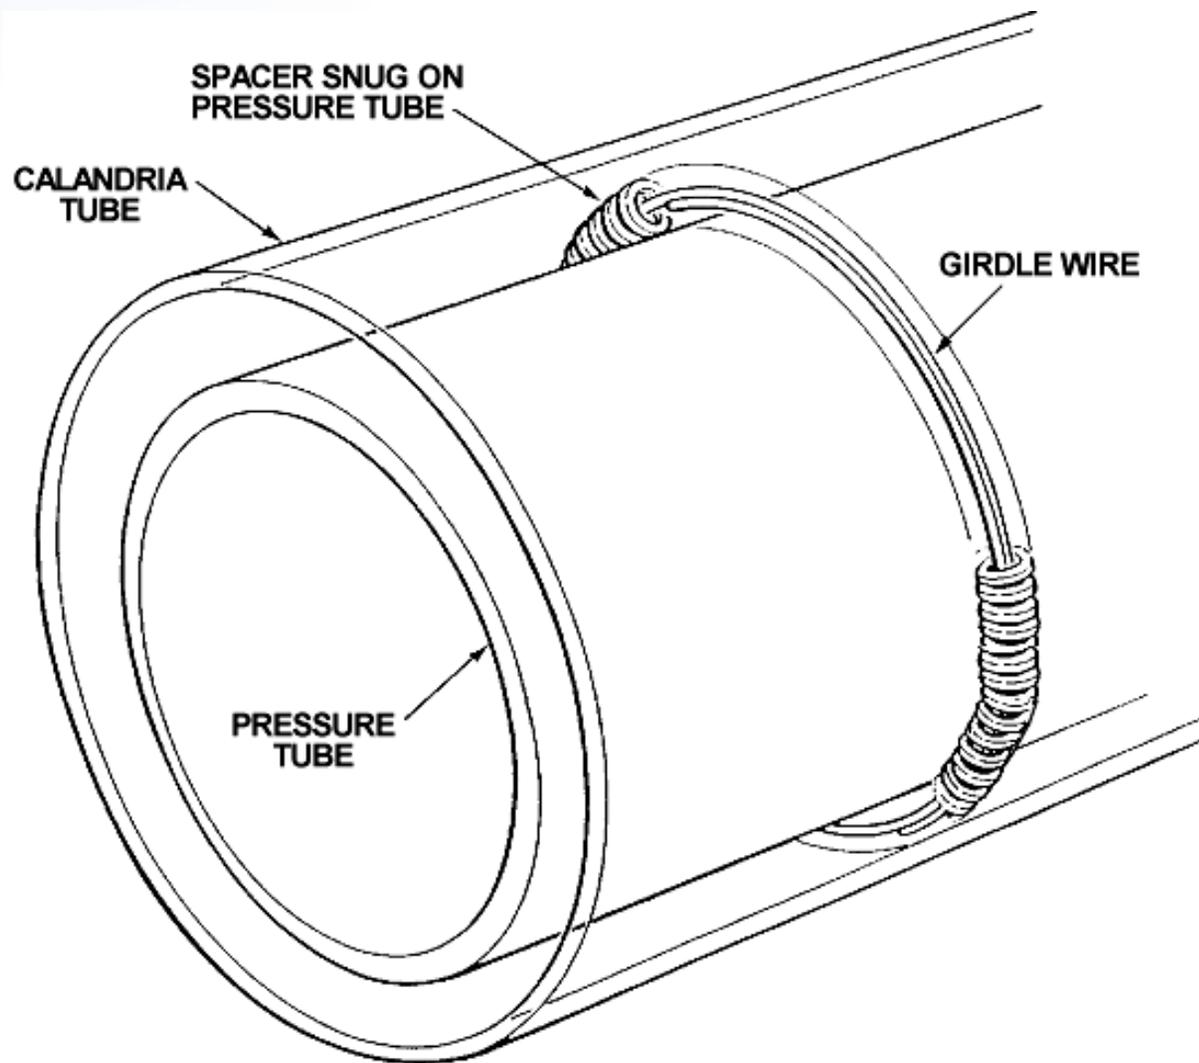



Calandria Tube

- The ACR calandria tube is made of Zircaloy-4
- The outside diameter of the calandria tube is 156 mm
- The wall thickness is 2.5 mm (0.098”) in the body of the tube and 4.5 mm (0.177”) at the ends to facilitate a rolled joint at the calandria tubesheet
- Note ACR calandria tube has larger diameter and it is thicker and stronger than CANDU 6 version
- The calandria tube is part of the calandria vessel pressure boundary, therefore it is designed in accordance with the Class 2C requirements of CSA Standards N285.0 and CAN/CSA-N285.2, with reference to Section III Subsection NC of the ASME Boiler and Pressure Vessel Code



Fuel Channel Components Design

FC Component	Code and Standard
Reactor Coolant Pressure Boundary Components	
Pressure Tube and PT to EF Rolled Joint	- Class 1C requirements of CSA Standards N285.0 and CAN/CSA-N285.2, with reference to Section III Subsection NB of the ASME Code
End Fitting	- Class 1 requirements of CSA Standards N285.0, with reference to Section III Subsection NB of the ASME Code
Closure Plug	- Class 1C requirements of CSA Standards N285.0, with additional requirements provided in CAN/CSA-N285.2, with reference to Section III, Subsection NB of the ASME Code
Non-Pressure Boundary Components	
Liner tube, Bearings, Spacers, and Shield Plug	Good engineering practice with adequate development, analysis and testing
Restraint	Section III, Subsection NF of the ASME Code
Bellows	Class 6 requirements of CSA Standard N285.0, with reference to Section VIII of the ASME Code
Calandria Tube (Calandria Vessel Pressure Boundary)	Class 2C requirements of CSA Standards N285.0 and CAN/CSA-N285.2, with reference to Section III Subsection NC of the ASME Code




Interfacing Systems

- **The following systems/structures interface with the Fuel Channel Assembly**
 - **Reactor Coolant System**
 - **Fuel**
 - **Fueling Machine**
 - **Annulus Gas System**
 - **Calandria Assembly**



ACR Reactor Coolant System Layout

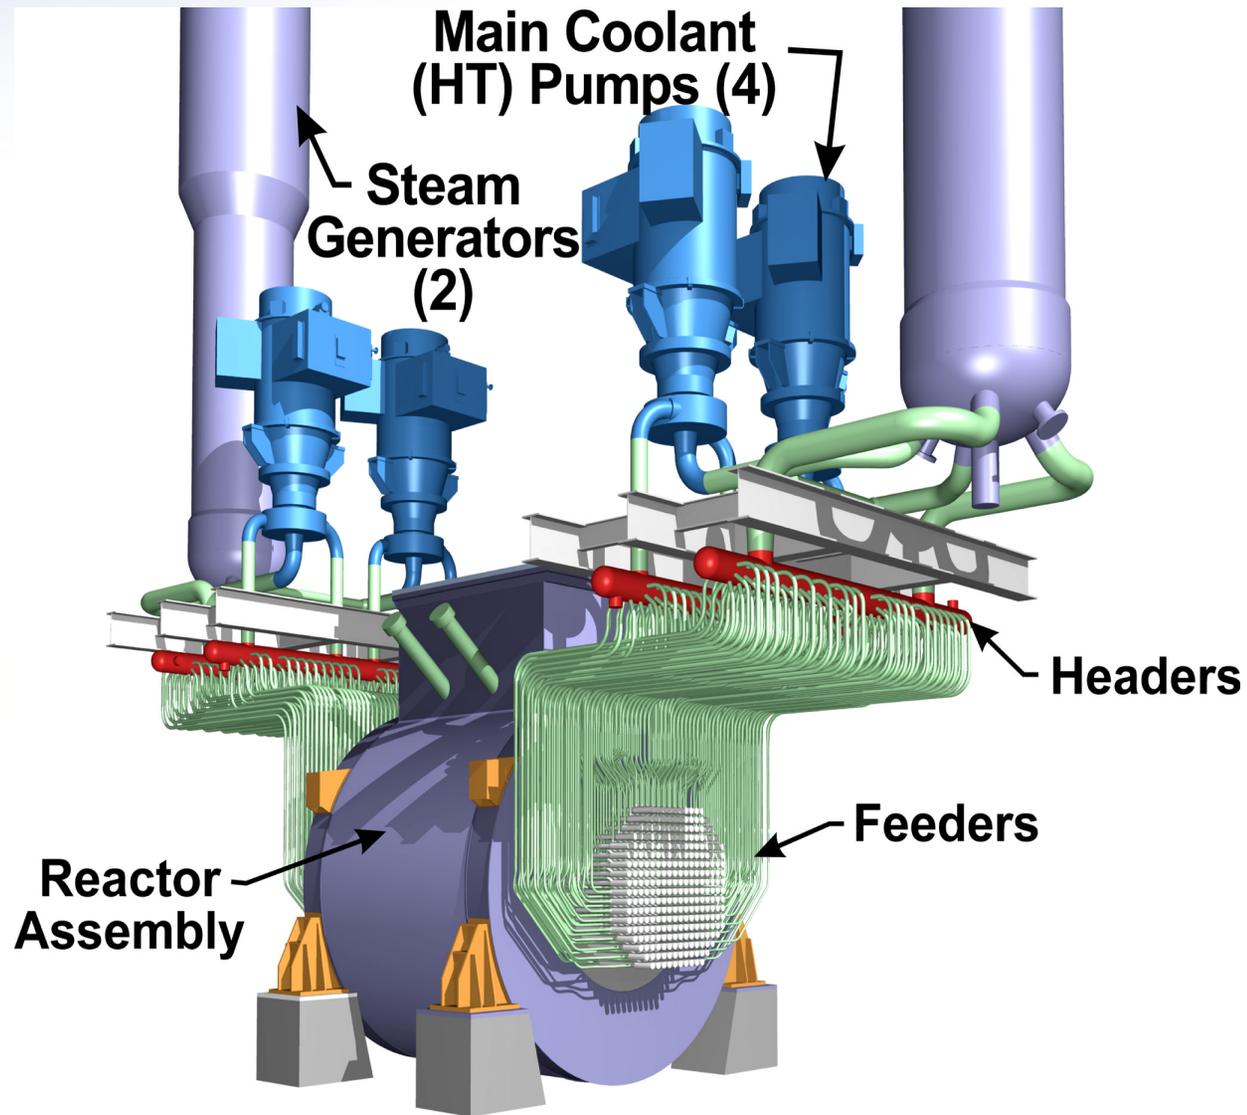




Fuel

- **There are 12 fuel bundles in each pressure tube**
- **In ACR the fuel bundle used is 43-element CANFLEX**
- **Each fuel bundle is supported on bearing pads which maintain proper clearance between the bundle and the pressure tube**
- **ACR uses two bundle shift and an average of about 20 channel visits per week (ACR-700)**



CANDU 6 Fueling Machine

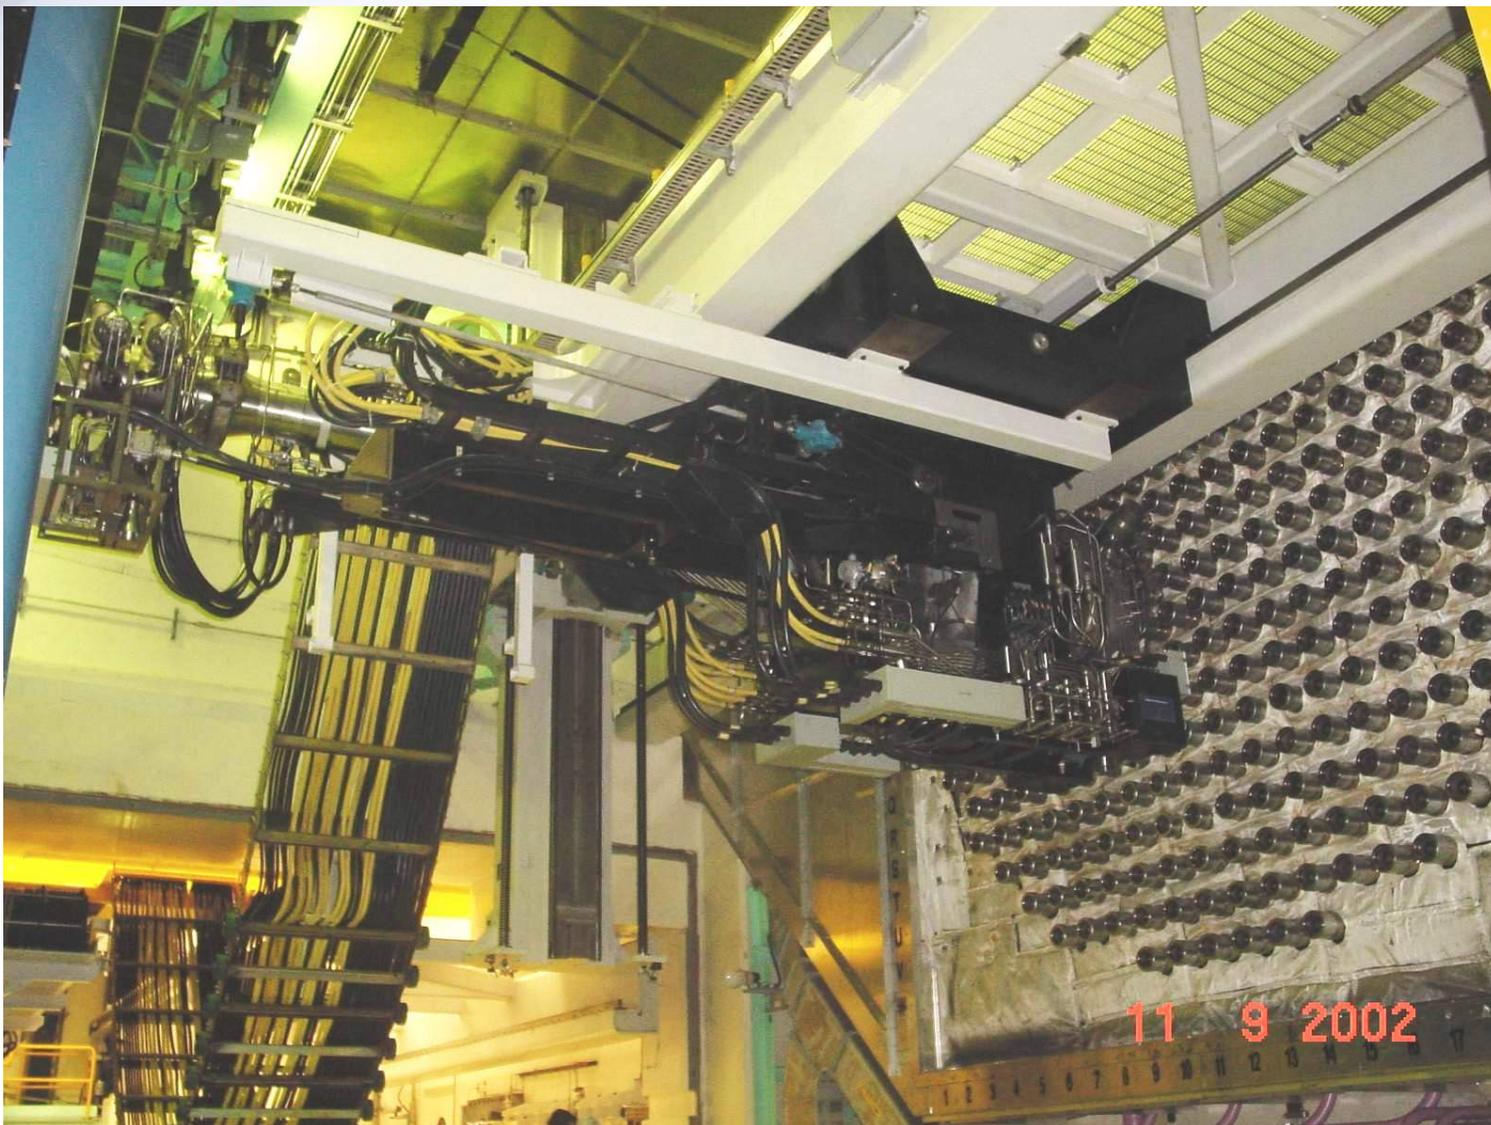



Fueling Machine

- **Performs on-power fuel changing**
- **Extension of Reactor Coolant System pressure boundary during fuel changing**
- **Designed in accordance with Section III, Subsection NB of the ASME Boiler and Pressure Vessel Code, with additional requirements provided in CAN/CSA-N285.2**
- **There is a safety lock that prevents fueling machine detachment from the end fitting during fueling**




Annulus Gas System (AGS)

- The AGS circulates dry CO₂ gas and monitors the moisture content of the gas in order to detect any water leakage from either the moderator or the reactor coolant
- The annulus gas:
 - Thermally insulates the hot pressure tube from the cold calandria tube
 - Provides protective atmosphere outside of the pressure tube
- Addition of a small amount of O₂ to annulus gas limits hydrogen ingress at outside of pressure tube



ACR Annulus Gas System

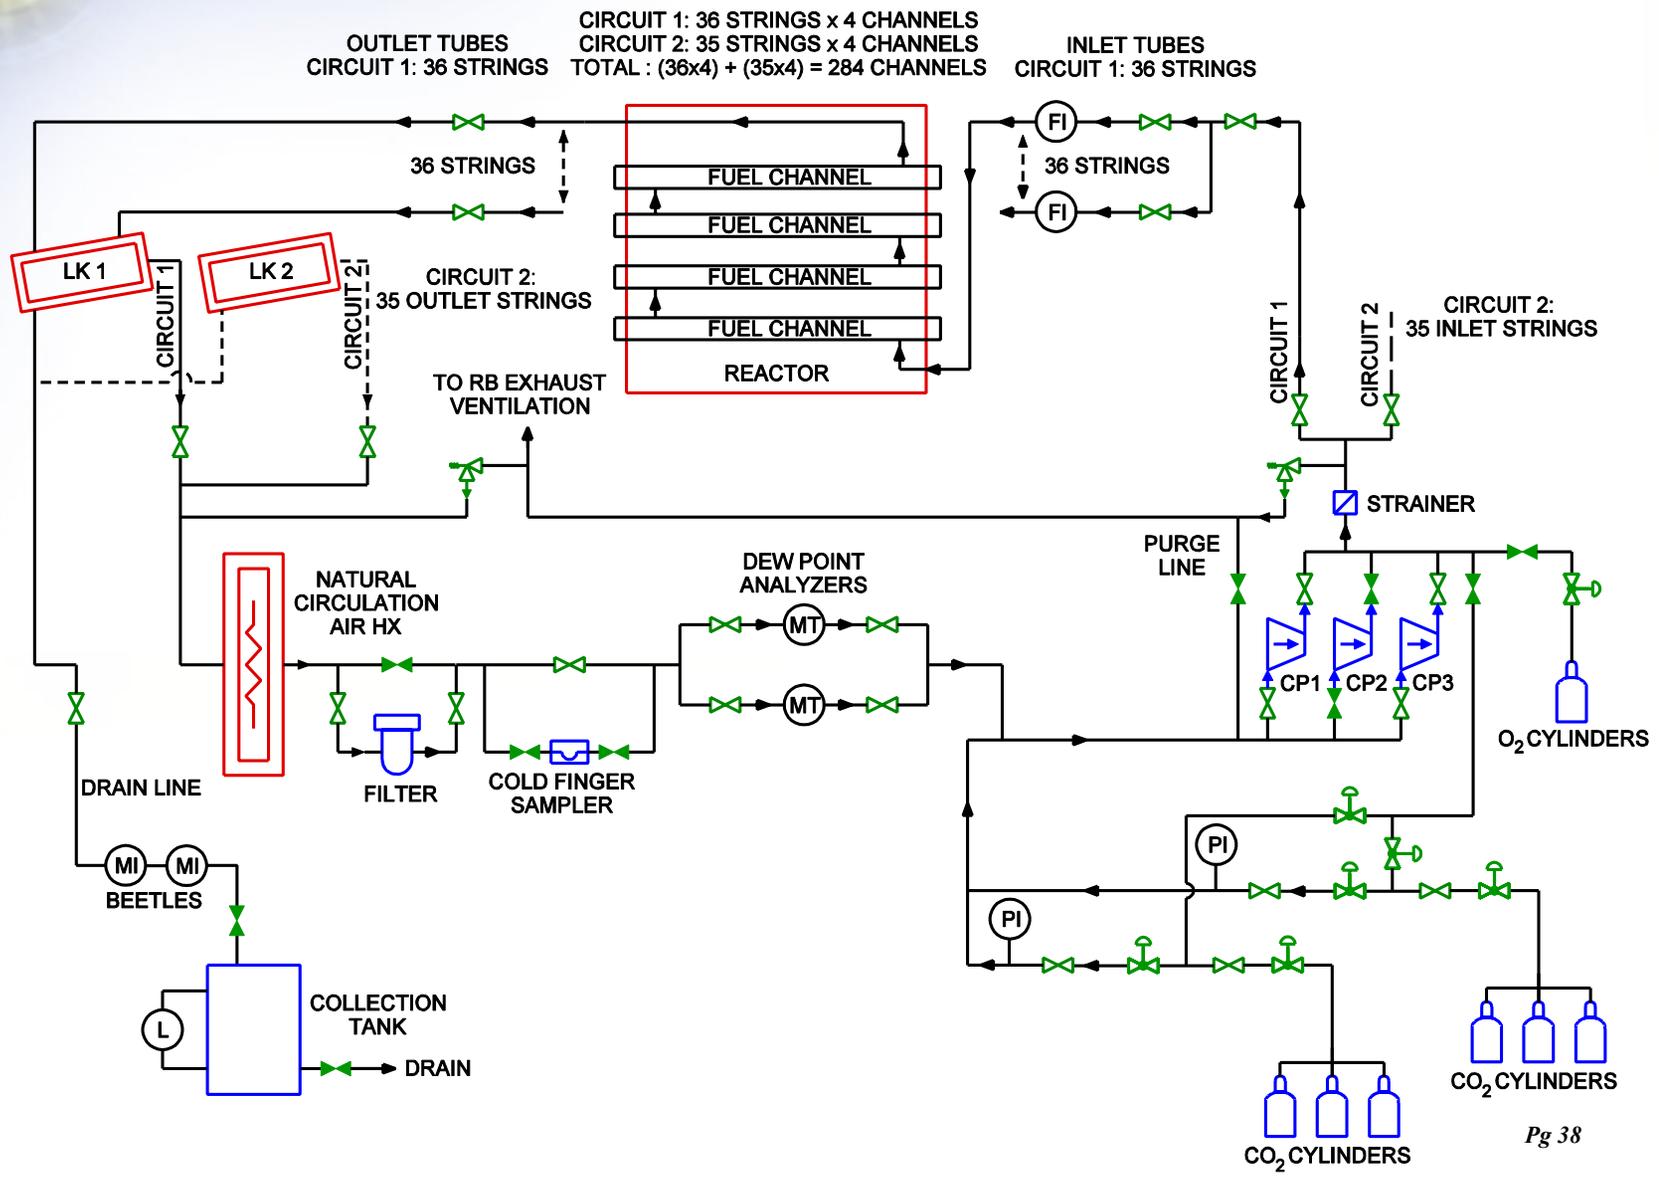



ACR Annulus Gas System

- **Design improved for leak detection capabilities:**
 - Larger flow rate
 - Reduced number of channels per string
 - Increased number of parallel circuits




Calandria Assembly

- **The horizontal cylindrical calandria is closed and supported at both ends by two end shields**
- **The end shields contain material for thermal and biological shielding**
- **The end shields are spanned by the 284 lattice tubes which support and align the fuel channels**
- **Each end fitting is supported in its lattice tube on two sliding bearings that permit axial movement of the channel due to thermal expansion and elongation due to irradiation**
- **The fuel channel assembly is positioned axially within the reactor by means of positioning assembly**



ACR Calandria and Shield Tank Assembly

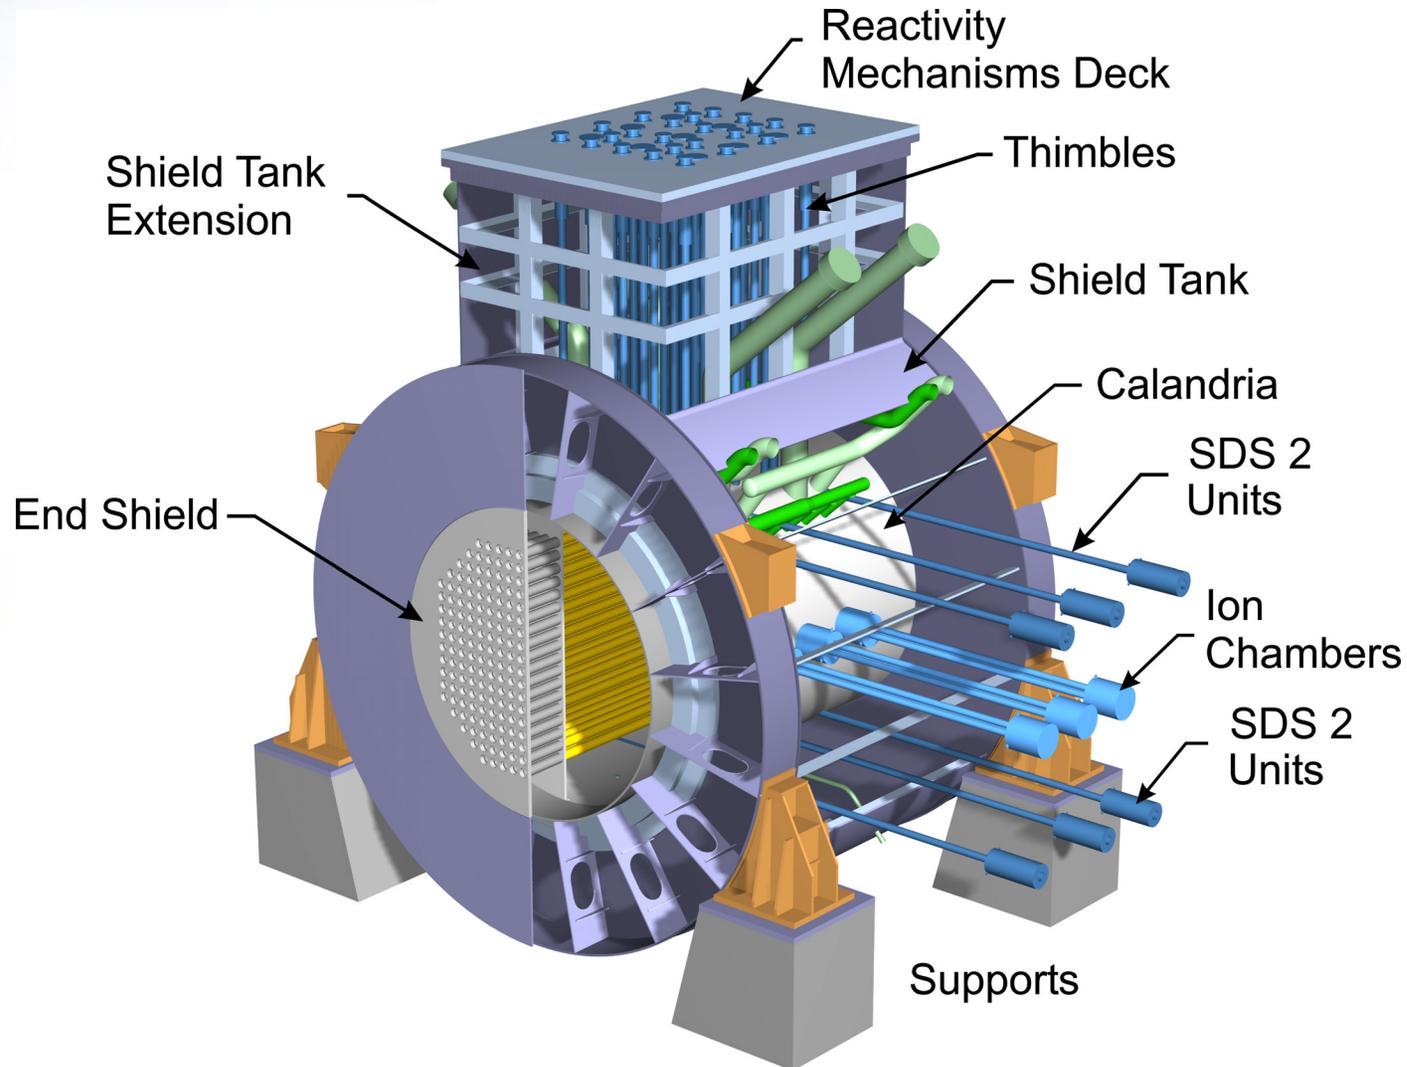



Summary

- **The ACR fuel channel design is based on existing CANDU designs, with increased margins for extended operating life**
- **The fuel channel design has been modified to suit reduced lattice pitch and thicker pressure tube**
- **The ACR anticipated R&D program for fuel channel is underway**



 **AECL**
TECHNOLOGIES INC.