

MANUAL HARD COPY DISTRIBUTION

DOCUMENT TRANSMITTAL 2003-1134

---

USER INFORMATION:

[REDACTED] EMPL#:23244 CA#: 0363  
[REDACTED]

Phone#: 254-3658

TRANSMITTAL INFORMATION:

[REDACTED] 01/07/2003

LOCATION: DOCUMENT CONTROL DESK  
FROM: NUCLEAR RECORDS DOCUMENT CONTROL CENTER  
(NUCSA-2)

THE FOLLOWING CHANGES HAVE OCCURRED TO THE HARDCOPY  
OR ELECTRONIC MANUAL ASSIGNED TO YOU:

115 - 115 - CHEMISTRY SAMPLING TEAM: EMERGENCY  
PLAN-POSITION SPECIFIC PROCEDURE

REMOVE MANUAL TABLE OF CONTENTS DATE: 10/25/2002

ADD MANUAL TABLE OF CONTENTS DATE: 01/06/2003

CATEGORY: PROCEDURES TYPE: EP  
ID: EP-PS-115  
ADD: PCAF 2003-1010 REV: N/A

UPDATES FOR HARD COPY MANUALS WILL BE DISTRIBUTED  
WITHIN 5 DAYS IN ACCORDANCE WITH DEPARTMENT  
PROCEDURES. PLEASE MAKE ALL CHANGES AND  
ACKNOWLEDGE COMPLETE IN YOUR NIMS INBOX UPON  
RECEIPT OF HARD COPY. FOR ELECTRONIC MANUAL USERS,  
ELECTRONICALLY REVIEW THE APPROPRIATE DOCUMENTS AND  
ACKNOWLEDGE COMPLETE IN YOUR NIMS INBOX.

A045



## PROCEDURE CHANGE PROCESS FORM

*01/30/03* *1303*  
REV. 5/13

1. PCAF NO. 2003-1010 | 2. PAGE 2 OF 6 | 3. PROC. NO. EP-PS-1150

11. This question documents the outcome of the 50.59 and 72.48 Review required by NDAP-QA-0726. Either 11a, b, c or d must be checked "YES" and the appropriate form attached or referenced.
- a. This change is an Administrative Correction for which 50.59 and 72.48 are not applicable.  YES  N/A
- b. This change is a change to any surveillance, maintenance or administrative procedure for which 50.59 and 72.48 are not applicable.  YES  N/A
- c. This change is bounded by a 50.59/72.48 Screen/Evaluation, therefore, no new 50.59/72.48 Evaluation is required.  YES  N/A  
Screen/Evaluation No. \_\_\_\_\_
- d. 50.59 and/or 72.48 are applicable to this change and a 50.59/72.48 Screen/Evaluation is attached.  YES  N/A
12. This change is consistent with the FSAR or an FSAR change is required.  YES  
Change Request No. N/A
13. Should this change be reviewed for potential effects on Training Needs or Material?  YES  NO  
If YES, enter an Action Item @ NIMS/Action/Gen Work Mech/PICN
14. Is a Surveillance Procedure Review Checklist required per NDAP-QA-0722?  YES  NO
15. Is a Special, Infrequent or Complex Test/Evolution Analysis Form required per NDAP-QA-0320? (SICT/E form does not need to be attached.)  YES  NO

16. Reviews may be documented below or by attaching Document Review Forms NDAP-QA-0101-1.

REVIEW	REVIEWED BY WITH NO COMMENTS	DATE
QADR	_____	_____
TECHNICAL REVIEW	_____	_____
REACTOR ENGINEERING/NUCLEAR FUELS *	_____	_____
IST **	_____	_____
OPERATIONS	_____	_____
NUCLEAR SYSTEMS ENGINEERING	_____	_____
NUCLEAR MODIFICATIONS	_____	_____
MAINTENANCE	_____	_____
HEALTH PHYSICS	_____	_____
NUCLEAR TECHNOLOGY	_____	_____
CHEMISTRY	_____	_____
OTHER <u>10 CFR 50.54Q review</u>	<u>JC Chalpin</u>	<u>1-3-2003</u>


- \* Required for changes that affect, or have potential for affecting core reactivity, nuclear fuel, core power level indication or impact the thermal power heat balance. <sup>(58)</sup>
- \*\* Required for changes to Section XI Inservice Test Acceptance Criteria.

PCAF

Attachment C

I. SPING PARTICULATE/IODINE SAMPLES


Sample Source	Sample #	Survey Meter #
Sample Start Date/Time	Sample Stop Date/Time	
Sample Duration	minutes	Stack Flow ccf/min

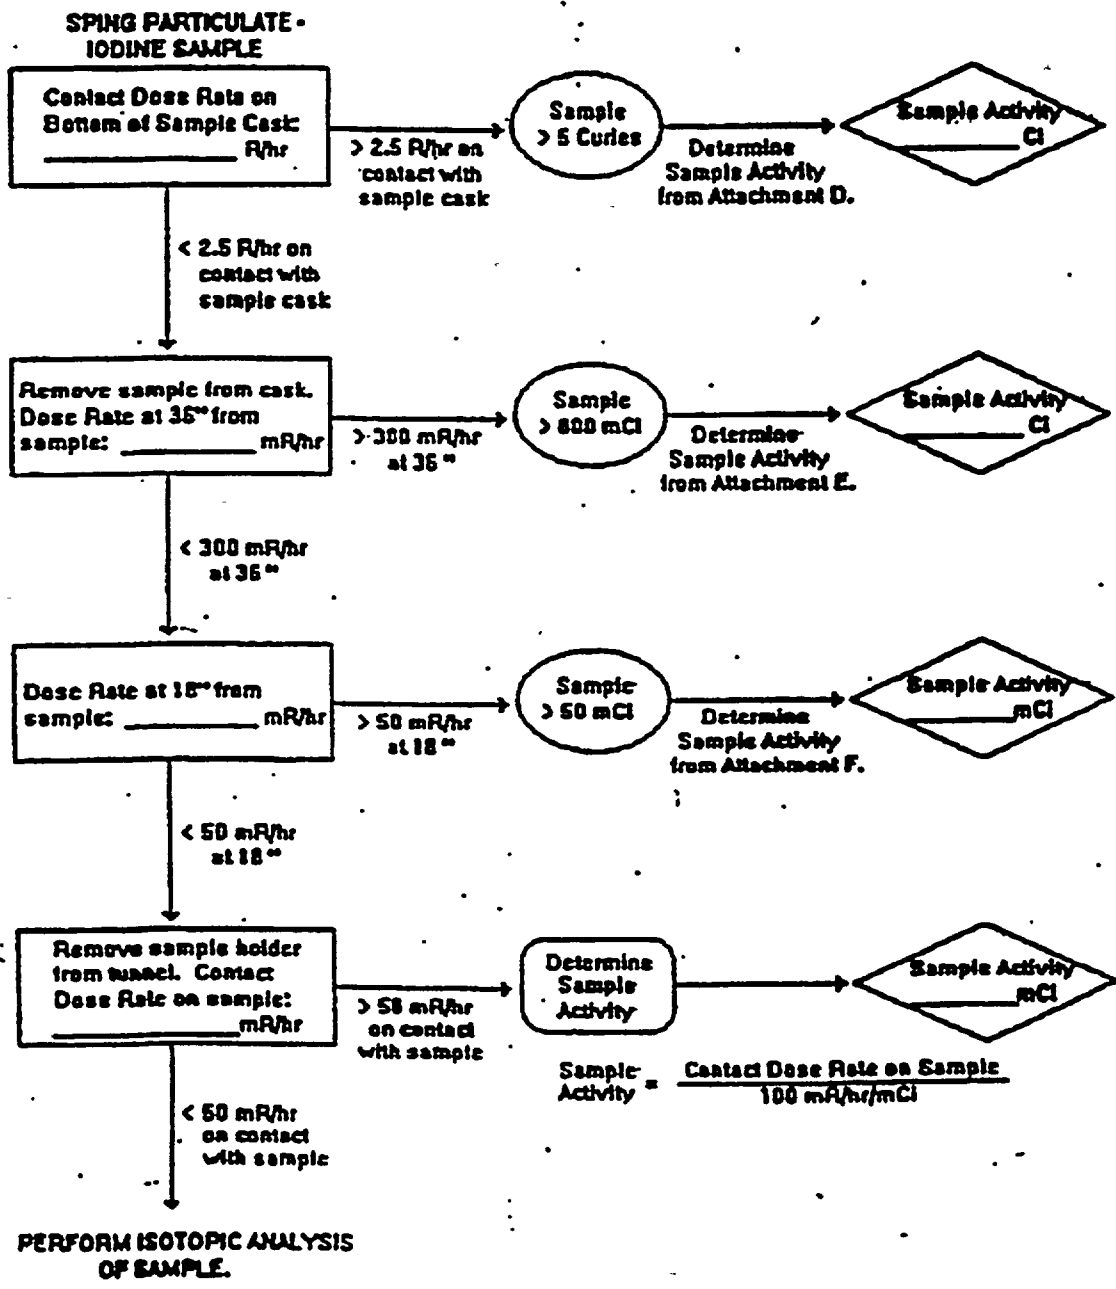

PCAF

Attachment D


SAMPLE ACTIVITY BASED ON CONTACT DOSE RATE AT  
BOTTOM OF PARTICULATE/IODINE SAMPLE CASK

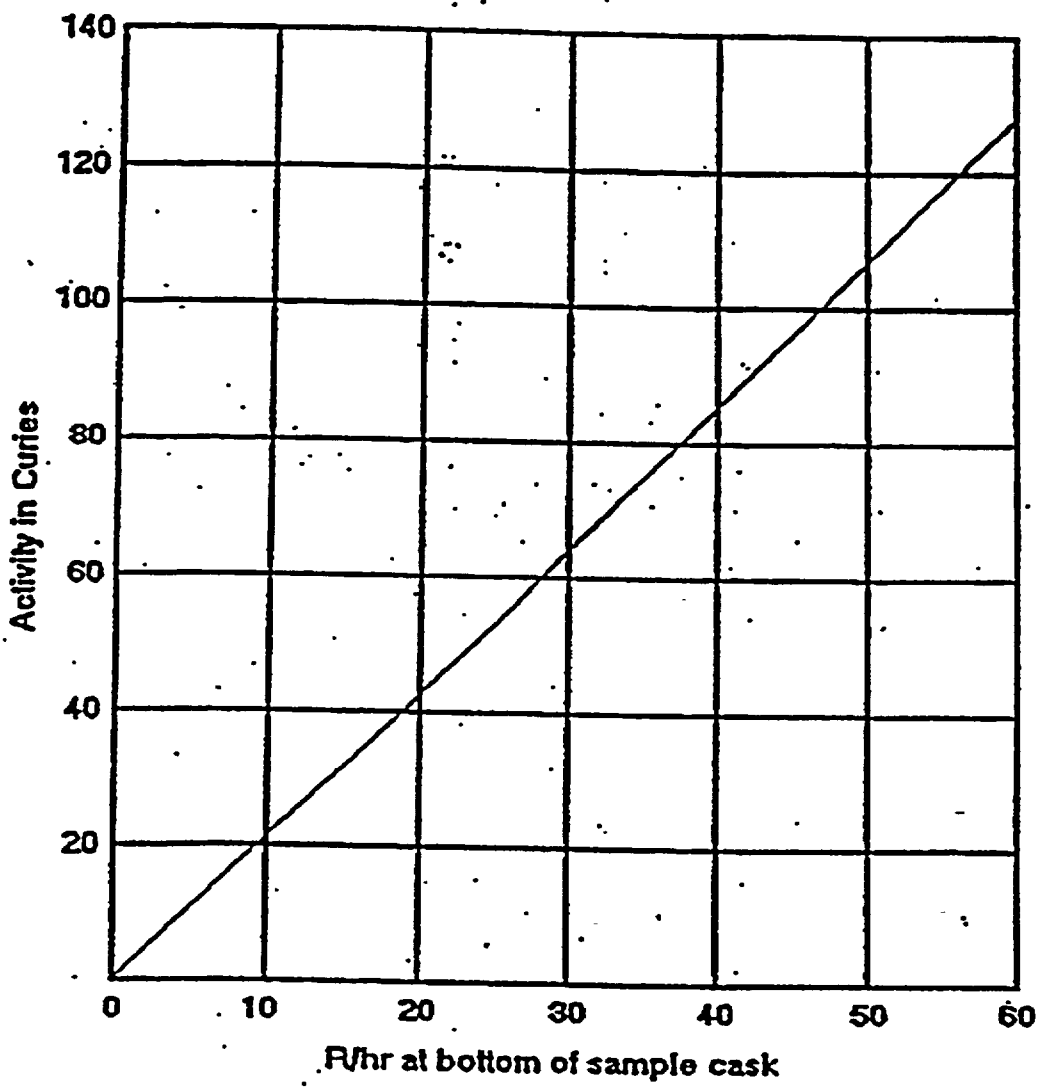

PCAF

Attachment E

SAMPLE ACTIVITY BASED ON DOSE RATE AT 36 INCHES  
FROM PARTICULATE/IODINE SAMPLE

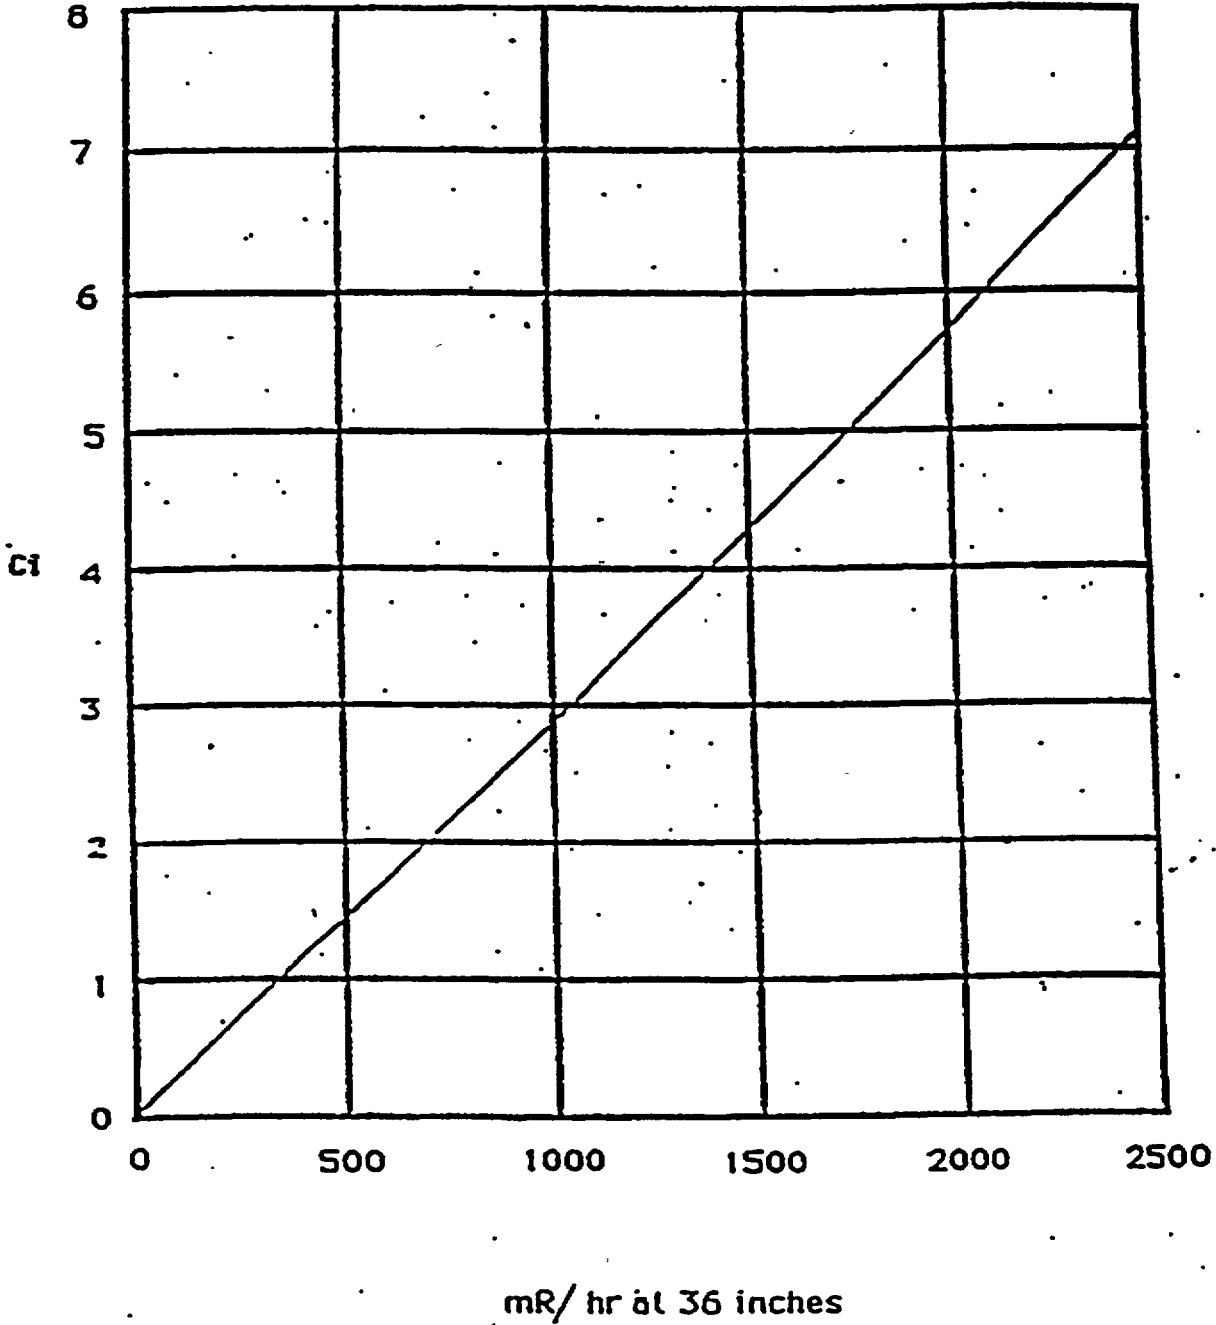


PCAF

PCAF # 2003-1010  
PAGE 6 OF 6

Attachment F

SAMPLE ACTIVITY BASED ON DOSE RATE AT 18 INCHES  
FROM PARTICULATE/IODINE SAMPLE

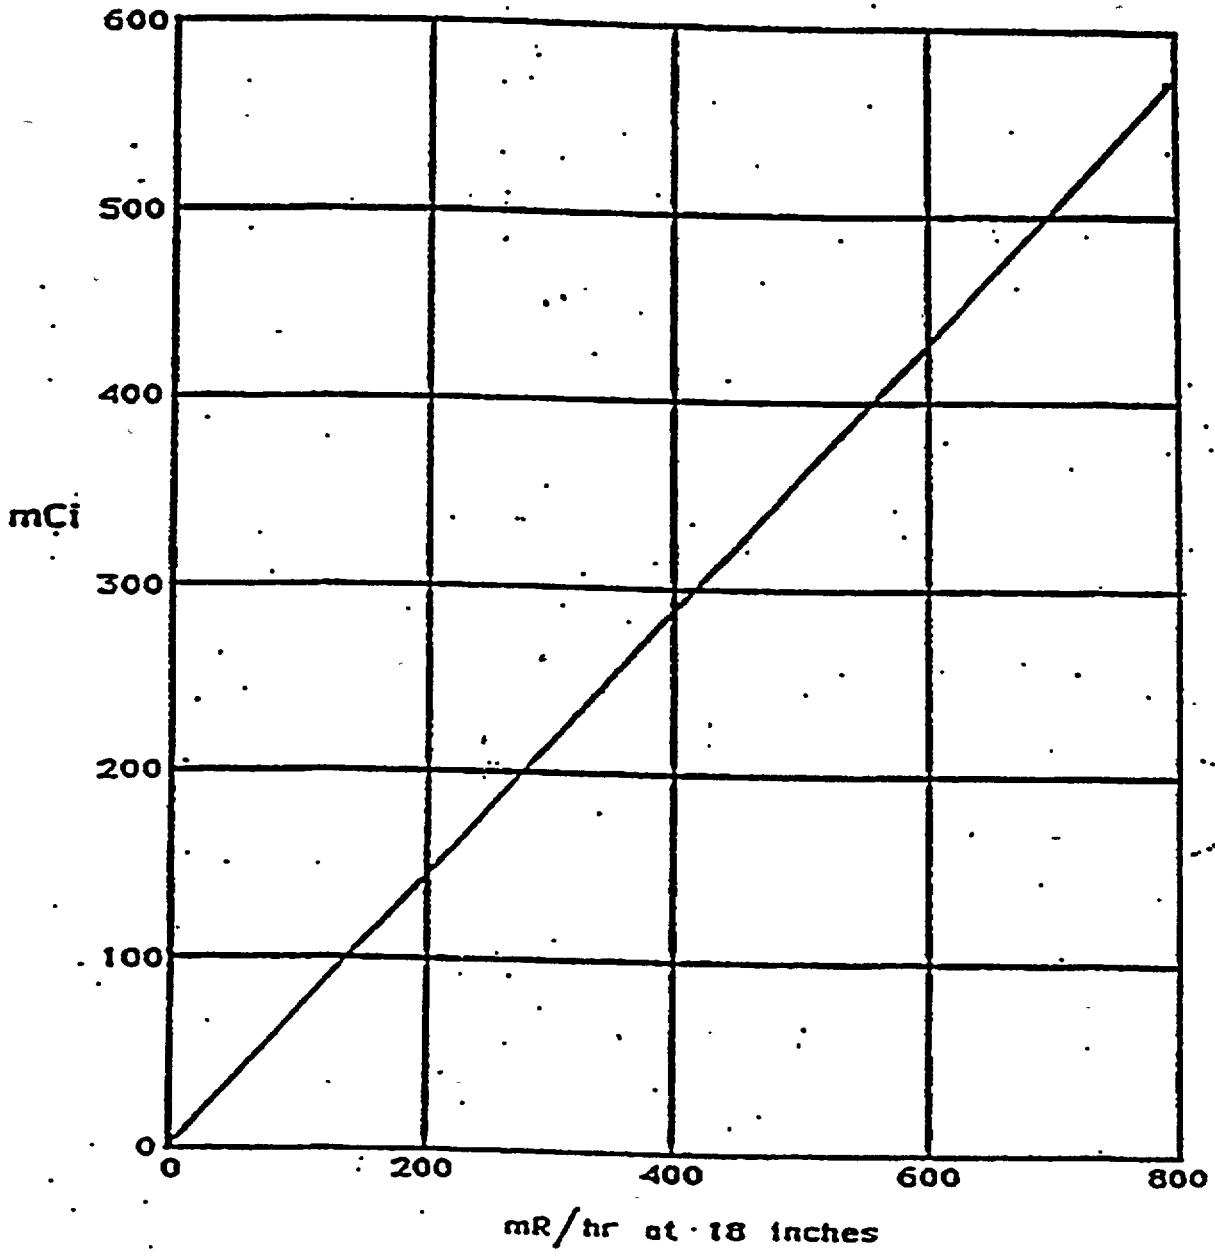

PCAF