




- A. 30 AMP MAKE UP AIR HEAT UP "IN USE"
- B. BIT CHANGE TALEDO SCALES
- C. SPARE
- D. ROOF FAN
- E. 30 AMP DUST COLLECTOR "SPARE"
- F. 100 AMP LIGHTING PANEL 5A AND 5B "IN USE"
- G. 60 AMP GRAPHIC DIGESTER
- H. 60 AMP WELDING RECEPTACLE "IN USE"
- I. 60 AMP VACUUM PUMP "SPARE"
- J. 60 AMP ATRITOR MILL "SPARE"
- K. 30 AMP DESPATCH OVEN "SPARE"

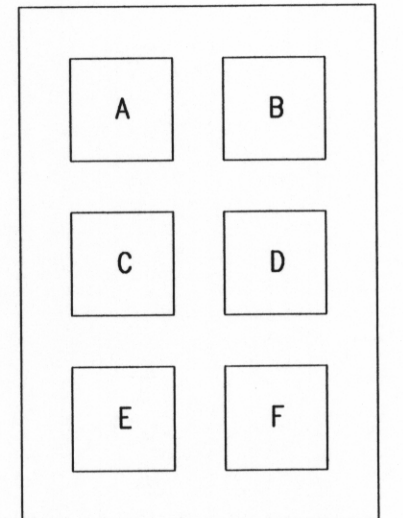



- A. 30 AMP EAST FURNACE CONTROL
- B. 30 AMP WEST FURNACE CONTROL
- C. 100 AMP EAST FURNACE UNLOADING END
- D. 100 AMP EAST FURNACE LOADING END
- E. 100 AMP WEST FURNACE UNLOADING
- F. 100 AMP WEST FURNACE LOADING END

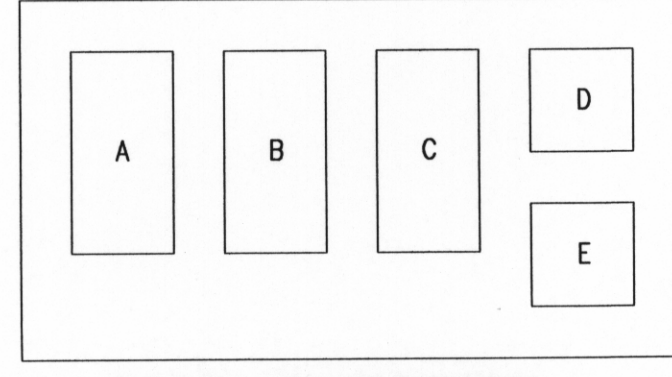

- A. 30 AMP SIZE 1 SOUTH BLOWER DRYER
- B. 30 AMP SIZE 1 MIDDLE BLOWER DRYER
- C. 30 AMP SIZE 1 NORTH BLOWER DRYER
- D. FUSE BOX
- E. START/STOP SWITCH EXHAUST BLOWER

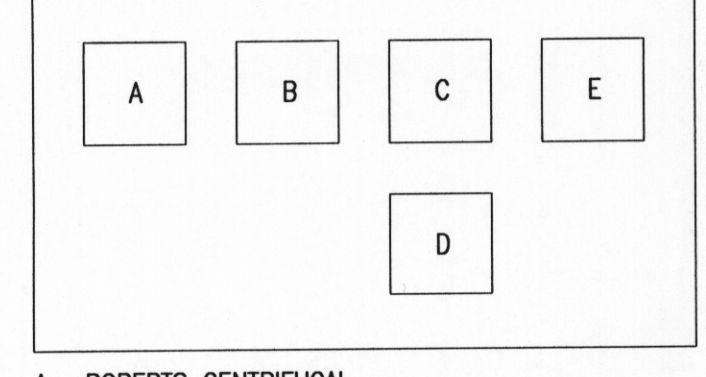

- A. ROBERTS CENTRIFUGAL
- B. FUSE BOX
- C. VACUUM PUMP FOR MAGNETIC SEPERATOR
- D. START/STOP CONTROL
- E. POWER TRANSFORMER

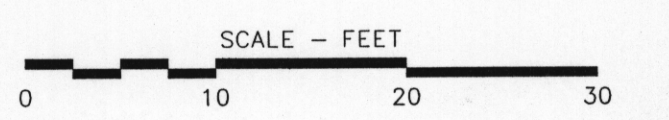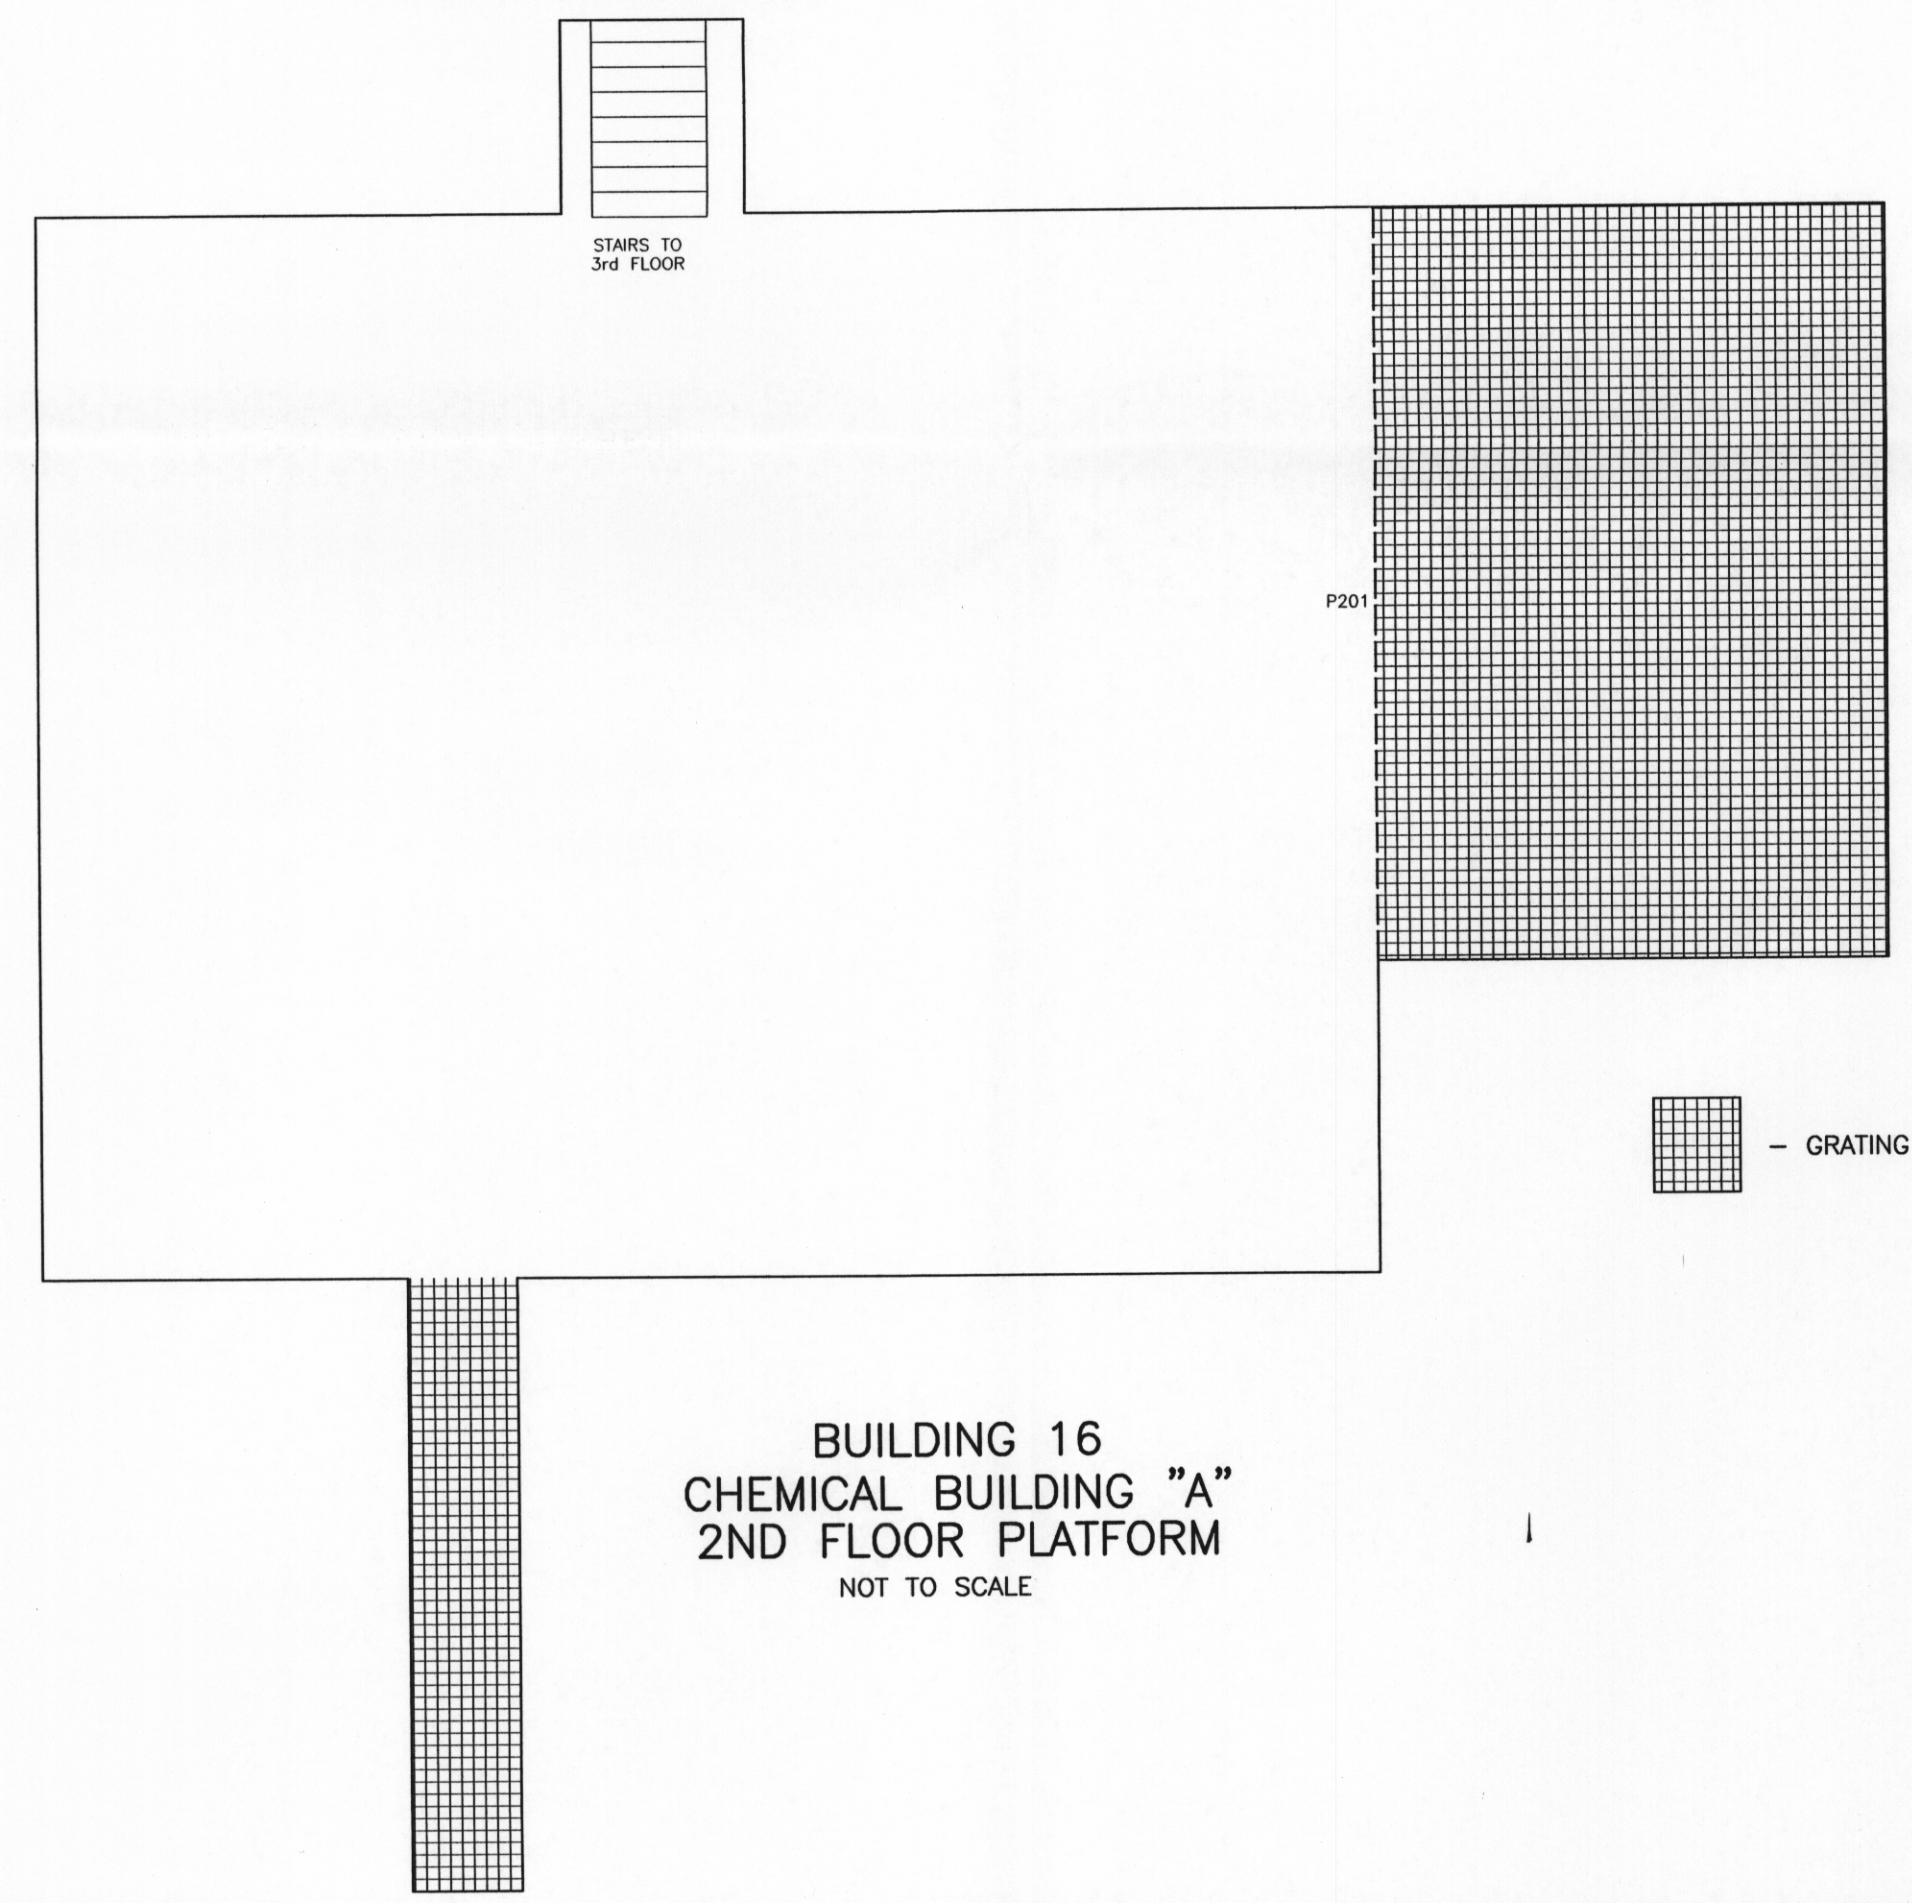

REVISION	DATE	DESCRIPTION
<b>FIGURE 4-3B</b> <b>CHEM A BUILDING 2nd FLOOR AND 3rd FLOOR</b> <b>DECOMMISSIONING PLAN</b> <b>FANSTEEL, INC.</b> <b>MUSKOGEE, OKLAHOMA</b>		
PREPARED FOR <b>FANSTEEL, INC.</b> <b>MUSKOGEE, OKLAHOMA</b>		
APPROVED	<i>[Signature]</i>	11/01/02
CHECKED	<i>[Signature]</i>	11/01/02
DRAWN	DEF	08/16/02
DRAWING NUMBER		6473413
		Earth Sciences Consultants, Inc.

REFERENCE  
FANSTEEL DRAWING "OEF-CHEMA-003.DWG".