
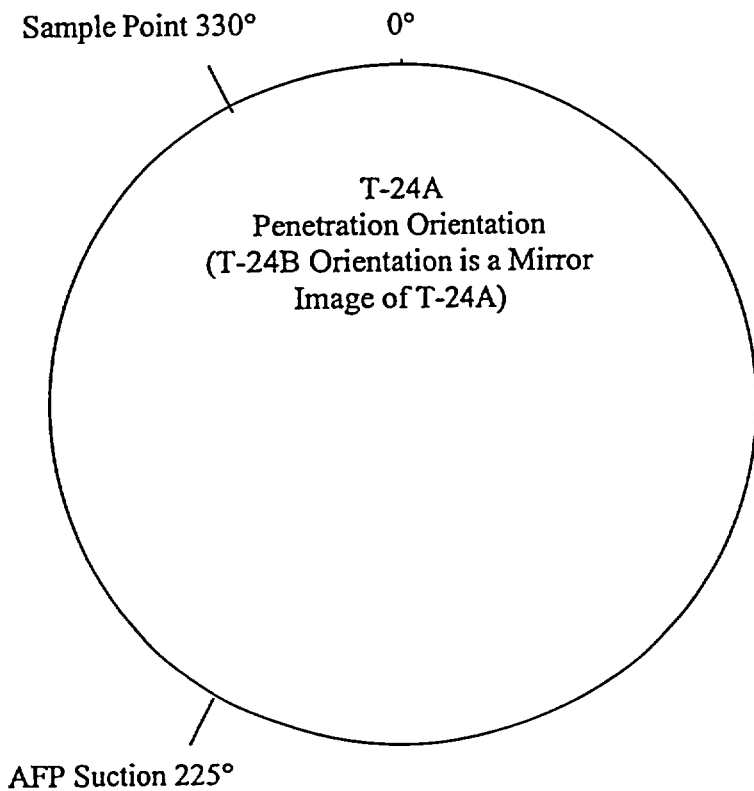


CST Normal Sample Point Geometry

The normal sample point for CSTs is on the instrument taps on the east side of the tanks. The tank outlet to the AFP Suction header is on the west side of the tanks. Water Treatment effluent, which fills the CSTs is connected to the AFP Suction header also. The following sketches depict the horizontal and radial orientation of the sample point with respect to the tank outlet.

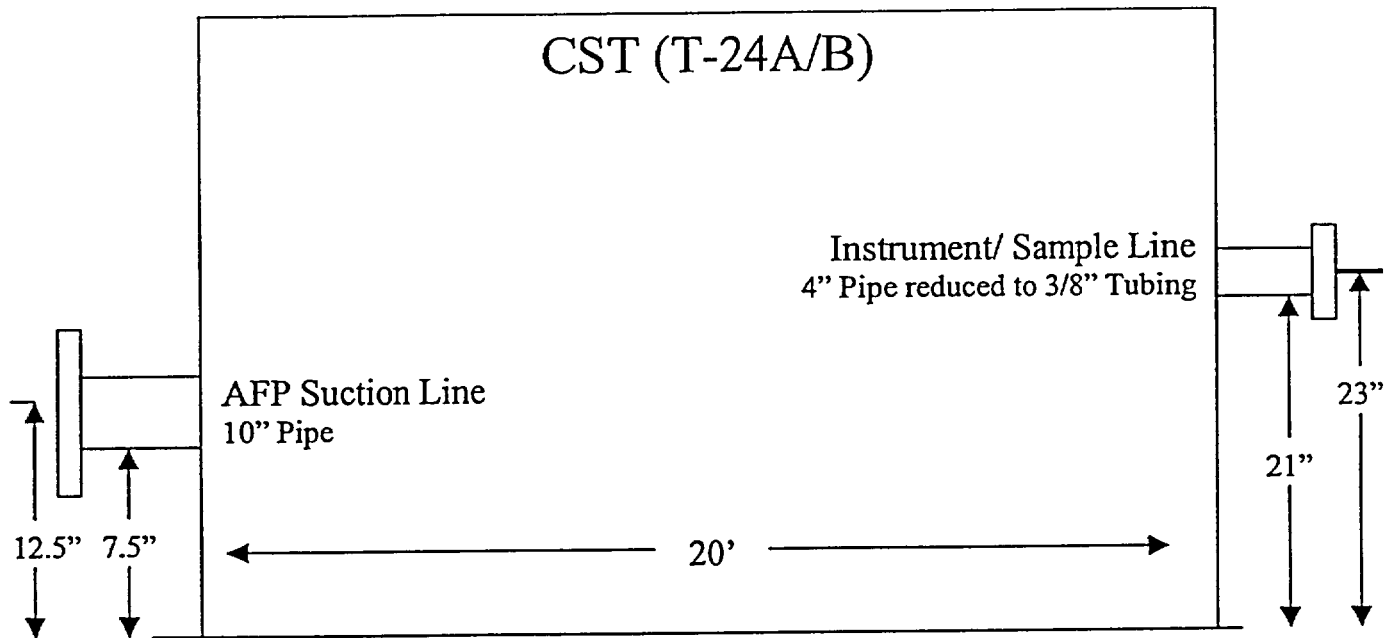

A19