



Friday, February 28, 2003
Document Control Desk
U.S. Nuclear Regulatory Commission
Washington, D.C. 20555

Ref: Docket 50-27

Dear Sir:

This letter is a response to a U.S. Nuclear Regulatory Commission request for additional information dated January 9, 2003.

The first item asked the following:

1. According to your request to change the Technical Specifications (Amendment No. 18) the new criterion to replace the "absolute filter" will be based purely in the performance of the filter. The pressure drop caused by the "absolute filter" will be the only indicator to ensure that the filter performance is acceptable. Figures 9-1 and 9-2 of the Safety Analysis Report are inconsistent on where the Pressure Elements (PE) are installed with respect to the "absolute filter." Please provide a detailed diagram of the installation of the two pressure elements used to calculate the pressure drop caused by the "absolute filter." This diagram should illustrate the section of the HVAC system that is used in the "dilute mode." The following detailed information should be included with this illustration:

- (a) duct dimensions where the "absolute filter", the first pressure element, and second pressure element are installed, and
- (b) the distances between the two pressure elements and the "absolute filter."

Response to first item:

Attached is a more detailed diagram entitled, "Pressure Sensor Positions Relative to the 'Absolute Filter'". On this diagram one can see the position of the pressure sensor on the pool side of the absolute filter. In the dilute mode, 300 CFM is being drawn from the pool room. It then passes the first pressure sensor located 37 1/2" upstream of the absolute filter. The filter consists of two side by side box shaped objects of dimension 23 1/2" x 23 1/2" x 11 1/2" oriented as shown. The second pressure sensor in the diagram is located 29 1/2" downstream of the absolute filter in the duct leading to the main ventilation system exhaust. In the dilute mode, 300 CFM of pool room air is passed through the HEPA filter and then mixed with 1700 CFM of "outside air" to produce a "dilution" factor of 6.67 when the filter is new. If the HEPA filter becomes slightly obstructed

A 001

through use, the dilution factor would become larger and therefore the radioactive air release rate would become more conservative. After dilution, the mixed air passes through damper D-6 and enters fan F-3 which draws the air into the main ventilation duct where the "Exhaust Gas Monitor" measures the Argon-41 release. The total distance between the two pressure sensors is 78.5".

The second item asked the following:

2. Please provide information on how you are planning to calculate the flow across the absolute filter to ensure that the filter is performing between the limits of pressure drop and volumetric flow specified by the TSs. Please provide an original-copy of the performance chart of the "absolute filter" provided by the manufacturer.

Response to the second item:

It was not our intension to re-calculate the flow across the absolute filter. Measurements of flow rates were made when the system was installed to validate the design. We could arrange to have the flow rates verified again but only if the US NRC considers it to be essential. We do not consider it relevant because if the "absolute filter" became more obstructed with use, the flow through it would be slightly reduced. A flow reduction through this filter would increase the dilution factor, making its performance more conservative than the less obstructed "new" filter.

Please find attached a FAX sent to us by the manufacturer of the "absolute filter" designated YY-F. It is the third row from the top in the CFM Capacities and Dimensions table.

The third item asked the following:

3. According to the SAR and the TSs, the HVAC system will change to emergency-mode if there is a reactor scram. Does the air monitoring system have the capacity to shut down the reactor and change to emergency-mode in case of an excessive airborne radioactive release? Please provide set-points of the air monitoring system used by the HVAC control system to change from dilute-mode to emergency-mode.

Response to the third item:

There are three important monitors relevant to the radioactivity in the pool room; namely a Continuous Air Monitor (CAM) close to the pool water just above the reactor, a GM detector on the reactor bridge, and an Exhaust Gas Monitor (EGM). The first two detectors are the most important while the third provides an additional element of safety.

When the CAM reaches 3.13×10^3 counts/minute a warning alarm sounds. Usually this happens if the diffusion pump is inadvertently off. The operator would then switch the diffusion pump back on and continue operations. When the CAM reaches 3.13×10^4 counts/minute the HVAC automatically switches to the "dilute mode" and the operator, in response, is required to "shutdown" the reactor by switching a reactor control to "rundown". The rundown following a high CAM alarm is intended to avoid "shock" to any leaking fuel element, should that be the cause for the alarm.

If the GM detector mounted on the bridge of the reactor reaches 200 mrem/hour it automatically initiates a reactor SCRAM which causes the HVAC system to switch to the "isolate" mode.

If the EGM reaches a count rate of 96.8 counts/minute (which is less than the DAC) an alarm sounds at the console and the operator is required to switch the HVAC system into "isolate" mode and to investigate the cause of the alarm.

The fourth item asked the following:

4. Please provide more information regarding the second change you are proposing in the requested amendment of the TSs, and explain why these two items are redundant. Include information on the control and instrumentation system activated by the access gate mentioned in the items 10.c and 10.d of Section 3.15 of the TSs.

Response to the fourth item:

Please note the circuit diagrams enclosed (entitled "BNCT/RX bridge movement panel" and "Beam Room Scram Chain") which should help to understand how the system operates.


10.c states that upon opening the BNC room's access gate the reactor scrams and the bridge moves to the retracted position.

This action was accomplished by placing a spring loaded micro-switch on the inside door frame of the access gate (which is actually a solid door). The micro-switch is Normally Closed (NC) when the switch is compress by a plate attached to the access gate (see switch 28SW6-A on the drawing "Beam Room Scram Chain"). The switch is NC when the gate is closed by this plate attached to the gate. If the access gate is opened a few millimeters, the micro-switch 28SW6-A changes to the "Open" state. This switch is part of the Beam Room scram chain. If any element in this scram chain opens, the reactor automatically scrams and the bridge automatically retracts. This micro-switch is actually the switch referred to in 10.d that describes it as "the bridge retraction switch on the access gate".

That means that "opening the access gate" in 10.c and "opening the bridge retraction switch" in 10.d are one and the same action; hence the redundancy.

If you have any questions, please contact Dr. Gerald Tripard, Facility Director (509) 335-0172


Sincerely,




Gerald E. Tripard
Director

Enclosures: Figure: Pressure Sensor Postions Relative to the "Absolute Filter"
Figure 9-1 Pool Room Ventilation System
Fax of manufacturer's transmittal sheet and table for relevant filters
Figures: "BNCT/RX bridge movement panel" and "Beam Room Scram Chain"
cc: US NRC Headquarters Office

Figure: Pressure Sensor Positions Relative to the "Absolute Filter"

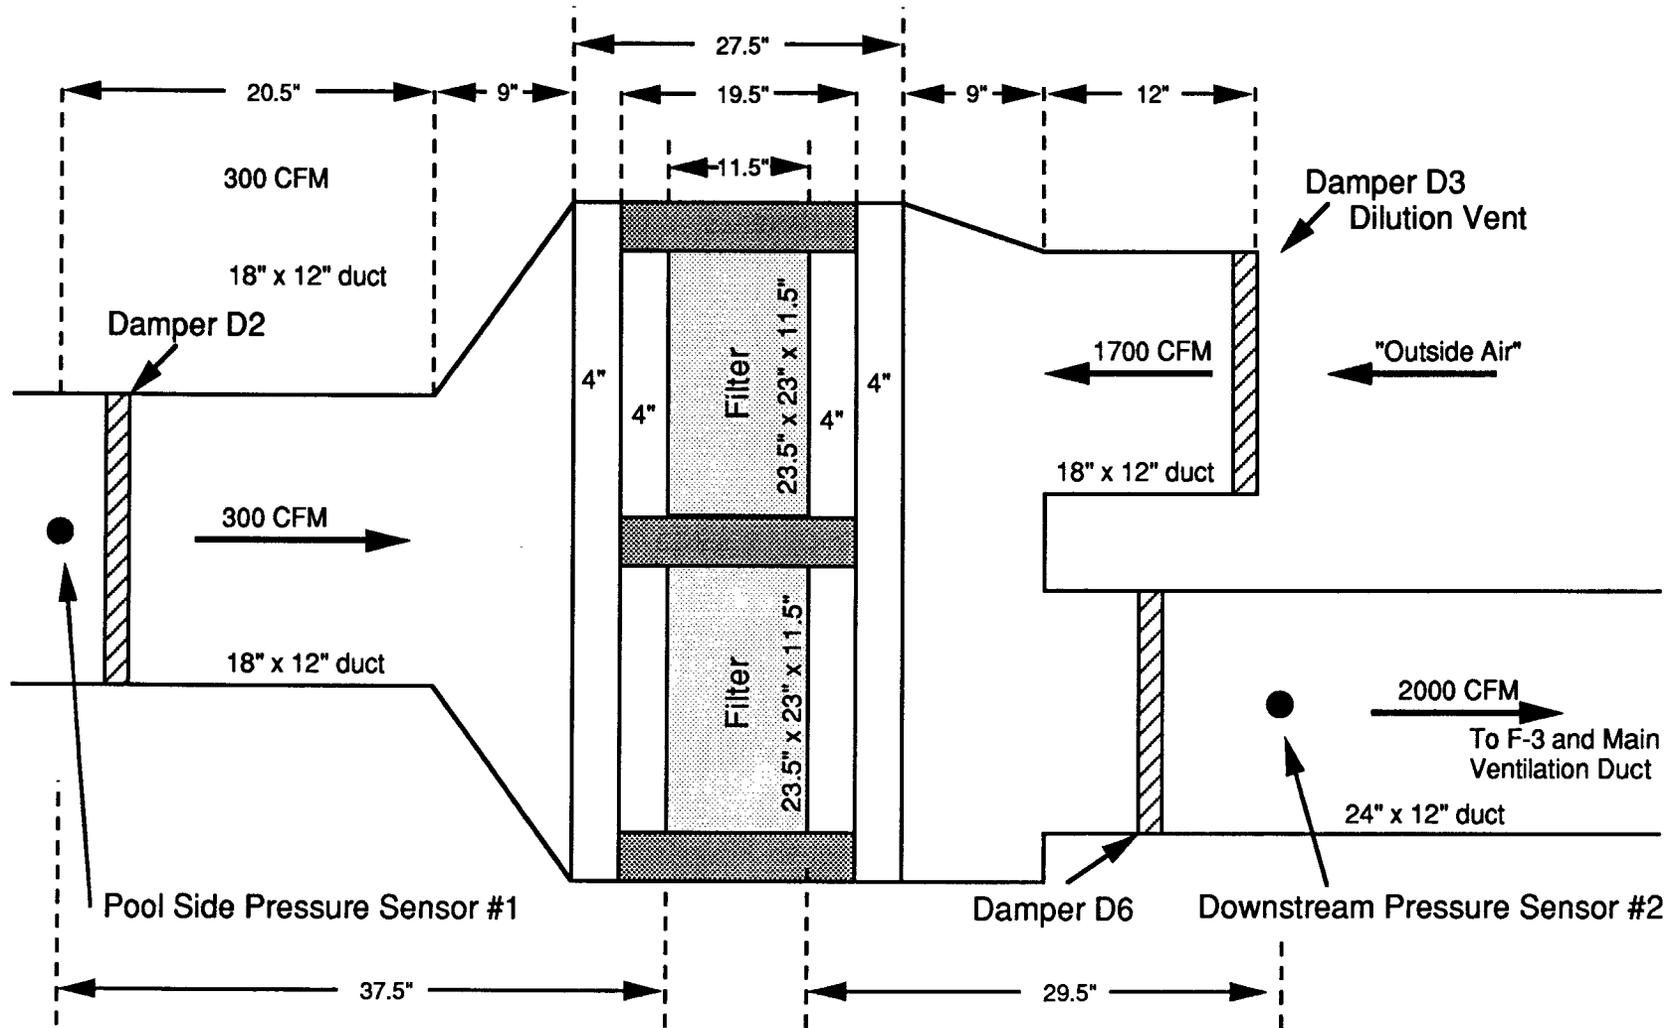

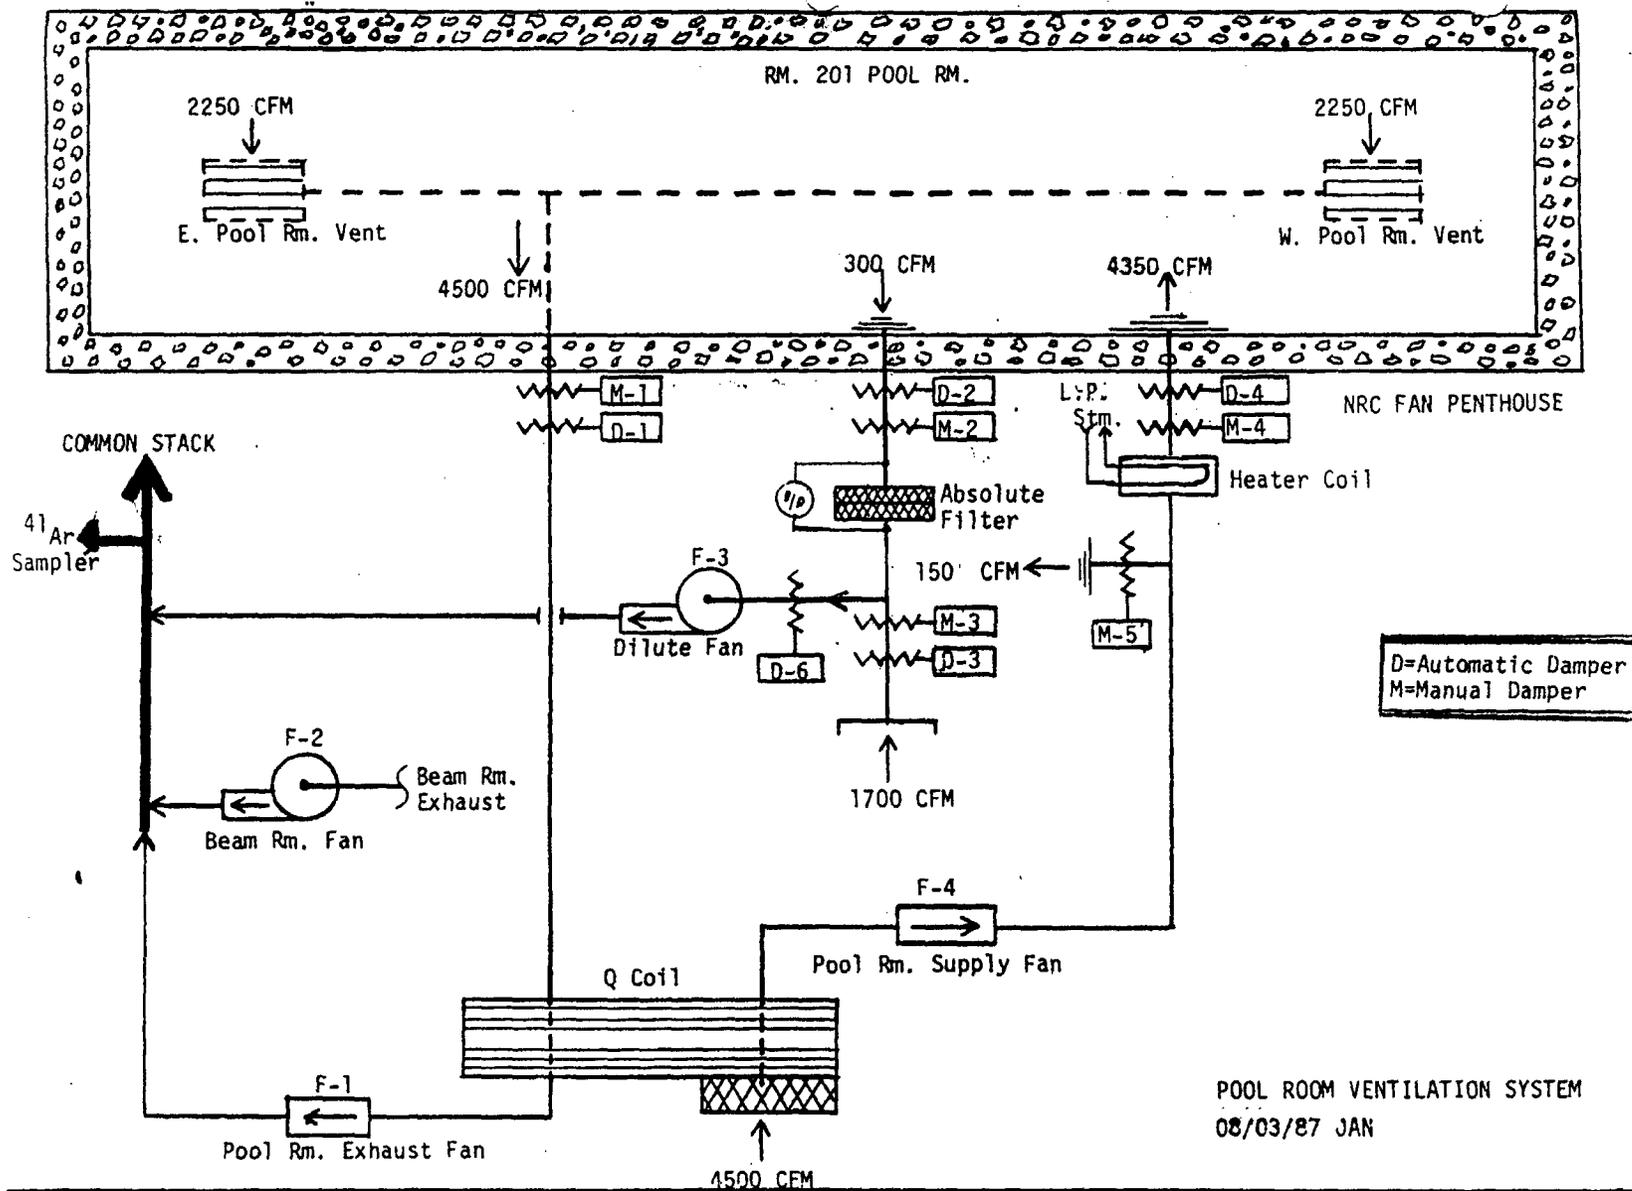

9-2

Figure 9-1

Airpure® Filter Sales & Service

18425 - 72nd. Ave. S. Kent, WA 98032
Phone: 425-251-8766 Fax: 425-251-8767

FAX TRANSMITTAL SHEET

DATE: _____ FAX NUMBER: 509 335 4433
TO: Kent COMPANY: W.S.U.
FROM: GARY FAYTO COMPANY: Airpure Filter Sales

1 PAGE(S) TO FOLLOW
COMMENTS: _____

These two are white on
right side
Small amount of gray on upper
left side


Alpha Cell HEPA Filter Dimensions and Capacities

Frame Depth (Inches)	Filter Depth (Inches)	Actual Face Size (Inches)	Cfm Capacity at Clean	Pressure Drop, Inches W.G.	Weight (Lb.)	5-7/8		11-1/2	
						Cfm Capacity at Clean	Pressure Drop, Inches W.G.	Cfm Capacity at Clean	Pressure Drop, Inches W.G.
36	24	24 x 24	650	1.00	1300	36	1.35	300	455
26	24	24 x 12	300	1.00	580	26	1.35	1735	580
37	29-3/8	29-3/8 x 23-3/8	815	1.00	1235	37	1.35	1235	945
25	23-3/8	23-3/8 x 11-3/8	275	1.00	550	25	1.35	425	550
45	24	24 x 30	830	1.275	1655	45	1.35	1275	1655
14	12	12 x 12	135	2.05	265	14	2.05	205	265
20	24	24 x 24	325	5.00	650	20	5.00	500	650
12	8	8 X 8	25	35	45	12	35	225	295
6	12	12 X 12	70	105	135	6	105	105	135
9	23-3/8	23-3/8 X 23-3/8	305	470	610	9	470	470	610
18	23-3/8	23-3/8 X 11-3/8	270	415	540	18	415	415	540
23	24	24 X 30	410	635	825	23	635	635	825
26	24	24 X 36	505	775	1010	26	775	775	1010
33	24	24 X 48	680	1045	1360	33	1045	1045	1360
39	24	24 X 60	860	1320	1715	39	1320	1320	1715
32	24	24 X 72	1035	1590	2065	32	1590	1590	2065
46	30	30 X 30	525	810	1055	46	810	810	1055
26	30	30 X 36	640	985	1280	26	985	985	1280
30	30	30 X 48	865	1330	1730	30	1330	1330	1730
37	30	30 X 60	1090	1680	2185	37	1680	1680	2185
30	30	30 X 72	1315	2025	2630	30	2025	2025	2630
33	36	36 X 36	790	1215	1580	33	1215	1215	1580
41	36	36 X 48	1050	1620	2105	41	1620	1620	2105
49	36	36 X 60	1315	2025	2630	49	2025	2025	2630
59	36	36 X 72	1580	2430	3160	59	2430	2430	3160


Flanders Precision manufactures both conventional Separator Style and Purform Separator HEPA filters. To make a Separator Style filter, the media is folded over corrugated aluminum separators with hemmed edges to separate the pleats in the filter pack. Flanders Precision manufactures its own filter media, enabling it to develop a unique manufacturing process for the production of Purform Separators HEPA Filters. In one manufacturing operation, Flanders Precision produces a self-supporting and self-separating Purform Media Pack.

The Purform Filter offers many advantages over conventional Separator Style HEPA Filters:


- More usable media area for longer service life because of higher dust holding capacity
- Reduced cost of ownership because of longer service life
- Maximum utilization of the media
- Can handle some harsh environments which may attack aluminum separators
- Media pack can be incinerated
- Media is 20 mils thick, which is significantly thicker than conventional 15 mil media used in Separator Style HEPA Filters

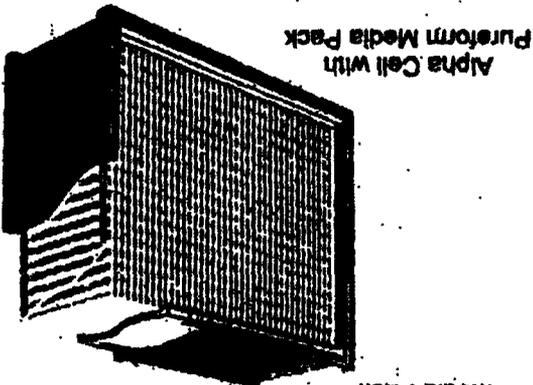

Alpha Cell with Purform Media Pack

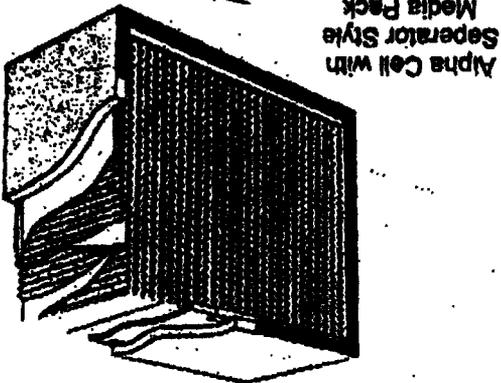

Alpha Cell with Separator Style Media Pack

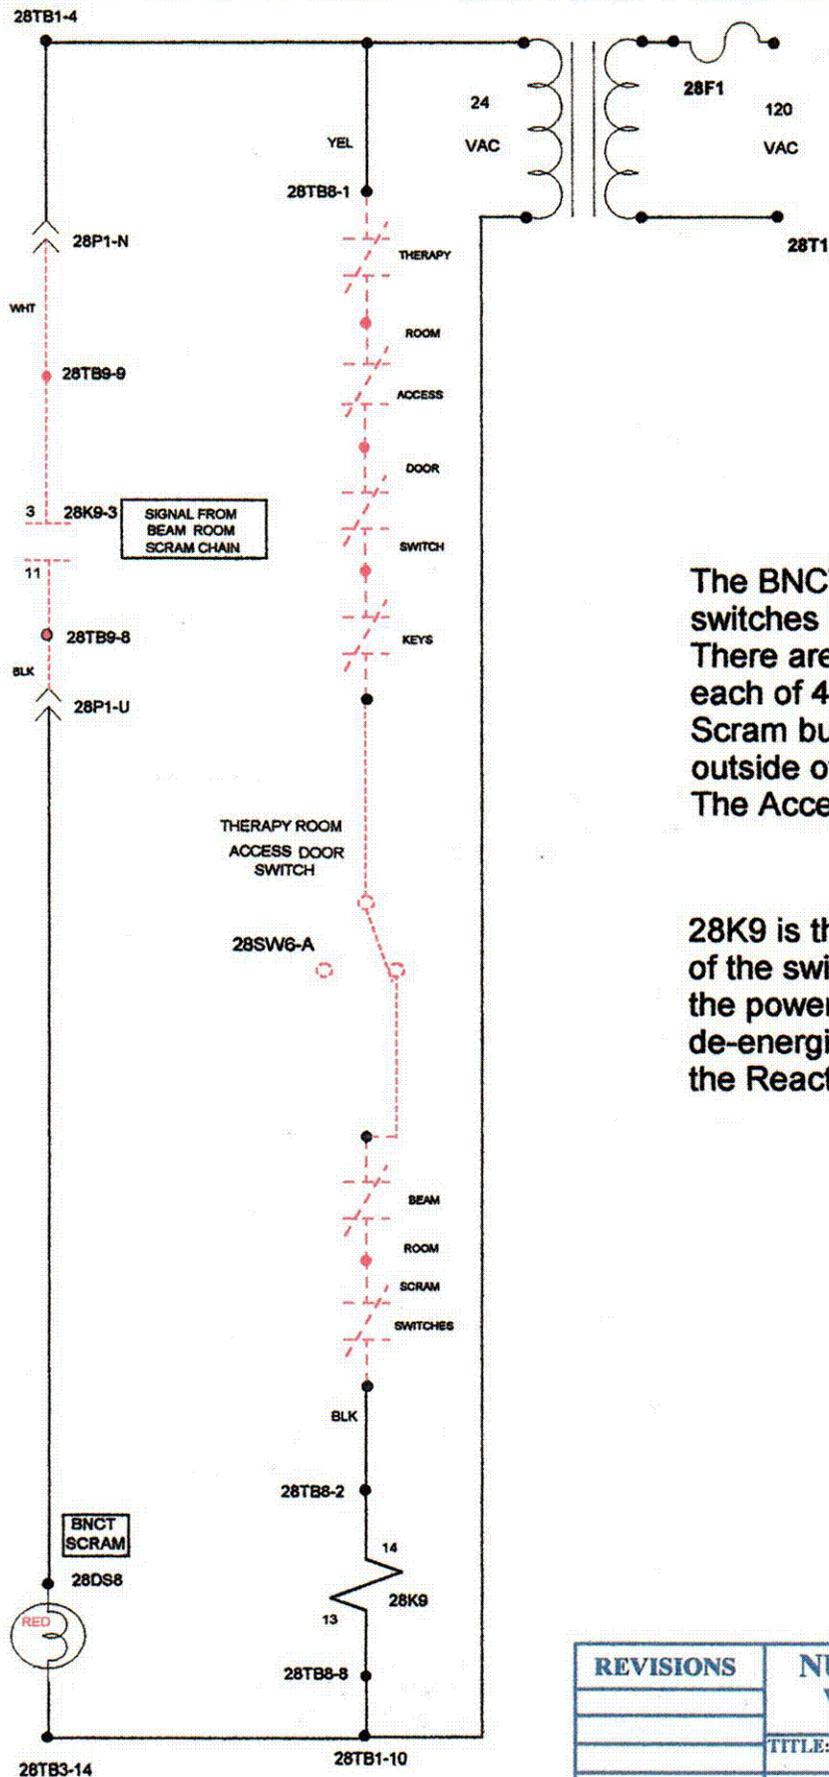


The BNCT Scram Chain consists of 7 switches in the beam room area. There are 4 switches associated with each of 4 access keys. There are 2 Scram buttons, one inside and one outside of the treatment room. The Access Door has the 7th switch.

28K9 is the BNCT Scram Relay. If any of the switches in this chain open or the power to this relay fails, this relay de-energizes and opens a contact in the Reactor's Main Scram Chain.

REVISIONS				NUCLEAR RADIATION CENTER WASHINGTON STATE UNIVERSITY PULLMAN, WASHINGTON	
				TITLE: BEAM ROOM SCRAM CHAIN	
SCALE: N.A.		DWG BY: G.E.T.		FILE NO: 5	
DATE: 07/30/2001		CHK BY: G.E.T.			

C-01

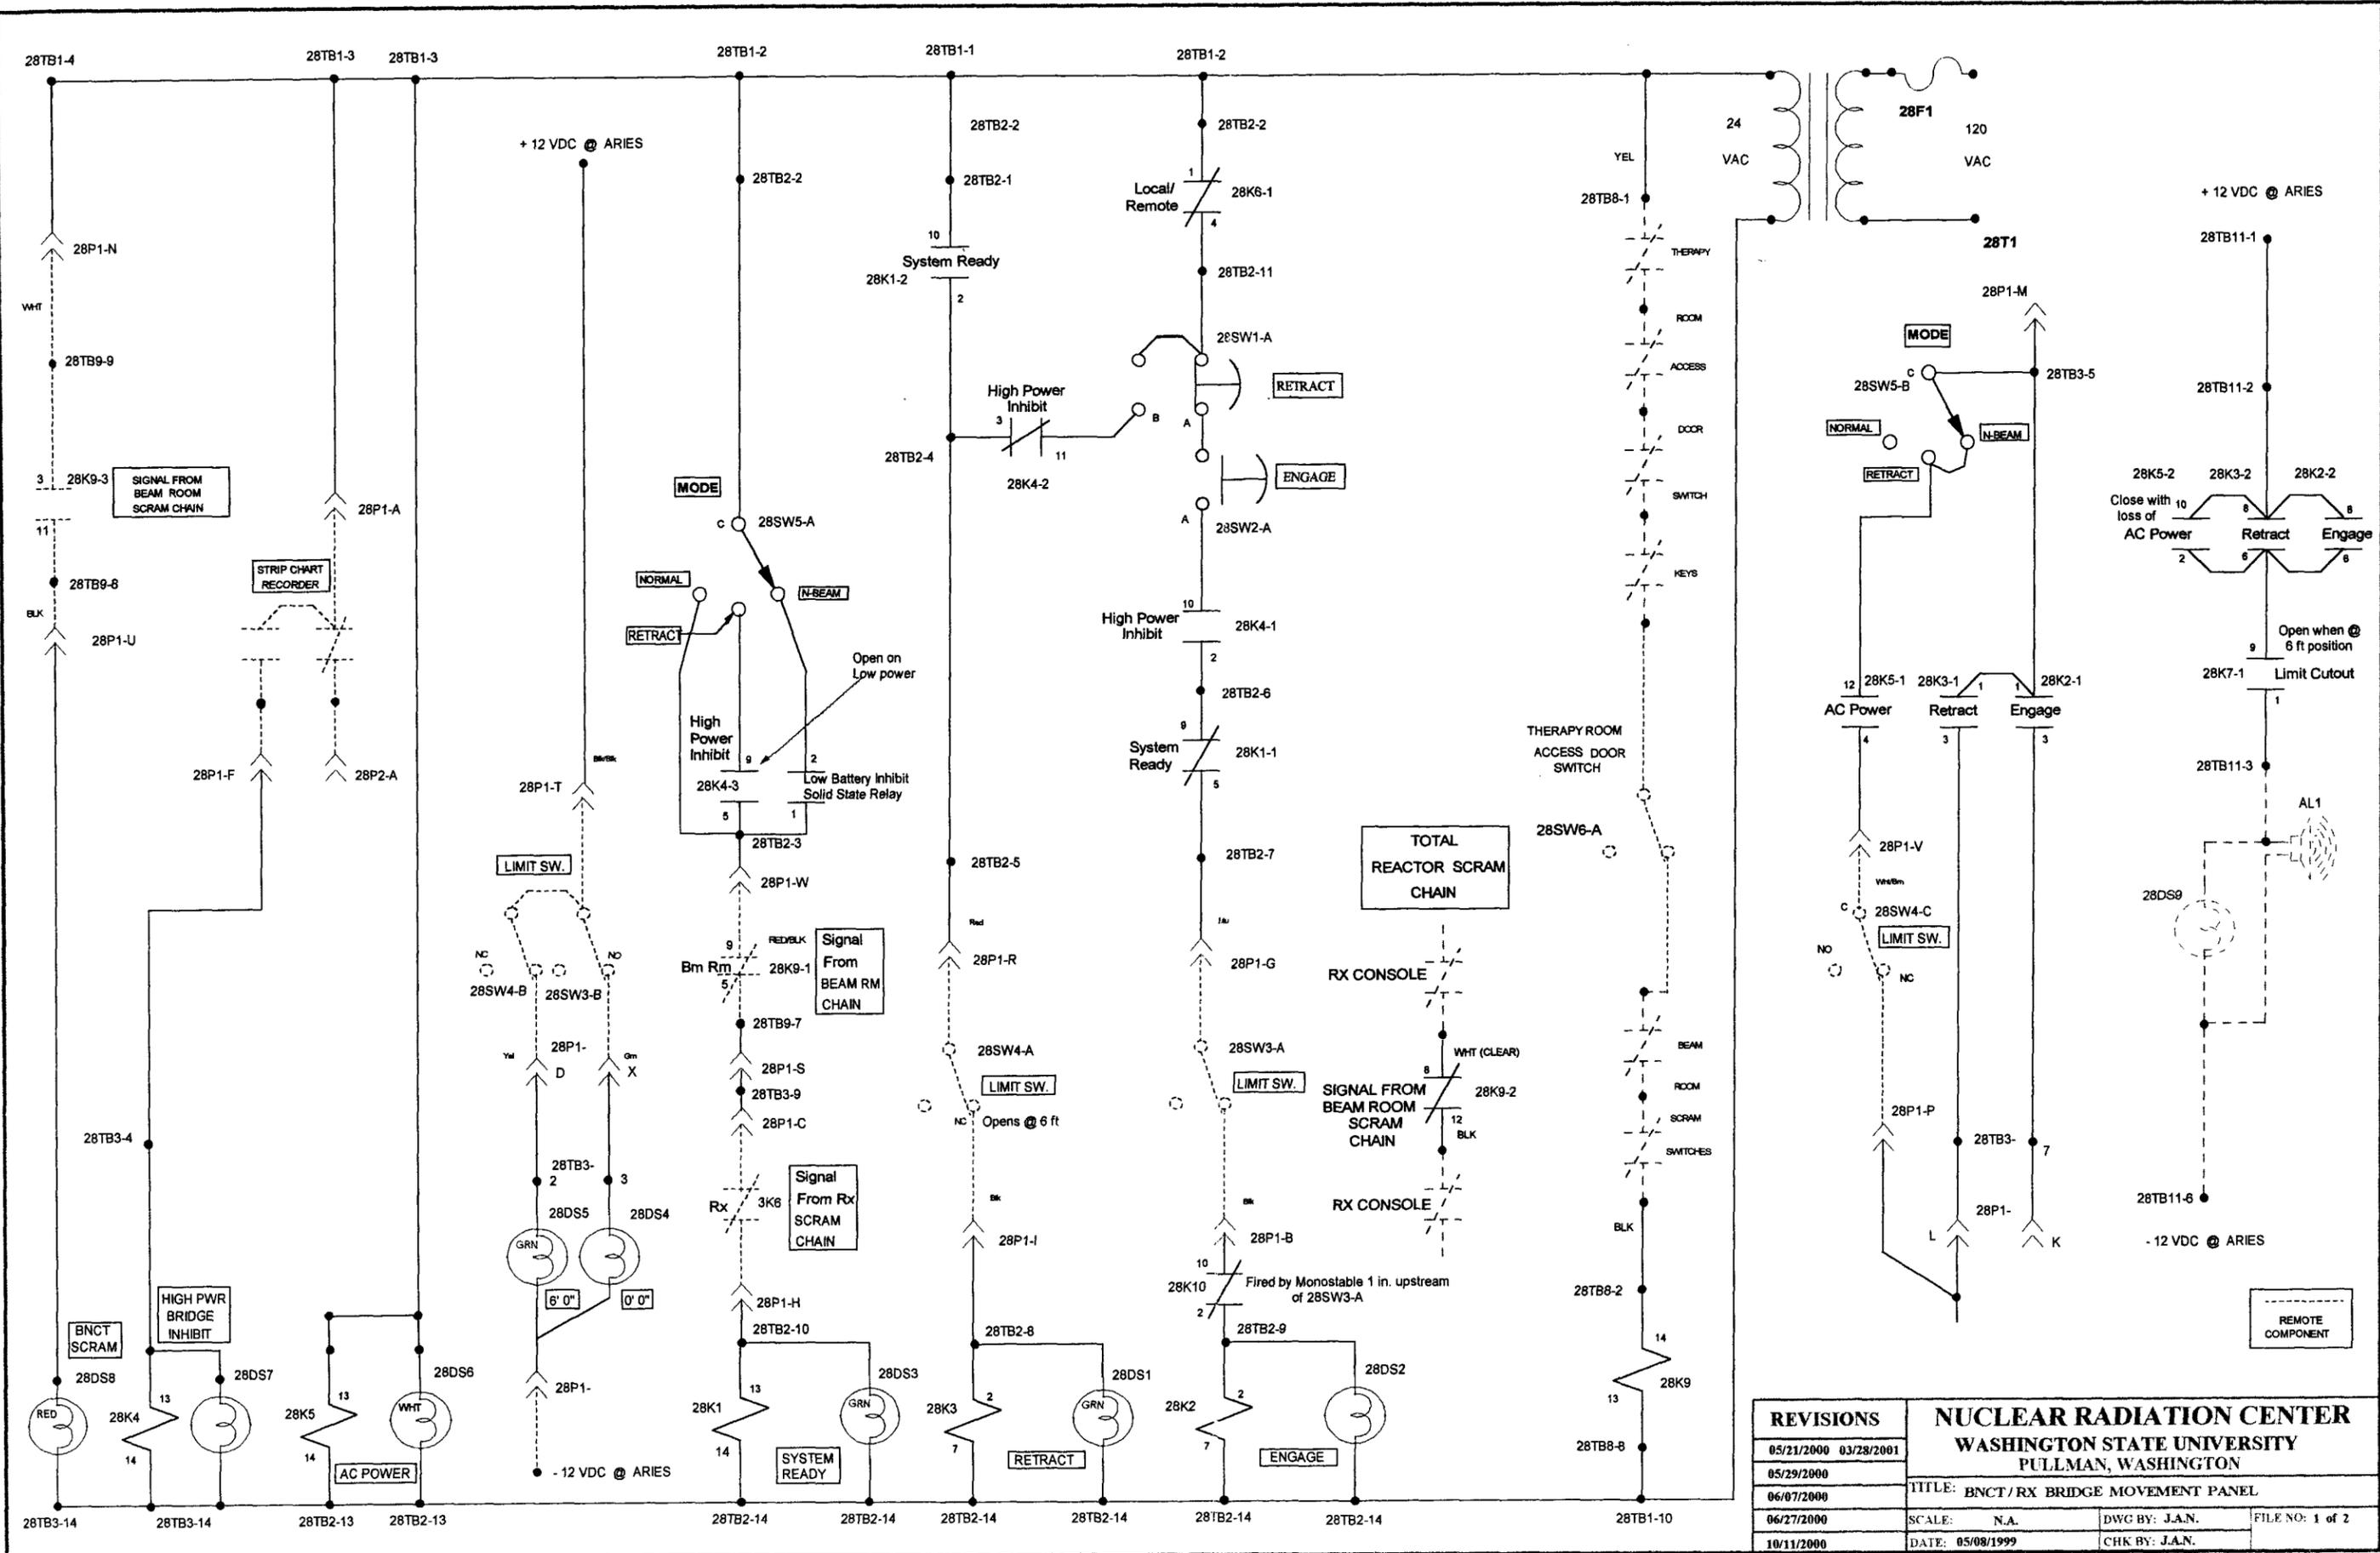

REVISIONS		NUCLEAR RADIATION CENTER	
05/21/2000	03/28/2001	WASHINGTON STATE UNIVERSITY	
05/29/2000		PULLMAN, WASHINGTON	
06/07/2000		TITLE: BNCT/RX BRIDGE MOVEMENT PANEL	
06/27/2000		SCALE: N.A.	DWG BY: J.A.N.
10/11/2000		DATE: 05/08/1999	CHK BY: J.A.N.
			FILE NO: 1 of 2