



444 South 16th Street Mall  
Omaha NE 68102-2247

March 12, 2003  
LIC-03-0028

U. S. Nuclear Regulatory Commission  
ATTN: Document Control Desk  
Washington, DC 20555-0001


Reference: Docket No. 50-285

**SUBJECT: February 2003 Monthly Operating Report (MOR)**

Pursuant to Fort Calhoun Station (FCS) Unit No. 1 Technical Specification 5.9.1.c, Omaha Public Power District (OPPD) submits the attached MOR for February 2003. No commitments are made to the NRC in this letter.

If you have any questions, please contact Mr. Erick Matzke at (402) 533-6855.

Sincerely,

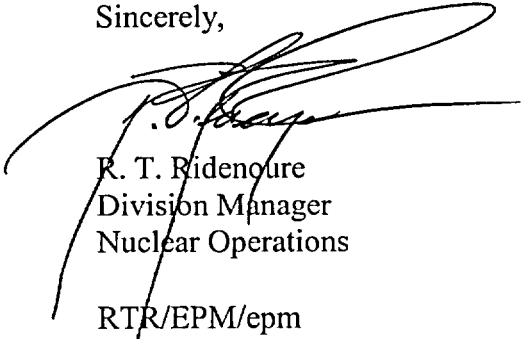

R. T. Ridenoure  
Division Manager  
Nuclear Operations

RTR/EPM/epm

Attachment

c: E. W. Merschoff, NRC Regional Administrator, Region IV  
A. B. Wang, NRC Project Manager  
J. G. Kramer, NRC Senior Resident Inspector  
INPO Records Center  
Winston & Strawn

IE24

LIC-03-0028  
Attachment

## OPERATING DATA REPORT

DOCKET NO. 50-285  
UNIT NAME Fort Calhoun Station  
DATE March 3, 2003  
COMPLETED BY E. P. Matzke  
TELEPHONE (402) 533-6855

REPORT PERIOD: February 2003

Design Electrical Rating (MWe-Net): 478  
Maximum Dependable Capacity (MWe-Net): 478

	<u>MONTH</u>	<u>YR-TO-DATE</u>	<u>CUMULATIVE</u>
Number of Hours Reactor was Critical:	672	1,416	209,378
Number of Hours Generator was On-line:	672	1,416	207,344
Unit Reserve Shutdown Hours:			
Net Electrical Energy Generated (MWh):	328,749	693,648	89,709,678

### UNIT SHUTDOWNS

No.	Date (yy/mm/dd)	Type F: Forced S: Scheduled	Duration (Hours)	Reason <sup>1</sup>	Method of Shutting Down Reactor <sup>2</sup>	Cause & Corrective Action Comments

(1) Reason:

- A-Equipment Failure (Explain)
- B-Maintenance or Test
- C-Refueling
- D-Regulatory Restriction
- E-Operator Training/License Examination
- F-Administrative
- G-Operational Error (Explain)
- H-Other (Explain)

(2) Method:

- 1-Manual
- 2-Manual Trip/Scram
- 3-Automatic Trip/Scram
- 4-Continuation
- 5-Other (Explain)

### OPERATIONS SUMMARY

The Fort Calhoun Station operated at a nominal 100% power for the entire month.

### SAFETY VALVE OR PORV CHALLENGES/FAILURES

No failures or challenges to safety valves or PORVs occurred during the month.