

Exelon Generation Company, LLC www.exeloncorp.com
Braidwood Station
35100 South Rt 53, Suite 84
Braceville, IL 60407-9619
Tel 815-417-2000

March 31, 2003
BW030025

U.S. Nuclear Regulatory Commission
ATTN: Document Control Desk
Washington, DC 20555-0001


Braidwood Station, Unit 1
Facility Operating License No. NPF-72
NRC Docket No. STN 50-456

Subject: Core Operating Limits Report, Braidwood Unit 1 Cycle 10 Sequence
 Number 5

The purpose of this letter is to transmit the Core Operating Limits Report (COLR) for Braidwood Unit 1 Cycle 10 Sequence Number 5, in accordance with Technical Specification 5.6.5, "Core Operating Limits Report (COLR)". This revision of the COLR was recently implemented and revises item 2.5.4, item 2.6.2 and corresponding Figures 2.6.2.a through 2.6.2.d, and item 2.13.2. These changes include: 1) deleting a control bank park position that will not be used, 2) updating W(z) data by providing data for burnups of 22,000, 23,000 and 25,000 MWD/MTU, and 3) editorial changes.

If you have any questions regarding this matter, please contact Mr. Scott Butler, Acting Regulatory Assurance Manager at (815) 417-3540.

Respectfully,



James D. von Suskil
Site Vice President
Braidwood Station

Attachment: Core Operating Limits Report, Braidwood Unit 1 Cycle 10 Sequence
 Number 5

cc: Regional Administrator – NRC Region III
 NRC Senior Resident Inspector – Braidwood Station

A001

ATTACHMENT 1

Core Operating Limits Report

Braidwood Unit 1, Cycle 10, Sequence Number 5

NUCLEAR FUELS DEPARTMENT
TRANSMITTAL OF DESIGN INFORMATION

SAFETY RELATED
 NON-SAFETY RELATED
 REGULATORY RELATED

Originating Organization
 Nuclear Fuels
 Other (specify) _____

TODI No. NFM0100083
Seq No. 5
Page 1 of 17

Station Braidwood Unit 1 Cycle 10 Genenc _____

To Lonnie K. Kepley - Braidwood

Subject Braidwood Unit 1 Cycle 10 Core Operating Limits Report in ITS Format and W(z) Function

Rob Lee [Signature] 03/14/03
Preparer Preparer's Signature Date

Annie Wong [Signature] 03/14/03
Reviewer Reviewer's Signature Date

Ted Lindholm (for Bob Tsai) [Signature] 03/14/03
NF Supervisor NF Supervisor's Signature Date

Status of Information
 Verified
 Unverified
 Engineering Judgement

Method and Schedule of Verification for Unverified TODIs: _____

Description of Information:

Attachment 1 is the Braidwood Unit 1 Cycle 10 Core Operating Limits Report (COLR) Sequence 5 in the ITS format and W(z) function. Sequence 5 of this TODI supersedes Sequence 4.

Purpose of Information:

The attached Core Operating Limits Report (COLR) for Braidwood Station Unit 1 Cycle 10 has been prepared in accordance with the requirements of Technical Specification 5.6.5 (ITS). In this sequence, the following COLR Sections were revised (as described in letter NF-MW-03-106, dated 3/11/03)

- Item 2.5.4 of the COLR is being revised to remove the last line of the table which reads "231 vs. 116"
- Item 2.6.2 of the COLR and the corresponding Figures 2.6.2.a through 2.6.2.d are being revised with newly updated W(z) data
- Item 2.13.2 of the COLR is being revised for updated wording

Braidwood Station is requested to perform a plant review of this document. Upon completion of the plant review, Braidwood Station is to transmit the COLR portion to the Nuclear Regulatory Commission pursuant to Technical Specification 5.6.5. Please provide NF (Rob Lee) with a copy of Braidwood Station's completed plant review and COLR submittal to the NRC.

Source of Information

1. Westinghouse Ltr 01-CB-G-151, "Braidwood Unit 1 Cycle 10 COLR Data", dated 08/28/01.
2. Westinghouse Ltr 01-CB-G-153, "Braidwood Unit 1 Cycle 10 COLR Revision 1", dated 08/31/01.
3. TODI NFM0100062, Revision 1, "BRIC10 Reload Design Initiation", dated 06/12/01.
4. NFS PNDCN 00-003, Rev 0, "Evaluation of SPIL Using 224 Steps Rod Withdrawn as Definition of ARO", dated 05/11/00
5. Westinghouse Ltr 01-CB-G-132, "Braidwood 1 Cycle 10 BEACON DMM Model Delivery", dated 07/27/01.
6. Westinghouse Ltr 01-CB-G-155, "Braidwood Unit 1 Cycle 10 Boron Concentration for Startup Physics Testing", dated 09/07/01
7. Westinghouse Ltr NF-CB-03-62/CAC-03-65, "Braidwood Unit 1 Cycle 10 Revised W(z) Factors." dated 03/13/03.

Supplemental Distribution L S Dworakowski (BR)

CORE OPERATING LIMITS REPORT (COLR) for BRAIDWOOD UNIT 1 CYCLE 10

1.0 CORE OPERATING LIMITS REPORT

This Core Operating Limits Report (COLR) for Braidwood Station Unit 1 Cycle 10 has been prepared in accordance with the requirements of Technical Specification 5.6.5 (ITS).

The Technical Specifications affected by this report are listed below:

- SL 2.1.1 Reactor Core Safety Limits (SLs)
- LCO 3.1.1 SHUTDOWN MARGIN (SDM)
- LCO 3.1.3 Moderator Temperature Coefficient (MTC)
- LCO 3.1.4 Rod Group Alignment Limits
- LCO 3.1.5 Shutdown Bank Insertion Limits
- LCO 3.1.6 Control Bank Insertion Limits
- LCO 3.1.8 PHYSICS TESTS Exceptions – MODE 2
- LCO 3.2.1 Heat Flux Hot Channel Factor ($F_{Q(Z)}$)
- LCO 3.2.2 Nuclear Enthalpy Rise Hot Channel Factor ($F_{\Delta H}^N$)
- LCO 3.2.3 AXIAL FLUX DIFFERENCE (AFD)
- LCO 3.2.5 Departure from Nucleate Boiling Ratio (DNBR)
- LCO 3.3.1 Reactor Trip System (RTS) Instrumentation
- LCO 3.3.9 Boron Dilution Protection System (BDPS)
- LCO 3.4.1 Reactor Coolant System (RCS) Pressure, Temperature, and Flow Departure from Nucleate Boiling (DNB) Limits
- LCO 3.9.1 Boron Concentration

The portions of the Technical Requirements Manual affected by this report are listed below:

- TRM TLCO 3.1.b Boration Flow Paths - Operating
- TRM TLCO 3.1.d Charging Pumps - Operating
- TRM TLCO 3.1.f Borated Water Sources - Operating
- TRM TLCO 3.1.g Position Indication System – Shutdown
- TRM TLCO 3.1.h Shutdown Margin (SDM) – MODE 1 and MODE 2 with $k_{eff} \geq 1.0$
- TRM TLCO 3.1.i Shutdown Margin (SDM) – MODE 5
- TRM TLCO 3.1.j Shutdown and Control Rods
- TRM TLCO 3.1.k Position Indication System – Shutdown (Special Test Exception)

CORE OPERATING LIMITS REPORT (COLR) for BRAIDWOOD UNIT 1 CYCLE 10

2.0 OPERATING LIMITS

The cycle-specific parameter limits for the specifications listed in Section 1.0 are presented in the following subsections. These limits are applicable for the entire cycle unless otherwise identified. These limits have been developed using the NRC-approved methodologies specified in Technical Specification 5.6.5.

2.1 Reactor Core Safety Limits (SLs) (SL 2.1.1)

2.1.1 In Modes 1 and 2, the combination of Thermal Power, Reactor Coolant System (RCS) highest loop average temperature, and pressurizer pressure shall not exceed the limits specified in Figure 2.1.1.

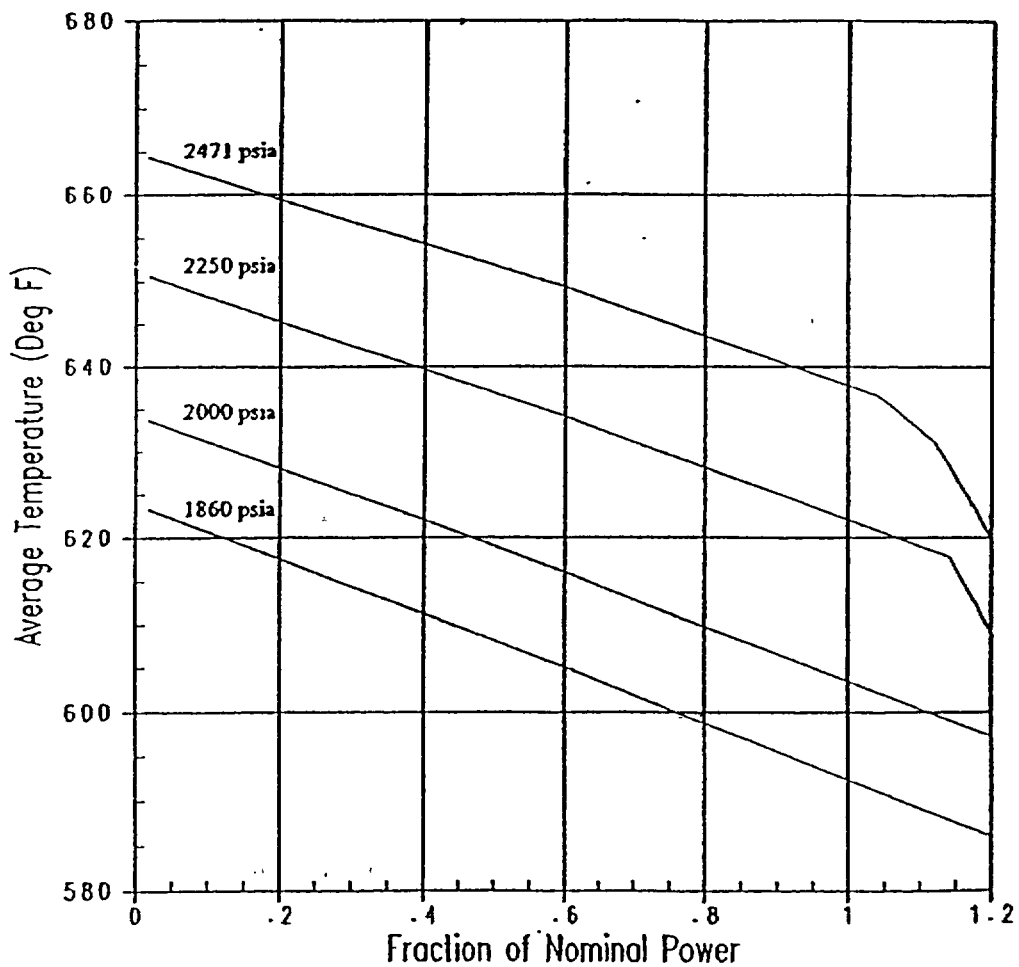


Figure 2.1.1: Reactor Core Limits

2.2 CORE OPERATING LIMITS REPORT (COLR) for BRAIDWOOD UNIT 1 CYCLE 10
SHUTDOWN MARGIN (SDM)

The SDM limit for MODES 1, 2, 3, and 4 is:

- 2.2.1 The SDM shall be greater than or equal to 1.3% $\Delta k/k$ (LCOs 3.1.1, 3.1.4, 3.1.5, 3.1.6, 3.1.8, 3.3.9, TRM TLCOs 3.1.b, 3.1.d, 3.1.f, 3.1.h, and 3.1.j)

The SDM limit for MODE 5 is:

- 2.2.2 SDM shall be greater than or equal to 1.3% $\Delta k/k$ (LCO 3.1.1, LCO 3.3.9; TRM TLCOs 3.1.i and 3.1.j).

2.3 Moderator Temperature Coefficient (MTC) (LCO 3.1.3)

The Moderator Temperature Coefficient (MTC) limits are:

- 2.3.1 The BOL/ARO/HZP-MTC upper limit shall be $+2.14 \times 10^{-5} \Delta k/k/^{\circ}F$
- 2.3.2 The EOL/ARO/HFP-MTC lower limit shall be $-4.6 \times 10^{-4} \Delta k/k/^{\circ}F$
- 2.3.3 The EOL/ARO/HFP-MTC Surveillance limit at 300 ppm shall be $-3.7 \times 10^{-4} \Delta k/k/^{\circ}F$.
- 2.3.4 The EOL/ARO/HFP-MTC Surveillance limit at 60 ppm shall be $-4.3 \times 10^{-4} \Delta k/k/^{\circ}F$.
 where: BOL stands for Beginning of Cycle Life
 ARO stands for All Rods Out
 HZP stands for Hot Zero Thermal Power
 EOL stands for End of Cycle Life
 HFP stands for Hot Full Thermal Power

2.4 Shutdown Bank Insertion Limits (LCO 3.1.5)

- 2.4.1 All shutdown banks shall be fully withdrawn to at least 224 steps.


2.5 Control Bank Insertion Limits (LCO 3.1.6)

- 2.5.1 The control banks, with the Bank A greater than or equal to 224 steps, shall be limited in physical insertion as shown in Figure 2.5.1.
- 2.5.2 Each control bank shall be considered fully withdrawn from the core at greater than or equal to 224 steps.
- 2.5.3 The control banks shall be operated in sequence by withdrawal of Bank A, Bank B, Bank C and Bank D. The control banks shall be sequenced in reverse order upon insertion.
- 2.5.4 Each control bank not fully withdrawn from the core shall be operated with the following overlap limits as a function of park position.

Park Position (step)	Overlap Limit (step)
225	110
226	111
227	112
228	113
229	114

CORE OPERATING LIMITS REPORT (COLR) for BRAIDWOOD UNIT 1 CYCLE 10

Figure 2.5.1:
Control Bank Insertion Limits Versus Percent Rated Thermal
Power

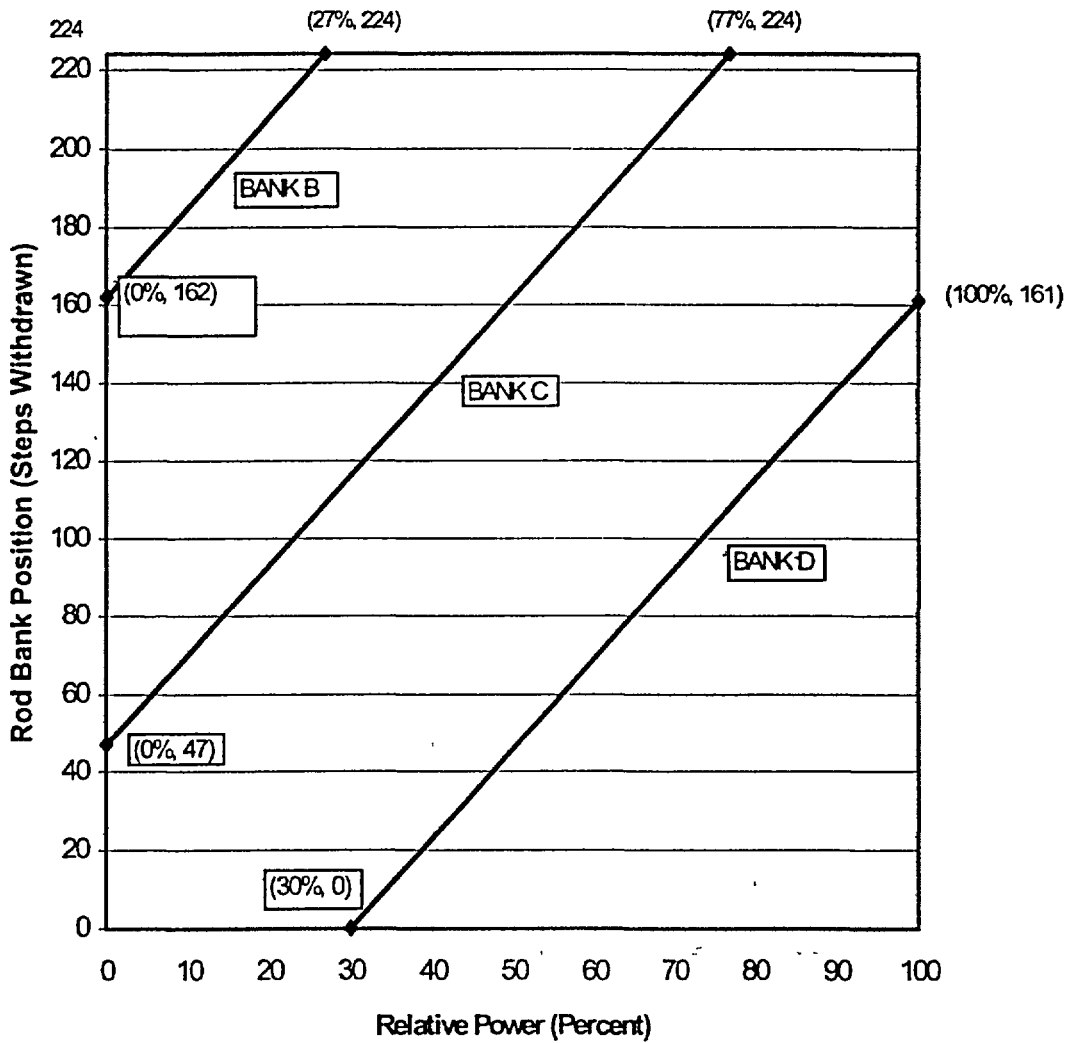

CORE OPERATING LIMITS REPORT (COLR) for BRAIDWOOD UNIT 1 CYCLE 10

2.6 Heat Flux Hot Channel Factor ($F_Q(Z)$) (LCO 3.2.1)

2.6.1

$$F_Q(Z) \leq \frac{F_Q^{RTP}}{0.5} \times K(Z) \quad \text{for } P \leq 0.5$$

$$F_Q(Z) \leq \frac{F_Q^{RTP}}{P} \times K(Z) \quad \text{for } P > 0.5$$

where: P = the ratio of THERMAL POWER to RATED THERMAL POWER

$$F_Q^{RTP} = 2.60$$

$K(Z)$ is provided in Figure 2.6.1.

2.6.2 $W(Z)$ Values:

a) When PDMS is OPERABLE, $W(Z) = 1.00000$ for all axial points.

b) When PDMS is Inoperable, $W(Z)$ is provided in Figures 2.6.2.a through 2.6.2.d.

The normal operation $W(Z)$ values have been determined at burnups of 20000, 22000, 23000, and 25000 MWD/MTU to support operation after 22000 MWD/MTU.

Table 2.6.2 shows the $F_Q^C(z)$ penalty factors that are greater than 2% per 31 Effective Full Power Days. These values shall be used to increase the $F_Q^W(z)$ as per Surveillance Requirement 3.2.1.2. A 2% penalty factor shall be used at all cycle burnups that are outside the range of Table 2.6.2.

$$\text{Multiplication Factor} = 1.02$$

2.6.3 Uncertainty:

The uncertainty, U_{FQ} , to be applied to the Heat Flux Hot Channel Factor $F_Q(Z)$ shall be calculated by the following formula

$$U_{FQ} = U_{qm} \cdot U_e$$

where:

U_{qm} = Base FQ measurement uncertainty = 1.05 when PDMS is inoperable.

U_e = Engineering uncertainty factor = 1.03


2.6.4 PDMS Alarms:

$F_Q(Z)$ Warning Setpoint $\geq 2\%$ of $F_Q(Z)$ Margin

$F_Q(Z)$ Alarm Setpoint $\geq 0\%$ of $F_Q(Z)$ Margin

CORE OPERATING LIMITS REPORT (COLR) for BRAIDWOOD UNIT 1 CYCLE 10

Figure 2.6.1: $K(Z)$ - Normalized $F_d(Z)$ as a Function of Core Height

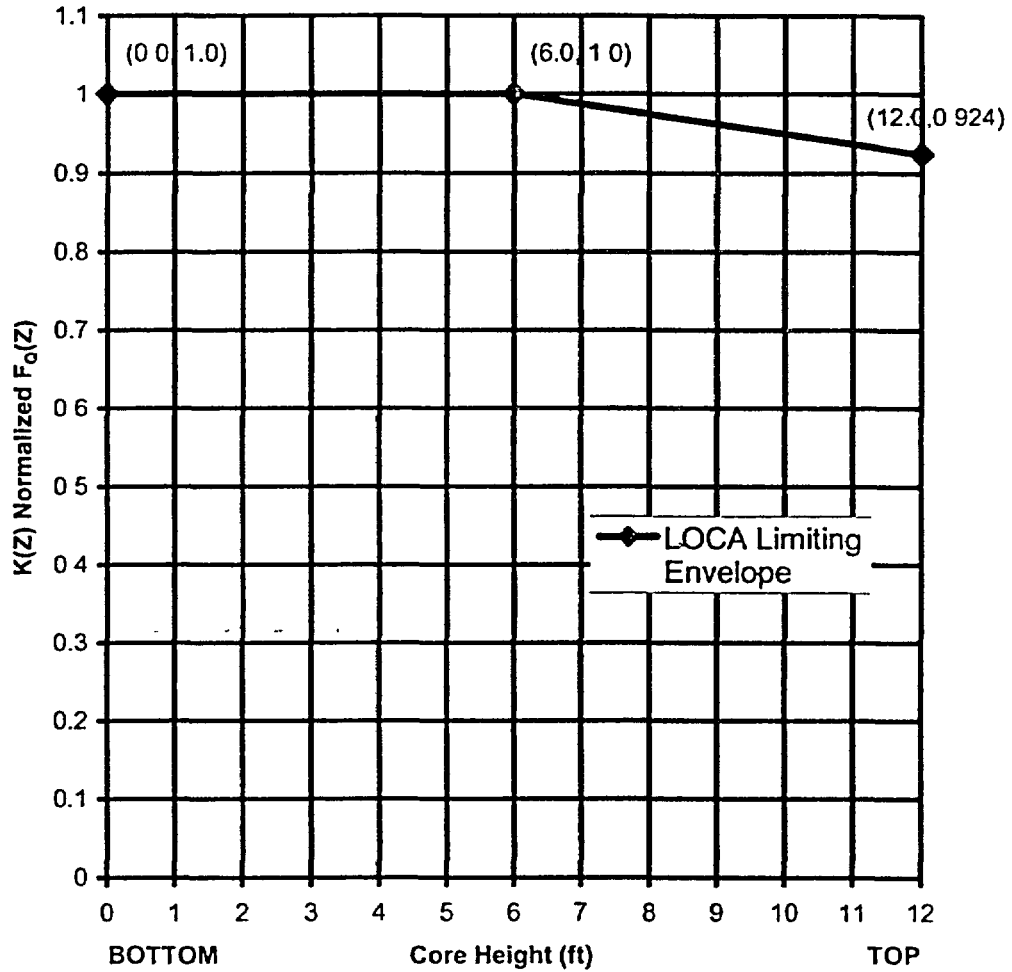


CORE OPERATING LIMITS REPORT (COR) for BRAIDWOOD UNIT 1 CYCLE 10

Height Feet	MAX W(Z)
0.00	1 0000
0.20	1 0000
0.40	1 0000
0.60	1 0000
0.80	1 0000
1.00	1 0000
1.20	1 0000
1.40	1 0000
1.60	1 0000
1.80	1 2378
2.00	1 2237
2.20	1 2128
2.40	1 2033
2.60	1 1925
2.80	1 1831
3.00	1 1739
3.20	1 1634
3.40	1 1653
3.60	1 1670
3.80	1 1677
4.00	1 1669
4.20	1 1644
4.40	1 1618
4.60	1 1553
4.80	1 1607
5.00	1 1659
5.20	1 1714
5.40	1 1739
5.60	1 1874
5.80	1 2059
6.00	1 2214
6.20	1 2349
6.40	1 2455
6.60	1 2521
6.80	1 2568
7.00	1 2586
7.20	1 2545
7.40	1 2504
7.60	1 2415
7.80	1 2315
8.00	1 2197
8.20	1 2029
8.40	1 1862
8.60	1 1666
8.80	1 1490
9.00	1 1329
9.20	1 1214
9.40	1 1300
9.60	1 1760
9.80	1 2160
10.00	1 2530
10.20	1 2870
10.40	1 0000
10.60	1 0000
10.80	1 0000
11.00	1 0000
11.20	1 0000
11.40	1 0000
11.60	1 0000
11.80	1 0000
12.00	1 0000

Braidwood Unit 1 Cycle 10

Figure 2.6.2.a

Summary of W(Z) Function at 20000 MWD/MTU
(Top and Bottom 15% Excluded per WCAP-10216)

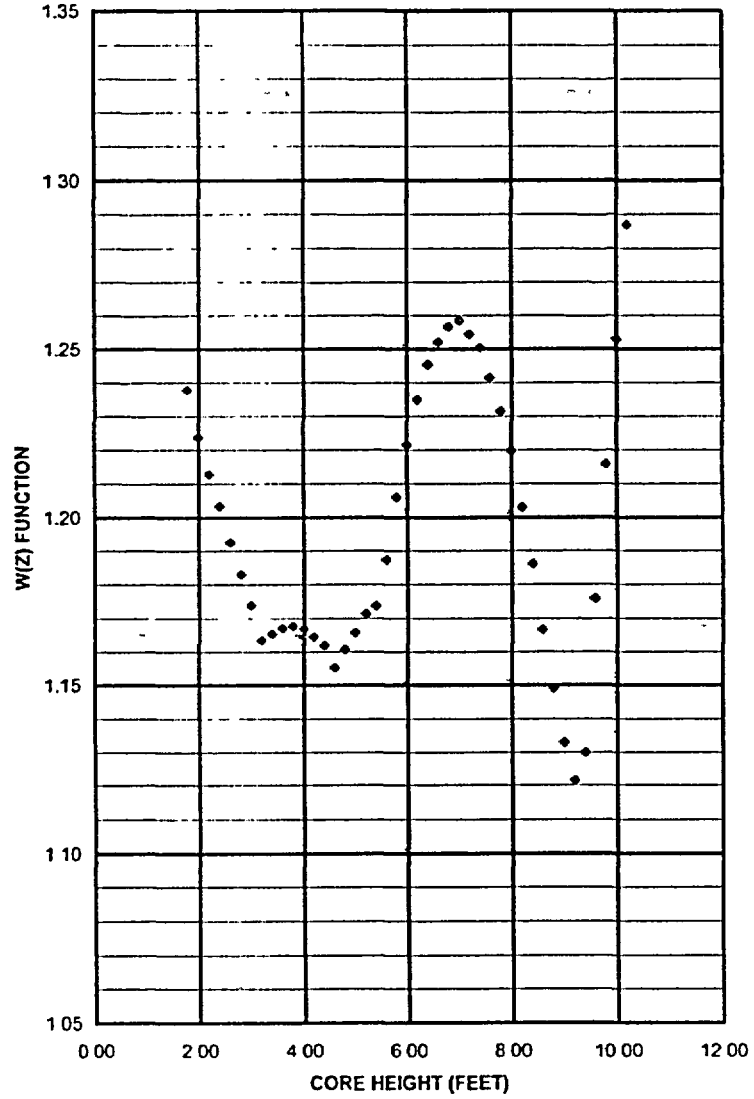


CORE OPERATING LIMITS REPORT (COLR) for BRAIDWOOD UNIT 1 CYCLE 10

Height Feet	MAX W(Z)
0.00	1 0000
0.20	1 0000
0.40	1 0000
0.60	1 0000
0.80	1 0000
1.00	1 0000
1.20	1 0000
1.40	1 0000
1.60	1 0060
1.80	1 2578
2.00	1 2237
2.20	1 2128
2.40	1 2033
2.60	1 1925
2.80	1 1831
3.00	1 1739
3.20	1 1634
3.40	1 1653
3.60	1 1670
3.80	1 1677
4.00	1 1669
4.20	1 1644
4.40	1 1618
4.60	1 1553
4.80	1 1607
5.00	1 1659
5.20	1 1714
5.40	1 1739
5.60	1 1874
5.80	1 2059
6.00	1 2214
6.20	1 2349
6.40	1 2455
6.60	1 2521
6.80	1 2568
7.00	1 2586
7.20	1 2545
7.40	1 2504
7.60	1 2415
7.80	1 2315
8.00	1 2197
8.20	1 2029
8.40	1 1862
8.60	1 1666
8.80	1 1490
9.00	1 1329
9.20	1 1214
9.40	1 1300
9.60	1 1760
9.80	1 2160
10.00	1 2530
10.20	1 2870
10.40	1 0000
10.60	1 0000
10.80	1 0000
11.00	1 0000
11.20	1 0000
11.40	1 0000
11.60	1 0000
11.80	1 0000
12.00	1 0000

Braidwood Unit 1 Cycle 10

Figure 2.6.2.b

Summary of W(Z) Function at 22000 MWD/MTU
(Top and Bottom 15% Excluded per WCAP-10216)

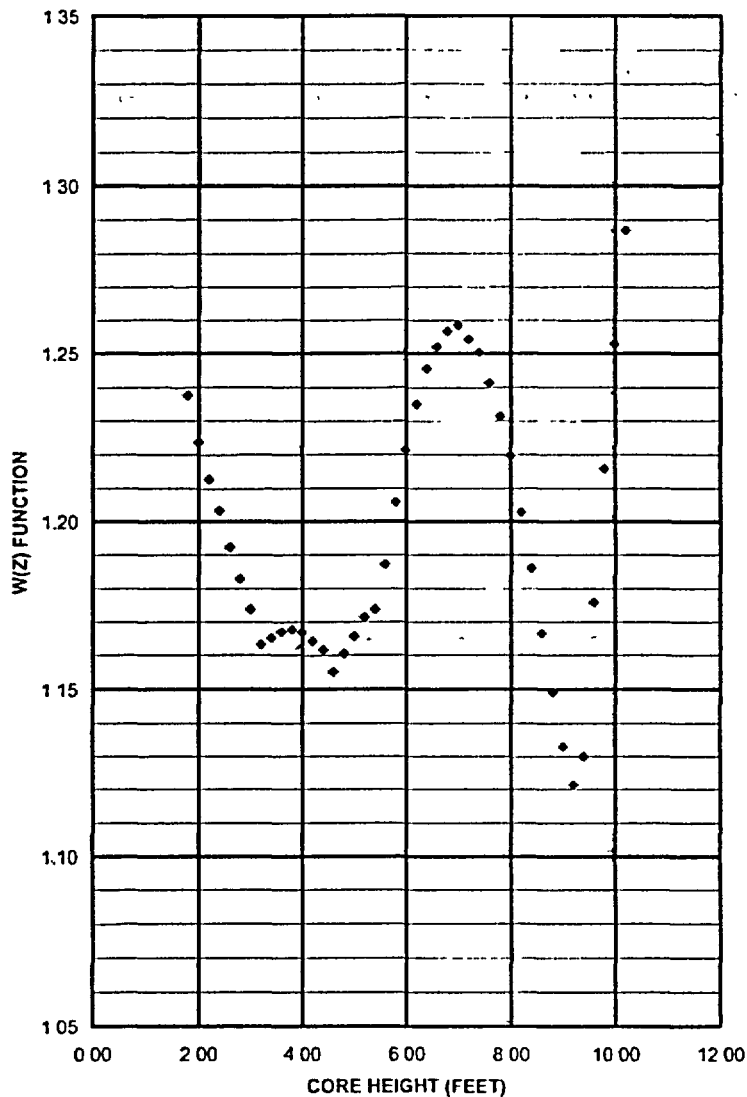


CORE OPERATING LIMITS REPORT (COLR) for BRAIDWOOD UNIT 1 CYCLE 10

Height Feet	MAX W(Z)
0.00	1 0000
0.20	1 0000
0.40	1 0000
0.60	1 0000
0.80	1 0000
1.00	1 0000
1.20	1 0000
1.40	1 0000
1.60	1 0000
1.80	1 2378
2.00	1 2237
2.20	1 2128
2.40	1 2033
2.60	1 1925
2.80	1 1831
3.00	1 1739
3.20	1 1634
3.40	1 1653
3.60	1 1670
3.80	1 1677
4.00	1 1669
4.20	1 1644
4.40	1 1618
4.60	1 1553
4.80	1 1607
5.00	1 1659
5.20	1 1714
5.40	1 1739
5.60	1 1874
5.80	1 2059
6.00	1 2214
6.20	1 2349
6.40	1 2455
6.60	1 2521
6.80	1 2568
7.00	1 2586
7.20	1 2545
7.40	1 2504
7.60	1 2415
7.80	1 2315
8.00	1 2197
8.20	1 2029
8.40	1 1862
8.60	1 1666
8.80	1 1490
9.00	1 1329
9.20	1 1214
9.40	1 1300
9.60	1 1760
9.80	1 2160
10.00	1 2530
10.20	1 2870
10.40	1 0000
10.60	1 0000
10.80	1 0000
11.00	1 0000
11.20	1 0000
11.40	1 0000
11.60	1 0000
11.80	1 0000
12.00	1 0000

Braidwood Unit 1 Cycle 10

Figure 2.6.2.c

Summary of W(Z) Function at 23000 MW/DABTU
(Top and Bottom 15% Excluded per WC AP-10216)

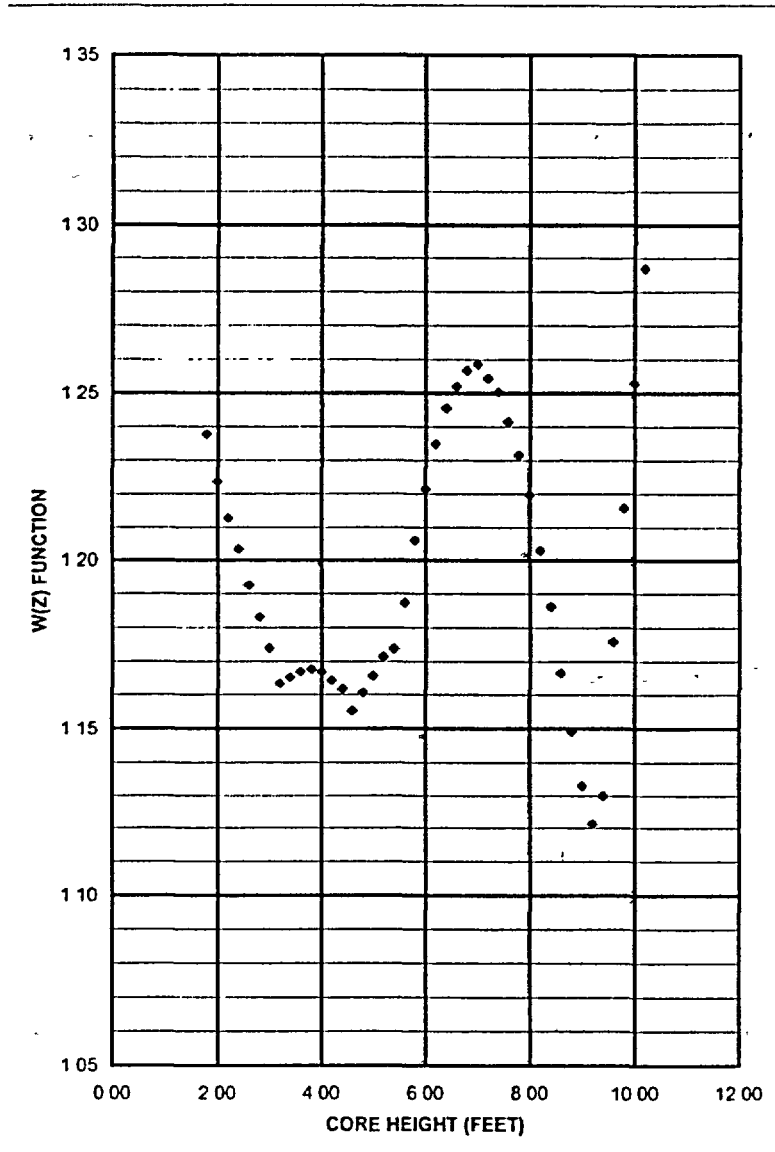


CORE OPERATING LIMITS REPORT (COLR) for BRAIDWOOD UNIT 1 CYCLE 10

Height Feet	MAX WCD
0.00	1 0000
0.20	1 0000
0.40	1 0000
0.60	1 0000
0.80	1 0000
1.00	1 0000
1.20	1 0000
1.40	1 0000
1.60	1 0000
1.80	1 2378
2.00	1 2237
2.20	1 2128
2.40	1 2053
2.60	1 1925
2.80	1 1851
3.00	1 1739
3.20	1 1634
3.40	1 1653
3.60	1 1670
3.80	1 1677
4.00	1 1669
4.20	1 1644
4.40	1 1618
4.60	1 1553
4.80	1 1607
5.00	1 1659
5.20	1 1714
5.40	1 1739
5.60	1 1874
5.80	1 2059
6.00	1 2214
6.20	1 2349
6.40	1 2455
6.60	1 2521
6.80	1 2568
7.00	1 2586
7.20	1 2545
7.40	1 2504
7.60	1 2415
7.80	1 2315
8.00	1 2197
8.20	1 2029
8.40	1 1862
8.60	1 1666
8.80	1 1490
9.00	1 1329
9.20	1 1214
9.40	1 1300
9.60	1 1760
9.80	1 2160
10.00	1 2530
10.20	1 2870
10.40	1 0000
10.60	1 0000
10.80	1 0000
11.00	1 0000
11.20	1 0000
11.40	1 0000
11.60	1 0000
11.80	1 0000
12.00	1 0000

Braidwood Unit 1 Cycle 10

Figure 2.6.2.d

Summary of WCD Function at 25000 MW DAMTU
(Top and Bottom 15% Excluded per WCAP-10216)

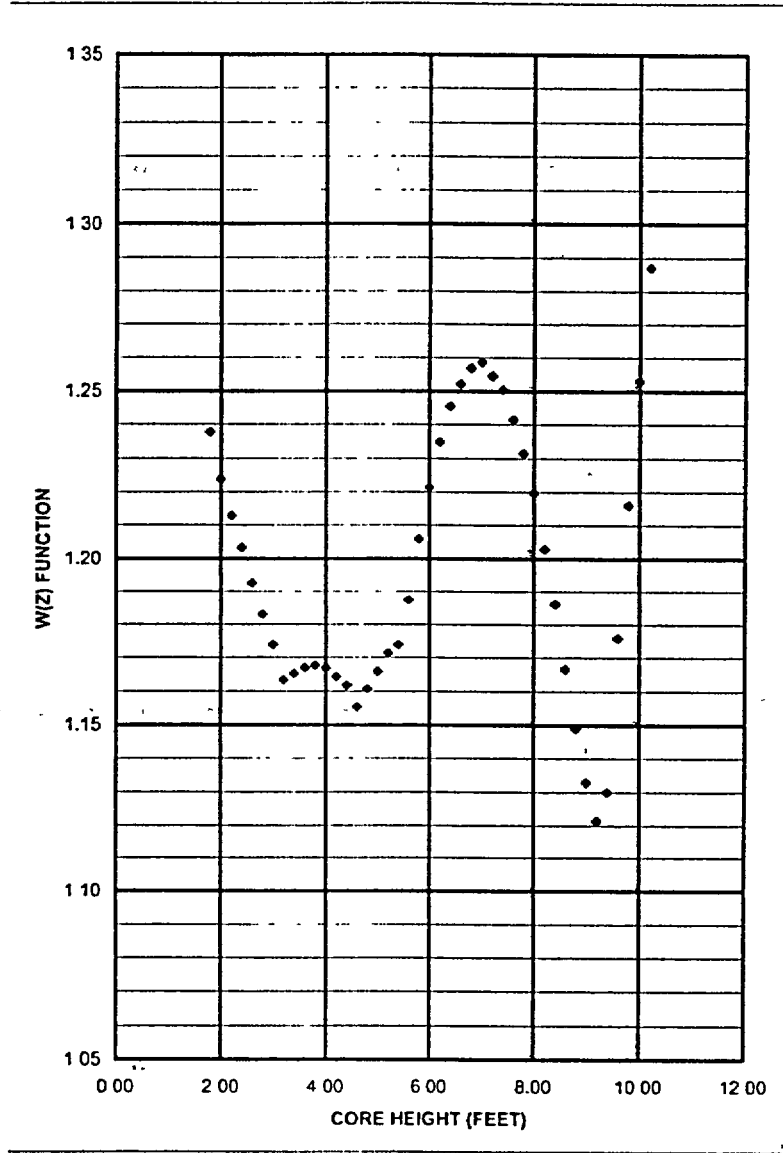

CORE OPERATING LIMITS REPORT (COLR) for BRAIDWOOD UNIT 1 CYCLE 10

Table 2.6.2
Fq Margin Decreases in Excess of 2% per 31 EFPD

Cycle Burnup (MWD/MTU)	Max % Decrease in Fq Margin
665	2.00
837	2.19
1008	3.19
1180	4.14
1351	4.99
1523	5.72
1695	6.13
1866	5.93
2038	5.59
2210	5.14
2381	4.63
2553	4.11
2724	3.63
2896	3.23
3068	2.91
3239	2.66
3411	2.45
3583	2.27
3754	2.08
3926	2.00
13365	2.00
13537	2.08
13708	2.27
13880	2.43
14052	2.55
14223	2.62
14395	2.64
14567	2.61
14738	2.53
14910	2.40
15081	2.24
15253	2.06
15425	2.00

Note: All cycle burnups outside the range of the table shall use a 2% decrease in Fq margin for compliance with the 3.2.1.2 Surveillance Requirements. Linear interpolation is adequate for intermediate cycle burnups.

CORE OPERATING LIMITS REPORT (COLR) for BRAIDWOOD UNIT 1 CYCLE 10

2.7 Nuclear Enthalpy Rise Hot Channel Factor ($F_{\Delta H}^N$) (LCO 3.2.2)

$$2.7.1 \quad F_{\Delta H}^N \leq F_{\Delta H}^{RTP} [1.0 + PF_{\Delta H}(1.0 - P)]$$

where: P = the ratio of THERMAL POWER to RATED THERMAL POWER

$$F_{\Delta H}^{RTP} = 1.70$$

$$PF_{\Delta H} = 0.3$$

2.7.2 Uncertainty when PDMS is inoperable

The uncertainty, $U_{F_{\Delta H}}$ to be applied to the Nuclear Enthalpy Rise Hot Channel Factor $F_{\Delta H}^N$ shall be calculated by the following formula:

$$U_{F_{\Delta H}} = U_{F_{\Delta Hm}}$$

where:

$$U_{F_{\Delta Hm}} = \text{Base } F_{\Delta H}^N \text{ measurement uncertainty} = 1.04$$

2.7.3 PDMS Alarms:

$F_{\Delta H}^N$ Warning Setpoint $\geq 2\%$ of $F_{\Delta H}^N$ Margin

$F_{\Delta H}^N$ Alarm Setpoint $\geq 0\%$ of $F_{\Delta H}^N$ Margin

2.8 AXIAL FLUX DIFFERENCE (AFD) (LCO 3.2.3)

2.8.1 When PDMS is Inoperable, the AXIAL FLUX DIFFERENCE (AFD) Acceptable Operation Limits are provided in Figure 2.8.1 or the latest valid PDMS Surveillance Report, whichever is more conservative.

2.8.2 When PDMS is OPERABLE, no AFD Acceptable Operation Limits are applicable.

2.9 Departure from Nucleate Boiling Ratio (DNBR) (LCO 3.2.5)

$$2.9.1 \quad DNBR_{APSL} \geq 1.536$$

The Axial Power Shape Limiting DNBR ($DNBR_{APSL}$) is applicable with THERMAL POWER $\geq 50\%$ RTP when PDMS is OPERABLE.


2.9.2 PDMS Alarms

DNBR Warning Setpoint $\geq 2\%$ of DNBR Margin

DNBR Alarm Setpoint $\geq 0\%$ of DNBR Margin

CORE OPERATING LIMITS REPORT (COLR) for BRAIDWOOD UNIT 1 CYCLE 10

Figure 2.8.1 Axial Flux Difference Limits as a Function of Rated Thermal Power

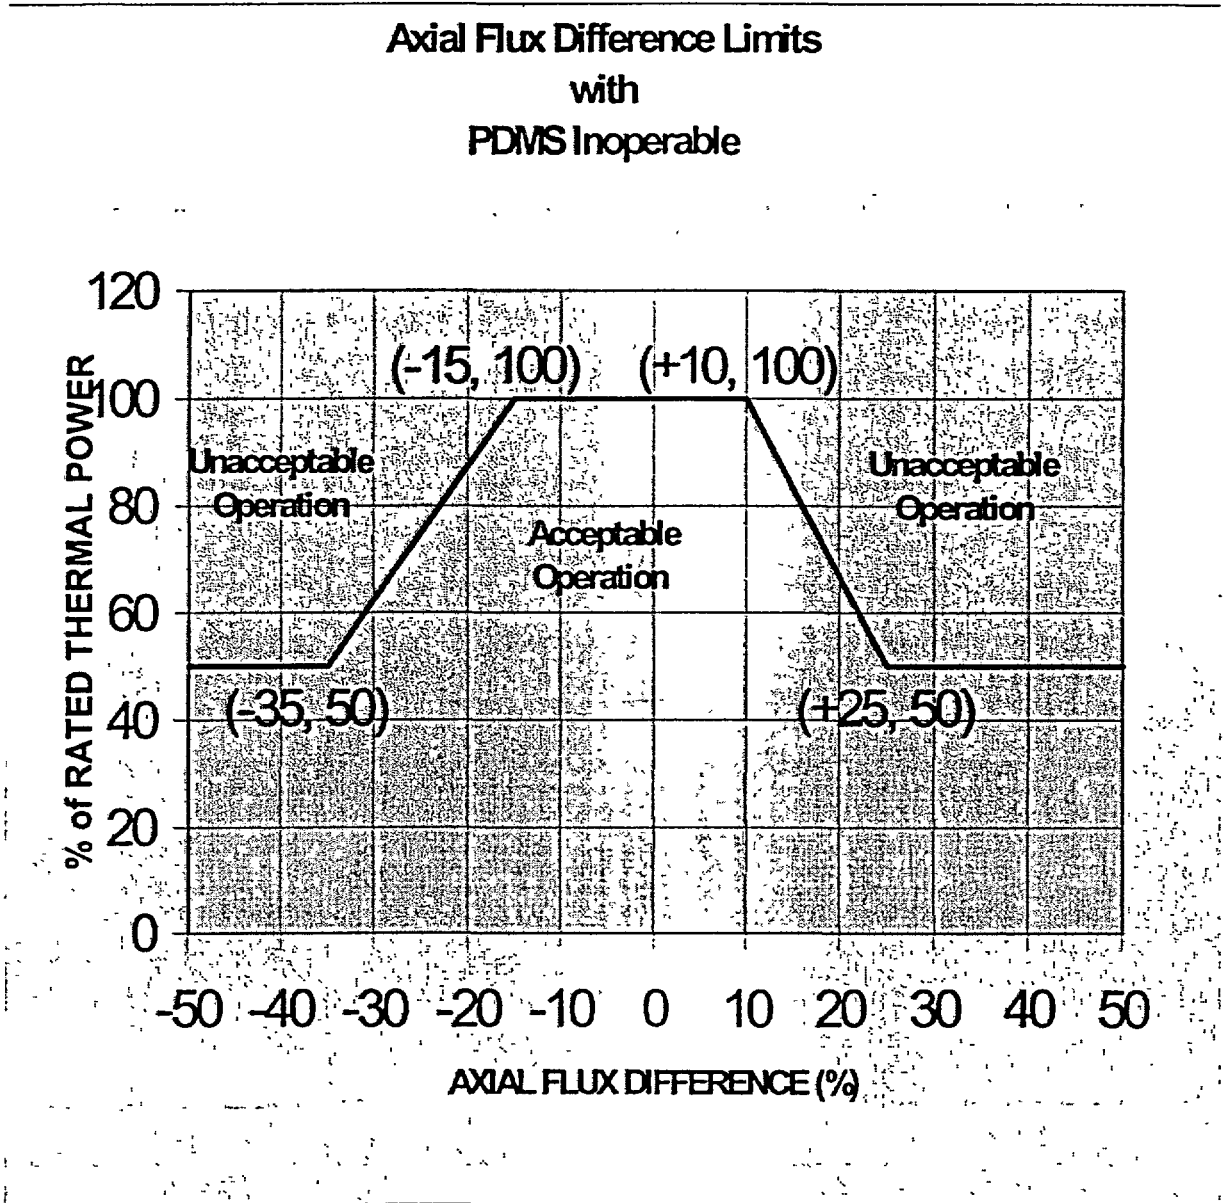

CORE OPERATING LIMITS REPORT (COLR) for BRAIDWOOD UNIT 1 CYCLE 10

2.10 Reactor Trip System (RTS) Instrumentation (LCO 3.3.1) - Overtemperature ΔT Setpoint Parameter Values

- 2.10.1 The Overtemperature ΔT reactor trip setpoint K_1 shall be equal to 1.325.
- 2.10.2 The Overtemperature ΔT reactor trip setpoint T_{avg} coefficient K_2 shall be equal to 0.0297 / $^{\circ}F$.
- 2.10.3 The Overtemperature ΔT reactor trip setpoint pressure coefficient K_3 shall be equal to 0.00181 / psig.
- 2.10.4 The nominal T_{avg} at RTP (indicated) T' shall be less than or equal to 588.0 $^{\circ}F$.
- 2.10.5 The nominal RCS operating pressure (indicated) P' shall be equal to 2235 psig.
- 2.10.6 The measured reactor vessel ΔT lead/lag time constant τ_1 shall be equal to 8 sec.
- 2.10.7 The measured reactor vessel ΔT lead/lag time constant τ_2 shall be equal to 3 sec.
- 2.10.8 The measured reactor vessel ΔT lag time constant τ_3 shall be less than or equal to 2 sec.
- 2.10.9 The measured reactor vessel average temperature lead/lag time constant τ_4 shall be equal to 33 sec.
- 2.10.10 The measured reactor vessel average temperature lead/lag time constant τ_5 shall be equal to 4 sec.
- 2.10.11 The measured reactor vessel average temperature lag time constant τ_6 shall be less than or equal to 2 sec.
- 2.10.12 The $f_1(\Delta I)$ "positive" breakpoint shall be +10% ΔI .
- 2.10.13 The $f_1(\Delta I)$ "negative" breakpoint shall be -18% ΔI .
- 2.10.14 The $f_1(\Delta I)$ "positive" slope shall be +3.47% / % ΔI .
- 2.10.15 The $f_1(\Delta I)$ "negative" slope shall be -2.61% / % ΔI .

CORE OPERATING LIMITS REPORT (COLR) for BRAIDWOOD UNIT 1 CYCLE 10

- 2.11 Reactor Trip System (RTS) Instrumentation (LCO 3.3.1) - Overpower ΔT Setpoint Parameter Values
- 2.11.1 The Overpower ΔT reactor trip setpoint K_4 shall be equal to 1.072.
- 2.11.2 The Overpower ΔT reactor trip setpoint T_{avg} rate/lag coefficient K_5 shall be equal to 0.02 / $^{\circ}F$ for increasing T_{avg}
- 2.11.3 The Overpower ΔT reactor trip setpoint T_{avg} rate/lag coefficient K_5 shall be equal to 0 / $^{\circ}F$ for decreasing T_{avg}
- 2.11.4 The Overpower ΔT reactor trip setpoint T_{avg} heatup coefficient K_6 shall be equal to 0.00245 / $^{\circ}F$ when $T > T''$.
- 2.11.5 The Overpower ΔT reactor trip setpoint T_{avg} heatup coefficient K_6 shall be equal to 0 / $^{\circ}F$ when $T \leq T''$.
- 2.11.6 The nominal T_{avg} at RTP (indicated) T'' shall be less than or equal to 588.0 $^{\circ}F$
- 2.11.7 The measured reactor vessel ΔT lead/lag time constant τ_1 shall be equal to 8 sec.
- 2.11.8 The measured reactor vessel ΔT lead/lag time constant τ_2 shall be equal to 3 sec.
- 2.11.9 The measured reactor vessel ΔT lag time constant τ_3 shall be less than or equal to 2 sec.
- 2.11.10 The measured reactor vessel average temperature lag time constant τ_6 shall be less than or equal to 2 sec
- 2.11.11 The measured reactor vessel average temperature rate/lag time constant τ_7 shall be equal to 10 sec
- 2.11.12 The $f_2(\Delta I)$ "positive" breakpoint shall be 0 for all ΔI .
- 2.11.13 The $f_2(\Delta I)$ "negative" breakpoint shall be 0 for all ΔI .
- 2.11.14 The $f_2(\Delta I)$ "positive" slope shall be 0 for all ΔI .
- 2.11.15 The $f_2(\Delta I)$ "negative" slope shall be 0 for all ΔI .

CORE OPERATING LIMITS REPORT (COLR) for BRAIDWOOD UNIT 1 CYCLE 10

2.12 Reactor Coolant System (RCS) Pressure, Temperature, and Flow Departure from Nucleate Boiling (DNB) Limits (LCO 3.4.1)

- 2.12.1 The pressurizer pressure shall be greater than or equal to 2209 psig.
- 2.12.2 The RCS average temperature (T_{avg}) shall be less than or equal to 593.1 °F.
- 2.12.3 The RCS total flow rate shall be greater than or equal to 380,900 gpm

2.13 Boron Concentration

- 2.13.1 The refueling boron concentration shall be greater than or equal to 1670 ppm (LCO 3.9.1)
- 2.13.2 To maintain $k_{eff} \leq 0.987$ with all shutdown and control rods fully withdrawn in MODES 3, 4, or 5 (TRM 3.1.g Required Action B.2 and TRM TLCO 3.1.k.2), the Reactor Coolant System boron concentration shall be greater than or equal to:
 - a) 1722 ppm prior to initial criticality.
 - b) 1972 ppm at all other times in core life.