

APPENDIX A

TECHNICAL SPECIFICATIONS

FOR

PEACH BOTTOM ATOMIC POWER STATION UNIT 3

# TABLE OF CONTENTS

1.0	USE AND APPLICATION . . . . .	1.1-1
1.1	Definitions . . . . .	1.1-1
1.2	Logical Connectors . . . . .	1.2-1
1.3	Completion Times . . . . .	1.3-1
1.4	Frequency . . . . .	1.4-1
2.0	SAFETY LIMITS (SLs) . . . . .	2.0-1
2.1	SLs . . . . .	2.0-1
2.2	SL Violations . . . . .	2.0-1
3.0	LIMITING CONDITION FOR OPERATION (LCO) APPLICABILITY . . . .	3.0-1
3.0	SURVEILLANCE REQUIREMENT (SR) APPLICABILITY . . . . .	3.0-4
3.1	REACTIVITY CONTROL SYSTEMS . . . . .	3.1-1
3.1.1	SHUTDOWN MARGIN (SDM) . . . . .	3.1-1
3.1.2	Reactivity Anomalies . . . . .	3.1-5
3.1.3	Control Rod OPERABILITY . . . . .	3.1-7
3.1.4	Control Rod Scram Times . . . . .	3.1-12
3.1.5	Control Rod Scram Accumulators . . . . .	3.1-15
3.1.6	Rod Pattern Control . . . . .	3.1-18
3.1.7	Standby Liquid Control (SLC) System . . . . .	3.1-20
3.1.8	Scram Discharge Volume (SDV) Vent and Drain Valves . . . .	3.1-26
3.2	POWER DISTRIBUTION LIMITS . . . . .	3.2-1
3.2.1	AVERAGE PLANAR LINEAR HEAT GENERATION RATE (APLHGR) . . . . .	3.2-1
3.2.2	MINIMUM CRITICAL POWER RATIO (MCPR) . . . . .	3.2-2
3.2.3	LINEAR HEAT GENERATION RATE (LHGR) . . . . .	3.2-4
3.3	INSTRUMENTATION . . . . .	3.3-1
3.3.1.1	Reactor Protection System (RPS) Instrumentation . . . .	3.3-1
3.3.1.2	Wide Range Neutron Monitor (WRNM) Instrumentation . . . .	3.3-10
3.3.2.1	Control Rod Block Instrumentation . . . . .	3.3-16
3.3.2.2	Feedwater and Main Turbine High Water Level Trip Instrumentation . . . . .	3.3-22
3.3.3.1	Post Accident Monitoring (PAM) Instrumentation . . . .	3.3-24
3.3.3.2	Remote Shutdown System . . . . .	3.3-27
3.3.4.1	Anticipated Transient Without Scram Recirculation Pump Trip (ATWS-RPT) Instrumentation . . . . .	3.3-29
3.3.4.2	End of Cycle Recirculation Pump Trip (EOC-RPT) Instrumentation . . . . .	3.3-31a thru 3.3-31c
3.3.5.1	Emergency Core Cooling System (ECCS) Instrumentation . . . .	3.3-32
3.3.5.2	Reactor Core Isolation Cooling (RCIC) System Instrumentation . . . . .	3.3-44
3.3.6.1	Primary Containment Isolation Instrumentation . . . .	3.3-48
3.3.6.2	Secondary Containment Isolation Instrumentation . . . .	3.3-55
3.3.7.1	Main Control Room Emergency Ventilation (MCREV) System Instrumentation . . . . .	3.3-59
3.3.8.1	Loss of Power (LOP) Instrumentation . . . . .	3.3-61
3.3.8.2	Reactor Protection System (RPS) Electric Power Monitoring . . . . .	3.3-66

(continued)

# TABLE OF CONTENTS (continued)

3.4	REACTOR COOLANT SYSTEM (RCS) . . . . .	3.4-1
3.4.1	Recirculation Loops Operating . . . . .	3.4-1
3.4.2	Jet Pumps . . . . .	3.4-6
3.4.3	Safety Relief Valves (SRVs) and Safety Valves (SVs) . . . . .	3.4-8
3.4.4	RCS Operational LEAKAGE . . . . .	3.4-10
3.4.5	RCS Leakage Detection Instrumentation . . . . .	3.4-12
3.4.6	RCS Specific Activity . . . . .	3.4-14
3.4.7	Residual Heat Removal (RHR) Shutdown Cooling System—Hot Shutdown . . . . .	3.4-16
3.4.8	Residual Heat Removal (RHR) Shutdown Cooling System—Cold Shutdown . . . . .	3.4-19
3.4.9	RCS Pressure and Temperature (P/T) Limits . . . . .	3.4-21
3.4.10	Reactor Steam Dome Pressure . . . . .	3.4-28
3.5	EMERGENCY CORE COOLING SYSTEMS (ECCS) AND REACTOR CORE ISOLATION COOLING (RCIC) SYSTEM . . . . .	3.5-1
3.5.1	ECCS—Operating . . . . .	3.5-1
3.5.2	ECCS—Shutdown . . . . .	3.5-8
3.5.3	RCIC System . . . . .	3.5-12
3.6	CONTAINMENT SYSTEMS . . . . .	3.6-1
3.6.1.1	Primary Containment . . . . .	3.6-1
3.6.1.2	Primary Containment Air Lock . . . . .	3.6-3
3.6.1.3	Primary Containment Isolation Valves (PCIVs) . . . . .	3.6-8
3.6.1.4	Drywell Air Temperature . . . . .	3.6-17
3.6.1.5	Reactor Building-to-Suppression Chamber Vacuum Breakers . . . . .	3.6-18
3.6.1.6	Suppression Chamber-to-Drywell Vacuum Breakers . . . . .	3.6-21
3.6.2.1	Suppression Pool Average Temperature . . . . .	3.6-23
3.6.2.2	Suppression Pool Water Level . . . . .	3.6-26
3.6.2.3	Residual Heat Removal (RHR) Suppression Pool Cooling . . . . .	3.6-27
3.6.2.4	Residual Heat Removal (RHR) Suppression Pool Spray . . . . .	3.6-29
3.6.3.1	Containment Atmospheric Dilution (CAD) System . . . . .	3.6-31
3.6.3.2	Primary Containment Oxygen Concentration . . . . .	3.6-33
3.6.4.1	Secondary Containment . . . . .	3.6-34
3.6.4.2	Secondary Containment Isolation Valves (SCIVs) . . . . .	3.6-36
3.6.4.3	Standby Gas Treatment (SGT) System . . . . .	3.6-40
3.7	PLANT SYSTEMS . . . . .	3.7-1
3.7.1	High Pressure Service Water (HPSW) System . . . . .	3.7-1
3.7.2	Emergency Service Water (ESW) System and Normal Heat Sink . . . . .	3.7-3
3.7.3	Emergency Heat Sink . . . . .	3.7-5
3.7.4	Main Control Room Emergency Ventilation (MCREV) System . . . . .	3.7-7
3.7.5	Main Condenser Offgas . . . . .	3.7-10

(continued)

# TABLE OF CONTENTS

3.7	PLANT SYSTEMS (continued)	
3.7.6	Main Turbine Bypass System . . . . .	3.7-12
3.7.7	Spent Fuel Storage Pool Water Level . . . . .	3.7-14
3.8	ELECTRICAL POWER SYSTEMS . . . . .	3.8-1
3.8.1	AC Sources—Operating . . . . .	3.8-1
3.8.2	AC Sources—Shutdown . . . . .	3.8-20
3.8.3	Diesel Fuel Oil, Lube Oil, and Starting Air . . . . .	3.8-25
3.8.4	DC Sources—Operating . . . . .	3.8-28
3.8.5	DC Sources—Shutdown . . . . .	3.8-34
3.8.6	Battery Cell Parameters . . . . .	3.8-37
3.8.7	Distribution Systems—Operating . . . . .	3.8-41
3.8.8	Distribution Systems—Shutdown . . . . .	3.8-44
3.9	REFUELING OPERATIONS . . . . .	3.9-1
3.9.1	Refueling Equipment Interlocks . . . . .	3.9-1
3.9.2	Refuel Position One-Rod-Out Interlock . . . . .	3.9-3
3.9.3	Control Rod Position . . . . .	3.9-5
3.9.4	Control Rod Position Indication . . . . .	3.9-6
3.9.5	Control Rod OPERABILITY—Refueling . . . . .	3.9-8
3.9.6	Reactor Pressure Vessel (RPV) Water Level . . . . .	3.9-9
3.9.7	Residual Heat Removal (RHR)—High Water Level . . . . .	3.9-10
3.9.8	Residual Heat Removal (RHR)—Low Water Level . . . . .	3.9-13
3.10	SPECIAL OPERATIONS . . . . .	3.10-1
3.10.1	Inservice Leak and Hydrostatic Testing Operation . . . . .	3.10-1
3.10.2	Reactor Mode Switch Interlock Testing . . . . .	3.10-4
3.10.3	Single Control Rod Withdrawal—Hot Shutdown . . . . .	3.10-6
3.10.4	Single Control Rod Withdrawal—Cold Shutdown . . . . .	3.10-9
3.10.5	Single Control Rod Drive (CRD) Removal—Refueling . . . . .	3.10-13
3.10.6	Multiple Control Rod Withdrawal—Refueling . . . . .	3.10-16
3.10.7	Control Rod Testing—Operating . . . . .	3.10-18
3.10.8	SHUTDOWN MARGIN (SDM) Test—Refueling . . . . .	3.10-20
4.0	DESIGN FEATURES . . . . .	4.0-1
4.1	Site . . . . .	4.0-1
4.2	Reactor Core . . . . .	4.0-1
4.3	Fuel Storage . . . . .	4.0-2
5.0	ADMINISTRATIVE CONTROLS . . . . .	5.0-1
5.1	Responsibility . . . . .	5.0-1
5.2	Organization . . . . .	5.0-2
5.3	Unit Staff Qualifications . . . . .	5.0-5
5.4	Procedures . . . . .	5.0-6
5.5	Programs and Manuals . . . . .	5.0-7
5.6	Reporting Requirements . . . . .	5.0-18
5.7	High Radiation Areas . . . . .	5.0-22

## 1.0 USE AND APPLICATION

### 1.1 Definitions

---

-----NOTE-----

The defined terms of this section appear in capitalized type and are applicable throughout these Technical Specifications and Bases.

---

<u>Term</u>	<u>Definition</u>
ACTIONS	ACTIONS shall be that part of a Specification that prescribes Required Actions to be taken under designated Conditions within specified Completion Times.
AVERAGE PLANAR LINEAR HEAT GENERATION RATE (APLHGR)	The APLHGR shall be applicable to a specific planar height and is equal to the sum of the heat generation rate per unit length of fuel rod for all the fuel rods in the specified bundle at the specified height divided by the number of fuel rods in the fuel bundle at the height.
CHANNEL CALIBRATION	A CHANNEL CALIBRATION shall be the adjustment, as necessary, of the channel output such that it responds within the necessary range and accuracy to known values of the parameter that the channel monitors. The CHANNEL CALIBRATION shall encompass the entire channel, including the required sensor, alarm, display, and trip functions, and shall include the CHANNEL FUNCTIONAL TEST. Calibration of instrument channels with resistance temperature detector (RTD) or thermocouple sensors may consist of an in-place qualitative assessment of sensor behavior and normal calibration of the remaining adjustable devices in the channel. The CHANNEL CALIBRATION may be performed by means of any series of sequential, overlapping, or total channel steps so that the entire channel is calibrated.
CHANNEL CHECK	A CHANNEL CHECK shall be the qualitative assessment, by observation, of channel behavior during operation. This determination shall include, where possible, comparison of the channel indication and status to other indications or status derived from independent instrument channels measuring the same parameter.

---

(continued)

## 1.1 Definitions (continued)

---

### CHANNEL FUNCTIONAL TEST

A CHANNEL FUNCTIONAL TEST shall be the injection of a simulated or actual signal into the channel as close to the sensor as practicable to verify OPERABILITY, including required alarm, interlock, display, and trip functions, and channel failure trips. The CHANNEL FUNCTIONAL TEST may be performed by means of any series of sequential, overlapping, or total channel steps so that the entire channel is tested.

### CORE ALTERATION

CORE ALTERATION shall be the movement of any fuel, sources, or reactivity control components within the reactor vessel with the vessel head removed and fuel in the vessel. The following exceptions are not considered to be CORE ALTERATIONS:

- a. Movement of wide range neutron monitors, local power range monitors, traversing incore probes, or special movable detectors (including undervessel replacement); and
- b. Control rod movement, provided there are no fuel assemblies in the associated core cell.

Suspension of CORE ALTERATIONS shall not preclude completion of movement of a component to a safe position.

### CORE OPERATING LIMITS REPORT (COLR)

The COLR is the unit specific document that provides cycle specific parameter limits for the current reload cycle. These cycle specific limits shall be determined for each reload cycle in accordance with Specification 5.6.5. Plant operation within these limits is addressed in individual Specifications.

### DOSE EQUIVALENT I-131

DOSE EQUIVALENT I-131 shall be that concentration of I-131 (microcuries/gram) that alone would produce the same thyroid dose as the quantity and isotopic mixture of I-131, I-132, I-133, I-134, and I-135 actually present. The thyroid dose conversion factors used for this calculation shall be those listed in Table III of TID-14844, AEC, 1962, "Calculation of Distance Factors for Power and Test Reactor Sites."

---

(continued)

## 1.1 Definitions (continued)

END OF CYCLE  
RECIRCULATION PUMP TRIP  
(EOC-RPT) SYSTEM RESPONSE  
TIME

The EOC-RPT SYSTEM RESPONSE TIME shall be that time interval from initial signal generation by the associated turbine stop valve limit switch or from when the turbine control valve hydraulic oil control oil pressure drops below the pressure switch setpoint to complete suppression of the electric arc between the fully open contacts of the recirculation pump circuit breaker. The response time may be measured by means of any series of sequential, overlapping, or total steps so that the entire response time is measured.

LEAKAGE

LEAKAGE shall be:

a. Identified LEAKAGE

1. LEAKAGE into the drywell, such as that from pump seals or valve packing, that is captured and conducted to a sump or collecting tank; or
2. LEAKAGE into the drywell atmosphere from sources that are both specifically located and known either not to interfere with the operation of leakage detection systems or not to be pressure boundary LEAKAGE;

b. Unidentified LEAKAGE

All LEAKAGE into the drywell that is not identified LEAKAGE;

c. Total LEAKAGE

Sum of the identified and unidentified LEAKAGE;

d. Pressure Boundary LEAKAGE

LEAKAGE through a nonisolable fault in a Reactor Coolant System (RCS) component body, pipe wall, or vessel wall.

LINEAR HEAT GENERATION  
RATE (LHGR)

The LHGR shall be the heat generation rate per unit length of fuel rod. It is the integral of the heat flux over the heat transfer area associated with the unit length.

(continued)

## 1.1 Definitions (continued)

---

### LOGIC SYSTEM FUNCTIONAL TEST

A LOGIC SYSTEM FUNCTIONAL TEST shall be a test of all required logic components (i.e., all required relays and contacts, trip units, solid state logic elements, etc.) of a logic circuit, from as close to the sensor as practicable up to, but not including, the actuated device, to verify OPERABILITY. The LOGIC SYSTEM FUNCTIONAL TEST may be performed by means of any series of sequential, overlapping, or total system steps so that the entire logic system is tested.

### MINIMUM CRITICAL POWER RATIO (MCPR)

The MCPR shall be the smallest critical power ratio (CPR) that exists in the core. The CPR is that power in the assembly that is calculated by application of the appropriate correlation(s) to cause some point in the assembly to experience boiling transition, divided by the actual assembly operating power.

### MODE

A MODE shall correspond to any one inclusive combination of mode switch position, average reactor coolant temperature, and reactor vessel head closure bolt tensioning specified in Table 1.1-1 with fuel in the reactor vessel.

### OPERABLE—OPERABILITY

A system, subsystem, division, component, or device shall be OPERABLE or have OPERABILITY when it is capable of performing its specified safety function(s) and when all necessary attendant instrumentation, controls, normal or emergency electrical power, cooling and seal water, lubrication, and other auxiliary equipment that are required for the system, subsystem, division, component, or device to perform its specified safety function(s) are also capable of performing their related support function(s).

### PHYSICS TESTS

PHYSICS TESTS shall be those tests performed to measure the fundamental nuclear characteristics of the reactor core and related instrumentation. These tests are:

- a. Described in Section 13.5, Startup and Power Test Program of the UFSAR;

---

(continued)



## 1.1 Definitions

---

PHYSICS TESTS (continued)	<ul style="list-style-type: none"><li>b. Authorized under the provisions of 10 CFR 50.59; or</li><li>c. Otherwise approved by the Nuclear Regulatory Commission.</li></ul>
RATED THERMAL POWER (RTP)	RTP shall be a total reactor core heat transfer rate to the reactor coolant of 3458 MWt.
REACTOR PROTECTION SYSTEM (RPS) RESPONSE TIME	The RPS RESPONSE TIME shall be that time interval from the opening of the sensor contact up to and including the opening of the trip actuator contacts.
SHUTDOWN MARGIN (SDM)	<p>SDM shall be the amount of reactivity by which the reactor is subcritical or would be subcritical assuming that:</p> <ul style="list-style-type: none"><li>a. The reactor is xenon free;</li><li>b. The moderator temperature is 68°F; and</li><li>c. All control rods are fully inserted except for the single control rod of highest reactivity worth, which is assumed to be fully withdrawn. With control rods not capable of being fully inserted, the reactivity worth of these control rods must be accounted for in the determination of SDM.</li></ul>
STAGGERED TEST BASIS	A STAGGERED TEST BASIS shall consist of the testing of one of the systems, subsystems, channels, or other designated components during the interval specified by the Surveillance Frequency, so that all systems, subsystems, channels, or other designated components are tested during $n$ Surveillance Frequency intervals, where $n$ is the total number of systems, subsystems, channels, or other designated components in the associated function.
THERMAL POWER	THERMAL POWER shall be the total reactor core heat transfer rate to the reactor coolant.

---

(continued)

1.1 Definitions (continued)

---

**TURBINE BYPASS SYSTEM  
RESPONSE TIME**

The TURBINE BYPASS SYSTEM RESPONSE TIME consists of two components:

- a. The time from initial movement of the main turbine stop valve or control valve until 80% of the turbine bypass capacity is established; and
- b. The time from initial movement of the main turbine stop valve or control valve until initial movement of the turbine bypass valve.

The response time may be measured by means of any series of sequential, overlapping, or total steps so that the entire response time is measured.

---

Table 1.1-1 (page 1 of 1)  
MODES

MODE	TITLE	REACTOR MODE SWITCH POSITION	AVERAGE REACTOR COOLANT TEMPERATURE (°F)
1	Power Operation	Run	NA
2	Startup	Refuel <sup>(a)</sup> or Startup/Hot Standby	NA
3	Hot Shutdown <sup>(a)</sup>	Shutdown	> 212
4	Cold Shutdown <sup>(a)</sup>	Shutdown	≤ 212
5	Refueling <sup>(b)</sup>	Shutdown or Refuel	NA

(a) All reactor vessel head closure bolts fully tensioned.

(b) One or more reactor vessel head closure bolts less than fully tensioned.

## 1.0 USE AND APPLICATION

### 1.2 Logical Connectors

---

PURPOSE	<p>The purpose of this section is to explain the meaning of logical connectors.</p> <p>Logical connectors are used in Technical Specifications (TS) to discriminate between, and yet connect, discrete Conditions, Required Actions, Completion Times, Surveillances, and Frequencies. The only logical connectors that appear in TS are <u>AND</u> and <u>OR</u>. The physical arrangement of these connectors constitutes logical conventions with specific meanings.</p>
BACKGROUND	<p>Several levels of logic may be used to state Required Actions. These levels are identified by the placement (or nesting) of the logical connectors and by the number assigned to each Required Action. The first level of logic is identified by the first digit of the number assigned to a Required Action and the placement of the logical connector in the first level of nesting (i.e., left justified with the number of the Required Action). The successive levels of logic are identified by additional digits of the Required Action number and by successive indentions of the logical connectors.</p> <p>When logical connectors are used to state a Condition, Completion Time, Surveillance, or Frequency, only the first level of logic is used, and the logical connector is left justified with the statement of the Condition, Completion Time, Surveillance, or Frequency.</p>
EXAMPLES	<p>The following examples illustrate the use of logical connectors.</p>

---

(continued)

## 1.2 Logical Connectors

### EXAMPLES (continued)

#### EXAMPLE 1.2-1

#### ACTIONS

CONDITION	REQUIRED ACTION	COMPLETION TIME
A. LCO not met.	A.1 Verify . . . <u>AND</u> A.2 Restore . . .	

In this example the logical connector AND is used to indicate that when in Condition A, both Required Actions A.1 and A.2 must be completed.

(continued)

## 1.2 Logical Connectors

### EXAMPLES (continued)

#### EXAMPLE 1.2-2

#### ACTIONS

CONDITION	REQUIRED ACTION	COMPLETION TIME
A. LCO not met.	A.1 Trip . . . <u>OR</u> A.2.1 Verify . . . <u>AND</u> A.2.2.1 Reduce . . . <u>OR</u> A.2.2.2 Perform . . . <u>OR</u> A.3 Align . . .	

This example represents a more complicated use of logical connectors. Required Actions A.1, A.2, and A.3 are alternative choices, only one of which must be performed as indicated by the use of the logical connector OR and the left justified placement. Any one of these three Actions may be chosen. If A.2 is chosen, then both A.2.1 and A.2.2 must be performed as indicated by the logical connector AND. Required Action A.2.2 is met by performing A.2.2.1 or A.2.2.2. The indented position of the logical connector OR indicates that A.2.2.1 and A.2.2.2 are alternative choices, only one of which must be performed.

## 1.0 USE AND APPLICATION

### 1.3 Completion Times

---

PURPOSE	The purpose of this section is to establish the Completion Time convention and to provide guidance for its use.
---------	---

---

BACKGROUND	Limiting Conditions for Operation (LCOs) specify minimum requirements for ensuring safe operation of the unit. The ACTIONS associated with an LCO state Conditions that typically describe the ways in which the requirements of the LCO can fail to be met. Specified with each stated Condition are Required Action(s) and Completion Times(s).
------------	---

---

DESCRIPTION	<p>The Completion Time is the amount of time allowed for completing a Required Action. It is referenced to the time of discovery of a situation (e.g., inoperable equipment or variable not within limits) that requires entering an ACTIONS Condition unless otherwise specified, providing the unit is in a MODE or specified condition stated in the Applicability of the LCO. Required Actions must be completed prior to the expiration of the specified Completion Time. An ACTIONS Condition remains in effect and the Required Actions apply until the Condition no longer exists or the unit is not within the LCO Applicability.</p> <p>If situations are discovered that require entry into more than one Condition at a time within a single LCO (multiple Conditions), the Required Actions for each Condition must be performed within the associated Completion Time. When in multiple Conditions, separate Completion Times are tracked for each Condition starting from the time of discovery of the situation that required entry into the Condition.</p> <p>Once a Condition has been entered, subsequent divisions, subsystems, components, or variables expressed in the Condition, discovered to be inoperable or not within limits, will <u>not</u> result in separate entry into the Condition unless specifically stated. The Required Actions of the Condition continue to apply to each additional failure, with Completion Times based on initial entry into the Condition.</p>
-------------	---

---

(continued)

### 1.3 Completion Times

---

DESCRIPTION  
(continued)

However, when a subsequent division, subsystem, component, or variable expressed in the Condition is discovered to be inoperable or not within limits, the Completion Time(s) may be extended. To apply this Completion Time extension, two criteria must first be met. The subsequent inoperability:

- a. Must exist concurrent with the first inoperability; and
- b. Must remain inoperable or not within limits after the first inoperability is resolved.

The total Completion Time allowed for completing a Required Action to address the subsequent inoperability shall be limited to the more restrictive of either:

- a. The stated Completion Time, as measured from the initial entry into the Condition, plus an additional 24 hours; or
- b. The stated Completion Time as measured from discovery of the subsequent inoperability.

The above Completion Time extension does not apply to those Specifications that have exceptions that allow completely separate re-entry into the Condition (for each division, subsystem, component or variable expressed in the Condition) and separate tracking of Completion Times based on this re-entry. These exceptions are stated in individual Specifications.

The above Completion Time extension does not apply to a Completion Time with a modified "time zero." This modified "time zero" may be expressed as a repetitive time (i.e., "once per 8 hours," where the Completion Time is referenced from a previous completion of the Required Action versus the time of Condition entry) or as a time modified by the phrase "from discovery . . ." Example 1.3-3 illustrates one use of this type of Completion Time. The 10 day Completion Time specified for Condition A and B in Example 1.3-3 may not be extended.

---

(continued)



### 1.3 Completion Times (continued)

#### EXAMPLES

The following examples illustrate the use of Completion Times with different types of Conditions and changing Conditions.

#### EXAMPLE 1.3-1

#### ACTIONS

CONDITION	REQUIRED ACTION	COMPLETION TIME
B. Required Action and associated Completion Time not met.	B.1 Be in MODE 3.	12 hours
	<u>AND</u> B.2 Be in MODE 4.	36 hours

Condition B has two Required Actions. Each Required Action has its own separate Completion Time. Each Completion Time is referenced to the time that Condition B is entered.

The Required Actions of Condition B are to be in MODE 3 within 12 hours AND in MODE 4 within 36 hours. A total of 12 hours is allowed for reaching MODE 3 and a total of 36 hours (not 48 hours) is allowed for reaching MODE 4 from the time that Condition B was entered. If MODE 3 is reached within 6 hours, the time allowed for reaching MODE 4 is the next 30 hours because the total time allowed for reaching MODE 4 is 36 hours.

If Condition B is entered while in MODE 3, the time allowed for reaching MODE 4 is the next 36 hours.

(continued)

# 1.3 Completion Times

## EXAMPLES (continued)

### EXAMPLE 1.3-2

#### ACTIONS

CONDITION	REQUIRED ACTION	COMPLETION TIME
A. One pump inoperable.	A.1 Restore pump to OPERABLE status.	7 days
B. Required Action and associated Completion Time not met.	B.1 Be in MODE 3.	12 hours
	<u>AND</u> B.2 Be in MODE 4.	36 hours

When a pump is declared inoperable, Condition A is entered. If the pump is not restored to OPERABLE status within 7 days, Condition B is also entered and the Completion Time clocks for Required Actions B.1 and B.2 start. If the inoperable pump is restored to OPERABLE status after Condition B is entered, Condition A and B are exited, and therefore, the Required Actions of Condition B may be terminated.

When a second pump is declared inoperable while the first pump is still inoperable, Condition A is not re-entered for the second pump. LCO 3.0.3 is entered, since the ACTIONS do not include a Condition for more than one inoperable pump. The Completion Time clock for Condition A does not stop after LCO 3.0.3 is entered, but continues to be tracked from the time Condition A was initially entered.

While in LCO 3.0.3, if one of the inoperable pumps is restored to OPERABLE status and the Completion Time for Condition A has not expired, LCO 3.0.3 may be exited and operation continued in accordance with Condition A.

(continued)

### 1.3 Completion Times

---

#### EXAMPLES

#### EXAMPLE 1.3-2 (continued)

While in LCO 3.0.3, if one of the inoperable pumps is restored to OPERABLE status and the Completion Time for Condition A has expired, LCO 3.0.3 may be exited and operation continued in accordance with Condition B. The Completion Time for Condition B is tracked from the time the Condition A Completion Time expired.

On restoring one of the pumps to OPERABLE status, the Condition A Completion Time is not reset, but continues from the time the first pump was declared inoperable. This Completion Time may be extended if the pump restored to OPERABLE status was the first inoperable pump. A 24 hour extension to the stated 7 days is allowed, provided this does not result in the second pump being inoperable for > 7 days.

---

(continued)

### 1.3 Completion Times

#### EXAMPLES (continued)

#### EXAMPLE 1.3-3

#### ACTIONS

CONDITION	REQUIRED ACTION	COMPLETION TIME
A. One Function X subsystem inoperable.	A.1 Restore Function X subsystem to OPERABLE status.	7 days  <u>AND</u> 10 days from discovery of failure to meet the LCO
B. One Function Y subsystem inoperable.	B.1 Restore Function Y subsystem to OPERABLE status.	72 hours  <u>AND</u> 10 days from discovery of failure to meet the LCO
C. One Function X subsystem inoperable.  <u>AND</u> One Function Y subsystem inoperable.	C.1 Restore Function X subsystem to OPERABLE status.  <u>OR</u> C.2 Restore Function Y subsystem to OPERABLE status.	12 hours   12 hours

(continued)

## 1.3 Completion Times

---

### EXAMPLES

#### EXAMPLE 1.3-3 (continued)

When one Function X subsystem and one Function Y subsystem are inoperable, Condition A and Condition B are concurrently applicable. The Completion Times for Condition A and Condition B are tracked separately for each subsystem, starting from the time each subsystem was declared inoperable and the Condition was entered. A separate Completion Time is established for Condition C and tracked from the time the second subsystem was declared inoperable (i.e., the time the situation described in Condition C was discovered).

If Required Action C.2 is completed within the specified Completion Time, Conditions B and C are exited. If the Completion Time for Required Action A.1 has not expired, operation may continue in accordance with Condition A. The remaining Completion Time in Condition A is measured from the time the affected subsystem was declared inoperable (i.e., initial entry into Condition A).

The Completion Times of Conditions A and B are modified by a logical connector, with a separate 10 day Completion Time measured from the time it was discovered the LCO was not met. In this example, without the separate Completion Time, it would be possible to alternate between Conditions A, B, and C in such a manner that operation could continue indefinitely without ever restoring systems to meet the LCO. The separate Completion Time modified by the phrase "from discovery of failure to meet the LCO" is designed to prevent indefinite continued operation while not meeting the LCO. This Completion Time allows for an exception to the normal "time zero" for beginning the Completion Time "clock". In this instance, the Completion Time "time zero" is specified as commencing at the time the LCO was initially not met, instead of at the time the associated Condition was entered.

---

(continued)

### 1.3 Completion Times

#### EXAMPLES (continued)

#### EXAMPLE 1.3-4

##### ACTIONS

CONDITION	REQUIRED ACTION	COMPLETION TIME
A. One or more valves inoperable.	A.1 Restore valve(s) to OPERABLE status.	4 hours
B. Required Action and associated Completion Time not met.	B.1 Be in MODE 3.	12 hours
	<u>AND</u> B.2 Be in MODE 4.	36 hours

A single Completion Time is used for any number of valves inoperable at the same time. The Completion Time associated with Condition A is based on the initial entry into Condition A and is not tracked on a per valve basis. Declaring subsequent valves inoperable, while Condition A is still in effect, does not trigger the tracking of separate Completion Times.

Once one of the valves has been restored to OPERABLE status, the Condition A Completion Time is not reset, but continues from the time the first valve was declared inoperable. The Completion Time may be extended if the valve restored to OPERABLE status was the first inoperable valve. The Condition A Completion Time may be extended for up to 4 hours provided this does not result in any subsequent valve being inoperable for > 4 hours.

If the Completion Time of 4 hours (plus the extension) expires while one or more valves are still inoperable, Condition B is entered.

(continued)

### 1.3 Completion Times

#### EXAMPLES (continued)

#### EXAMPLE 1.3-5

#### ACTIONS

-----NOTE-----  
Separate Condition entry is allowed for each inoperable valve.  
-----

CONDITION	REQUIRED ACTION	COMPLETION TIME
A. One or more valves inoperable.	A.1 Restore valve to OPERABLE status.	4 hours
B. Required Action and associated Completion Time not met.	B.1 Be in MODE 3.	12 hours
	<u>AND</u> B.2 Be in MODE 4.	36 hours

The Note above the ACTIONS Table is a method of modifying how the Completion Time is tracked. If this method of modifying how the Completion Time is tracked was applicable only to a specific Condition, the Note would appear in that Condition rather than at the top of the ACTIONS Table.

The Note allows Condition A to be entered separately for each inoperable valve, and Completion Times tracked on a per valve basis. When a valve is declared inoperable, Condition A is entered and its Completion Time starts. If subsequent valves are declared inoperable, Condition A is entered for each valve and separate Completion Times start and are tracked for each valve.

(continued)

### 1.3 Completion Times

#### EXAMPLES

#### EXAMPLE 1.3-5 (continued)

If the Completion Time associated with a valve in Condition A expires, Condition B is entered for that valve. If the Completion Times associated with subsequent valves in Condition A expire, Condition B is entered separately for each valve and separate Completion Times start and are tracked for each valve. If a valve that caused entry into Condition B is restored to OPERABLE status, Condition B is exited for that valve.

Since the Note in this example allows multiple Condition entry and tracking of separate Completion Times, Completion Time extensions do not apply.

#### EXAMPLE 1.3-6

#### ACTIONS

CONDITION	REQUIRED ACTION	COMPLETION TIME
A. One channel inoperable.	A.1 Perform SR 3.x.x.x.	Once per 8 hours
	<u>OR</u> A.2 Place channel in trip.	8 hours
B. Required Action and associated Completion Time not met.	B.1 Be in MODE 3.	12 hours

(continued)



### 1.3 Completion Times

---

#### EXAMPLES

#### EXAMPLE 1.3-6 (continued)

Entry into Condition A offers a choice between Required Action A.1 or A.2. Required Action A.1 has a "once per" Completion Time, which qualifies for the 25% extension, per SR 3.0.2, to each performance after the initial performance. The initial 8 hour interval of Required Action A.1 begins when Condition A is entered and the initial performance of Required Action A.1 must be complete within the first 8 hour interval. If Required Action A.1 is followed and the Required Action is not met within the Completion Time (plus the extension allowed by SR 3.0.2), Condition B is entered. If Required Action A.2 is followed and the Completion Time of 8 hours is not met, Condition B is entered.

If after entry into Condition B, Required Action A.1 or A.2 is met, Condition B is exited and operation may then continue in Condition A.

---

(continued)

### 1.3 Completion Times

#### EXAMPLES (continued)

#### EXAMPLE 1.3-7

#### ACTIONS

CONDITION	REQUIRED ACTION	COMPLETION TIME
A. One subsystem inoperable.	A.1 Verify affected subsystem isolated.	1 hour <u>AND</u> Once per 8 hours thereafter
	<u>AND</u> A.2 Restore subsystem to OPERABLE status.	72 hours
B. Required Action and associated Completion Time not met.	B.1 Be in MODE 3.	12 hours
	<u>AND</u> B.2 Be in MODE 4.	36 hours

Required Action A.1 has two Completion Times. The 1 hour Completion Time begins at the time the Condition is entered and each "Once per 8 hours thereafter" interval begins upon performance of Required Action A.1.

If after Condition A is entered, Required Action A.1 is not met within either the initial 1 hour or any subsequent 8 hour interval from the previous performance (plus the extension allowed by SR 3.0.2), Condition B is entered. The Completion Time clock for Condition A does not stop after Condition B is entered, but continues from the time Condition A was initially entered. If Required Action A.1

(continued)

### 1.3 Completion Times

---

#### EXAMPLES

#### EXAMPLE 1.3-7 (continued)

is met after Condition B is entered, Condition B is exited and operation may continue in accordance with Condition A, provided the Completion Time for Required Action A.2 has not expired.

---

#### IMMEDIATE COMPLETION TIME

When "Immediately" is used as a Completion Time, the Required Action should be pursued without delay and in a controlled manner.

---

## 1.0 USE AND APPLICATION

### 1.4 Frequency

---

PURPOSE	The purpose of this section is to define the proper use and application of Frequency requirements.
---------	--

---

DESCRIPTION	<p>Each Surveillance Requirement (SR) has a specified Frequency in which the Surveillance must be met in order to meet the associated Limiting Condition for Operation (LCO). An understanding of the correct application of the specified Frequency is necessary for compliance with the SR.</p> <p>The "specified Frequency" is referred to throughout this section and each of the Specifications of Section 3.0, Surveillance Requirement (SR) Applicability. The "specified Frequency" consists of the requirements of the Frequency column of each SR, as well as certain Notes in the Surveillance column that modify performance requirements.</p> <p>Sometimes special situations dictate when the requirements of a Surveillance are to be met. They are "otherwise stated" conditions allowed by SR 3.0.1. They may be stated as clarifying Notes in the Surveillance, as part of the Surveillance, or both. Example 1.4-4 discusses these special situations.</p> <p>Situations where a Surveillance could be required (i.e., its Frequency could expire), but where it is not possible or not desired that it be performed until sometime after the associated LCO is within its Applicability, represent potential SR 3.0.4 conflicts. To avoid these conflicts, the SR (i.e., the Surveillance or the Frequency) is stated such that it is only "required" when it can be and should be performed. With an SR satisfied, SR 3.0.4 imposes no restriction.</p> <p>The use of "met" or "performed" in these instances conveys specific meanings. A Surveillance is "met" only when the acceptance criteria are satisfied. Known failure of the requirements of a Surveillance, even without a Surveillance specifically being "performed," constitutes a Surveillance not "met." "Performance" refers only to the requirement to specifically determine the ability to meet the acceptance</p>
-------------	---

---

(continued)

## 1.4 Frequency

DESCRIPTION  
(continued)

criteria. SR 3.0.4 restrictions would not apply if both the following conditions are satisfied:

- a. The Surveillance is not required to be performed; and
- b. The Surveillance is not required to be met or, even if required to be met, is not known to be failed.

## EXAMPLES

The following examples illustrate the various ways that Frequencies are specified. In these examples, the Applicability of the LCO (LCO not shown) is MODES 1, 2, and 3.

EXAMPLE 1.4-1SURVEILLANCE REQUIREMENTS

SURVEILLANCE	FREQUENCY
Perform CHANNEL CHECK.	12 hours

Example 1.4-1 contains the type of SR most often encountered in the Technical Specifications (TS). The Frequency specifies an interval (12 hours) during which the associated Surveillance must be performed at least one time. Performance of the Surveillance initiates the subsequent interval. Although the Frequency is stated as 12 hours, an extension of the time interval to 1.25 times the interval specified in the Frequency is allowed by SR 3.0.2 for operational flexibility. The measurement of this interval continues at all times, even when the SR is not required to be met per SR 3.0.1 (such as when the equipment is inoperable, a variable is outside specified limits, or the unit is outside the Applicability of the LCO). If the interval specified by SR 3.0.2 is exceeded while the unit is in a MODE or other specified condition in the Applicability of the LCO, and the performance of the Surveillance is not otherwise modified (refer to Examples 1.4-3 and 1.4-4), then SR 3.0.3 becomes applicable.

(continued)

## 1.4 Frequency

## EXAMPLES

EXAMPLE 1.4-1 (continued)

If the interval as specified by SR 3.0.2 is exceeded while the unit is not in a MODE or other specified condition in the Applicability of the LCO for which performance of the SR is required, the Surveillance must be performed within the Frequency requirements of SR 3.0.2 prior to entry into the MODE or other specified condition. Failure to do so would result in a violation of SR 3.0.4.

EXAMPLE 1.4-2SURVEILLANCE REQUIREMENTS

SURVEILLANCE	FREQUENCY
Verify flow is within limits.	Once within 12 hours after ≥ 25% RTP  <u>AND</u>  24 hours thereafter

Example 1.4-2 has two Frequencies. The first is a one time performance Frequency, and the second is of the type shown in Example 1.4-1. The logical connector "AND" indicates that both Frequency requirements must be met. Each time reactor power is increased from a power level < 25% RTP to ≥ 25% RTP, the Surveillance must be performed within 12 hours.

The use of "once" indicates a single performance will satisfy the specified Frequency (assuming no other Frequencies are connected by "AND"). This type of Frequency does not qualify for the extension allowed by SR 3.0.2.

(continued)

## 1.4 Frequency

## EXAMPLES

EXAMPLE 1.4-2 (continued)

"Thereafter" indicates future performances must be established per SR 3.0.2, but only after a specified condition is first met (i.e., the "once" performance in this example). If reactor power decreases to  $< 25\%$  RTP, the measurement of both intervals stops. New intervals start upon reactor power reaching  $25\%$  RTP.

EXAMPLE 1.4-3SURVEILLANCE REQUIREMENTS

SURVEILLANCE	FREQUENCY
-----NOTE----- Not required to be performed until 12 hours after $\geq 25\%$ RTP. -----	
Perform channel adjustment.	7 days

The interval continues whether or not the unit operation is  $< 25\%$  RTP between performances.

As the Note modifies the required performance of the Surveillance, it is construed to be part of the "specified Frequency." Should the 7 day interval be exceeded while operation is  $< 25\%$  RTP, this Note allows 12 hours after power reaches  $\geq 25\%$  RTP to perform the Surveillance. The Surveillance is still considered to be within the "specified Frequency." Therefore, if the Surveillance were not performed within the 7 day interval (plus the extension allowed by SR 3.0.2), but operation was  $< 25\%$  RTP, it would not constitute a failure of the SR or failure to meet the LCO. Also, no violation of SR 3.0.4 occurs when changing MODES, even with the 7 day Frequency not met, provided operation does not exceed 12 hours with power  $\geq 25\%$  RTP.

(continued)

## 1.4 Frequency

## EXAMPLES

EXAMPLE 1.4-3 (continued)

Once the unit reaches 25% RTP, 12 hours would be allowed for completing the Surveillance. If the Surveillance were not performed within this 12 hour interval, there would then be a failure to perform a Surveillance within the specified Frequency, and the provisions of SR 3.0.3 would apply.

EXAMPLE 1.4-4SURVEILLANCE REQUIREMENTS

SURVEILLANCE	FREQUENCY
-----NOTE----- Only required to be met in MODE 1. -----	
Verify leakage rates are within limits.	24 hours

Example 1.4-4 specifies that the requirements of this Surveillance do not have to be met until the unit is in MODE 1. The interval measurement for the Frequency of this Surveillance continues at all times, as described in Example 1.4-1. However, the Note constitutes an "otherwise stated" exception to the Applicability of this Surveillance. Therefore, if the Surveillance were not performed within the 24 hour interval (plus the extension allowed by SR 3.0.2), but the unit was not in MODE 1, there would be no failure of the SR nor failure to meet the LCO. Therefore, no violation of SR 3.0.4 occurs when changing MODES, even with the 24 hour Frequency exceeded, provided the MODE change was not made into MODE 1. Prior to entering MODE 1 (assuming again that the 24 hour Frequency were not met), SR 3.0.4 would require satisfying the SR.



---

## 2.1 SLs

### 2.1.1 Reactor Core SLs

2.1.1.1 With the reactor steam dome pressure < 785 psig or core flow < 10% rated core flow:

THERMAL POWER shall be  $\leq$  25% RTP.

2.1.1.2 With the reactor steam dome pressure  $\geq$  785 psig and core flow  $\geq$  10% rated core flow:

MCPR shall be  $\geq$  1.09 for two recirculation loop operation or  $\geq$  1.11 for single recirculation loop operation.

2.1.1.3 Reactor vessel water level shall be greater than the top of active irradiated fuel.

### 2.1.2 Reactor Coolant System Pressure SL

Reactor steam dome pressure shall be  $\leq$  1325 psig.

---

## 2.2 SL Violations

With any SL violation, the following actions shall be completed:

2.2.1 Within 1 hour, notify the NRC Operations Center, in accordance with 10 CFR 50.72.

2.2.2 Within 2 hours:

2.2.2.1 Restore compliance with all SLs; and

2.2.2.2 Insert all insertable control rods.

2.2.3 Within 24 hours, notify the Plant Manager and the Vice President—Peach Bottom Atomic Power Station.

---

(continued)

2.0 SLs

---

2.2 SL Violations (continued)

2.2.4 Within 30 days, a Licensee Event Report (LER) shall be prepared pursuant to 10 CFR 50.73. The LER shall be submitted to the NRC, the Plant Manager, and the Vice President—Peach Bottom Atomic Power Station.

2.2.5 Operation of the unit shall not be resumed until authorized by the NRC.

---

### 3.0 LIMITING CONDITION FOR OPERATION (LCO) APPLICABILITY

---

LCO 3.0.1 LCOs shall be met during the MODES or other specified conditions in the Applicability, except as provided in LCO 3.0.2 and LCO 3.0.7.

---

LCO 3.0.2 Upon discovery of a failure to meet an LCO, the Required Actions of the associated Conditions shall be met, except as provided in LCO 3.0.5 and LCO 3.0.6.

If the LCO is met or is no longer applicable prior to expiration of the specified Completion Time(s), completion of the Required Action(s) is not required, unless otherwise stated.

---

LCO 3.0.3 When an LCO is not met and the associated ACTIONS are not met, an associated ACTION is not provided, or if directed by the associated ACTIONS, the unit shall be placed in a MODE or other specified condition in which the LCO is not applicable. Action shall be initiated within 1 hour to place the unit, as applicable, in:

- a. MODE 2 within 7 hours;
- b. MODE 3 within 13 hours; and
- c. MODE 4 within 37 hours.

Exceptions to this Specification are stated in the individual Specifications.

Where corrective measures are completed that permit operation in accordance with the LCO or ACTIONS, completion of the actions required by LCO 3.0.3 is not required.

LCO 3.0.3 is only applicable in MODES 1, 2, and 3.

---

LCO 3.0.4 When an LCO is not met, entry into a MODE or other specified condition in the Applicability shall not be made except when the associated ACTIONS to be entered permit continued operation in the MODE or other specified condition in the Applicability for an unlimited period of time. This Specification shall not prevent changes in MODES or other specified conditions in the Applicability that are required to comply with ACTIONS, or that are part of a shutdown of the unit.

---

(continued)

### 3.0 LCO APPLICABILITY

---

LCO 3.0.4  
(continued)

Exceptions to this Specification are stated in the individual Specifications. These exceptions allow entry into MODES or other specified conditions in the Applicability when the associated ACTIONS to be entered allow unit operation in the MODE or other specified condition in the Applicability only for a limited period of time.

LCO 3.0.4 is only applicable for entry into a MODE or other specified condition in the Applicability in MODES 1, 2, and 3.

---

LCO 3.0.5

Equipment removed from service or declared inoperable to comply with ACTIONS may be returned to service under administrative control solely to perform testing required to demonstrate its OPERABILITY or the OPERABILITY of other equipment. This is an exception to LCO 3.0.2 for the system returned to service under administrative control to perform the testing required to demonstrate OPERABILITY.

---

LCO 3.0.6

When a supported system LCO is not met solely due to a support system LCO not being met, the Conditions and Required Actions associated with this supported system are not required to be entered. Only the support system LCO ACTIONS are required to be entered. This is an exception to LCO 3.0.2 for the supported system. In this event, additional evaluations and limitations may be required in accordance with Specification 5.5.11, "Safety Function Determination Program (SFDP)." If a loss of safety function is determined to exist by this program, the appropriate Conditions and Required Actions of the LCO in which the loss of safety function exists are required to be entered.

When a support system's Required Action directs a supported system to be declared inoperable or directs entry into Conditions and Required Actions for a supported system, the applicable Conditions and Required Actions shall be entered in accordance with LCO 3.0.2.

---

(continued)

3.0 LCO APPLICABILITY (continued)

---

LCO 3.0.7      Special Operations LCOs in Section 3.10 allow specified Technical Specifications (TS) requirements to be changed to permit performance of special tests and operations. Unless otherwise specified, all other TS requirements remain unchanged. Compliance with Special Operations LCOs is optional. When a Special Operations LCO is desired to be met but is not met, the ACTIONS of the Special Operations LCO shall be met. When a Special Operations LCO is not desired to be met, entry into a MODE or other specified condition in the Applicability shall only be made in accordance with the other applicable Specifications.

---

### 3.0 SURVEILLANCE REQUIREMENT (SR) APPLICABILITY

---

SR 3.0.1      SRs shall be met during the MODES or other specified conditions in the Applicability for individual LCOs, unless otherwise stated in the SR. Failure to meet a Surveillance, whether such failure is experienced during the performance of the Surveillance or between performances of the Surveillance, shall be failure to meet the LCO. Failure to perform a Surveillance within the specified Frequency shall be failure to meet the LCO except as provided in SR 3.0.3. Surveillances do not have to be performed on inoperable equipment or variables outside specified limits.

---

SR 3.0.2      The specified Frequency for each SR is met if the Surveillance is performed within 1.25 times the interval specified in the Frequency, as measured from the previous performance or as measured from the time a specified condition of the Frequency is met.

For Frequencies specified as "once," the above interval extension does not apply. If a Completion Time requires periodic performance on a "once per . . ." basis, the above Frequency extension applies to each performance after the initial performance.

Exceptions to this Specification are stated in the individual Specifications.

---

SR 3.0.3      If it is discovered that a Surveillance was not performed within its specified Frequency, then compliance with the requirement to declare the LCO not met may be delayed, from the time of discovery, up to 24 hours or up to the limit of the specified Frequency, whichever is greater. This delay period is permitted to allow performance of the Surveillance. A risk evaluation shall be performed for any Surveillance delayed greater than 24 hours and the risk impact shall be managed.

If the Surveillance is not performed within the delay period, the LCO must immediately be declared not met, and the applicable Condition(s) must be entered.

When the Surveillance is performed within the delay period and the Surveillance is not met, the LCO must immediately be declared not met, and the applicable Condition(s) must be entered.

---

(continued)

3.0 SR APPLICABILITY (continued)

---

SR 3.0.4      Entry into a MODE or other specified condition in the Applicability of an LCO shall not be made unless the LCO's Surveillances have been met within their specified Frequency. This provision shall not prevent entry into MODES or other specified conditions in the Applicability that are required to comply with ACTIONS or that are part of a shutdown of the unit.

SR 3.0.4 is only applicable for entry into a MODE or other specified condition in the Applicability in MODES 1, 2, and 3.

---

## 3.1 REACTIVITY CONTROL SYSTEMS

## 3.1.1 SHUTDOWN MARGIN (SDM)

LCO 3.1.1 SDM shall be:

- a.  $\geq 0.38\% \Delta k/k$ , with the highest worth control rod analytically determined; or
- b.  $\geq 0.28\% \Delta k/k$ , with the highest worth control rod determined by test.

APPLICABILITY: MODES 1, 2, 3, 4, and 5.

## ACTIONS

CONDITION	REQUIRED ACTION	COMPLETION TIME
A. SDM not within limits in MODE 1 or 2.	A.1 Restore SDM to within limits.	6 hours
B. Required Action and associated Completion Time of Condition A not met.	B.1 Be in MODE 3.	12 hours
C. SDM not within limits in MODE 3.	C.1 Initiate action to fully insert all insertable control rods.	Immediately
D. SDM not within limits in MODE 4.	D.1 Initiate action to fully insert all insertable control rods.  <u>AND</u>	Immediately  (continued)



## ACTIONS

CONDITION	REQUIRED ACTION	COMPLETION TIME
D. (continued)	D.2 Initiate action to restore secondary containment to OPERABLE status.	1 hour
	<u>AND</u>	
	D.3 Initiate action to restore one standby gas treatment (SGT) subsystem for Unit 3 to OPERABLE status.	1 hour
	<u>AND</u>	
	D.4 Initiate action to restore isolation capability in each required secondary containment penetration flow path not isolated.	1 hour
E. SDM not within limits in MODE 5.	E.1 Suspend CORE ALTERATIONS except for control rod insertion and fuel assembly removal.	Immediately
	<u>AND</u>	
	E.2 Initiate action to fully insert all insertable control rods in core cells containing one or more fuel assemblies.	Immediately
	<u>AND</u>	
		(continued)

## ACTIONS

CONDITION	REQUIRED ACTION	COMPLETION TIME
E. (continued)	E.3      Initiate action to restore secondary containment to OPERABLE status.	1 hour
	<u>AND</u>	
	E.4      Initiate action to restore one SGT subsystem for Unit 3 to OPERABLE status.	1 hour
	<u>AND</u>	
	E.5      Initiate action to restore isolation capability in each required secondary containment penetration flow path not isolated.	1 hour

## SURVEILLANCE REQUIREMENTS

SURVEILLANCE	FREQUENCY
<p>SR 3.1.1.1    Verify SDM is:</p> <p>a.   <math>\geq 0.38\% \Delta k/k</math> with the highest worth control rod analytically determined; or</p> <p>b.   <math>\geq 0.28\% \Delta k/k</math> with the highest worth control rod determined by test.</p>	<p>Prior to each in vessel fuel movement during fuel loading sequence</p> <p><u>AND</u></p> <p>Once within 4 hours after criticality following fuel movement within the reactor pressure vessel or control rod replacement</p>

### 3.1 REACTIVITY CONTROL SYSTEMS

#### 3.1.2 Reactivity Anomalies

LC0 3.1.2      The reactivity difference between the monitored rod density and the predicted rod density shall be within  $\pm 1\% \Delta k/k$ .

APPLICABILITY:    MODES 1 and 2.

#### ACTIONS

CONDITION	REQUIRED ACTION	COMPLETION TIME
A. Core reactivity difference not within limit.	A.1      Restore core reactivity difference to within limit.	72 hours
B. Required Action and associated Completion Time not met.	B.1      Be in MODE 3.	12 hours

SURVEILLANCE REQUIREMENTS

SURVEILLANCE	FREQUENCY
<p>SR 3.1.2.1      Verify core reactivity difference between the monitored rod density and the predicted rod density is within <math>\pm 1\% \Delta k/k</math>.</p>	<p>Once within 24 hours after reaching equilibrium conditions following startup after fuel movement within the reactor pressure vessel or control rod replacement</p> <p><u>AND</u></p> <p>1000 MWD/T thereafter during operations in MODE 1</p>

### 3.1 REACTIVITY CONTROL SYSTEMS

#### 3.1.3 Control Rod OPERABILITY

LCO 3.1.3 Each control rod shall be OPERABLE.

APPLICABILITY: MODES 1 and 2.

#### ACTIONS

-----NOTE-----  
Separate Condition entry is allowed for each control rod.  
-----

CONDITION	REQUIRED ACTION	COMPLETION TIME
A. One withdrawn control rod stuck.	-----NOTE----- Rod worth minimizer (RWM) may be bypassed as allowed by LCO 3.3.2.1, "Control Rod Block Instrumentation," if required, to allow continued operation. -----	
	A.1 Verify stuck control rod separation criteria are met.	Immediately
	<u>AND</u>	
	A.2 Disarm the associated control rod drive (CRD). <u>AND</u>	2 hours
		(continued)

ACTIONS

CONDITION	REQUIRED ACTION	COMPLETION TIME
A. (continued)	A.3 Perform SR 3.1.3.2 and SR 3.1.3.3 for each withdrawn OPERABLE control rod.	24 hours from discovery of Condition A concurrent with THERMAL POWER greater than the low power setpoint (LPSP) of the RWM
	<u>AND</u> A.4 Perform SR 3.1.1.1.	72 hours
B. Two or more withdrawn control rods stuck.	B.1 Be in MODE 3.	12 hours
C. One or more control rods inoperable for reasons other than Condition A or B.	C.1 -----NOTE----- RWM may be bypassed as allowed by LCO 3.3.2.1, if required, to allow insertion of inoperable control rod and continued operation. ----- Fully insert inoperable control rod.	3 hours
	<u>AND</u> C.2 Disarm the associated CRD.	4 hours

(continued)

### ACTIONS (continued)

CONDITION	REQUIRED ACTION	COMPLETION TIME
D. -----NOTE----- Not applicable when THERMAL POWER > 10% RTP. -----  Two or more inoperable control rods not in compliance with banked position withdrawal sequence (BPWS) and not separated by two or more OPERABLE control rods.	D.1      Restore compliance with BPWS.  <u>OR</u>  D.2      Restore control rod to OPERABLE status.	4 hours    4 hours
E. Required Action and associated Completion Time of Condition A, C, or D not met.  <u>OR</u>  Nine or more control rods inoperable.	E.1      Be in MODE 3.	12 hours



**SURVEILLANCE REQUIREMENTS**

SURVEILLANCE		FREQUENCY
SR 3.1.3.1	Determine the position of each control rod.	24 hours
SR 3.1.3.2	<p>-----NOTE-----            Not required to be performed until 7 days after the control rod is withdrawn and THERMAL POWER is greater than the LPSP of the RWM.            -----</p> <p>Insert each fully withdrawn control rod at least one notch.</p>	7 days
SR 3.1.3.3	<p>-----NOTE-----            Not required to be performed until 31 days after the control rod is withdrawn and THERMAL POWER is greater than the LPSP of the RWM.            -----</p> <p>Insert each partially withdrawn control rod at least one notch.</p>	31 days
SR 3.1.3.4	Verify each control rod scram time from fully withdrawn to notch position 06 is $\leq 7$ seconds.	In accordance with SR 3.1.4.1, SR 3.1.4.2, SR 3.1.4.3, and SR 3.1.4.4

(continued)

**SURVEILLANCE REQUIREMENTS (continued)**

SURVEILLANCE	FREQUENCY
SR 3.1.3.5    Verify each withdrawn control rod does not go to the withdrawn overtravel position.	Each time the control rod is withdrawn to "full out" position  <u>AND</u>  Prior to declaring control rod OPERABLE after work on control rod or CRD System that could affect coupling

### 3.1 REACTIVITY CONTROL SYSTEMS

#### 3.1.4 Control Rod Scram Times

- LCO 3.1.4
- a. No more than 13 OPERABLE control rods shall be "slow," in accordance with Table 3.1.4-1; and
  - b. No more than 2 OPERABLE control rods that are "slow" shall occupy adjacent locations.

APPLICABILITY: MODES 1 and 2.

#### ACTIONS

CONDITION	REQUIRED ACTION	COMPLETION TIME
A. Requirements of the LCO not met.	A.1 Be in MODE 3.	12 hours

#### SURVEILLANCE REQUIREMENTS

-----NOTE-----  
During single control rod scram time Surveillances, the control rod drive (CRD) pumps shall be isolated from the associated scram accumulator.  
-----

SURVEILLANCE	FREQUENCY
SR 3.1.4.1 Verify each control rod scram time is within the limits of Table 3.1.4-1 with reactor steam dome pressure $\geq$ 800 psig.	Prior to exceeding 40% RTP after each refueling  <u>AND</u>  (continued)

**SURVEILLANCE REQUIREMENTS**

SURVEILLANCE	FREQUENCY
SR 3.1.4.1 (continued)	Prior to exceeding 40% RTP after each reactor shutdown ≥ 120 days
SR 3.1.4.2      Verify, for a representative sample, each tested control rod scram time is within the limits of Table 3.1.4-1 with reactor steam dome pressure ≥ 800 psig.	120 days cumulative operation in MODE 1
SR 3.1.4.3      Verify each affected control rod scram time is within the limits of Table 3.1.4-1 with any reactor steam dome pressure.	Prior to declaring control rod OPERABLE after work on control rod or CRD System that could affect scram time
SR 3.1.4.4      Verify each affected control rod scram time is within the limits of Table 3.1.4-1 with reactor steam dome pressure ≥ 800 psig.	Prior to exceeding 40% RTP after work on control rod or CRD System that could affect scram time  <u>AND</u>  Prior to exceeding 40% RTP after fuel movement within the reactor pressure vessel

Table 3.1.4-1 (page 1 of 1)  
Control Rod Scram Times

- NOTES-----
1. OPERABLE control rods with scram times not within the limits of this Table are considered "slow."
  2. Enter applicable Conditions and Required Actions of LCO 3.1.3, "Control Rod OPERABILITY," for control rods with scram times > 7 seconds to notch position 06. These control rods are inoperable, in accordance with SR 3.1.3.4, and are not considered "slow."
- 

NOTCH POSITION	SCRAM TIMES WHEN REACTOR STEAM DOME PRESSURE ≥ 800 psig (a) (b) (seconds)
46	0.44
36	1.08
26	1.83
06	3.35

- (a) Maximum scram time from fully withdrawn position, based on de-energization of scram pilot valve solenoids at time zero.
- (b) When reactor steam dome pressure is < 800 psig, established scram time limits apply.

### 3.1 REACTIVITY CONTROL SYSTEMS

#### 3.1.5 Control Rod Scram Accumulators

LCO 3.1.5 Each control rod scram accumulator shall be OPERABLE.

APPLICABILITY: MODES 1 and 2.

#### ACTIONS

-----NOTE-----  
Separate Condition entry is allowed for each control rod scram accumulator.  
-----

CONDITION	REQUIRED ACTION	COMPLETION TIME
A. One control rod scram accumulator inoperable with reactor steam dome pressure $\geq 900$ psig.	A.1 -----NOTE----- Only applicable if the associated control rod scram time was within the limits of Table 3.1.4-1 during the last scram time Surveillance. ----- Declare the associated control rod scram time "slow."	8 hours
	<u>OR</u> A.2 Declare the associated control rod inoperable.	8 hours

(continued)

ACTIONS (continued)

CONDITION	REQUIRED ACTION	COMPLETION TIME
B. Two or more control rod scram accumulators inoperable with reactor steam dome pressure $\geq 900$ psig.	B.1 Restore charging water header pressure to $\geq 940$ psig.	20 minutes from discovery of Condition B concurrent with charging water header pressure $< 940$ psig
	<u>AND</u>	
	B.2.1 -----NOTE----- Only applicable if the associated control rod scram time was within the limits of Table 3.1.4-1 during the last scram time Surveillance. ----- Declare the associated control rod scram time "slow."	1 hour
	<u>OR</u> B.2.2 Declare the associated control rod inoperable.	1 hour

(continued)

**ACTIONS (continued)**

CONDITION	REQUIRED ACTION	COMPLETION TIME
C. One or more control rod scram accumulators inoperable with reactor steam dome pressure < 900 psig.	C.1 Verify all control rods associated with inoperable accumulators are fully inserted.	Immediately upon discovery of charging water header pressure < 940 psig .
	<u>AND</u> C.2 Declare the associated control rod inoperable.	1 hour
D. Required Action B.1 or C.1 and associated Completion Time not met.	D.1 -----NOTE----- Not applicable if all inoperable control rod scram accumulators are associated with fully inserted control rods. ----- Place the reactor mode switch in the shutdown position.	Immediately

**SURVEILLANCE REQUIREMENTS**

SURVEILLANCE	FREQUENCY
SR 3.1.5.1 Verify each control rod scram accumulator pressure is $\geq$ 940 psig.	7 days



### 3.1 REACTIVITY CONTROL SYSTEMS

#### 3.1.6 Rod Pattern Control

LCO 3.1.6 OPERABLE control rods shall comply with the requirements of the banked position withdrawal sequence (BPWS).

APPLICABILITY: MODES 1 and 2 with THERMAL POWER  $\leq$  10% RTP.

#### ACTIONS

CONDITION	REQUIRED ACTION	COMPLETION TIME
A. One or more OPERABLE control rods not in compliance with BPWS.	A.1 -----NOTE----- Rod worth minimizer (RWM) may be bypassed as allowed by LCO 3.3.2.1, "Control Rod Block Instrumentation." -----	
	Move associated control rod(s) to correct position.	8 hours
	<u>OR</u> A.2 Declare associated control rod(s) inoperable.	8 hours

(continued)

**ACTIONS (continued)**

CONDITION	REQUIRED ACTION	COMPLETION TIME
B. Nine or more OPERABLE control rods not in compliance with BPWS.	B.1 -----NOTE----- RWM may be bypassed as allowed by LCO 3.3.2.1. ----- Suspend withdrawal of control rods.	Immediately
	<u>AND</u> B.2 Place the reactor mode switch in the shutdown position.	1 hour

**SURVEILLANCE REQUIREMENTS**

SURVEILLANCE	FREQUENCY
SR 3.1.6.1 Verify all OPERABLE control rods comply with BPWS.	24 hours

### 3.1 REACTIVITY CONTROL SYSTEMS

#### 3.1.7 Standby Liquid Control (SLC) System

LCO 3.1.7 Two SLC subsystems shall be OPERABLE.

APPLICABILITY: MODES 1 and 2.

#### ACTIONS

CONDITION	REQUIRED ACTION	COMPLETION TIME
A. Concentration of boron in solution > 9.82% weight.	A.1 Verify the concentration and temperature of boron in solution and pump suction piping temperature are within the limits of Figure 3.1.7-1.	8 hours <u>AND</u> Once per 12 hours thereafter
	<u>AND</u> A.2 Restore concentration of boron in solution to $\leq 9.82\%$ weight.	72 hours <u>AND</u> 10 days from discovery of failure to meet the LCO
B. One SLC subsystem inoperable for reasons other than Condition A.	B.1 Restore SLC subsystem to OPERABLE status.	7 days <u>AND</u> 10 days from discovery of failure to meet the LCO

(continued)

**ACTIONS (continued)**

CONDITION	REQUIRED ACTION	COMPLETION TIME
C. Two SLC subsystems inoperable for reasons other than Condition A.	C.1 Restore one SLC subsystem to OPERABLE status.	8 hours
D. Required Action and associated Completion Time not met.	D.1 Be in MODE 3.	12 hours

**SURVEILLANCE REQUIREMENTS**

SURVEILLANCE	FREQUENCY
SR 3.1.7.1 Verify level of sodium pentaborate solution in the SLC tank is $\geq 46\%$ .	24 hours
SR 3.1.7.2 Verify temperature of sodium pentaborate solution is $\geq 53^{\circ}\text{F}$ .	24 hours
SR 3.1.7.3 Verify temperature of pump suction piping is $\geq 53^{\circ}\text{F}$ .	24 hours
SR 3.1.7.4 Verify continuity of explosive charge.	31 days

(continued)

SURVEILLANCE REQUIREMENTS (continued)

SURVEILLANCE	FREQUENCY
<p>SR 3.1.7.5    Verify the concentration of boron in solution is <math>\leq 9.82\%</math> weight and within the limits of Table 3.1.7-1.</p>	<p>31 days</p> <p><u>AND</u></p> <p>Once within 24 hours after water or boron is added to solution</p> <p><u>AND</u></p> <p>Once within 24 hours after solution temperature is restored within limits</p>
<p>SR 3.1.7.6    Verify each SLC subsystem manual and power operated valve in the flow path that is not locked, sealed, or otherwise secured in position is in the correct position, or can be aligned to the correct position.</p>	<p>31 days</p>
<p>SR 3.1.7.7    Verify the quantity of B-10 stored in the SLC tank is <math>\geq 162.7</math> lbm.</p>	<p>31 days</p>
<p>SR 3.1.7.8    Verify each pump develops a flow rate <math>\geq 43.0</math> gpm at a discharge pressure <math>\geq 1255</math> psig.</p>	<p>In accordance with the Inservice Testing Program</p>

(continued)

**SURVEILLANCE REQUIREMENTS (continued)**

SURVEILLANCE	FREQUENCY
SR 3.1.7.9    Verify flow through one SLC subsystem from pump into reactor pressure vessel.	24 months on a STAGGERED TEST BASIS
SR 3.1.7.10    Verify sodium pentaborate atom percent B-10 enrichment is within the limits of Table 3.1.7-1.	Once within 8 hours after addition to SLC tank

Table 3.1.7-1 (page 1 of 1)  
Standby Liquid Control System Boron Concentration,  
Pump Flow Rate, and Boron Enrichment Limits

The combination of SLC System boron concentration, pump flow rate, and boron enrichment shall be in accordance with the following equation:

$$\frac{C}{13\% \text{ weight}} \times \frac{Q}{86 \text{ gpm}} \times \frac{E}{19.8\% \text{ atom}} \geq 1$$

where,

C = % weight sodium pentaborate solution concentration,

Q = Pump flow rate (gpm) at a discharge pressure of  $\geq 1255$  psig, and

E = Boron-10 enrichment (% atom Boron-10).

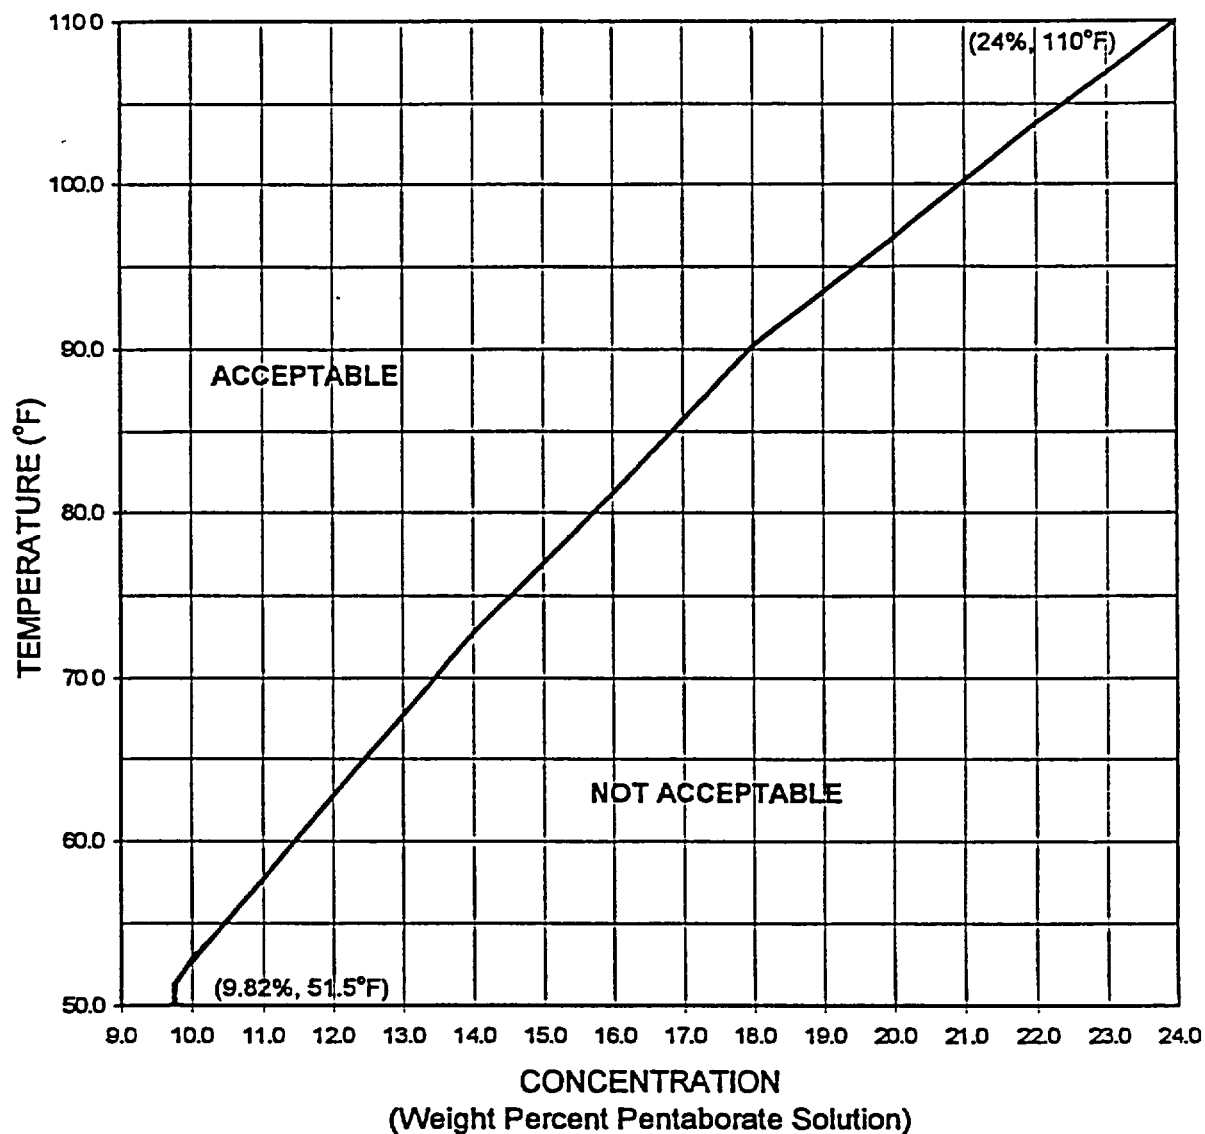


Figure 3.1.7-1 (page 1 of 1)  
Sodium Pentaborate Solution Temperature Versus Concentration Requirements



### 3.1 REACTIVITY CONTROL SYSTEMS

#### 3.1.8 Scram Discharge Volume (SDV) Vent and Drain Valves

LCO 3.1.8 Each SDV vent and drain valve shall be OPERABLE.

APPLICABILITY: MODES 1 and 2.

#### ACTIONS

-----NOTE-----  
Separate Condition entry is allowed for each SDV vent and drain line.  
-----

CONDITION	REQUIRED ACTION	COMPLETION TIME
A. One or more SDV vent or drain lines with one valve inoperable.	A.1 Restore valve to OPERABLE status.	7 days
B. One or more SDV vent or drain lines with both valves inoperable.	B.1 -----NOTE----- An isolated line may be unisolated under administrative control to allow draining and venting of the SDV. ----- Isolate the associated line.	8 hours
C. Required Action and associated Completion Time not met.	C.1 Be in MODE 3.	12 hours

**SURVEILLANCE REQUIREMENTS**

SURVEILLANCE	FREQUENCY
<p>SR 3.1.8.1 -----NOTE-----            Not required to be met on vent and drain valves closed during performance of SR 3.1.8.2 or SR 3.3.1.1.9 for Function 13 of Table 3.3.1.1-1.            -----            Verify each SDV vent and drain valve is open.</p>	31 days
<p>SR 3.1.8.2 Cycle each SDV vent and drain valve to the fully closed and fully open position.</p>	92 days
<p>SR 3.1.8.3 Verify each SDV vent and drain valve closes in <math>\leq 15</math> seconds after receipt of an actual or simulated scram signal.</p>	24 months

## 3.2 POWER DISTRIBUTION LIMITS

### 3.2.1 AVERAGE PLANAR LINEAR HEAT GENERATION RATE (APLHGR)

LCO 3.2.1 All APLHGRs shall be less than or equal to the limits specified in the COLR.

APPLICABILITY: THERMAL POWER  $\geq$  25% RTP.

#### ACTIONS

CONDITION	REQUIRED ACTION	COMPLETION TIME
A. Any APLHGR not within limits.	A.1 Restore APLHGR(s) to within limits.	2 hours
B. Required Action and associated Completion Time not met.	B.1 Reduce THERMAL POWER to < 25% RTP.	4 hours

#### SURVEILLANCE REQUIREMENTS

SURVEILLANCE	FREQUENCY
SR 3.2.1.1 Verify all APLHGRs are less than or equal to the limits specified in the COLR.	Once within 12 hours after $\geq$ 25% RTP  <u>AND</u> 24 hours thereafter

### 3.2 POWER DISTRIBUTION LIMITS

#### 3.2.2 MINIMUM CRITICAL POWER RATIO (MCPR)

LCO 3.2.2 All MCPRs shall be greater than or equal to the MCPR operating limits specified in the COLR.

APPLICABILITY: THERMAL POWER  $\geq$  25% RTP.

#### ACTIONS

CONDITION	REQUIRED ACTION	COMPLETION TIME
A. Any MCPR not within limits.	A.1 Restore MCPR(s) to within limits.	2 hours
B. Required Action and associated Completion Time not met.	B.1 Reduce THERMAL POWER to < 25% RTP.	4 hours

#### SURVEILLANCE REQUIREMENTS

SURVEILLANCE	FREQUENCY
SR 3.2.2.1 Verify all MCPRs are greater than or equal to the limits specified in the COLR.	Once within 12 hours after $\geq$ 25% RTP  <u>AND</u> 24 hours thereafter

(continued)

SURVEILLANCE REQUIREMENTS (continued)

SURVEILLANCE	FREQUENCY
SR 3.2.2.2 Determine the MCPR limits.	Once within 72 hours after each completion of SR 3.1.4.1  <u>AND</u>  Once within 72 hours after each completion of SR 3.1.4.2

## 3.2 POWER DISTRIBUTION LIMITS

### 3.2.3 LINEAR HEAT GENERATION RATE (LHGR)

LCO 3.2.3 All LHGRs shall be less than or equal to the limits specified in the COLR.

APPLICABILITY: THERMAL POWER  $\geq$  25% RTP.

#### ACTIONS

CONDITION	REQUIRED ACTION	COMPLETION TIME
A. Any LHGR not within limits.	A.1 Restore LHGR(s) to within limits.	2 hours
B. Required Action and associated Completion Time not met.	B.1 Reduce THERMAL POWER to < 25% RTP.	4 hours

#### SURVEILLANCE REQUIREMENTS

SURVEILLANCE	FREQUENCY
SR 3.2.3.1 Verify all LHGRs are less than or equal to the limits specified in the COLR.	Once within 12 hours after $\geq$ 25% RTP  <u>AND</u> 24 hours thereafter

### 3.3 INSTRUMENTATION

#### 3.3.1.1 Reactor Protection System (RPS) Instrumentation

LCO 3.3.1.1 The RPS instrumentation for each Function in Table 3.3.1.1-1 shall be OPERABLE.

APPLICABILITY: According to Table 3.3.1.1-1.

#### ACTIONS

-----NOTE-----  
Separate Condition entry is allowed for each channel.  
-----

CONDITION	REQUIRED ACTION	COMPLETION TIME
A. One or more required channels inoperable.	A.1 Place channel in trip.	12 hours
	OR A.2 -----NOTE----- Not applicable for Functions 2.a, 2.b, 2.c, or 2.d. ----- Place associated trip system in trip.	12 hours
B. -----NOTE----- Not applicable for Functions 2.a, 2.b, 2.c, or 2.d. ----- One or more Functions with one or more required channels inoperable in both trip systems.	B.1 Place channel in one trip system in trip.	6 hours
	OR B.2 Place one trip system in trip.	6 hours

(continued)

ACTIONS (continued)

CONDITION	REQUIRED ACTION	COMPLETION TIME
<p>C. One or more automatic Functions with RPS trip capability not maintained.</p> <p><u>OR</u></p> <p>Two or more manual Functions with RPS trip capability not maintained.</p>	C.1 Restore RPS trip capability.	1 hour
D. Required Action and associated Completion Time of Condition A, B, or C not met.	D.1 Enter the Condition referenced in Table 3.3.1.1-1 for the channel.	Immediately
E. As required by Required Action D.1 and referenced in Table 3.3.1.1-1.	E.1 Reduce THERMAL POWER to < 30% RTP.	4 hours
F. As required by Required Action D.1 and referenced in Table 3.3.1.1-1.	F.1 Be in MODE 2.	6 hours
G. As required by Required Action D.1 and referenced in Table 3.3.1.1-1.	G.1 Be in MODE 3.	12 hours

(continued)



ACTIONS (continued)

CONDITION	REQUIRED ACTION	COMPLETION TIME
H. As required by Required Action D.1 and referenced in Table 3.3.1.1-1.	H.1 Initiate action to fully insert all insertable control rods in core cells containing one or more fuel assemblies.	Immediately

SURVEILLANCE REQUIREMENTS

-----NOTES-----

1. Refer to Table 3.3.1.1-1 to determine which SRs apply for each RPS Function.
  2. When a channel is placed in an inoperable status solely for performance of required Surveillances, entry into associated Conditions and Required Actions may be delayed for up to 6 hours provided the associated Function maintains RPS trip capability.
- 

SURVEILLANCE	FREQUENCY
SR 3.3.1.1.1 Perform CHANNEL CHECK.	12 hours
SR 3.3.1.1.2 -----NOTE----- Not required to be performed until 12 hours after THERMAL POWER $\geq$ 25% RTP. ----- Verify the absolute difference between the average power range monitor (APRM) channels and the calculated power is $\leq$ 2% RTP while operating at $\geq$ 25% RTP.	7 days

(continued)

SURVEILLANCE REQUIREMENTS (continued)

SURVEILLANCE	FREQUENCY
SR 3.3.1.1.3 (Not Used.)	
SR 3.3.1.1.4 Perform CHANNEL FUNCTIONAL TEST.	7 days
SR 3.3.1.1.5 -----NOTE----- Not required to be performed when entering MODE 2 from MODE 1 until 12 hours after entering MODE 2. ----- Perform CHANNEL FUNCTIONAL TEST	31 days
SR 3.3.1.1.6 Perform CHANNEL FUNCTIONAL TEST.	31 days
SR 3.3.1.1.7 (Not Used.)	
SR 3.3.1.1.8 Calibrate the local power range monitors.	1000 MWD/T average core exposure

(continued)

SURVEILLANCE REQUIREMENTS (continued)

SURVEILLANCE	FREQUENCY
SR 3.3.1.1.9 Perform CHANNEL FUNCTIONAL TEST.	92 days
SR 3.3.1.1.10 -----NOTE----- Radiation detectors are excluded. ----- Perform CHANNEL CALIBRATION.	92 days
SR 3.3.1.1.11 -----NOTES----- 1. For Function 2.a, not required to be performed when entering MODE 2 from MODE 1 until 12 hours after entering MODE 2. 2. For Function 2.b, the CHANNEL FUNCTIONAL TEST includes the recirculation flow input processing, excluding the flow transmitters. ----- Perform CHANNEL FUNCTIONAL TEST.	184 days
SR 3.3.1.1.12 -----NOTES----- 1. Neutron detectors are excluded. 2. For Function 1, not required to be performed when entering MODE 2 from MODE 1 until 12 hours after entering MODE 2. 3. For Function 2.b, the recirculation flow transmitters that feed the APRMs are included. ----- Perform CHANNEL CALIBRATION.	24 months

(continued)

SURVEILLANCE REQUIREMENTS (continued)

SURVEILLANCE		FREQUENCY
SR 3.3.1.1.13	Verify Turbine Stop Valve—Closure and Turbine Control Valve Fast Closure, Trip Oil Pressure—Low Functions are not bypassed when THERMAL POWER is $\geq$ 30% RTP.	24 months
SR 3.3.1.1.14	Perform CHANNEL FUNCTIONAL TEST.	24 months
SR 3.3.1.1.15	Perform CHANNEL CALIBRATION.	24 months
SR 3.3.1.1.16	Calibrate each radiation detector.	24 months
SR 3.3.1.1.17	Perform LOGIC SYSTEM FUNCTIONAL TEST.	24 months
SR 3.3.1.1.18	Verify the RPS RESPONSE TIME is within limits.	24 months

Table 3.3.1.1-1 (page 1 of 3)  
Reactor Protection System Instrumentation

FUNCTION	APPLICABLE MODES OR OTHER SPECIFIED CONDITIONS	REQUIRED CHANNELS PER TRIP SYSTEM	CONDITIONS REFERENCED FROM REQUIRED ACTION D.1	SURVEILLANCE REQUIREMENTS	ALLOWABLE VALUE
<b>1. Wide Range Neutron Monitors</b>					
a. Period-Short	2	3	G	SR 3.3.1.1.1 SR 3.3.1.1.5 SR 3.3.1.1.12 SR 3.3.1.1.17 SR 3.3.1.1.18	≥ 13 seconds
	5(a)	3	H	SR 3.3.1.1.1 SR 3.3.1.1.6 SR 3.3.1.1.12 SR 3.3.1.1.17 SR 3.3.1.1.18	≥ 13 seconds
b. Inop	2	3	G	SR 3.3.1.1.5 SR 3.3.1.1.17	NA
	5(a)	3	H	SR 3.3.1.1.6 SR 3.3.1.1.17	NA
<b>2. Average Power Range Monitors</b>					
a. Neutron Flux-High (Setdown)	2	3(c)	G	SR 3.3.1.1.1 SR 3.3.1.1.8 SR 3.3.1.1.11 SR 3.3.1.1.12	≤ 15.0% RTP
b. Simulated Thermal Power-High	1	3(c)	F	SR 3.3.1.1.1 SR 3.3.1.1.2	≤ 0.66 W + 64.9% RTP <sup>(b)</sup> and ≤ 118.0% RTP
				SR 3.3.1.1.8 SR 3.3.1.1.11 SR 3.3.1.1.12	
c. Neutron Flux-High	1	3(c)	F	SR 3.3.1.1.1 SR 3.3.1.1.2 SR 3.3.1.1.8 SR 3.3.1.1.11 SR 3.3.1.1.12	≤ 119.7% RTP
d. Inop	1,2	3(c)	G	SR 3.3.1.1.11	NA
e. 2-Out-Of-4 Voter	1,2	2	G	SR 3.3.1.1.1 SR 3.3.1.1.11 SR 3.3.1.1.17 SR 3.3.1.1.18	NA

(continued)

(a) With any control rod withdrawn from a core cell containing one or more fuel assemblies.

(b) 0.66 W + 64.9% - 0.66 ΔW RTP when reset for single loop operation per LCO 3.4.1, "Recirculation Loops Operating."

(c) Each APRM channel provides inputs to both trip systems.

Table 3.3.1.1-1 (page 2 of 3)  
Reactor Protection System Instrumentation

FUNCTION	APPLICABLE MODES OR OTHER SPECIFIED CONDITIONS	REQUIRED CHANNELS PER TRIP SYSTEM	CONDITIONS REFERENCED FROM REQUIRED ACTION D.1	SURVEILLANCE REQUIREMENTS	ALLOWABLE VALUE
3. Reactor Pressure —High	1,2	2	G	SR 3.3.1.1.1 SR 3.3.1.1.9 SR 3.3.1.1.15 SR 3.3.1.1.17 SR 3.3.1.1.18	≤ 1085.0 psig
4. Reactor Vessel Water Level —Low (Level 3)	1,2	2	G	SR 3.3.1.1.1 SR 3.3.1.1.9 SR 3.3.1.1.15 SR 3.3.1.1.17 SR 3.3.1.1.18	≥ 1.0 inches
5. Main Steam Isolation Valve —Closure	1	8	F	SR 3.3.1.1.9 SR 3.3.1.1.15 SR 3.3.1.1.17 SR 3.3.1.1.18	≤ 10% closed
6. Drywell Pressure —High	1,2	2	G	SR 3.3.1.1.1 SR 3.3.1.1.9 SR 3.3.1.1.15 SR 3.3.1.1.17 SR 3.3.1.1.18	≤ 2.0 psig
7. Scram Discharge Volume Water Level —High	1,2	2	G	SR 3.3.1.1.9 SR 3.3.1.1.15 SR 3.3.1.1.17 SR 3.3.1.1.18	≤ 50.0 gallons
	5(a)	2	H	SR 3.3.1.1.9 SR 3.3.1.1.15 SR 3.3.1.1.17	≤ 50.0 gallons
8. Turbine Stop Valve —Closure	≥ 30% RTP	4	E	SR 3.3.1.1.9 SR 3.3.1.1.13 SR 3.3.1.1.15 SR 3.3.1.1.17 SR 3.3.1.1.18	≤ 10% closed
9. Turbine Control Valve Fast Closure, Trip Oil Pressure —Low	≥ 30% RTP	2	E	SR 3.3.1.1.9 SR 3.3.1.1.13 SR 3.3.1.1.15 SR 3.3.1.1.17 SR 3.3.1.1.18	≥ 500.0 psig
10. Turbine Condenser —Low Vacuum	1	2	F	SR 3.3.1.1.1 SR 3.3.1.1.9 SR 3.3.1.1.15 SR 3.3.1.1.17 SR 3.3.1.1.18	≥ 23.0 inches Hg vacuum
11. Main Steam Line —High Radiation	1,2	2	G	SR 3.3.1.1.1 SR 3.3.1.1.10 SR 3.3.1.1.16 SR 3.3.1.1.17 SR 3.3.1.1.18	≤ 15 X Full Power Background
12. Reactor Mode Switch — Shutdown Position	1,2	1	G	SR 3.3.1.1.14 SR 3.3.1.1.17	NA
	5(a)	1	H	SR 3.3.1.1.14 SR 3.3.1.1.17	NA

(continued)

(a) With any control rod withdrawn from a core cell containing one or more fuel assemblies.

Table 3.3.1.1-1 (page 3 of 3)  
Reactor Protection System Instrumentation

FUNCTION	APPLICABLE MODES OR OTHER SPECIFIED CONDITIONS	REQUIRED CHANNELS PER TRIP SYSTEM	CONDITIONS REFERENCED FROM REQUIRED ACTION D.1	SURVEILLANCE REQUIREMENTS	ALLOWABLE VALUE
13. Manual Scram	1,2	1	G	SR 3.3.1.1.9 SR 3.3.1.1.17	NA
	5(a)	1	H	SR 3.3.1.1.9 SR 3.3.1.1.17	NA
14. RPS Channel Test Switch	1,2	2	G	SR 3.3.1.1.4 SR 3.3.1.1.17	NA
	5(a)	2	H	SR 3.3.1.1.4 SR 3.3.1.1.17	NA

(a) With any control rod withdrawn from a core cell containing one or more fuel assemblies.

### 3.3 INSTRUMENTATION

#### | 3.3.1.2 Wide Range Neutron Monitor (WRNM) Instrumentation

| LCO 3.3.1.2 The WRNM instrumentation in Table 3.3.1.2-1 shall be OPERABLE.

APPLICABILITY: According to Table 3.3.1.2-1.

#### ACTIONS

CONDITION	REQUIRED ACTION	COMPLETION TIME
A. One or more required WRNMs inoperable in MODE 2.	A.1 Restore required WRNMs to OPERABLE status.	4 hours
B. Three required WRNMs inoperable in MODE 2.	B.1 Suspend control rod withdrawal.	Immediately
C. Required Action and associated Completion Time of Condition A or B not met.	C.1 Be in MODE 3.	12 hours

(continued)



## ACTIONS (continued)

CONDITION	REQUIRED ACTION	COMPLETION TIME
D. One or more required WRNMs inoperable in MODE 3 or 4.	D.1 Fully insert all insertable control rods.	1 hour
	<u>AND</u> D.2 Place reactor mode switch in the shutdown position.	1 hour
E. One or more required WRNMs inoperable in MODE 5.	E.1 Suspend CORE ALTERATIONS except for control rod insertion.	Immediately
	<u>AND</u> E.2 Initiate action to fully insert all insertable control rods in core cells containing one or more fuel assemblies.	Immediately

## SURVEILLANCE REQUIREMENTS

-----NOTE-----  
Refer to Table 3.3.1.2-1 to determine which SRs apply for each applicable MODE or other specified conditions.  
-----

SURVEILLANCE	FREQUENCY
SR 3.3.1.2.1 Perform CHANNEL CHECK.	12 hours

(continued)

**SURVEILLANCE REQUIREMENTS (continued)**

SURVEILLANCE	FREQUENCY
<p>SR 3.3.1.2.2 -----NOTES-----</p> <ol style="list-style-type: none"> <li>1. Only required to be met during CORE ALTERATIONS.</li> <li>2. One WRNM may be used to satisfy more than one of the following.</li> </ol> <p>-----</p> <p>Verify an OPERABLE WRNM detector is located in:</p> <ol style="list-style-type: none"> <li>a. The fueled region;</li> <li>b. The core quadrant where CORE ALTERATIONS are being performed, when the associated WRNM is included in the fueled region; and</li> <li>c. A core quadrant adjacent to where CORE ALTERATIONS are being performed, when the associated WRNM is included in the fueled region.</li> </ol>	<p>12 hours</p>
<p>SR 3.3.1.2.3 Perform CHANNEL CHECK.</p>	<p>24 hours</p>

(continued)

REQUIREMENTS (continued)

SURVEILLANCE	FREQUENCY
<p>.4 -----NOTES-----</p> <ol style="list-style-type: none"> <li>1. Not required to be met with less than or equal to four fuel assemblies adjacent to the WRNM and no other fuel assemblies in the associated core quadrant.</li> <li>2. Not required to be met during spiral unloading.</li> </ol> <p>-----</p> <p>Verify count rate is:</p> <ol style="list-style-type: none"> <li>a. <math>\geq 3.0</math> cps; or</li> <li>b. Within the limits of Figure 3.3.1.2-1.</li> </ol>	<p>12 hours during CORE ALTERATIONS</p> <p><u>AND</u></p> <p>24 hours</p>
<p>SR 3.3.1.2.5 -----NOTE-----</p> <p>Not required to be performed until 12 hours after WRNMs indicate 125E-5 % power or below.</p> <p>-----</p> <p>Perform CHANNEL FUNCTIONAL TEST and determination of signal to noise ratio.</p>	<p>31 days</p>
<p>SR 3.3.1.2.6 -----NOTES-----</p> <ol style="list-style-type: none"> <li>1. Neutron detectors are excluded.</li> <li>2. Not required to be performed until 12 hours after WRNMs indicate 125E-5 % power or below.</li> </ol> <p>-----</p> <p>Perform CHANNEL CALIBRATION.</p>	<p>24 months</p>

Table 3.3.1.2-1 (page 1 of 1)  
Wide Range Neutron Monitor Instrumentation

FUNCTION	APPLICABLE MODES OR OTHER SPECIFIED CONDITIONS	REQUIRED CHANNELS	SURVEILLANCE REQUIREMENTS
1. Wide Range Neutron Monitor	2 <sup>(a)</sup>	3 <sup>(d)</sup>	SR 3.3.1.2.1
			SR 3.3.1.2.4
			SR 3.3.1.2.5
			SR 3.3.1.2.6
	3,4	2	SR 3.3.1.2.3
			SR 3.3.1.2.4
			SR 3.3.1.2.5
			SR 3.3.1.2.6
	5	2 <sup>(b)(c)</sup>	SR 3.3.1.2.1
			SR 3.3.1.2.2
			SR 3.3.1.2.4
			SR 3.3.1.2.5
			SR 3.3.1.2.6

(a) With WRNMs reading 125E-5 % power or below.

(b) Only one WRNM channel is required to be OPERABLE during spiral offload or reload when the fueled region includes only that WRNM detector.

(c) Special movable detectors may be used in place of WRNMs if connected to normal WRNM circuits.

(d) Channels must be in 3 of 4 core quadrants.

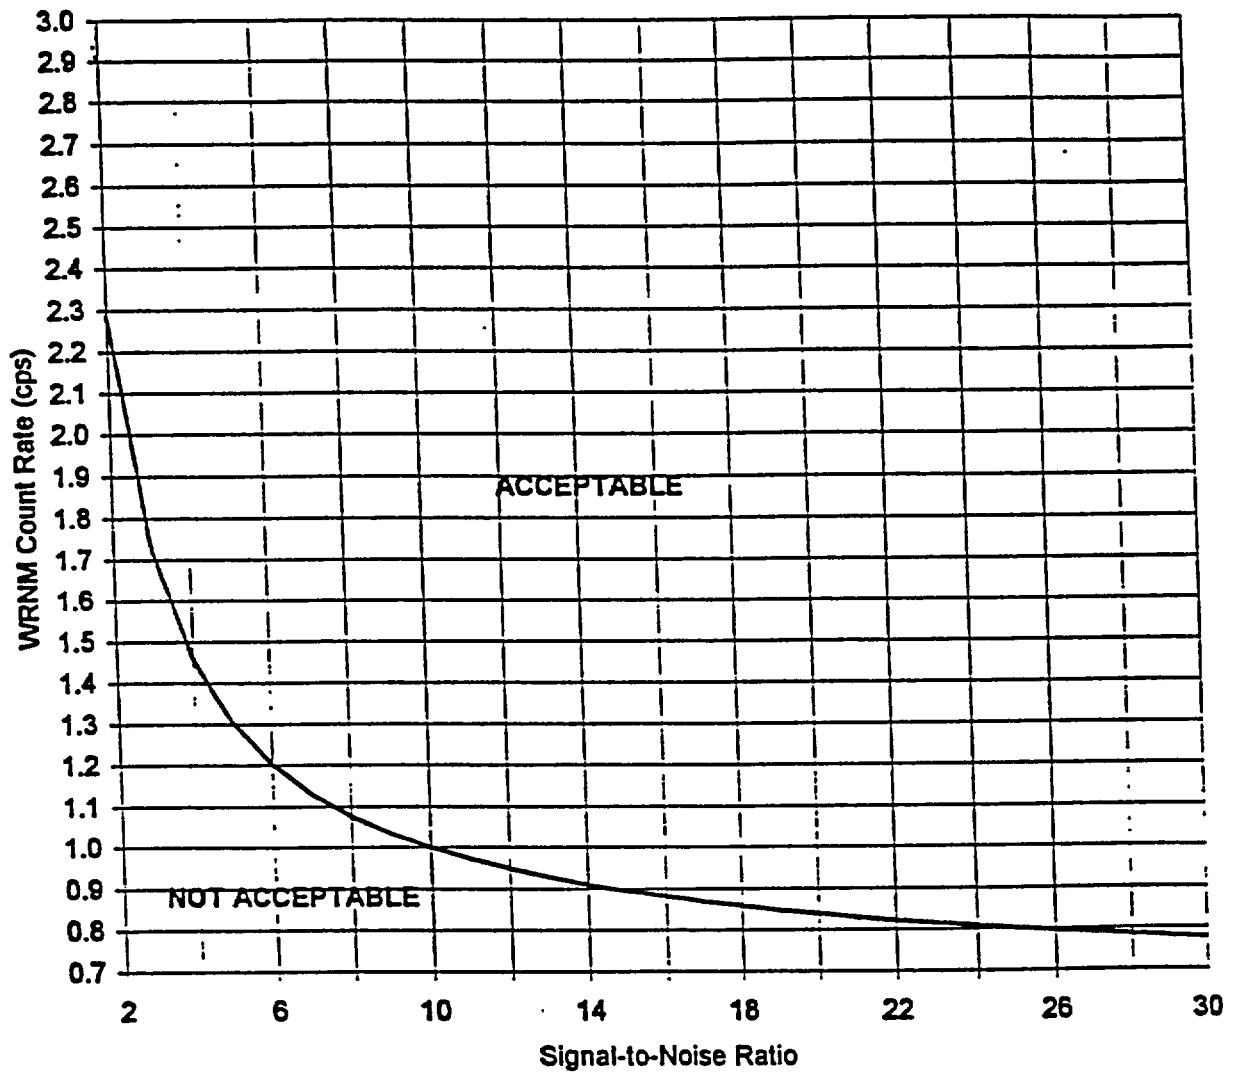


Figure 3.3.1.2-1 (page 1 of 1)  
Minimum WRNM Count Rate Versus Signal to Noise Ratio

### 3.3 INSTRUMENTATION

#### 3.3.2.1 Control Rod Block Instrumentation

LC0 3.3.2.1 The control rod block instrumentation for each Function in Table 3.3.2.1-1 shall be OPERABLE.

APPLICABILITY: According to Table 3.3.2.1-1.

#### ACTIONS

CONDITION	REQUIRED ACTION	COMPLETION TIME
A. One rod block monitor (RBM) channel inoperable.	A.1 Restore RBM channel to OPERABLE status.	24 hours
B. Required Action and associated Completion Time of Condition A not met.  <u>OR</u>  Two RBM channels inoperable.	B.1 Place one RBM channel in trip.	1 hour
C. Rod worth minimizer (RWM) inoperable during reactor startup.	C.1 Suspend control rod movement except by scram.  <u>OR</u>	Immediately  (continued)

ACTIONS

CONDITION	REQUIRED ACTION	COMPLETION TIME
C. (continued)	C.2.1.1 Verify $\geq 12$ rods withdrawn.	Immediately
	<u>OR</u>	
	C.2.1.2 Verify by administrative methods that startup with RWM inoperable has not been performed in the last calendar year.	Immediately
	<u>AND</u>	
	C.2.2 Verify movement of control rods is in compliance with banked position withdrawal sequence (BPWS) by a second licensed operator or other qualified member of the technical staff.	During control rod movement
D. RWM inoperable during reactor shutdown.	D.1 Verify movement of control rods is in accordance with BPWS by a second licensed operator or other qualified member of the technical staff.	During control rod movement

(continued)

ACTIONS (continued)

CONDITION	REQUIRED ACTION	COMPLETION TIME
E. One or more Reactor Mode Switch—Shutdown Position channels inoperable.	E.1 Suspend control rod withdrawal.	Immediately
	AND E.2 Initiate action to fully insert all insertable control rods in core cells containing one or more fuel assemblies.	Immediately

SURVEILLANCE REQUIREMENTS

NOTES

1. Refer to Table 3.3.2.1-1 to determine which SRs apply for each Control Rod Block Function.
2. When an RBM channel is placed in an inoperable status solely for performance of required Surveillances, entry into associated Conditions and Required Actions may be delayed for up to 6 hours provided the associated Function maintains control rod block capability.

SURVEILLANCE	FREQUENCY
SR 3.3.2.1.1 Perform CHANNEL FUNCTIONAL TEST.	184 days

(continued)



SURVEILLANCE REQUIREMENTS (continued)

SURVEILLANCE	FREQUENCY
<p>SR 3.3.2.1.2 -----NOTE-----                      Not required to be performed until 1 hour                      after any control rod is withdrawn at  <math>\leq 10\%</math> RTP in MODE 2.                      -----                      Perform CHANNEL FUNCTIONAL TEST.</p>	92 days
<p>SR 3.3.2.1.3 -----NOTE-----                      Not required to be performed until 1 hour                      after THERMAL POWER is <math>\leq 10\%</math> RTP in                      MODE 1.                      -----                      Perform CHANNEL FUNCTIONAL TEST.</p>	92 days
<p>SR 3.3.2.1.4 -----NOTE-----                      Neutron detectors are excluded.                      -----                      Verify the RBM:                      a. Low Power Range—Upscale Function is                          not bypassed when THERMAL POWER is                          <math>\geq 28.4\%</math> RTP.                      b. Intermediate Power Range—Upscale                          Function is not bypassed when THERMAL                          POWER is <math>\geq 63.4\%</math> RTP.                      c. High Power Range—Upscale Function is                          not bypassed when THERMAL POWER is                          <math>\geq 83.4\%</math> RTP.</p>	24 months

(continued)

SURVEILLANCE REQUIREMENTS (continued)

SURVEILLANCE		FREQUENCY
SR 3.3.2.1.5	-----NOTE----- Neutron detectors are excluded. -----	24 months
	Perform CHANNEL CALIBRATION.	
SR 3.3.2.1.6	Verify the RWM is not bypassed when THERMAL POWER is $\leq$ 10% RTP.	24 months
SR 3.3.2.1.7	-----NOTE----- Not required to be performed until 1 hour after reactor mode switch is in the shutdown position. -----	24 months
	Perform CHANNEL FUNCTIONAL TEST.	
SR 3.3.2.1.8	Verify control rod sequences input to the RWM are in conformance with BPWS.	Prior to declaring RWM OPERABLE following loading of sequence into RWM

Control Rod Block Instrumentation  
3.3.2.1

Table 3.3.2.1-1 (page 1 of 1)  
Control Rod Block Instrumentation

FUNCTION	APPLICABLE MODES OR OTHER SPECIFIED CONDITIONS	REQUIRED CHANNELS	SURVEILLANCE REQUIREMENTS	ALLOWABLE VALUE
1. Rod Block Monitor				
a. Low Power Range - Upscale	(a)	2	SR 3.3.2.1.1 SR 3.3.2.1.4 SR 3.3.2.1.5	(h)
b. Intermediate Power Range - Upscale	(b)	2	SR 3.3.2.1.1 SR 3.3.2.1.4 SR 3.3.2.1.5	(h)
c. High Power Range - Upscale	(c)	2	SR 3.3.2.1.1 SR 3.3.2.1.4 SR 3.3.2.1.5	(h)
d. Inop	(a)	2	SR 3.3.2.1.1	NA
2. Rod Worth Minimizer	1 <sup>(f)</sup> , 2 <sup>(f)</sup>	1	SR 3.3.2.1.2 SR 3.3.2.1.3 SR 3.3.2.1.6 SR 3.3.2.1.8	NA
3. Reactor Mode Switch - Shutdown Position	(g)	2	SR 3.3.2.1.7	NA

- (a) THERMAL POWER  $\geq$  28.4% RTP and MCPR less than the limit specified in the COLR.
- (b) THERMAL POWER  $\geq$  63.4% RTP and MCPR less than the limit specified in the COLR.
- (c) THERMAL POWER  $\geq$  83.4% and MCPR less than the limit specified in the COLR.
- (d) Deleted.
- (e) Deleted.
- (f) With THERMAL POWER  $\leq$  10% RTP.
- (g) Reactor mode switch in the shutdown position.
- (h) Less than or equal to the Allowable Value specified in the COLR.

### 3.3 INSTRUMENTATION

#### 3.3.2.2 Feedwater and Main Turbine High Water Level Trip Instrumentation

LCO 3.3.2.2 Two channels per trip system of the Digital Feedwater Control System (DFCS) high water level trip instrumentation Function shall be OPERABLE.

APPLICABILITY: THERMAL POWER  $\geq$  25% RTP.

#### ACTIONS

-----NOTE-----  
Separate Condition entry is allowed for each channel.  
-----

CONDITION	REQUIRED ACTION	COMPLETION TIME
A. One or more DFCS high water level trip channels inoperable.	A.1 Place channel in trip.	72 hours
B. DFCS high water level trip capability not maintained.	B.1 Restore DFCS high water level trip capability.	2 hours
C. Required Action and associated Completion Time not met.	C.1 Reduce THERMAL POWER to < 25% RTP.	4 hours

## SURVEILLANCE REQUIREMENTS

-----NOTE-----

When a channel is placed in an inoperable status solely for performance of required Surveillances, entry into associated Conditions and Required Actions may be delayed for up to 6 hours provided DFCS high water level trip capability is maintained.

-----

SURVEILLANCE	FREQUENCY
SR 3.3.2.2.1 Perform CHANNEL CHECK.	24 hours
SR 3.3.2.2.2 Perform CHANNEL FUNCTIONAL TEST.	92 days
SR 3.3.2.2.3 Perform CHANNEL CALIBRATION. The Allowable Value shall be $\leq 49.0$ inches.	24 months
SR 3.3.2.2.4 Perform LOGIC SYSTEM FUNCTIONAL TEST including valve actuation.	24 months

### 3.3 INSTRUMENTATION

#### 3.3.3.1 Post Accident Monitoring (PAM) Instrumentation

LC0 3.3.3.1 The PAM instrumentation for each Function in Table 3.3.3.1-1 shall be OPERABLE.

APPLICABILITY: MODES 1 and 2.

#### ACTIONS

- NOTES-----
1. LC0 3.0.4 is not applicable.
  2. Separate Condition entry is allowed for each Function.
- 

CONDITION	REQUIRED ACTION	COMPLETION TIME
A. One or more Functions with one required channel inoperable.	A.1 Restore required channel to OPERABLE status.	30 days
B. Required Action and associated Completion Time of Condition A not met.	B.1 Initiate action in accordance with Specification 5.6.6.	Immediately
C. One or more Functions with two required channels inoperable.	C.1 Restore one required channel to OPERABLE status.	7 days

(continued)

**ACTIONS (continued)**

CONDITION	REQUIRED ACTION	COMPLETION TIME
D. Required Action and associated Completion Time of Condition C not met.	D.1 Enter the Condition referenced in Table 3.3.3.1-1 for the channel.	Immediately
E. As required by Required Action D.1 and referenced in Table 3.3.3.1-1.	E.1 Be in MODE 3.	12 hours
F. As required by Required Action D.1 and referenced in Table 3.3.3.1-1.	F.1 Initiate action in accordance with Specification 5.6.6.	Immediately

**SURVEILLANCE REQUIREMENTS**

SURVEILLANCE	FREQUENCY
SR 3.3.3.1.1 Perform CHANNEL CHECK for each required PAM instrumentation channel.	31 days
SR 3.3.3.1.2 Perform CHANNEL CALIBRATION of the Drywell and Suppression Chamber H <sub>2</sub> & O <sub>2</sub> Analyzers.	92 days
SR 3.3.3.1.3 Perform CHANNEL CALIBRATION for each required PAM instrumentation channel except for the Drywell and Suppression Chamber H <sub>2</sub> & O <sub>2</sub> Analyzers.	24 months

Table 3.3.3.1-1 (page 1 of 1)  
Post Accident Monitoring Instrumentation

FUNCTION	REQUIRED CHANNELS	CONDITIONS REFERENCED FROM REQUIRED ACTION D.1
1. Reactor Pressure	2	E
2. Reactor Vessel Water Level (Wide Range)	2	E
3. Reactor Vessel Water Level (Fuel Zone)	2	E
4. Suppression Chamber Water Level (Wide Range)	2	E
5. Drywell Pressure (Wide Range)	2	E
6. Drywell Pressure (Subatmospheric Range)	2	E
7. Drywell High Range Radiation	2	F
8. PCIV Position	2 per penetration flow path (a)(b)	E
9. Drywell H <sub>2</sub> & O <sub>2</sub> Analyzer	2	E
10. Suppression Chamber H <sub>2</sub> & O <sub>2</sub> Analyzer	2	E
11. Suppression Chamber Water Temperature	2(c)	E

- (a) Not required for isolation valves whose associated penetration flow path is isolated by at least one closed and deactivated automatic valve, closed manual valve, blind flange, or check valve with flow through the valve secured.
- (b) Only one position indication channel is required for penetration flow paths with only one installed control room indication channel.
- (c) Each channel requires 10 resistance temperature detectors (RTDs) to be OPERABLE with no two adjacent RTDs inoperable.



### 3.3 INSTRUMENTATION

#### 3.3.3.2 Remote Shutdown System

LCO 3.3.3.2 The Remote Shutdown System Functions shall be OPERABLE.

APPLICABILITY: MODES 1 and 2.

#### ACTIONS

- NOTES-----
1. LCO 3.0.4 is not applicable.
  2. Separate Condition entry is allowed for each Function.
- 

CONDITION	REQUIRED ACTION	COMPLETION TIME
A. One or more required Functions inoperable.	A.1 Restore required Function to OPERABLE status.	30 days
B. Required Action and associated Completion Time not met.	B.1 Be in MODE 3.	12 hours

#### SURVEILLANCE REQUIREMENTS

SURVEILLANCE REQUIREMENTS	FREQUENCY
SR 3.3.3.2.1 Verify each required control circuit and transfer switch is capable of performing the intended function.	24 months

(continued)

**SURVEILLANCE REQUIREMENTS (continued)**

SURVEILLANCE REQUIREMENTS		FREQUENCY
SR 3.3.3.2.2	Perform CHANNEL CALIBRATION for each required instrumentation channel.	24 months

### 3.3 INSTRUMENTATION

#### 3.3.4.1 Anticipated Transient Without Scram Recirculation Pump Trip (ATWS-RPT) Instrumentation

LCO 3.3.4.1 Two channels per trip system for each ATWS-RPT instrumentation Function listed below shall be OPERABLE:

- a. Reactor Vessel Water Level—Low Low (Level 2); and
- b. Reactor Pressure—High.

APPLICABILITY: MODE 1.

#### ACTIONS

-----NOTE-----  
Separate Condition entry is allowed for each channel.  
-----

CONDITION	REQUIRED ACTION	COMPLETION TIME
A. One or more channels inoperable.	A.1 Restore channel to OPERABLE status.	14 days
	<p><u>OR</u></p> <p>A.2 -----NOTE----- Not applicable if inoperable channel is the result of an inoperable breaker. -----</p> <p>Place channel in trip.</p>	14 days

(continued)

ACTIONS (continued)

CONDITION	REQUIRED ACTION	COMPLETION TIME
B. One Function with ATWS-RPT trip capability not maintained.	B.1 Restore ATWS-RPT trip capability.	72 hours
C. Both Functions with ATWS-RPT trip capability not maintained.	C.1 Restore ATWS-RPT trip capability for one Function.	1 hour
D. Required Action and associated Completion Time not met.	D.1 Remove the associated recirculation pump from service.	6 hours
	<u>OR</u> D.2 Be in MODE 2.	6 hours

SURVEILLANCE REQUIREMENTS

-----NOTE-----  
When a channel is placed in an inoperable status solely for performance of required Surveillances, entry into associated Conditions and Required Actions may be delayed for up to 6 hours provided the associated Function maintains ATWS-RPT trip capability.  
-----

SURVEILLANCE	FREQUENCY
SR 3.3.4.1.1 Perform CHANNEL CHECK.	12 hours

(continued)

**SURVEILLANCE REQUIREMENTS (continued)**

SURVEILLANCE		FREQUENCY
SR 3.3.4.1.2	Perform CHANNEL FUNCTIONAL TEST.	92 days
SR 3.3.4.1.3	Perform CHANNEL CALIBRATION. The Allowable Values shall be:  a. Reactor Vessel Water Level—Low Low (Level 2): $\geq -48.0$ inches; and  b. Reactor Pressure—High: $\leq 1106.0$ psig.	24 months
SR 3.3.4.1.4	Perform LOGIC SYSTEM FUNCTIONAL TEST including breaker actuation.	24 months

### 3.3 INSTRUMENTATION

#### 3.3.4.2 End of Cycle Recirculation Pump Trip (EOC-RPT) Instrumentation

LCO 3.3.4.2 a. Two channels per trip system for each EOC-RPT instrumentation Function listed below shall be OPERABLE:

1. Turbine Stop Valve (TSV) - Closure; and
2. Turbine Control Valve (TCV) Fast Closure, Trip Oil Pressure - Low.

OR

b. The following limits are made applicable:

1. LCO 3.2.1, "AVERAGE PLANAR LINEAR HEAT GENERATION RATE (APLHGR)," limits for inoperable EOC-RPT as specified in the COLR; and
2. LCO 3.2.2, "MINIMUM CRITICAL POWER RATIO (MCPR)," limits for inoperable EOC-RPT as specified in the COLR.

APPLICABILITY: THERMAL POWER  $\geq$  30% RTP.

#### ACTIONS

-----NOTE-----  
Separate Condition entry is allowed for each channel.  
-----

CONDITION	REQUIRED ACTION	COMPLETION TIME
<del>A.</del> One or more channels inoperable.	A.1 Restore channel to OPERABLE status.	72 hours
	<u>OR</u>	
	A.2 -----NOTE----- Not applicable if inoperable channel is the result of an inoperable breaker. ----- Place channel in trip.	72 hours

(continued)

ACTIONS (continued)

CONDITION	REQUIRED ACTION	COMPLETION TIME
B. One or more Functions with EOC-RPT trip capability not maintained.	B.1 Restore EOC-RPT trip capability.	2 hours
C. Required Action and associated Completion Time not met.	C.1 Remove the associated recirculation pump from service.	4 hours
	<u>OR</u> C.2 Reduce THERMAL POWER to < 30% RTP.	4 hours

SURVEILLANCE REQUIREMENTS

-----NOTE-----

When a channel is placed in an inoperable status solely for performance of required Surveillances, entry into associated Conditions and Required Actions may be delayed for up to 6 hours provided the associated Function maintains EOC-RPT trip capability.

SURVEILLANCE	FREQUENCY
SR 3.3.4.2.1 Perform CHANNEL FUNCTIONAL TEST.	92 days

(continued)

SURVEILLANCE REQUIREMENTS (continued)

SURVEILLANCE	FREQUENCY
<p>SR 3.3.4.2.2 Perform CHANNEL CALIBRATION. The Allowable Values shall be:</p> <p>TSV-Closure: <math>\leq 10\%</math> closed; and</p> <p>TCV Fast Closure, Trip Oil Pressure-Low: <math>\geq 500</math> psig.</p>	24 months
<p>SR 3.3.4.2.3 Perform LOGIC SYSTEM FUNCTIONAL TEST including breaker actuation.</p>	24 months
<p>SR 3.3.4.2.4 Verify TSV-Closure and TCV Fast Closure, Trip Oil Pressure-Low Functions are not bypassed when THERMAL POWER is <math>\geq 30\%</math> RTP.</p>	24 months
<p>SR 3.3.4.2.5 -----NOTE----- Breaker interruption time may be assumed from the most recent performance of SR 3.3.4.2.6. ----- Verify the EOC-RPT SYSTEM RESPONSE TIME is within limits.</p>	24 months on a STAGGERED TEST BASIS
<p>SR 3.3.4.2.6 Determine RPT breaker interruption time.</p>	60 months



### 3.3 INSTRUMENTATION

#### 3.3.5.1 Emergency Core Cooling System (ECCS) Instrumentation

LCO 3.3.5.1 The ECCS instrumentation for each Function in Table 3.3.5.1-1 shall be OPERABLE.

APPLICABILITY: According to Table 3.3.5.1-1.

#### ACTIONS

-----NOTE-----  
Separate Condition entry is allowed for each channel.  
-----

CONDITION	REQUIRED ACTION	COMPLETION TIME
A. One or more channels inoperable.	A.1 Enter the Condition referenced in Table 3.3.5.1-1 for the channel.	Immediately
B. As required by Required Action A.1 and referenced in Table 3.3.5.1-1.	<p>B.1 -----NOTES-----</p> <p>1. Only applicable in MODES 1, 2, and 3.</p> <p>2. Only applicable for Functions 1.a, 1.b, 2.a, and 2.b.</p> <p>-----</p> <p>Declare supported feature(s) inoperable when its redundant feature ECCS initiation capability is inoperable.</p> <p><u>AND</u></p>	<p>1 hour from discovery of loss of feature initiation capability in both trip systems</p> <p>(continued)</p>

ACTIONS

CONDITION	REQUIRED ACTION	COMPLETION TIME
B. (continued)	<p>B.2 -----NOTE----- Only applicable for Functions 3.a and 3.b. -----</p> <p>Declare High Pressure Coolant Injection (HPCI) System inoperable.</p>	1 hour from discovery of loss of HPCI initiation capability
	<p><u>AND</u></p> <p>B.3 Place channel in trip.</p>	24 hours
C. As required by Required Action A.1 and referenced in Table 3.3.5.1-1.	<p>C.1 -----NOTES----- 1. Only applicable in MODES 1, 2, and 3.  2. Only applicable for Functions 1.c, 1.e, 1.f, 2.c, 2.d, and 2.f. -----</p> <p>Declare supported feature(s) inoperable when its redundant feature ECCS initiation capability is inoperable.</p>	1 hour from discovery of loss of subsystem initiation capability in both subsystems
	<p><u>AND</u></p> <p>C.2 Restore channel to OPERABLE status.</p>	24 hours

(continued)

ACTIONS (continued)

CONDITION	REQUIRED ACTION	COMPLETION TIME
D. As required by Required Action A.1 and referenced in Table 3.3.5.1-1.	<p>D.1 -----NOTE----- Only applicable if HPCI pump suction is not aligned to the suppression pool. -----</p> <p>Declare HPCI System inoperable.</p>	1 hour from discovery of loss of HPCI initiation capability
	<u>AND</u>	
	D.2.1 Place channel in trip.	24 hours
	<u>OR</u>	
	D.2.2 Align the HPCI pump suction to the suppression pool.	24 hours

(continued)

ACTIONS (continued)

CONDITION	REQUIRED ACTION	COMPLETION TIME
E. As required by Required Action A.1 and referenced in Table 3.3.5.1-1.	<p>E.1</p> <p>-----NOTES-----</p> <p>1. Only applicable in MODES 1, 2, and 3.</p> <p>2. Only applicable to Functions 1.d and 2.g.</p> <p>-----</p> <p>Declare supported feature(s) inoperable when its redundant feature ECCS initiation capability is inoperable.</p>	1 hour from discovery of loss of subsystem initiation capability in both subsystems
	<p><u>AND</u></p> <p>E.2 Restore channel to OPERABLE status.</p>	7 days

(continued)

ACTIONS (continued)

CONDITION	REQUIRED ACTION	COMPLETION TIME
F. As required by Required Action A.1 and referenced in Table 3.3.5.1-1.	F.1 Declare Automatic Depressurization System (ADS) valves inoperable.	1 hour from discovery of loss of ADS initiation capability in both trip systems
	<u>AND</u>	
	F.2 Place channel in trip.	96 hours from discovery of inoperable channel concurrent with HPCI or reactor core isolation cooling (RCIC) inoperable
		<u>AND</u> 8 days

(continued)

ACTIONS (continued)

CONDITION	REQUIRED ACTION	COMPLETION TIME
G. As required by Required Action A.1 and referenced in Table 3.3.5.1-1.	G.1 Declare ADS valves inoperable.	1 hour from discovery of loss of ADS initiation capability in both trip systems
	<u>AND</u> G.2 Restore channel to OPERABLE status.	96 hours from discovery of inoperable channel concurrent with HPCI or RCIC inoperable  <u>AND</u> 8 days
H. Required Action and associated Completion Time of Condition B, C, D, E, F, or G not met.	H.1 Declare associated supported feature(s) inoperable.	Immediately

## SURVEILLANCE REQUIREMENTS

### -----NOTES-----

1. Refer to Table 3.3.5.1-1 to determine which SRs apply for each ECCS Function.
2. When a channel is placed in an inoperable status solely for performance of required Surveillances, entry into associated Conditions and Required Actions may be delayed as follows: (a) for up to 6 hours for Functions 3.c and 3.f; and (b) for up to 6 hours for Functions other than 3.c and 3.f provided the associated Function or the redundant Function maintains ECCS initiation capability.

SURVEILLANCE	FREQUENCY
SR 3.3.5.1.1 Perform CHANNEL CHECK.	12 hours
SR 3.3.5.1.2 Perform CHANNEL FUNCTIONAL TEST.	92 days
SR 3.3.5.1.3 Perform CHANNEL CALIBRATION.	92 days
SR 3.3.5.1.4 Perform CHANNEL CALIBRATION.	24 months
SR 3.3.5.1.5 Perform LOGIC SYSTEM FUNCTIONAL TEST.	24 months

Table 3.3.5.1-1 (page 1 of 5)  
Emergency Core Cooling System Instrumentation

FUNCTION	APPLICABLE MODES OR OTHER SPECIFIED CONDITIONS	REQUIRED CHANNELS PER FUNCTION	CONDITIONS REFERENCED FROM REQUIRED ACTION A.1	SURVEILLANCE REQUIREMENTS	ALLOWABLE VALUE
1. Core Spray System					
a. Reactor Vessel Water Level —Low Low Low (Level 1)	1,2,3, 4(a), 5(a)	4(b)	B	SR 3.3.5.1.1 SR 3.3.5.1.2 SR 3.3.5.1.4 SR 3.3.5.1.5	≥ -160.0 inches
b. Drywell Pressure —High	1,2,3	4(b)	B	SR 3.3.5.1.1 SR 3.3.5.1.2 SR 3.3.5.1.4 SR 3.3.5.1.5	≤ 2.0 psig
c. Reactor Pressure —Low (Injection Permissive)	1,2,3	4	C	SR 3.3.5.1.1 SR 3.3.5.1.2 SR 3.3.5.1.4 SR 3.3.5.1.5	≥ 425.0 psig and ≤ 475.0 psig
	4(a), 5(a)	4	B	SR 3.3.5.1.1 SR 3.3.5.1.2 SR 3.3.5.1.4 SR 3.3.5.1.5	≥ 425.0 psig and ≤ 475.0 psig
d. Core Spray Pump Discharge Flow —Low (Bypass)	1,2,3, 4(a), 5(a)	4 (1 per pump)	E	SR 3.3.5.1.2 SR 3.3.5.1.4	≥ 319.0 psid and ≤ 351.0 psid
e. Core Spray Pump Start- Time Delay Relay (loss of offsite power)	1,2,3 4(a), 5(a)	4 (1 per pump)	C	SR 3.3.5.1.4 SR 3.3.5.1.5	≥ 5.0 seconds and ≤ 7.0 seconds
f. Core Spray Pump Start- Time Delay Relay (offsite power available)					
Pumps A,C	1,2,3 4(a), 5(a)	2 (1 per pump)	C	SR 3.3.5.1.4 SR 3.3.5.1.5	≥ 12.1 seconds and ≤ 13.9 seconds
Pumps B,D	1,2,3 4(a), 5(a)	2 (1 per pump)	C	SR 3.3.5.1.4 SR 3.3.5.1.5	≥ 21.4 seconds and ≤ 24.6 seconds

(continued)

(a) When associated subsystem(s) are required to be OPERABLE.

(b) Also required to initiate the associated diesel generator (DG).



Table 3.3.5.1-1 (page 2 of 5)  
Emergency Core Cooling System Instrumentation

FUNCTION	APPLICABLE MODES OR OTHER SPECIFIED CONDITIONS	REQUIRED CHANNELS PER FUNCTION	CONDITIONS REFERENCED FROM REQUIRED ACTION A.1	SURVEILLANCE REQUIREMENTS	ALLOWABLE VALUE
<b>2. Low Pressure Coolant Injection (LPCI) System</b>					
a. Reactor Vessel Water Level —Low Low Low (Level 1)	1,2,3, 4(a), 5(a)	4	B	SR 3.3.5.1.1 SR 3.3.5.1.2 SR 3.3.5.1.4 SR 3.3.5.1.5	≥ -160 inches
b. Drywell Pressure —High	1,2,3	4	B	SR 3.3.5.1.1 SR 3.3.5.1.2 SR 3.3.5.1.4 SR 3.3.5.1.5	≤ 2.0 psig
c. Reactor Pressure —Low (Injection Permissive)	1,2,3	4	C	SR 3.3.5.1.1 SR 3.3.5.1.2 SR 3.3.5.1.4 SR 3.3.5.1.5	≥ 425.0 psig and ≤ 475.0 psig
	4(a), 5(a)	4	B	SR 3.3.5.1.1 SR 3.3.5.1.2 SR 3.3.5.1.4 SR 3.3.5.1.5	≥ 425.0 psig and ≤ 475.0 psig
d. Reactor Pressure —Low Low (Recirculation Discharge Valve Permissive)	1(c), 2(c), 3(c)	4	C	SR 3.3.5.1.1 SR 3.3.5.1.2 SR 3.3.5.1.4 SR 3.3.5.1.5	≥ 211.0 psig
e. Reactor Vessel Shroud Level —Level 0	1,2,3	2	B	SR 3.3.5.1.1 SR 3.3.5.1.2 SR 3.3.5.1.4 SR 3.3.5.1.5	≥ -226.0 inches
f. Low Pressure Coolant Injection Pump Start —Time Delay Relay (offsite power available)	1,2,3, 4(a), 5(a)	8 (2 per pump)	C	SR 3.3.5.1.4 SR 3.3.5.1.5	
Pumps A,B					≥ 1.9 seconds and ≤ 2.1 seconds
Pumps C,D					≥ 7.5 seconds and ≤ 8.5 seconds
g. Low Pressure Coolant Injection Pump Discharge Flow —Low (Bypass)	1,2,3 4(a), 5(a)	4 (1 per pump)	E	SR 3.3.5.1.2 SR 3.3.5.1.4 SR 3.3.5.1.5	≥ 299.0 psid and ≤ 331.0 psid

(continued)

(a) When associated subsystem(s) are required to be OPERABLE.

(c) With associated recirculation pump discharge valve open.

Table 3.3.5.1-1 (page 3 of 5)  
Emergency Core Cooling System Instrumentation

FUNCTION	APPLICABLE MODES OR OTHER SPECIFIED CONDITIONS	REQUIRED CHANNELS PER FUNCTION	CONDITIONS REFERENCED FROM REQUIRED ACTION A.1	SURVEILLANCE REQUIREMENTS	ALLOWABLE VALUE
<b>3. High Pressure Coolant Injection (HPCI) System</b>					
a. Reactor Vessel Water Level —Low Low (Level 2)	1, 2(d), 3(d)	4	B	SR 3.3.5.1.1 SR 3.3.5.1.2 SR 3.3.5.1.4 SR 3.3.5.1.5	≥ -48.0 inches
b. Drywell Pressure —High	1, 2(d), 3(d)	4	B	SR 3.3.5.1.1 SR 3.3.5.1.2 SR 3.3.5.1.4 SR 3.3.5.1.5	≤ 2.0 psig
c. Reactor Vessel Water Level —High (Level 8)	1, 2(d), 3(d)	2	C	SR 3.3.5.1.1 SR 3.3.5.1.2 SR 3.3.5.1.4 SR 3.3.5.1.5	≤ 46.0 inches
d. Condensate Storage Tank Level —Low	1, 2(d), 3(d)	2	D	SR 3.3.5.1.2 SR 3.3.5.1.4 SR 3.3.5.1.5	≥ 5.25 ft above tank bottom
e. Suppression Pool Water Level —High	1, 2(d), 3(d)	2	D	SR 3.3.5.1.2 SR 3.3.5.1.4 SR 3.3.5.1.5	≤ 5.0 inches above torus midpoint
f. High Pressure Coolant Injection Pump Discharge Flow —Low (Bypass)	1, 2(d), 3(d)	1	E	SR 3.3.5.1.2 SR 3.3.5.1.4 SR 3.3.5.1.5	≥ 3.5 in-wc and ≤ 19.0 in-wc
<b>4. Automatic Depressurization System (ADS) Trip System A</b>					
a. Reactor Vessel Water Level —Low Low Low (Level 1)	1, 2(e), 3(e)	2	F	SR 3.3.5.1.1 SR 3.3.5.1.2 SR 3.3.5.1.4 SR 3.3.5.1.5	≥ -160.0 inches
b. Drywell Pressure —High	1, 2(e), 3(e)	2	F	SR 3.3.5.1.1 SR 3.3.5.1.2 SR 3.3.5.1.4 SR 3.3.5.1.5	≤ 2.0 psig
c. Automatic Depressurization System Initiation Timer	1, 2(e), 3(e)	1	G	SR 3.3.5.1.4 SR 3.3.5.1.5	≤ 115.0 seconds

(continued)

(d) With reactor steam dome pressure > 150 psig.

(e) With reactor steam dome pressure > 100 psig.

Table 3.3.5.1-1 (page 4 of 5)  
Emergency Core Cooling System Instrumentation

FUNCTION	APPLICABLE MODES OR OTHER SPECIFIED CONDITIONS	REQUIRED CHANNELS PER FUNCTION	CONDITIONS REFERENCED FROM REQUIRED ACTION A.1	SURVEILLANCE REQUIREMENTS	ALLOWABLE VALUE
4. ADS Trip System A (continued)					
d. Reactor Vessel Water Level—Low Low Low (Level 1), (Permissive)	1, 2(e), 3(e)	2	F	SR 3.3.5.1.1 SR 3.3.5.1.2 SR 3.3.5.1.4 SR 3.3.5.1.5	≥ -160.0 inches
e. Reactor Vessel Water Confirmatory Level—Low (Level 4)	1, 2(e), 3(e)	1	F	SR 3.3.5.1.1 SR 3.3.5.1.2 SR 3.3.5.1.4 SR 3.3.5.1.5	≥ 6.0 inches
f. Core Spray Pump Discharge Pressure—High	1, 2(e), 3(e)	4	G	SR 3.3.5.1.3 SR 3.3.5.1.5	≥ 175.0 psig and ≤ 195.0 psig
g. Low Pressure Coolant Injection Pump Discharge Pressure—High	1, 2(e), 3(e)	8	G	SR 3.3.5.1.3 SR 3.3.5.1.5	≥ 40.0 psig and ≤ 60.0 psig
h. Automatic Depressurization System Low Water Level Actuation Timer	1, 2(e), 3(e)	2	G	SR 3.3.5.1.4 SR 3.3.5.1.5	≤ 9.5 minutes
5. ADS Trip System B					
a. Reactor Vessel Water Level—Low Low Low (Level 1)	1, 2(e), 3(e)	2	F	SR 3.3.5.1.1 SR 3.3.5.1.2 SR 3.3.5.1.4 SR 3.3.5.1.5	≥ -160.0 inches
b. Drywell Pressure—High	1, 2(e), 3(e)	2	F	SR 3.3.5.1.1 SR 3.3.5.1.2 SR 3.3.5.1.4 SR 3.3.5.1.5	≤ 2.0 psig
c. Automatic Depressurization System Initiation Timer	1, 2(e), 3(e)	1	G	SR 3.3.5.1.4 SR 3.3.5.1.5	≤ 115.0 seconds
d. Reactor Vessel Water Level—Low Low Low (Level 1), (Permissive)	1, 2(e), 3(e)	2	F	SR 3.3.5.1.1 SR 3.3.5.1.2 SR 3.3.5.1.4 SR 3.3.5.1.5	≥ -160.0 inches

(continued)

(e) With reactor steam dome pressure &gt; 100 psig.

Table 3.3.5.1-1 (page 5 of 5)  
Emergency Core Cooling System Instrumentation

FUNCTION	APPLICABLE MODES OR OTHER SPECIFIED CONDITIONS	REQUIRED CHANNELS PER FUNCTION	CONDITIONS REFERENCED FROM REQUIRED ACTION A.1	SURVEILLANCE REQUIREMENTS	ALLOWABLE VALUE
5. ADS Trip System B (continued)					
e. Reactor Vessel Water Confirmatory Level —Low (Level 4)	1, 2(e), 3(e)	1	F	SR 3.3.5.1.1 SR 3.3.5.1.2 SR 3.3.5.1.4 SR 3.3.5.1.5	≥ 6.0 inches
f. Core Spray Pump Discharge Pressure —High	1, 2(e), 3(e)	4	G	SR 3.3.5.1.3 SR 3.3.5.1.5	≥ 175.0 psig and ≤ 195.0 psig
g. Low Pressure Coolant Injection Pump Discharge Pressure —High	1, 2(e), 3(e)	8	G	SR 3.3.5.1.3 SR 3.3.5.1.5	≥ 40.0 psig and ≤ 60.0 psig
h. Automatic Depressurization System Low Water Level Actuation Timer	1, 2(e), 3(e)	2	G	SR 3.3.5.1.4 SR 3.3.5.1.5	≤ 9.5 minutes

(e) With reactor steam dome pressure &gt; 100 psig.

### 3.3 INSTRUMENTATION

#### 3.3.5.2 Reactor Core Isolation Cooling (RCIC) System Instrumentation

LCO 3.3.5.2 The RCIC System instrumentation for each Function in Table 3.3.5.2-1 shall be OPERABLE.

APPLICABILITY: MODE 1,  
MODES 2 and 3 with reactor steam dome pressure > 150 psig.

#### ACTIONS

-----NOTE-----  
Separate Condition entry is allowed for each channel.  
-----

CONDITION	REQUIRED ACTION	COMPLETION TIME
A. One or more channels inoperable.	A.1 Enter the Condition referenced in Table 3.3.5.2-1 for the channel.	Immediately
B. As required by Required Action A.1 and referenced in Table 3.3.5.2-1.	B.1 Declare RCIC System inoperable.	1 hour from discovery of loss of RCIC initiation capability
	<u>AND</u> B.2 Place channel in trip.	24 hours
C. As required by Required Action A.1 and referenced in Table 3.3.5.2-1.	C.1 Restore channel to OPERABLE status.	24 hours

(continued)

ACTIONS (continued)

CONDITION	REQUIRED ACTION	COMPLETION TIME
D. As required by Required Action A.1 and referenced in Table 3.3.5.2-1.	D.1 -----NOTE----- Only applicable if RCIC pump suction is not aligned to the suppression pool. -----  Declare RCIC System inoperable.	1 hour from discovery of loss of RCIC initiation capability
	<u>AND</u>	
	D.2.1 Place channel in trip.	24 hours
	<u>OR</u>  D.2.2 Align RCIC pump suction to the suppression pool.	24 hours
E. Required Action and associated Completion Time of Condition B, C, or D not met.	E.1 Declare RCIC System inoperable.	Immediately

# SURVEILLANCE REQUIREMENTS

## -----NOTES-----

1. Refer to Table 3.3.5.2-1 to determine which SRs apply for each RCIC Function.
2. When a channel is placed in an inoperable status solely for performance of required Surveillances, entry into associated Conditions and Required Actions may be delayed as follows: (a) for up to 6 hours for Function 2; and (b) for up to 6 hours for Functions 1 and 3 provided the associated Function maintains RCIC initiation capability.

SURVEILLANCE	FREQUENCY
SR 3.3.5.2.1 Perform CHANNEL CHECK.	12 hours
SR 3.3.5.2.2 Perform CHANNEL FUNCTIONAL TEST.	92 days
SR 3.3.5.2.3 Perform CHANNEL CALIBRATION.	24 months
SR 3.3.5.2.4 Perform LOGIC SYSTEM FUNCTIONAL TEST.	24 months

Table 3.3.5.2-1 (page 1 of 1)  
Reactor Core Isolation Cooling System Instrumentation

FUNCTION	REQUIRED CHANNELS PER FUNCTION	CONDITIONS REFERENCED FROM REQUIRED ACTION A.1	SURVEILLANCE REQUIREMENTS	ALLOWABLE VALUE
1. Reactor Vessel Water Level —Low Low (Level 2)	4	B	SR 3.3.5.2.1 SR 3.3.5.2.2 SR 3.3.5.2.3 SR 3.3.5.2.4	$\geq -48.0$ inches
2. Reactor Vessel Water Level —High (Level 8)	2	C	SR 3.3.5.2.1 SR 3.3.5.2.2 SR 3.3.5.2.3 SR 3.3.5.2.4	$\leq 46.0$ inches
3. Condensate Storage Tank Level —Low	2	D	SR 3.3.5.2.1 SR 3.3.5.2.2 SR 3.3.5.2.3 SR 3.3.5.2.4	$\geq 5.25$ ft above tank bottom



### 3.3 INSTRUMENTATION

#### 3.3.6.1 Primary Containment Isolation Instrumentation

LCO 3.3.6.1 The primary containment isolation instrumentation for each Function in Table 3.3.6.1-1 shall be OPERABLE.

APPLICABILITY: According to Table 3.3.6.1-1.

#### ACTIONS

-----NOTE-----  
Separate Condition entry is allowed for each channel.  
-----

CONDITION	REQUIRED ACTION	COMPLETION TIME
A. One or more required channels inoperable.	A.1 Place channel in trip.	12 hours for Functions 1.d, 2.a, and 2.b  <u>AND</u> 24 hours for Functions other than Functions 1.d, 2.a, and 2.b
B. One or more Functions with isolation capability not maintained.	B.1 Restore isolation capability.	1 hour
C. Required Action and associated Completion Time of Condition A or B not met.	C.1 Enter the Condition referenced in Table 3.3.6.1-1 for the channel.	Immediately

(continued)

ACTIONS (continued)

CONDITION	REQUIRED ACTION	COMPLETION TIME
D. As required by Required Action C.1 and referenced in Table 3.3.6.1-1.	D.1 Isolate associated main steam line (MSL).	12 hours
	<u>OR</u>	
	D.2.1 Be in MODE 3.	12 hours
	<u>AND</u>	
	D.2.2 Be in MODE 4.	36 hours
E. As required by Required Action C.1 and referenced in Table 3.3.6.1-1.	E.1 Be in MODE 2.	6 hours
F. As required by Required Action C.1 and referenced in Table 3.3.6.1-1.	F.1 Isolate the affected penetration flow path(s).	1 hour
G. As required by Required Action C.1 and referenced in Table 3.3.6.1-1.	G.1 Be in MODE 3.	12 hours
	<u>AND</u>	
<u>OR</u>	G.2 Be in MODE 4.	36 hours
Required Action and associated Completion Time of Condition F not met.		

(continued)

ACTIONS (continued)

CONDITION	REQUIRED ACTION	COMPLETION TIME
H. As required by Required Action C.1 and referenced in Table 3.3.6.1-1.	H.1 Declare associated standby liquid control (SLC) subsystem inoperable.	1 hour
	<u>OR</u> H.2 Isolate the Reactor Water Cleanup System.	1 hour
I. As required by Required Action C.1 and referenced in Table 3.3.6.1-1.	I.1 Initiate action to restore channel to OPERABLE status.	Immediately
	<u>OR</u> I.2 Initiate action to isolate the Residual Heat Removal (RHR) Shutdown Cooling System.	Immediately

# SURVEILLANCE REQUIREMENTS

## -----NOTES-----

1. Refer to Table 3.3.6.1-1 to determine which SRs apply for each Primary Containment Isolation Function.
2. When a channel is placed in an inoperable status solely for performance of required Surveillances, entry into associated Conditions and Required Actions may be delayed for up to 6 hours provided the associated Function maintains primary containment isolation capability.

SURVEILLANCE		FREQUENCY
SR 3.3.6.1.1	Perform CHANNEL CHECK.	12 hours
SR 3.3.6.1.2	Perform CHANNEL FUNCTIONAL TEST.	92 days
SR 3.3.6.1.3	-----NOTE----- For Function 1.d, radiation detectors are excluded. ----- Perform CHANNEL CALIBRATION.	92 days
SR 3.3.6.1.4	Perform CHANNEL CALIBRATION.	18 months
SR 3.3.6.1.5	Perform CHANNEL CALIBRATION.	24 months
SR 3.3.6.1.6	Calibrate each radiation detector.	24 months
SR 3.3.6.1.7	Perform LOGIC SYSTEM FUNCTIONAL TEST.	24 months

Primary Containment Isolation Instrumentation  
3.3.6.1

Table 3.3.6.1-1 (page 1 of 3)  
Primary Containment Isolation Instrumentation

FUNCTION	APPLICABLE MODES OR OTHER SPECIFIED CONDITIONS	REQUIRED CHANNELS PER TRIP SYSTEM	CONDITIONS REFERENCED FROM REQUIRED ACTION C.1	SURVEILLANCE REQUIREMENTS	ALLOWABLE VALUE
<b>1. Main Steam Line Isolation</b>					
a. Reactor Vessel Water Level —Low Low Low (Level 1)	1,2,3	2	D	SR 3.3.6.1.1 SR 3.3.6.1.2 SR 3.3.6.1.5 SR 3.3.6.1.7	≥ -160.0 inches
b. Main Steam Line Pressure —Low	1	2	E	SR 3.3.6.1.3 SR 3.3.6.1.7	≥ 850.0 psig
c. Main Steam Line Flow —High	1,2,3	2 per MSL	D	SR 3.3.6.1.1 SR 3.3.6.1.2 SR 3.3.6.1.5 SR 3.3.6.1.7	≤ 123.3 psid
d. Main Steam Line —High Radiation	1,2,3	2	D	SR 3.3.6.1.1 SR 3.3.6.1.3 SR 3.3.6.1.6 SR 3.3.6.1.7	≤ 15 X Full Power Background
e. Main Steam Tunnel Temperature —High	1,2,3	8	D	SR 3.3.6.1.1 SR 3.3.6.1.2 SR 3.3.6.1.5 SR 3.3.6.1.7	≤ 200.0°F
<b>2. Primary Containment Isolation</b>					
a. Reactor Vessel Water Level —Low (Level 3)	1,2,3	2	G	SR 3.3.6.1.1 SR 3.3.6.1.2 SR 3.3.6.1.5 SR 3.3.6.1.7	≥ 1.0 inches
b. Drywell Pressure —High	1,2,3	2	G	SR 3.3.6.1.1 SR 3.3.6.1.2 SR 3.3.6.1.5 SR 3.3.6.1.7	≤ 2.0 psig
c. Main Stack Monitor Radiation —High	1,2,3	1	F	SR 3.3.6.1.1 SR 3.3.6.1.2 SR 3.3.6.1.4 SR 3.3.6.1.7	≤ 2 X 10 <sup>-2</sup> μCi/cc
d. Reactor Building Ventilation Exhaust Radiation —High	1,2,3	2	G	SR 3.3.6.1.1 SR 3.3.6.1.3 SR 3.3.6.1.7	≤ 16.0 mR/hr
e. Refueling Floor Ventilation Exhaust Radiation —High	1,2,3	2	G	SR 3.3.6.1.1 SR 3.3.6.1.3 SR 3.3.6.1.7	≤ 16.0 mR/hr

(continued)

Primary Containment Isolation Instrumentation  
3.3.6.1

Table 3.3.6.1-1 (page 2 of 3)  
Primary Containment Isolation Instrumentation

FUNCTION	APPLICABLE MODES OR OTHER SPECIFIED CONDITIONS	REQUIRED CHANNELS PER TRIP SYSTEM	CONDITIONS REFERENCED FROM REQUIRED ACTION C.1	SURVEILLANCE REQUIREMENTS	ALLOWABLE VALUE
<b>3. High Pressure Coolant Injection (HPCI) System Isolation</b>					
a. HPCI Steam Line Flow—High	1,2,3	1	F	SR 3.3.6.1.3 SR 3.3.6.1.7	≤ 225.0 in-wc
b. HPCI Steam Line Flow—Time Delay Relays	1,2,3	1	F	SR 3.3.6.1.5 SR 3.3.6.1.7	≤ 10.0 seconds
c. HPCI Steam Supply Line Pressure—Low	1,2,3	2	F	SR 3.3.6.1.3 SR 3.3.6.1.7	≥ 60.0 psig
d. Drywell Pressure—High (Vacuum Breakers)	1,2,3	2	F	SR 3.3.6.1.1 SR 3.3.6.1.2 SR 3.3.6.1.5 SR 3.3.6.1.7	≤ 2.0 psig
e. HPCI Compartment and Steam Line Area Temperature—High	1,2,3	8	F	SR 3.3.6.1.1 SR 3.3.6.1.2 SR 3.3.6.1.5 SR 3.3.6.1.7	≤ 200.0°F
<b>4. Reactor Core Isolation Cooling (RCIC) System Isolation</b>					
a. RCIC Steam Line Flow—High	1,2,3	1	F	SR 3.3.6.1.3 SR 3.3.6.1.7	≤ 450.0 in-wc
b. RCIC Steam Line Flow—Time Delay Relays	1,2,3	1	F	SR 3.3.6.1.5 SR 3.3.6.1.7	≤ 10.0 seconds
c. RCIC Steam Supply Line Pressure—Low	1,2,3	2	F	SR 3.3.6.1.3 SR 3.3.6.1.7	≥ 60.0 psig
d. Drywell Pressure—High (Vacuum Breakers)	1,2,3	2	F	SR 3.3.6.1.1 SR 3.3.6.1.2 SR 3.3.6.1.5 SR 3.3.6.1.7	≤ 2.0 psig
e. RCIC Compartment and Steam Line Area Temperature—High	1,2,3	8	F	SR 3.3.6.1.1 SR 3.3.6.1.2 SR 3.3.6.1.5 SR 3.3.6.1.7	≤ 200.0°F

(continued)

Primary Containment Isolation Instrumentation  
3.3.6.1

Table 3.3.6.1-1 (page 3 of 3)  
Primary Containment Isolation Instrumentation

FUNCTION	APPLICABLE MODES OR OTHER SPECIFIED CONDITIONS	REQUIRED CHANNELS PER TRIP SYSTEM	CONDITIONS REFERENCED FROM REQUIRED ACTION C.1	SURVEILLANCE REQUIREMENTS	ALLOWABLE VALUE
5. Reactor Water Cleanup (RWCU) System Isolation					
a. RWCU Flow—High	1,2,3	1	F	SR 3.3.6.1.1 SR 3.3.6.1.3 SR 3.3.6.1.7	≤ 125% rated flow (23.0 in-wc)
b. SLC System Initiation	1,2	1	H	SR 3.3.6.1.7	NA
c. Reactor Vessel Water Level—Low (Level 3)	1,2,3	2	F	SR 3.3.6.1.1 SR 3.3.6.1.2 SR 3.3.6.1.5 SR 3.3.6.1.7	≥ 1.0 inches
6. RHR Shutdown Cooling System Isolation					
a. Reactor Pressure—High	1,2,3	1	F	SR 3.3.6.1.3 SR 3.3.6.1.7	≤ 70.0 psig
b. Reactor Vessel Water Level—Low (Level 3)	3,4,5	2 <sup>(a)</sup>	I	SR 3.3.6.1.1 SR 3.3.6.1.2 SR 3.3.6.1.5 SR 3.3.6.1.7	≥ 1.0 inches
7. Feedwater Recirculation Isolation					
a. Reactor Pressure—High	1,2,3	2	F	SR 3.3.6.1.1 SR 3.3.6.1.2 SR 3.3.6.1.5 SR 3.3.6.1.7	≤ 600 psig

(a) In MODES 4 and 5, provided RHR Shutdown Cooling System integrity is maintained, only one channel per trip system with an isolation signal available to one shutdown cooling pump suction isolation valve is required.

### 3.3 INSTRUMENTATION

#### 3.3.6.2 Secondary Containment Isolation Instrumentation

LCO 3.3.6.2      The secondary containment isolation instrumentation for each Function in Table 3.3.6.2-1 shall be OPERABLE.

APPLICABILITY:    According to Table 3.3.6.2-1.

#### ACTIONS

-----NOTE-----  
Separate Condition entry is allowed for each channel.  
-----

CONDITION	REQUIRED ACTION	COMPLETION TIME
A. One or more channels inoperable.	A.1      Place channel in trip.	12 hours for Functions 1 and 2  <u>AND</u>  24 hours for Functions other than Functions 1 and 2
B. One or more Functions with isolation capability not maintained.	B.1      Restore isolation capability.	1 hour

(continued)



ACTIONS (continued)

CONDITION	REQUIRED ACTION	COMPLETION TIME
C. Required Action and associated Completion Time of Condition A or B not met.	C.1.1 Isolate the associated secondary containment penetration flow path(s).	1 hour
	<u>OR</u>	
	C.1.2 Declare associated secondary containment isolation valves inoperable.	1 hour
	<u>AND</u>	
	C.2.1 Place the associated standby gas treatment (SGT) subsystem(s) in operation.	1 hour
	<u>OR</u>	
	C.2.2 Declare associated SGT subsystem(s) inoperable.	1 hour

## SURVEILLANCE REQUIREMENTS

### -----NOTES-----

1. Refer to Table 3.3.6.2-1 to determine which SRs apply for each Secondary Containment Isolation Function.
2. When a channel is placed in an inoperable status solely for performance of required Surveillances, entry into associated Conditions and Required Actions may be delayed for up to 6 hours provided the associated Function maintains secondary containment isolation capability.

SURVEILLANCE	FREQUENCY
SR 3.3.6.2.1    Perform CHANNEL CHECK.	12 hours
SR 3.3.6.2.2    Perform CHANNEL FUNCTIONAL TEST.	92 days
SR 3.3.6.2.3    Perform CHANNEL CALIBRATION.	92 days
SR 3.3.6.2.4    Perform CHANNEL CALIBRATION.	24 months
SR 3.3.6.2.5    Perform LOGIC SYSTEM FUNCTIONAL TEST.	24 months

Secondary Containment Isolation Instrumentation  
3.3.6.2

Table 3.3.6.2-1 (page 1 of 1)  
Secondary Containment Isolation Instrumentation

FUNCTION	APPLICABLE MODES OR OTHER SPECIFIED CONDITIONS	REQUIRED CHANNELS PER TRIP SYSTEM	SURVEILLANCE REQUIREMENTS	ALLOWABLE VALUE
1. Reactor Vessel Water Level —Low (Level 3)	1,2,3, (a)	2	SR 3.3.6.2.1 SR 3.3.6.2.2 SR 3.3.6.2.4 SR 3.3.6.2.5	$\geq 1.0$ inches
2. Drywell Pressure —High	1,2,3	2	SR 3.3.6.2.1 SR 3.3.6.2.2 SR 3.3.6.2.4 SR 3.3.6.2.5	$\leq 2.0$ psig
3. Reactor Building Ventilation Exhaust Radiation —High	1,2,3, (a),(b)	2	SR 3.3.6.2.1 SR 3.3.6.2.3 SR 3.3.6.2.5	$\leq 16.0$ mR/hr
4. Refueling Floor Ventilation Exhaust Radiation —High	1,2,3, (a),(b)	2	SR 3.3.6.2.1 SR 3.3.6.2.3 SR 3.3.6.2.5	$\leq 16.0$ mR/hr

(a) During operations with a potential for draining the reactor vessel.

(b) During CORE ALTERATIONS, and during movement of irradiated fuel assemblies in secondary containment.

### 3.3 INSTRUMENTATION

#### 3.3.7.1 Main Control Room Emergency Ventilation (MCREV) System Instrumentation

LC0 3.3.7.1 Two channels per trip system of the Control Room Air Intake Radiation—High Function shall be OPERABLE.

APPLICABILITY: MODES 1, 2, and 3,  
During movement of irradiated fuel assemblies in the secondary containment,  
During CORE ALTERATIONS,  
During operations with a potential for draining the reactor vessel (OPDRVs).

#### ACTIONS

-----NOTE-----  
Separate Condition entry is allowed for each channel.  
-----

CONDITION	REQUIRED ACTION	COMPLETION TIME
A. One or more required channels inoperable.	A.1 Declare associated MCREV subsystems inoperable.	1 hour from discovery of loss of MCREV System initiation capability
	<u>AND</u> A.2 Place channel in trip.	6 hours

(continued)

ACTIONS (continued)

CONDITION	REQUIRED ACTION	COMPLETION TIME
B. Required Action and associated Completion Time not met.	B.1 Place the associated MCREV subsystem(s) in operation.	1 hour
	<u>OR</u> B.2 Declare associated MCREV subsystem(s) inoperable.	1 hour

SURVEILLANCE REQUIREMENTS

-----NOTE-----  
When a channel is placed in an inoperable status solely for performance of required Surveillances, entry into associated Conditions and Required Actions may be delayed for up to 6 hours provided the associated Function maintains MCREV System initiation capability.  
-----

SURVEILLANCE	FREQUENCY
SR 3.3.7.1.1 Perform CHANNEL CHECK.	12 hours
SR 3.3.7.1.2 Perform CHANNEL FUNCTIONAL TEST.	92 days
SR 3.3.7.1.3 Perform CHANNEL CALIBRATION. The Allowable Value shall be $\leq 400$ cpm..	18 months
SR 3.3.7.1.4 Perform LOGIC SYSTEM FUNCTIONAL TEST.	24 months

### 3.3 INSTRUMENTATION

#### 3.3.8.1 Loss of Power (LOP) Instrumentation

LCO 3.3.8.1 The Unit 3 LOP instrumentation for each Function in Table 3.3.8.1-1 shall be OPERABLE.

AND

The Unit 2 LOP instrumentation for Functions 1, 2, 3, and 5 in Unit 2 Table 3.3.8.1-1 shall be OPERABLE.

APPLICABILITY: When the associated diesel generator and offsite circuit are required to be OPERABLE by LCO 3.8.1, "AC Sources—Operating," or LCO 3.8.2, "AC Sources—Shutdown."

#### ACTIONS

-----NOTE-----  
Separate Condition entry is allowed for each channel.  
-----

CONDITION	REQUIRED ACTION	COMPLETION TIME
<p>A. One 4 kV emergency bus with one or two required Function 3 channels inoperable.</p> <p><u>OR</u></p> <p>One 4 kV emergency bus with one or two required Function 5 channels inoperable.</p>	<p>A.1 -----NOTE----- Enter applicable Conditions and Required Actions of LCO 3.8.1 for offsite circuits made inoperable by LOP instrumentation. ----- Place channel in trip.</p>	<p>14 days</p>

(continued)

ACTIONS (continued)

CONDITION	REQUIRED ACTION	COMPLETION TIME
<p>B. Two 4 kV emergency buses with one required Function 3 channel inoperable.</p> <p><u>OR</u></p> <p>Two 4 kV emergency buses with one required Function 5 channel inoperable.</p> <p><u>OR</u></p> <p>One 4 kV emergency bus with one required Function 3 channel inoperable and a different 4 kV emergency bus with one required Function 5 channel inoperable.</p>	<p>B.1</p> <p>-----NOTE----- Enter applicable Conditions and Required Actions of LCO 3.8.1 for offsite circuits made inoperable by LOP instrumentation. -----</p> <p>Place the channel in trip.</p>	<p>24 hours</p>

(continued)

ACTIONS (continued)

CONDITION	REQUIRED ACTION	COMPLETION TIME
<p>C. One or more 4 kV emergency buses with one or more required Function 1, 2, or 4 channels inoperable.</p> <p><u>OR</u></p> <p>One 4 kV emergency bus with one required Function 3 channel and one required Function 5 channel inoperable.</p> <p><u>OR</u></p> <p>Any combination of three or more required Function 3 and Function 5 channels inoperable.</p>	<p>C.1 -----NOTE----- Enter applicable Conditions and Required Actions of LCO 3.8.1 for offsite circuits made inoperable by LOP instrumentation. -----</p> <p>Place the channel in trip.</p>	<p>1 hour</p>
<p>D. Required Action and associated Completion Time not met.</p>	<p>D.1 Declare associated diesel generator (DG) inoperable.</p>	<p>Immediately</p>



## SURVEILLANCE REQUIREMENTS

### NOTES

1. Refer to Table 3.3.8.1-1 to determine which SRs apply for each Unit 3 LOP Function. SR 3.3.8.1.5 is applicable only to the Unit 2 LOP instrumentation.
2. When a channel is placed in an inoperable status solely for performance of required Surveillances, entry into associated Conditions and Required Actions may be delayed for up to 2 hours provided: (a) for Function 1, the associated Function maintains initiation capability for three DGs; and (b) for Functions 2, 3, 4, and 5, the associated Function maintains undervoltage transfer capability for three 4 kV emergency buses.

SURVEILLANCE	FREQUENCY
SR 3.3.8.1.1 Perform CHANNEL FUNCTIONAL TEST.	31 days
SR 3.3.8.1.2 Perform CHANNEL CALIBRATION.	18 months
SR 3.3.8.1.3 Perform CHANNEL FUNCTIONAL TEST.	24 months
SR 3.3.8.1.4 Perform LOGIC SYSTEM FUNCTIONAL TEST.	24 months
SR 3.3.8.1.5 For required Unit 2 LOP instrumentation Functions, the SRs of Unit 2 Specification 3.3.8.1 are applicable.	In accordance with applicable SRs

Table 3.3.8.1-1 (page 1 of 1)  
Loss of Power Instrumentation

FUNCTION	REQUIRED CHANNELS PER BUS	SURVEILLANCE REQUIREMENTS	ALLOWABLE VALUE
1. 4 kV Emergency Bus Undervoltage (Loss of Voltage)			
a. Bus Undervoltage	1	SR 3.3.8.1.3 SR 3.3.8.1.4	NA
2. 4 kV Emergency Bus Undervoltage (Degraded Voltage Low Setting)			
a. Bus Undervoltage	2 (1 per source)	SR 3.3.8.1.1 SR 3.3.8.1.2 SR 3.3.8.1.4	$\geq 2286 \text{ V}$ and $\leq 2706 \text{ V}$
b. Time Delay	2 (1 per source)	SR 3.3.8.1.1 SR 3.3.8.1.2 SR 3.3.8.1.4	$\geq 1.5$ seconds and $\leq 2.1$ seconds
3. 4 kV Emergency Bus Undervoltage (Degraded Voltage High Setting)			
a. Bus Undervoltage	2 (1 per source)	SR 3.3.8.1.1 SR 3.3.8.1.2 SR 3.3.8.1.4	$\geq 3409 \text{ V}$ and $\leq 3829 \text{ V}$
b. Time Delay	2 (1 per source)	SR 3.3.8.1.1 SR 3.3.8.1.2 SR 3.3.8.1.4	$\geq 23.0$ seconds and $\leq 37.0$ seconds
4. 4 kV Emergency Bus Undervoltage (Degraded Voltage LOCA)			
a. Bus Undervoltage	2 (1 per source)	SR 3.3.8.1.1 SR 3.3.8.1.2 SR 3.3.8.1.4	$\geq 3766 \text{ V}$ and $\leq 3836 \text{ V}$ (a)
b. Time Delay	2 (1 per source)	SR 3.3.8.1.1 SR 3.3.8.1.2 SR 3.3.8.1.4	$\geq 9.2$ seconds and $\leq 10.8$ seconds (a)
5. 4 kV Emergency Bus Undervoltage (Degraded Voltage non-LOCA)			
a. Bus Undervoltage	2 (1 per source)	SR 3.3.8.1.1 SR 3.3.8.1.2 SR 3.3.8.1.4	$\geq 4116 \text{ V}$ and $\leq 4186 \text{ V}$ (a)
b. Time Delay	2 (1 per source)	SR 3.3.8.1.1 SR 3.3.8.1.2 SR 3.3.8.1.4	$\geq 57.8$ seconds and $\leq 64.2$ seconds (a)

(a) Prior to the implementation of modification 96-01511, on a particular Function 4 or 5 relay, its Allowable Values are:

- 4.a  $\geq 3691 \text{ V}$  and  $\leq 3713 \text{ V}$ , with internal time delay set  $\geq 0.9$  seconds and  $\leq 1.1$  seconds,
- 4.b  $\geq 8.4$  seconds and  $\leq 9.6$  seconds,
- 5.a  $\geq 4065 \text{ V}$  and  $\leq 4089 \text{ V}$ , with internal time delay set  $\geq 0.9$  seconds and  $\leq 1.1$  seconds,
- 5.b  $\geq 57.0$  seconds and  $\leq 63.0$  seconds.

This note expires upon completion of modification 96-01511, but no later than March 1, 2000.

### 3.3 INSTRUMENTATION

#### 3.3.8.2 Reactor Protection System (RPS) Electric Power Monitoring

LCO 3.3.8.2 Two RPS electric power monitoring assemblies shall be OPERABLE for each inservice RPS motor generator set or alternate power supply.

APPLICABILITY: MODES 1 and 2,  
MODES 3, 4, and 5 with any control rod withdrawn from a core cell containing one or more fuel assemblies.

#### ACTIONS

CONDITION	REQUIRED ACTION	COMPLETION TIME
A. One or both inservice power supplies with one electric power monitoring assembly inoperable.	A.1 Remove associated inservice power supply(s) from service.	72 hours
B. One or both inservice power supplies with both electric power monitoring assemblies inoperable.	B.1 Remove associated inservice power supply(s) from service.	1 hour
C. Required Action and associated Completion Time of Condition A or B not met in MODE 1 or 2.	C.1 Be in MODE 3.	12 hours

(continued)

**ACTIONS (continued)**

CONDITION	REQUIRED ACTION	COMPLETION TIME
D. Required Action and associated Completion Time of Condition A or B not met in MODE 3, 4, or 5 with any control rod withdrawn from a core cell containing one or more fuel assemblies.	D.1 Initiate action to fully insert all insertable control rods in core cells containing one or more fuel assemblies.	Immediately

**SURVEILLANCE REQUIREMENTS**

SURVEILLANCE	FREQUENCY
<p>SR 3.3.8.2.1 -----NOTE----- Only required to be performed prior to entering MODE 2 or 3 from MODE 4, when in MODE 4 for <math>\geq 24</math> hours. -----</p> <p>Perform CHANNEL FUNCTIONAL TEST.</p>	184 days
<p>SR 3.3.8.2.2 Perform CHANNEL CALIBRATION for each RPS motor generator set electric power monitoring assembly. The Allowable Values shall be:</p> <p>a. Overvoltage <math>\leq 133</math> V, with time delay set to <math>\leq 1.5</math> seconds.</p> <p>b. Undervoltage <math>\geq 111</math> V, with time delay set to <math>\leq 1.5</math> seconds.</p> <p>c. Underfrequency <math>\geq 56.8</math> Hz, with time delay set to <math>\leq 7.0</math> seconds.</p>	24 months

(continued)

**SURVEILLANCE REQUIREMENTS (continued)**

SURVEILLANCE	FREQUENCY
<p>SR 3.3.8.2.3    Perform CHANNEL CALIBRATION for each RPS alternate power supply electric power monitoring assembly. The Allowable Values shall be:</p> <ul style="list-style-type: none"> <li>a.    Overvoltage <math>\leq 133</math> V, with time delay set to <math>\leq 1.5</math> seconds.</li> <li>b.    Undervoltage <math>\geq 111</math> V, with time delay set to <math>\leq 4.0</math> seconds.</li> <li>c.    Underfrequency <math>\geq 56.8</math> Hz, with time delay set to <math>\leq 1.5</math> seconds.</li> </ul>	24 months
<p>SR 3.3.8.2.4    Perform a system functional test.</p>	24 months

### 3.4 REACTOR COOLANT SYSTEM (RCS)

#### 3.4.1 Recirculation Loops Operating

LCO 3.4.1 Two recirculation loops with matched flows shall be in operation with core flow as a function of THERMAL POWER in the "Unrestricted" Region of Figure 3.4.1-1.

OR

One recirculation loop shall be in operation with core flow as a function of THERMAL POWER in the "Unrestricted" Region of Figure 3.4.1-1 and with the following limits applied when the associated LCO is applicable:

- a. LCO 3.2.1, "AVERAGE PLANAR LINEAR HEAT GENERATION RATE (APLHGR)," single loop operation limits specific in the COLR;
- b. LCO 3.2.2, "MINIMUM CRITICAL POWER RATIO (MCPR)," single loop operation limits specified in the COLR; and
- c. LCO 3.3.1.1, "Reactor Protection System (RPS) Instrumentation," Function 2.b (Average Power Range Monitors Simulated Thermal Power-High), Allowable Value of Table 3.3.1.1-1 is reset for single loop operation.

-----NOTE-----  
Required limit modifications for single recirculation loop operation may be delayed for up to 12 hours after transition from two recirculation loop operation to single recirculation loop operation.  
-----

APPLICABILITY: MODES 1 and 2.

ACTIONS

CONDITION	REQUIRED ACTION	COMPLETION TIME
A. One or two recirculation loops in operation with core flow as a function of THERMAL POWER in the "Restricted" Region of Figure 3.4.1-1.	A.1 Verify APRM and LPRM neutron flux noise levels are $\leq 4\%$ and $\leq 3$ times baseline noise levels.	1 hour <u>AND</u> Once per 8 hours thereafter <u>AND</u> 1 hour after completion of any THERMAL POWER increase $\geq 5\%$ RTP
B. Required Action and associated Completion Time of Condition A not met.	B.1 Restore APRM and LPRM neutron flux noise levels to $\leq 4\%$ and $\leq 3$ times baseline noise levels.	2 hours
C. One recirculation loop in operation with core flow $\leq 39\%$ of rated core flow and THERMAL POWER in the "Restricted" Region of Figure 3.4.1-1.	C.1 Reduce THERMAL POWER to the "Unrestricted" Region of Figure 3.4.1-1. <u>OR</u> C.2 Increase core flow to $> 39\%$ of rated core flow.	4 hours  4 hours

(continued)

ACTIONS (continued)

CONDITION	REQUIRED ACTION	COMPLETION TIME
D. Requirements of the LCO not met for reasons other than Conditions A, B, C, and F.	D.1 Satisfy the requirements of the LCO.	24 hours
E. Required Action and associated Completion Time of Condition B, C, or D not met.	E.1 Be in MODE 3.	12 hours
F. No recirculation loops in operation.	F.1 Initiate action to reduce THERMAL POWER to the "Unrestricted" Region of Figure 3.4.1-1.	Immediately
	<u>AND</u> F.2 Be in MODE 3.	6 hours



**SURVEILLANCE REQUIREMENTS**

SURVEILLANCE	FREQUENCY
<p>SR 3.4.1.1 -----NOTE-----            Not required to be performed until 24 hours            after both recirculation loops are in            operation.            -----</p> <p>Verify recirculation loop jet pump flow            mismatch with both recirculation loops in            operation is:</p> <p>a. <math>\leq 10.25 \times 10^6</math> lbm/hr when operating at  <math>&lt; 71.75 \times 10^6</math> lbm/hr; and</p> <p>b. <math>\leq 5.125 \times 10^6</math> lbm/hr when operating at  <math>\geq 71.75 \times 10^6</math> lbm/hr.</p>	<p>24 hours</p>
<p>SR 3.4.1.2 Verify core flow as a function of THERMAL            POWER is in the "Unrestricted" Region of            Figure 3.4.1-1.</p>	<p>24 hours</p>

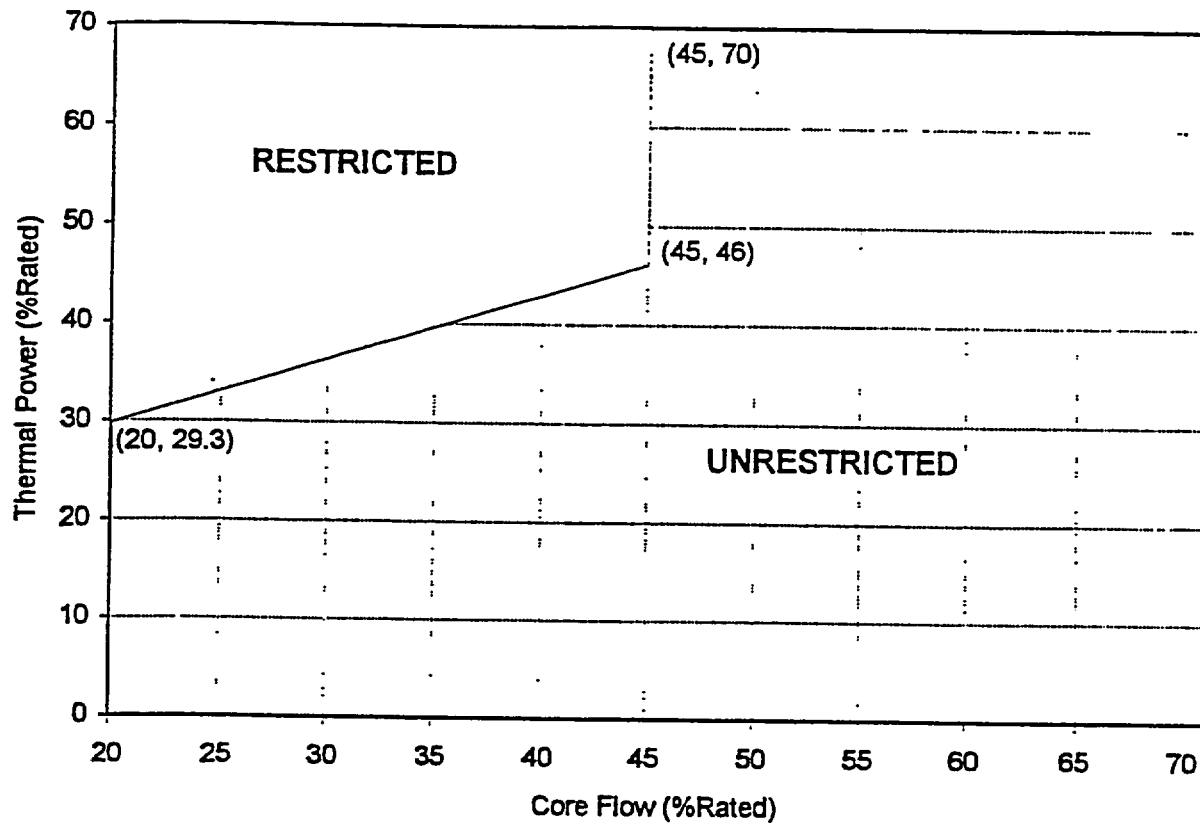


Figure 3.4.1-1 (page 1 of 1)  
THERMAL POWER VERSUS CORE FLOW  
STABILITY REGIONS

### 3.4 REACTOR COOLANT SYSTEM (RCS)

#### 3.4.2 Jet Pumps

LCO 3.4.2 All jet pumps shall be OPERABLE.

APPLICABILITY: MODES 1 and 2.

#### ACTIONS

CONDITION	REQUIRED ACTION	COMPLETION TIME
A. One or more jet pumps inoperable.	A.1 Be in MODE 3.	12 hours

# SURVEILLANCE REQUIREMENTS

SURVEILLANCE	FREQUENCY
<p>SR 3.4.2.1 -----NOTES-----</p> <ol style="list-style-type: none"> <li>1. Not required to be performed until 4 hours after associated recirculation loop is in operation.</li> <li>2. Not required to be performed until 24 hours after &gt; 25% RTP.</li> </ol> <p>-----</p> <p>Verify at least one of the following criteria (a, b, or c) is satisfied for each operating recirculation loop:</p> <ol style="list-style-type: none"> <li>a. Recirculation pump flow to speed ratio differs by <math>\leq 5\%</math> from established patterns, and jet pump loop flow to recirculation pump speed ratio differs by <math>\leq 5\%</math> from established patterns.</li> <li>b. Each jet pump diffuser to lower plenum differential pressure differs by <math>\leq 20\%</math> from established patterns.</li> <li>c. Each jet pump flow differs by <math>\leq 10\%</math> from established patterns.</li> </ol>	<p>24 hours</p>

### 3.4 REACTOR COOLANT SYSTEM (RCS)

#### 3.4.3 Safety Relief Valves (SRVs) and Safety Valves (SVs)

LCO 3.4.3 The safety function of 11 valves (any combination of SRVs and SVs) shall be OPERABLE.

APPLICABILITY: MODES 1, 2, and 3.

#### ACTIONS

CONDITION	REQUIRED ACTION	COMPLETION TIME
A. One or more required SRVs or SVs inoperable.	A.1 Be in MODE 3.	12 hours
	<u>AND</u> A.2 Be in MODE 4.	36 hours

# SURVEILLANCE REQUIREMENTS

SURVEILLANCE		FREQUENCY
SR 3.4.3.1	Verify the safety function lift setpoints of the required SRVs and SVs are as follows:	In accordance with the Inservice Testing Program
	<u>Number of SRVs</u>	
	<u>Setpoint (psig)</u>	
	4	
	4	
SR 3.4.3.2	4	24 months
	3	
	1135 ± 11.0	
	1145 ± 11.0	
	1155 ± 12.0	
SR 3.4.3.2	<u>Number of SVs</u>	24 months
	<u>Setpoint (psig)</u>	
	2	
	1260 ± 13.0	

### 3.4 REACTOR COOLANT SYSTEM (RCS)

#### 3.4.4 RCS Operational LEAKAGE

LCO 3.4.4 RCS operational LEAKAGE shall be limited to:

- a. No pressure boundary LEAKAGE;
- b.  $\leq 5$  gpm unidentified LEAKAGE;
- c.  $\leq 25$  gpm total LEAKAGE averaged over the previous 24 hour period; and
- d.  $\leq 2$  gpm increase in unidentified LEAKAGE within the previous 24 hour period in MODE 1.

APPLICABILITY: MODES 1, 2, and 3.

#### ACTIONS

CONDITION	REQUIRED ACTION	COMPLETION TIME
A. Unidentified LEAKAGE not within limit.  <u>OR</u>  Total LEAKAGE not within limit.	A.1 Reduce LEAKAGE to within limits.	4 hours
B. Unidentified LEAKAGE increase not within limit.	B.1 Reduce LEAKAGE increase to within limits.  <u>OR</u>	4 hours  (continued)

# ACTIONS

CONDITION	REQUIRED ACTION	COMPLETION TIME
B. (continued)	B.2 Verify source of unidentified LEAKAGE increase is not service sensitive type 304 or type 316 austenitic stainless steel.	4 hours
C. Required Action and associated Completion Time of Condition A or B not met.  <u>OR</u>  Pressure boundary LEAKAGE exists.	C.1 Be in MODE 3. <u>AND</u> C.2 Be in MODE 4.	12 hours  36 hours

# SURVEILLANCE REQUIREMENTS

SURVEILLANCE	FREQUENCY
SR 3.4.4.1 Verify RCS unidentified and total LEAKAGE and unidentified LEAKAGE increase are within limits.	4 hours



### 3.4 REACTOR COOLANT SYSTEM (RCS)

#### 3.4.5 RCS Leakage Detection Instrumentation

LCO 3.4.5 The following RCS leakage detection instrumentation shall be OPERABLE:

- a. Drywell sump monitoring system; and
- b. One channel of primary containment atmospheric gaseous monitoring system.

APPLICABILITY: MODES 1, 2, and 3.

#### ACTIONS

CONDITION	REQUIRED ACTION	COMPLETION TIME
A. Drywell sump monitoring system inoperable.	A.1 Restore drywell sump monitoring system to OPERABLE status.	24 hours
B. Required primary containment atmospheric monitoring system inoperable.	-----NOTE----- LCO 3.0.4 is not applicable. -----	
	B.1 Analyze grab samples of primary containment atmosphere.	Once per 12 hours
	<u>AND</u> B.2 Restore required primary containment atmospheric monitoring system to OPERABLE status.	30 days

(continued)

**ACTIONS (continued)**

CONDITION	REQUIRED ACTION	COMPLETION TIME
C. Required Action and associated Completion Time of Condition A or B not met.	C.1 Be in MODE 3.	12 hours
	<u>AND</u> C.2 Be in MODE 4.	36 hours
D. All required leakage detection systems inoperable.	D.1 Enter LCO 3.0.3.	Immediately

**SURVEILLANCE REQUIREMENTS**

SURVEILLANCE	FREQUENCY
SR 3.4.5.1 Perform a CHANNEL CHECK of required primary containment atmospheric monitoring system.	12 hours
SR 3.4.5.2 Perform a CHANNEL FUNCTIONAL TEST of required leakage detection instrumentation.	31 days
SR 3.4.5.3 Perform a CHANNEL CALIBRATION of required leakage detection instrumentation.	92 days

### 3.4 REACTOR COOLANT SYSTEM (RCS)

#### 3.4.6 RCS Specific Activity

LCO 3.4.6 The specific activity of the reactor coolant shall be limited to DOSE EQUIVALENT I-131 specific activity  $\leq 0.2 \mu\text{Ci/gm}$ .

APPLICABILITY: MODE 1,  
MODES 2 and 3 with any main steam line not isolated.

#### ACTIONS

CONDITION	REQUIRED ACTION	COMPLETION TIME
<p>A. Reactor coolant specific activity <math>&gt; 0.2 \mu\text{Ci/gm}</math> and <math>\leq 4.0 \mu\text{Ci/gm}</math> DOSE EQUIVALENT I-131.</p>	<p>-----NOTE----- LCO 3.0.4 is not applicable. -----</p>	
	<p>A.1 Determine DOSE EQUIVALENT I-131.</p> <p><u>AND</u></p> <p>A.2 Restore DOSE EQUIVALENT I-131 to within limits.</p>	<p>Once per 4 hours</p> <p>48 hours</p>
<p>B. Required Action and associated Completion Time of Condition A not met.</p> <p><u>OR</u></p> <p>Reactor coolant specific activity <math>&gt; 4.0 \mu\text{Ci/gm}</math> DOSE EQUIVALENT I-131.</p>	<p>B.1 Determine DOSE EQUIVALENT I-131.</p> <p><u>AND</u></p> <p>B.2.1 Isolate all main steam lines.</p>	<p>Once per 4 hours</p> <p>12 hours</p>
	<p><u>OR</u></p>	<p>(continued)</p>

# ACTIONS

CONDITION	REQUIRED ACTION	COMPLETION TIME
B. (continued)	B.2.2.1 Be in MODE 3.	12 hours
	<u>AND</u> B.2.2.2 Be in MODE 4.	36 hours

# SURVEILLANCE REQUIREMENTS

SURVEILLANCE	FREQUENCY
SR 3.4.6.1 -----NOTE----- Only required to be performed in MODE 1. ----- Verify reactor coolant DOSE EQUIVALENT I-131 specific activity is $\leq 0.2 \mu\text{Ci/gm.}$	7 days

### 3.4 REACTOR COOLANT SYSTEM (RCS)

#### 3.4.7 Residual Heat Removal (RHR) Shutdown Cooling System—Hot Shutdown

LCO 3.4.7 Two RHR shutdown cooling subsystems shall be OPERABLE, and, with no recirculation pump in operation, at least one RHR shutdown cooling subsystem shall be in operation.

- NOTES-----
1. Both required RHR shutdown cooling subsystems and recirculation pumps may be removed from operation for up to 2 hours per 8 hour period.
  2. One required RHR shutdown cooling subsystem may be inoperable for up to 2 hours for performance of Surveillances.
- 

APPLICABILITY: MODE 3, with reactor steam dome pressure less than the RHR shutdown cooling isolation pressure.

#### ACTIONS

- NOTES-----
1. LCO 3.0.4 is not applicable.
  2. Separate Condition entry is allowed for each RHR shutdown cooling subsystem.
- 

CONDITION	REQUIRED ACTION	COMPLETION TIME
A. One or two required RHR shutdown cooling subsystems inoperable.	A.1 Initiate action to restore required RHR shutdown cooling subsystem(s) to OPERABLE status.  <u>AND</u>	Immediately          (continued)

ACTIONS

CONDITION	REQUIRED ACTION	COMPLETION TIME
A. (continued)	A.2      Verify an alternate method of decay heat removal is available for each required inoperable RHR shutdown cooling subsystem.	1 hour
	<u>AND</u> A.3      Be in MODE 4.	24 hours
B. No RHR shutdown cooling subsystem in operation.  <u>AND</u> No recirculation pump in operation.	B.1      Initiate action to restore one RHR shutdown cooling subsystem or one recirculation pump to operation.	Immediately
	<u>AND</u> B.2      Verify reactor coolant circulation by an alternate method.	1 hour from discovery of no reactor coolant circulation  <u>AND</u> Once per 12 hours thereafter
	<u>AND</u> B.3      Monitor reactor coolant temperature and pressure.	Once per hour

**SURVEILLANCE REQUIREMENTS**

SURVEILLANCE	FREQUENCY
<p>SR 3.4.7.1 -----NOTE-----            Not required to be met until 2 hours after            reactor steam dome pressure is less            than the RHR shutdown cooling isolation            pressure.            -----            Verify one required RHR shutdown cooling            subsystem or recirculation pump is            operating.</p>	<p>12 hours</p>

### 3.4 REACTOR COOLANT SYSTEM (RCS)

#### 3.4.8 Residual Heat Removal (RHR) Shutdown Cooling System—Cold Shutdown

LCO 3.4.8 Two RHR shutdown cooling subsystems shall be OPERABLE, and, with no recirculation pump in operation, at least one RHR shutdown cooling subsystem shall be in operation.

-----NOTES-----

1. Both required RHR shutdown cooling subsystems and recirculation pumps may be removed from operation for up to 2 hours per 8 hour period.
  2. One required RHR shutdown cooling subsystem may be inoperable for up to 2 hours for performance of Surveillances.
- 

APPLICABILITY: MODE 4.

#### ACTIONS

-----NOTE-----

Separate Condition entry is allowed for each RHR shutdown cooling subsystem.

-----

CONDITION	REQUIRED ACTION	COMPLETION TIME
A. One or two required RHR shutdown cooling subsystems inoperable.	A.1 Verify an alternate method of decay heat removal is available for each inoperable required RHR shutdown cooling subsystem.	1 hour  <u>AND</u> Once per 24 hours thereafter

(continued)



ACTIONS (continued)

CONDITION	REQUIRED ACTION	COMPLETION TIME
B. No RHR shutdown cooling subsystem in operation.  <u>AND</u>  No recirculation pump in operation.	B.1 Verify reactor coolant circulating by an alternate method.	1 hour from discovery of no reactor coolant circulation  <u>AND</u>  Once per 12 hours thereafter
	<u>AND</u>  B.2 Monitor reactor coolant temperature and pressure.	Once per hour

SURVEILLANCE REQUIREMENTS

SURVEILLANCE	FREQUENCY
SR 3.4.8.1 Verify one required RHR shutdown cooling subsystem or recirculation pump is operating.	12 hours

### 3.4 REACTOR COOLANT SYSTEM (RCS)

#### 3.4.9 RCS Pressure and Temperature (P/T) Limits

LCO 3.4.9 RCS pressure, RCS temperature, RCS heatup and cooldown rates, and the recirculation pump starting temperature requirements shall be maintained within limits.

APPLICABILITY: At all times.

#### ACTIONS

CONDITION	REQUIRED ACTION	COMPLETION TIME
A. -----NOTE----- Required Action A.2 shall be completed if this Condition is entered. ----- Requirements of the LCO not met in MODE 1, 2, or 3.	A.1 Restore parameter(s) to within limits.	30 minutes
	<u>AND</u> A.2 Determine RCS is acceptable for continued operation.	72 hours
B. Required Action and associated Completion Time of Condition A not met.	B.1 Be in MODE 3.	12 hours
	<u>AND</u> B.2 Be in MODE 4.	36 hours

(continued)

**ACTIONS (continued)**

[illegible]

## SURVEILLANCE REQUIREMENTS

SURVEILLANCE		FREQUENCY
SR 3.4.9.1	<p>-----NOTE-----</p> <p>Only required to be performed during RCS heatup and cooldown operations and RCS inservice leak and hydrostatic testing.</p> <p>-----</p> <p>Verify:</p> <ul style="list-style-type: none"> <li>a. RCS pressure and RCS temperature are within the applicable limits specified in Figures 3.4.9-1 and 3.4.9-2; and</li> <li>b. RCS heatup and cooldown rates are <math>\leq 100^{\circ}\text{F}</math> in any 1 hour period.</li> </ul>	30 minutes

(continued)

**SURVEILLANCE REQUIREMENTS (continued)**

SURVEILLANCE	FREQUENCY
<p>SR 3.4.9.2      Verify RCS pressure and RCS temperature are within the criticality limits specified in Figure 3.4.9-3.</p>	<p>Once within 15 minutes prior to control rod withdrawal for the purpose of achieving criticality</p>
<p>SR 3.4.9.3      -----NOTE----- Only required to be met in MODES 1, 2, 3, and 4 during recirculation pump start. -----  Verify the difference between the bottom head coolant temperature and the reactor pressure vessel (RPV) coolant temperature is <math>\leq 145^{\circ}\text{F}</math>.</p>	<p>Once within 15 minutes prior to each startup of a recirculation pump</p>
<p>SR 3.4.9.4      -----NOTE----- Only required to be met in MODES 1, 2, 3, and 4 during recirculation pump start. -----  Verify the difference between the reactor coolant temperature in the recirculation loop to be started and the RPV coolant temperature is <math>\leq 50^{\circ}\text{F}</math>.</p>	<p>Once within 15 minutes prior to each startup of a recirculation pump</p>

(continued)

SURVEILLANCE REQUIREMENTS (continued)

SURVEILLANCE	FREQUENCY
<p>SR 3.4.9.5 -----NOTE----- Only required to be performed when tensioning the reactor vessel head bolting studs. -----</p> <p>Verify reactor vessel flange and head flange temperatures are &gt; 70°F.</p>	30 minutes
<p>SR 3.4.9.6 -----NOTE----- Not required to be performed until 30 minutes after RCS temperature ≤ 80°F in MODE 4. -----</p> <p>Verify reactor vessel flange and head flange temperatures are &gt; 70°F.</p>	30 minutes
<p>SR 3.4.9.7 -----NOTE----- Not required to be performed until 12 hours after RCS temperature ≤ 100°F in MODE 4. -----</p> <p>Verify reactor vessel flange and head flange temperatures are &gt; 70°F.</p>	12 hours

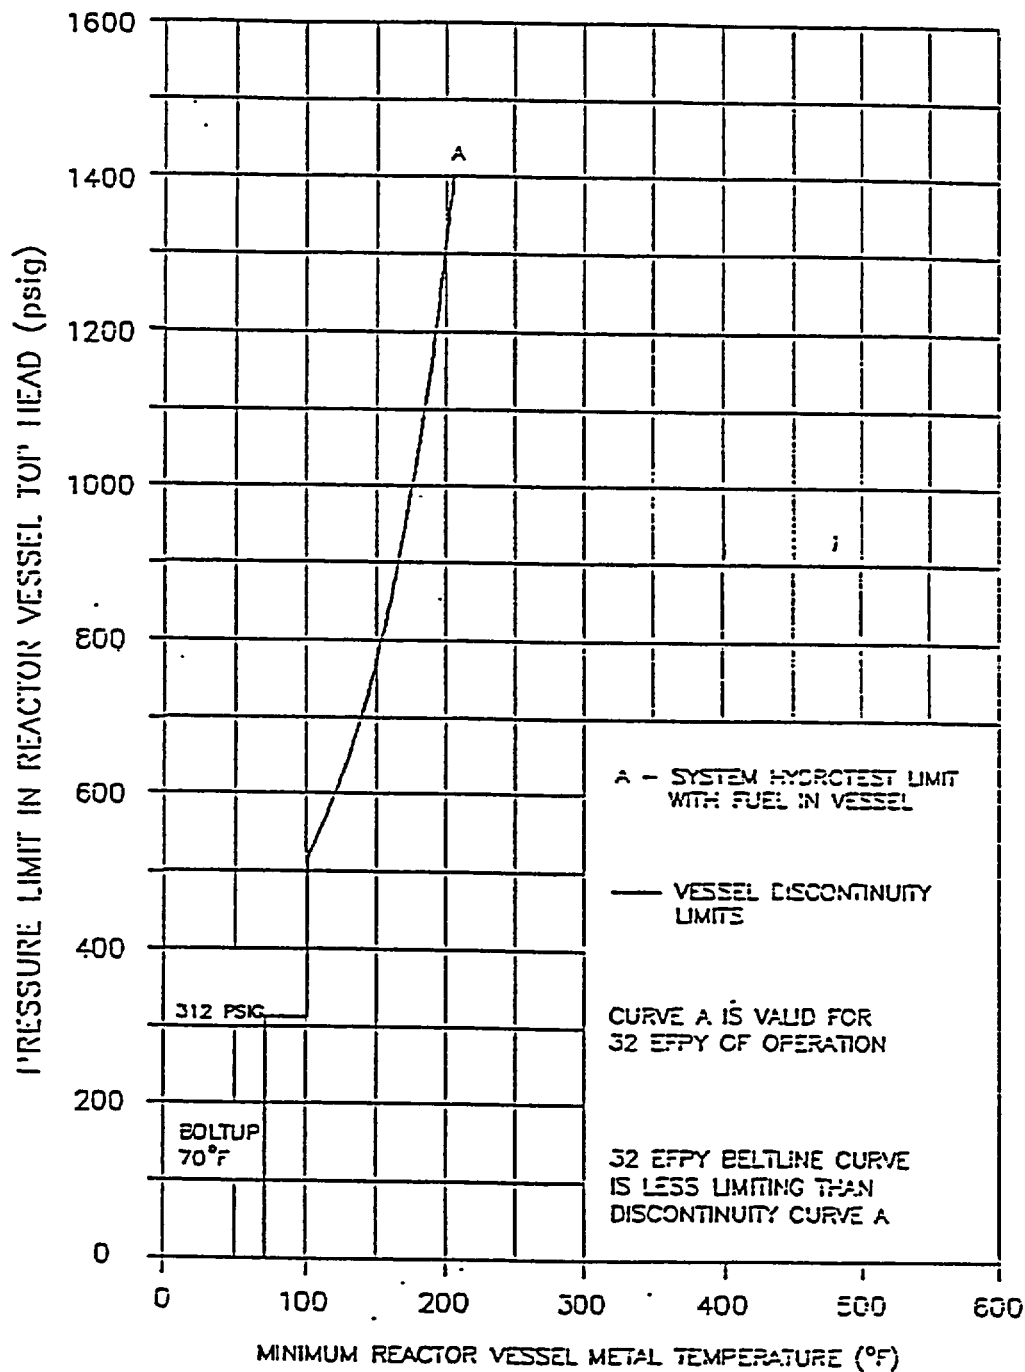


Figure 3.4.9-1 (page 1 of 1)

Temperature/Pressure Limits for  
Inservice Hydrostatic and Inservice Leakage Tests

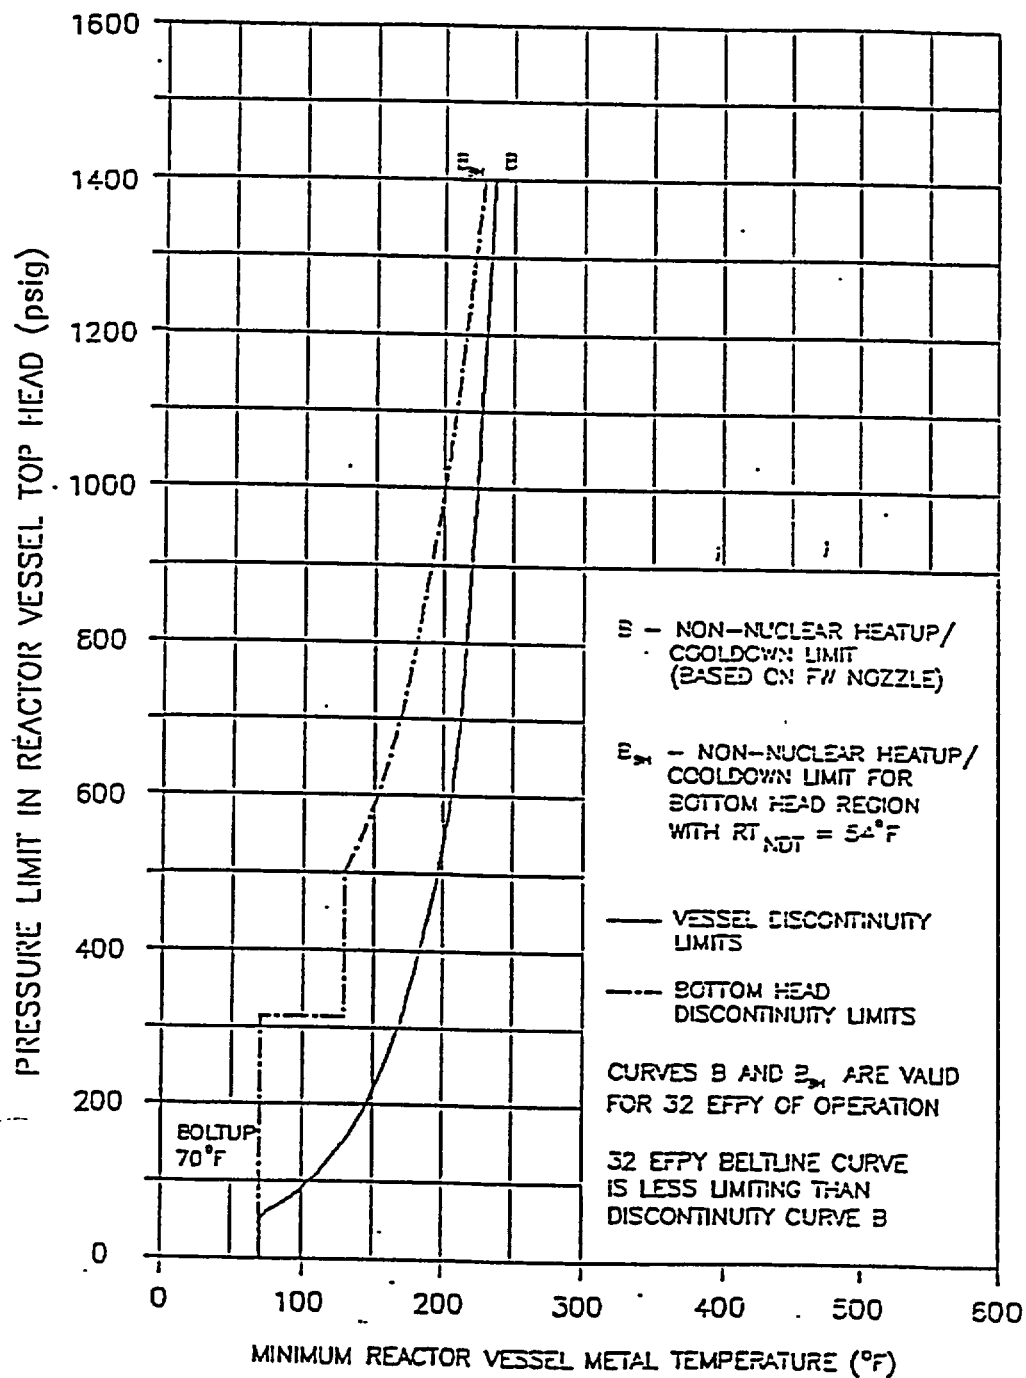


Figure 3.4.9-2 (page 1 of 1)

Temperature/Pressure Limits for  
Non-Nuclear Heatup and Cooldown Following a Shutdown

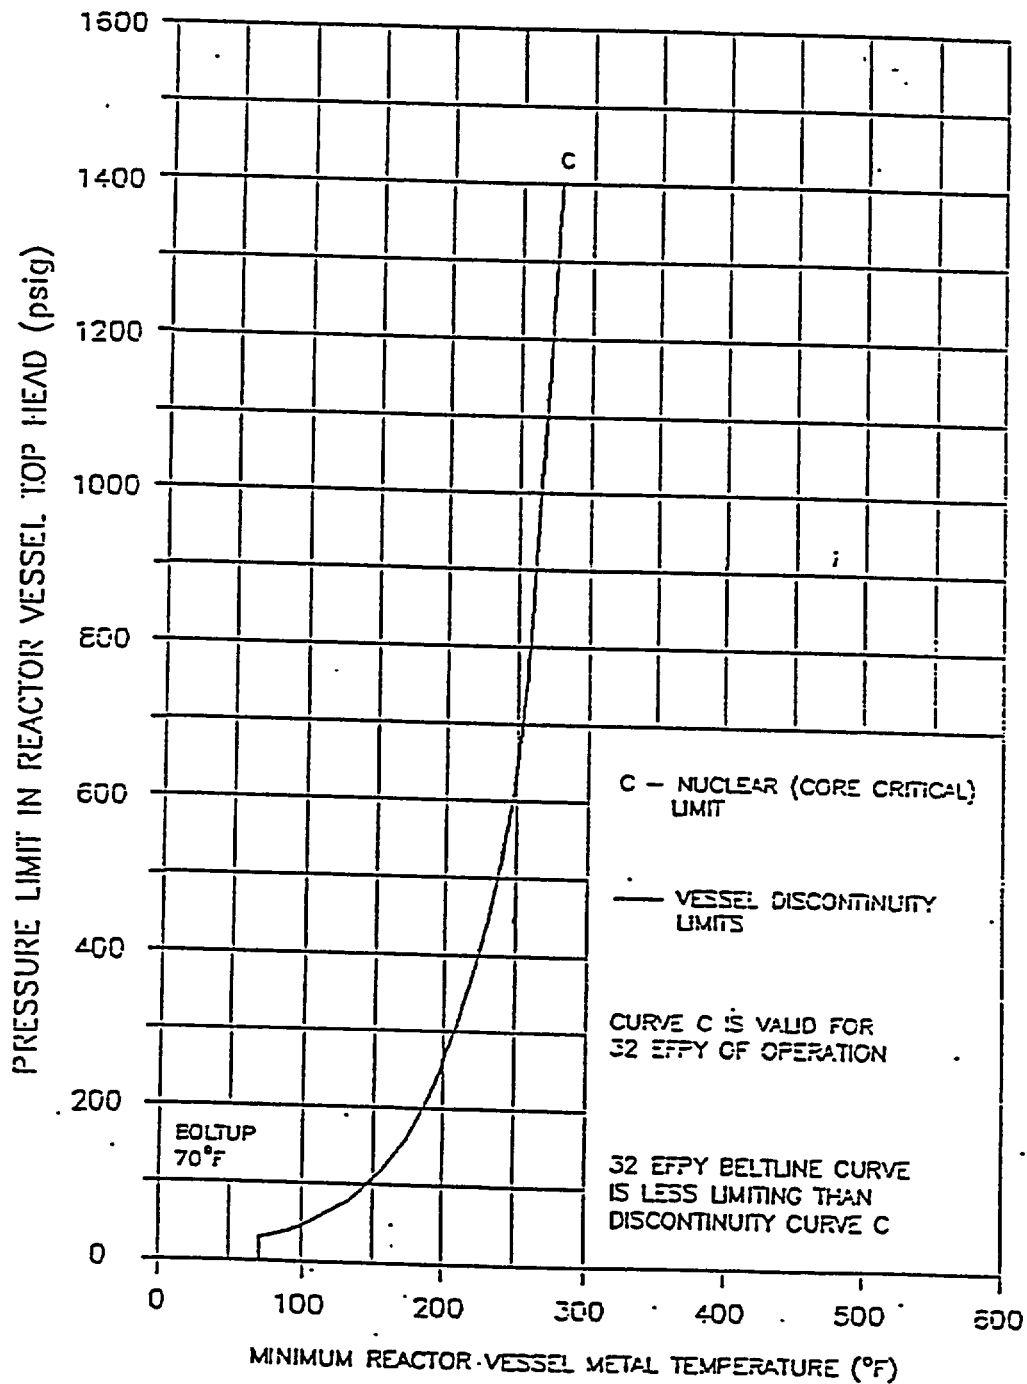


Figure 3.4.9-3 (page 1 of 1)  
Temperature/Pressure Limits for Criticality



3.4 REACTOR COOLANT SYSTEM (RCS)

3.4.10 Reactor Steam Dome Pressure

LCO 3.4.10 The reactor steam dome pressure shall be  $\leq$  1053 psig.

APPLICABILITY: MODES 1 and 2.

ACTIONS

CONDITION	REQUIRED ACTION	COMPLETION TIME
A. Reactor steam dome pressure not within limit.	A.1 Restore reactor steam dome pressure to within limit.	15 minutes
B. Required Action and associated Completion Time not met.	B.1 Be in MODE 3.	12 hours

SURVEILLANCE REQUIREMENTS

SURVEILLANCE	FREQUENCY
SR 3.4.10.1 Verify reactor steam dome pressure is $\leq$ 1053 psig.	12 hours

## 3.5 EMERGENCY CORE COOLING SYSTEMS (ECCS) AND REACTOR CORE ISOLATION COOLING (RCIC) SYSTEM

## 3.5.1 ECCS—Operating

LCO 3.5.1 Each ECCS injection/spray subsystem and the Automatic Depressurization System (ADS) function of five safety/relief valves shall be OPERABLE.

APPLICABILITY: MODE 1,  
MODES 2 and 3, except high pressure coolant injection (HPCI) is not required to be OPERABLE with reactor steam dome pressure  $\leq 150$  psig and ADS valves are not required to be OPERABLE with reactor steam dome pressure  $\leq 100$  psig.

## ACTIONS

CONDITION	REQUIRED ACTION	COMPLETION TIME
A. One low pressure ECCS injection/spray subsystem inoperable.  <u>OR</u>  One low pressure coolant injection (LPCI) pump in each subsystem inoperable.	A.1 Restore low pressure ECCS injection/spray subsystem(s) to OPERABLE status.	7 days
B. Required Action and associated Completion Time of Condition A not met.	B.1 Be in MODE 3.  <u>AND</u>  B.2 Be in MODE 4.	12 hours   36 hours

(continued)

## ACTIONS (continued)

CONDITION	REQUIRED ACTION	COMPLETION TIME
C. HPCI System inoperable.	C.1 Verify by administrative means RCIC System is OPERABLE.	Immediately
	<u>AND</u> C.2 Restore HPCI System to OPERABLE status.	14 days
D. HPCI System inoperable.  <u>AND</u> One low pressure ECCS injection/spray subsystem is inoperable.	D.1 Restore HPCI System to OPERABLE status.	72 hours
	<u>OR</u> D.2 Restore low pressure ECCS injection/spray subsystem to OPERABLE status.	72 hours
E. Required Action and associated Completion Time of Condition C or D not met.	E.1 Be in MODE 3.	12 hours
	<u>AND</u> E.2 Reduce reactor steam dome pressure to $\leq 150$ psig.	36 hours
F. One ADS valve inoperable.	F.1 Restore ADS valve to OPERABLE status.	14 days

(continued)

## ACTIONS (continued)

CONDITION	REQUIRED ACTION	COMPLETION TIME
G. One ADS valve inoperable.  <u>AND</u>  One low pressure ECCS injection/spray subsystem inoperable.	G.1 Restore ADS valve to OPERABLE status.  <u>OR</u>  G.2 Restore low pressure ECCS injection/spray subsystem to OPERABLE status.	72 hours   72 hours
H. Two or more ADS valves inoperable.  <u>OR</u>  Required Action and associated Completion Time of Condition F or G not met.	H.1 Be in MODE 3.  <u>AND</u>  H.2 Reduce reactor steam dome pressure to $\leq 100$ psig.	12 hours   36 hours
I. Two or more low pressure ECCS injection/spray subsystems inoperable for reasons other than Condition A.  <u>OR</u>  HPCI System and one or more ADS valves inoperable.	I.1 Enter LCO 3.0.3.	Immediately

# SURVEILLANCE REQUIREMENTS

SURVEILLANCE		FREQUENCY
SR 3.5.1.1	Verify, for each ECCS injection/spray subsystem, the piping is filled with water from the pump discharge valve to the injection valve.	31 days
SR 3.5.1.2	<p>-----NOTE-----  Low pressure coolant injection (LPCI) subsystems may be considered OPERABLE during alignment and operation for decay heat removal with reactor steam dome pressure less than the Residual Heat Removal (RHR) shutdown cooling isolation pressure in MODE 3, if capable of being manually realigned and not otherwise inoperable.  -----</p> <p>Verify each ECCS injection/spray subsystem manual, power operated, and automatic valve in the flow path, that is not locked, sealed, or otherwise secured in position, is in the correct position.</p>	31 days
SR 3.5.1.3	Verify ADS nitrogen supply header pressure is $\geq 85$ psig.	31 days
SR 3.5.1.4	Verify the LPCI cross tie valve is closed and power is removed from the valve operator.	31 days

(continued)

## SURVEILLANCE REQUIREMENTS (continued)

SURVEILLANCE		FREQUENCY																
SR 3.5.1.5	<p>-----NOTE----- Not required to be performed if performed within the previous 31 days. -----</p> <p>Verify each recirculation pump discharge valve cycles through one complete cycle of full travel or is de-energized in the closed position.</p>	Once each startup prior to exceeding 25% RTP																
SR 3.5.1.6	Verify automatic transfer of the power supply from the normal source to the alternate source for each LPCI subsystem inboard injection valve and each recirculation pump discharge valve.	61 days																
SR 3.5.1.7	<p>-----NOTE----- For the core spray pumps, SR 3.5.1.7 may be met using equivalent values for flow rate and test pressure determined using pump curves. -----</p> <p>Verify the following ECCS pumps develop the specified flow rate against a system head corresponding to the specified reactor pressure.</p> <table><thead><tr><th>SYSTEM</th><th>FLOW RATE</th><th>NO. OF PUMPS</th><th>SYSTEM HEAD CORRESPONDING TO A REACTOR PRESSURE OF</th></tr></thead><tbody><tr><td>Core</td><td></td><td></td><td></td></tr><tr><td>Spray</td><td>≥ 3,125 gpm</td><td>1</td><td>≥ 105 psig</td></tr><tr><td>LPCI</td><td>≥ 10,900 gpm</td><td>1</td><td>≥ 20 psig</td></tr></tbody></table>	SYSTEM	FLOW RATE	NO. OF PUMPS	SYSTEM HEAD CORRESPONDING TO A REACTOR PRESSURE OF	Core				Spray	≥ 3,125 gpm	1	≥ 105 psig	LPCI	≥ 10,900 gpm	1	≥ 20 psig	92 days
SYSTEM	FLOW RATE	NO. OF PUMPS	SYSTEM HEAD CORRESPONDING TO A REACTOR PRESSURE OF															
Core																		
Spray	≥ 3,125 gpm	1	≥ 105 psig															
LPCI	≥ 10,900 gpm	1	≥ 20 psig															

(continued)

**SURVEILLANCE REQUIREMENTS (continued)**

SURVEILLANCE	FREQUENCY
<p>SR 3.5.1.8 -----NOTE-----            Not required to be performed until 12 hours after reactor steam pressure and flow are adequate to perform the test.</p> <p>Verify, with reactor pressure <math>\leq 1053</math> and <math>\geq 940</math> psig, the HPCI pump can develop a flow rate <math>\geq 5000</math> gpm against a system head corresponding to reactor pressure.</p>	92 days
<p>SR 3.5.1.9 -----NOTE-----            Not required to be performed until 12 hours after reactor steam pressure and flow are adequate to perform the test.</p> <p>Verify, with reactor pressure <math>\leq 175</math> psig, the HPCI pump can develop a flow rate <math>\geq 5000</math> gpm against a system head corresponding to reactor pressure.</p>	24 months
<p>SR 3.5.1.10 -----NOTE-----            Vessel injection/spray may be excluded.</p> <p>Verify each ECCS injection/spray subsystem actuates on an actual or simulated automatic initiation signal.</p>	24 months
<p>SR 3.5.1.11 -----NOTE-----            Valve actuation may be excluded.</p> <p>Verify the ADS actuates on an actual or simulated automatic initiation signal.</p>	24 months

(continued)

SURVEILLANCE REQUIREMENTS (continued)

SURVEILLANCE	FREQUENCY
SR 3.5.1.12 Verify each ADS valve actuator strokes when manually actuated in the depressurization mode.	24 months



3.5 EMERGENCY CORE COOLING SYSTEMS (ECCS) AND REACTOR CORE ISOLATION  
COOLING (RCIC) SYSTEM

## 3.5.2 ECCS—Shutdown

LCO 3.5.2 Two low pressure ECCS injection/spray subsystems shall be  
OPERABLE.APPLICABILITY: MODE 4,  
MODE 5, except with the spent fuel storage pool gates  
removed, water level  $\geq$  458 inches above reactor pressure  
vessel instrument zero, and no operations with a  
potential for draining the reactor vessel (OPDRVs) in  
progress.

## ACTIONS

CONDITION	REQUIRED ACTION	COMPLETION TIME
A. One required ECCS injection/spray subsystem inoperable.	A.1 Restore required ECCS injection/spray subsystem to OPERABLE status.	4 hours
B. Required Action and associated Completion Time of Condition A not met.	B.1 Initiate action to suspend OPDRVs.	Immediately
C. Two required ECCS injection/spray subsystems inoperable.	C.1 Initiate action to suspend OPDRVs.	Immediately
	<u>AND</u> C.2 Restore one ECCS injection/spray subsystem to OPERABLE status.	4 hours

(continued)

## ACTIONS (continued)

CONDITION	REQUIRED ACTION	COMPLETION TIME
D. Required Action C.2 and associated Completion Time not met.	D.1 Initiate action to restore secondary containment to OPERABLE status.	Immediately
	<u>AND</u>	
	D.2 Initiate action to restore one standby gas treatment subsystem for Unit 3 to OPERABLE status.	Immediately
	<u>AND</u>	
	D.3 Initiate action to restore isolation capability in each required secondary containment penetration flow path not isolated.	Immediately

## SURVEILLANCE REQUIREMENTS

SURVEILLANCE	FREQUENCY
SR 3.5.2.1 Verify, for each required low pressure coolant injection (LPCI) subsystem, the suppression pool water level is $\geq 11.0$ ft.	12 hours

(continued)

SURVEILLANCE REQUIREMENTS (continued)

SURVEILLANCE	FREQUENCY
<p>SR 3.5.2.2     Verify, for each required core spray (CS) subsystem, the:</p> <p>    a.    Suppression pool water level is <math>\geq 11.0</math> ft; or</p> <p>    b.    -----NOTE-----                   Only one required CS subsystem may take credit for this option during OPDRVs.                   -----</p> <p>         Condensate storage tank water level is <math>\geq 17.3</math> ft.</p>	<p>12 hours</p>
<p>SR 3.5.2.3     Verify, for each required ECCS injection/spray subsystem, the piping is filled with water from the pump discharge valve to the injection valve.</p>	<p>31 days</p>
<p>SR 3.5.2.4     -----NOTE-----                   One LPCI subsystem may be considered OPERABLE during alignment and operation for decay heat removal if capable of being manually realigned and not otherwise inoperable.                   -----</p> <p>         Verify each required ECCS injection/spray subsystem manual, power operated, and automatic valve in the flow path, that is not locked, sealed, or otherwise secured in position, is in the correct position.</p>	<p>31 days</p>

(continued)

**SURVEILLANCE REQUIREMENTS (continued)**

SURVEILLANCE					FREQUENCY
SR 3.5.2.5	-----NOTE----- For the CS pumps, SR 3.5.2.5 may be met using equivalent values for flow rate and test pressure determined using pump curves. -----				92 days
	Verify each required ECCS pump develops the specified flow rate against a system head corresponding to the specified reactor pressure.				
			NO. OF PUMPS	SYSTEM HEAD CORRESPONDING TO A REACTOR PRESSURE OF	
	<u>SYSTEM</u>	<u>FLOW RATE</u>			
	CS	≥ 3,125 gpm	1	≥ 105 psig	
LPCI	≥ 10,900 gpm	1	≥ 20 psig		
SR 3.5.2.6	-----NOTE----- Vessel injection/spray may be excluded. -----				24 months
	Verify each required ECCS injection/spray subsystem actuates on an actual or simulated automatic initiation signal.				

### 3.5 EMERGENCY CORE COOLING SYSTEMS (ECCS) AND REACTOR CORE ISOLATION COOLING (RCIC) SYSTEM

#### 3.5.3 RCIC System

LCO 3.5.3 The RCIC System shall be OPERABLE.

APPLICABILITY: MODE 1,  
MODES 2 and 3 with reactor steam dome pressure > 150 psig.

#### ACTIONS

CONDITION	REQUIRED ACTION	COMPLETION TIME
A. RCIC System inoperable.	A.1 Verify by administrative means High Pressure Coolant Injection System is OPERABLE.	Immediately
	<u>AND</u> A.2 Restore RCIC System to OPERABLE status.	14 days
B. Required Action and associated Completion Time not met.	B.1 Be in MODE 3.	12 hours
	<u>AND</u> B.2 Reduce reactor steam dome pressure to $\leq$ 150 psig.	36 hours

**SURVEILLANCE REQUIREMENTS**

SURVEILLANCE	FREQUENCY
SR 3.5.3.1    Verify the RCIC System piping is filled with water from the pump discharge valve to the injection valve.	31 days
SR 3.5.3.2    Verify each RCIC System manual, power operated, and automatic valve in the flow path, that is not locked, sealed, or otherwise secured in position, is in the correct position.	31 days
SR 3.5.3.3    -----NOTE----- Not required to be performed until 12 hours after reactor steam pressure and flow are adequate to perform the test. ----- Verify, with reactor pressure $\leq 1053$ psig and $\geq 940$ psig, the RCIC pump can develop a flow rate $\geq 600$ gpm against a system head corresponding to reactor pressure.	92 days
SR 3.5.3.4    -----NOTE----- Not required to be performed until 12 hours after reactor steam pressure and flow are adequate to perform the test. ----- Verify, with reactor pressure $\leq 175$ psig, the RCIC pump can develop a flow rate $\geq 600$ gpm against a system head corresponding to reactor pressure.	24 months

(continued)

**SURVEILLANCE REQUIREMENTS (continued)**

SURVEILLANCE	FREQUENCY
<p>SR 3.5.3.5 -----NOTE-----  Vessel injection may be excluded.  -----  Verify the RCIC System actuates on an  actual or simulated automatic initiation  signal.</p>	<p>24 months</p>