

NRC 2003-0059

June 27, 2003


Mr. J. E. Dyer, Regional Administrator  
U. S. Nuclear Regulatory Commission  
Region III  
801 Warrenville Road  
Lisle, IL 60532-4351

DOCKET NUMBERS 50-266 AND 50-301  
POINT BEACH NUCLEAR PLANT, UNITS 1 AND 2  
SUBMITTAL OF ADDITIONAL INFORMATION CONCERNING  
AUXILIARY FEEDWATER ORIFICE REGULATORY CONFERENCE

Dear Mr. Dyer:

On June 6, 2003, a regulatory conference was conducted between representatives of the Nuclear Management Company, LLC (NMC) and members of your Staff to discuss the Auxiliary Feedwater Orifice Issue at Point Beach Nuclear Plant (PBNP). During the presentation, a several questions were raised regarding information presented or discussed during the conference. The majority of these questions were related to the preliminary probabilistic risk assessment (PRA) NMC is presently working on. Although we do not anticipate completion of this assessment until later this summer, NMC agreed to present additional information concerning these preliminary results. Attached and enclosed with this letter are answers to the specific questions asked at the conference and preliminary information concerning the PRA assessment. As discussed at the conference, and confirmed in a telephone call between your G. Grant and M. Reddemann on June 19, 2003, we agreed to provided this information by June 27, 2003.

If you have any questions, please contact Gordon P. Arent at 920/755-6518.



A. J. Cayia  
Site Vice President

GPA/kmd  
Enclosure

NRC 2003-0059  
June 27, 2003

- Attachment:
1. Response to Questions from the June 6, 2003 Regulatory Conference
  2. Qualification of the Risk Increase Point Beach AFW Orifice Issue (Preliminary)
  3. Calculation of Availability/Reliability of the Water Treatment System (Final)
  4. Hydraulic Calculation for Injecting Low-Pressure Water into the Steam Generators (Final)
  5. Summary of MAAP Analysis (Preliminary)
  6. Summary of Human Error Analysis (Preliminary)

cc: (with enclosure)

S. Burgess, Senior Reactor Analyst, NRC Region III

cc: (w/o enclosure)

T. Vogel, PBNP Branch Chief, NRC Region III

Mr. M. Kunowski, Project Engineer, NRC Region III

NRC Resident Inspector - Point Beach Nuclear Plant

PSCW

**ATTACHMENT 1**

**Response to Questions Made During**

**the Regulatory Conference Held on June 6, 2003**

**POINT BEACH NUCLEAR PLANT, UNITS 1 AND 2**

1. *Please provide specific information on the Enhance Understanding of System, Design and Accident Progression training being provided to Engineering and Operations.*

#### Engineering Training

There is training planned to review the final configuration of all the AFW modifications. This training includes the identification of the safety portion of the system. This is in the Engineering Curriculum Review Committees for review and is not currently scheduled due to the flux of changes being made.

Section 3 of Chapter 14 of the FSAR, Accident Analysis, which covers large and small break LOCAs was completed on June 12, 2003. There are a few that have not completed the training and are being tracked via remediation forms. Remediation will consist of reviewing a videotaped classroom presentation, questions with the instructor, and an evaluation. Another section of Chapter 14 is scheduled in December.

Operability Determination Training is scheduled for every Tuesday starting July 8 and ending August 12 (two sessions on July 15). The Licensed Senior Reactor Operators, Certified Senior Reactor Operators, and those Engineers who have or wish to have Operability Determination qualifications have been invited. The pilot for this session was completed on June 26, 2003.

A Modifications training session was provided during the roll out of the Fleet Modification process to all design engineers. The topic of procedural adherence was reinforced. Future qualifications for those engineers who perform modifications is linked to this training. This training was completed in March 2003.

Human Error Avoidance training was provided to the Engineering staff to assist in self-checking and questioning attitudes (QV & V) during April and May of 2003.

50.59-refresher training is in the planning stage, but has not yet been scheduled. This will incorporate Engineers and Operators.

#### Operations Training

The Operation Department has had training on the implications these modification as they were being incorporated in the plant. This training has been through standard and routine classroom training and on the Simulator. Just in Time Training (JITT) has been used to ensure that all of the crews understand the procedural requirements and system responses as the modifications were made.

BR-91-143 – Simulator briefing on how to operate AFW under the new procedural requirements.  
LP 3627 AFW system review given in cycle 02-01  
Simulator Guide (SG) 96 – Loss of Instrument Air and affects on AFW were discussed  
LP 3648 – Recirculation issues discussed in cycle 02-02  
LP 3719 – Recirculation changes associated with removing internal to a check valve  
Briefing 02-157 – On shift brief regarding AFW operational changes  
Entry for October 31 regarding AFW recirc issues  
JITT briefing for Emergency AFW issues on November 2002 (BR02-155)  
Briefing 02-180 – Recirculation issues briefing provided (Thanksgiving week) Ops Notebook  
SG-92 – Provided in cycle 03-01 for ruptured/Faulted Steam Generator and operators action while using AFW.

LP 3735 – AFW issues – Reviewed the status of the AFW system (1.5 hours)

SG-123 – Loss of IA – AFW aspects were evaluated. (Cycle 03-02)

BR-03-084 – Briefing on AFW. (Cycle 03-02)

SG-0122 – Loss of AC and the AFW effects were discussed. (Cycle 03-02)

SG-0126 - Instrument Bus malfunctions – AFW Recirculation requirements were discussed. (Cycle 03-03)

LP 3757 AFW review - Updated the crews on the status of AFW (Cycle 03-03)

- 2. How does Point Beach calculate the reliability and availability of the Water Treatment System. Please provide availability data specifically covering the period of concern (partial system unavailability included).*

The calculation for Water Treatment availability and reliability is provided in Attachment 3.

- 3. Provide the numbers for the internal events and seismic profiles. Include the instantaneous risk values.*

Over the 1 year period considered in the risk evaluation two AFW pump recirculation orifice configurations were considered. First was the period of time where only the motor driven pumps had the modification orifices. The instantaneous plant risk increase during this period was  $1.11\text{E-}5/\text{yr}$ . Second was the period of time where both the motor driven and turbine driven pumps had the modified orifices. For this period of time, the instantaneous risk increase was  $1.16\text{E-}4/\text{yr}$ . These values include internal events and seismic. These values are preliminary and will be re-evaluated upon completion of the verification/validation of the evaluation and completion of the fire risk significance.

The qualification methodology used to establish the plant risk described above is provided in Attachment 2.

- 4. Please provide details and hydraulic analysis for capability to supply adequate Steam Generator (S/G) flow from Service Water or Fire Water with a disabled AFW pump. Did you consider clearances in the stalled AFW pumps and the strainer sizes in both the Service Water and Fire Water system.*

The hydraulics analysis developed to determine the ability to supply low pressure water to the steam generators is provided in Attachment 4.

5. Was the SQUG methodology used for the Condensate Storage Tank (CST) seismic fragility? If not, what type was done?

The CST's capacity calculation followed the SQUG methodology as contained in Section 7 of the Generic Implementation Procedure (GIP) with the single exception of the allowable buckling stress "knockdown" factor. It is noteworthy to explain that the GIP (SQUG Methodology) is used for design basis assessments in resolving the issues addressed by USI A-46, and that the CST is not part of the Point Beach A-46 safe shutdown equipment list (SSEL). The GIP methodology would call for a knockdown factor of 0.72 while the EPRI Report NP-6041-SL, *A Methodology for Assessment of Nuclear Power Plant Seismic Margin (Revision 1)*, Section H, which applies almost the identical methodology to the GIP methodology, calls for 0.90 as the knockdown factor for purposes of fragility calculations that are used for probabilistic assessments in calculating "beyond design basis capacities." Had the CST been deterministically evaluated for the A-46 design basis assessment, its calculated seismic capacity would exceed the Point Beach design basis Safe Shutdown Earthquake (SSE), which is a 0.12 g peak ground acceleration (PGA) event, with more than a 50% margin using the aforementioned 0.72 knockdown; however, this was not formally calculated since the CST is not part of the Point Beach A-46 SSEL component population as previously stated. Additionally, the tank's damping was conservatively set at 4% of critical damping, as called for by the GIP, as opposed to 5% damping allowed by NP-6041 for the tank's impulsive modes.

The CST's median fragility,  $A_m$ , capacity is calculated as follows:

$$\text{Tank } A_m = 0.12\text{g} \times 1.99 \times 2.1 = 0.50 \text{ g (PGA)}$$

Where 1.99 is the factor of safety from S&A calculation 91C2696-C-014 with respect to the design basis (SSE) earthquake using the aforementioned "knockdown" factor of 0.90, and the 2.1 factor is the approximate ratio of the median fragility to the seismic capacity calculated in the referenced calculation, which is explained in next paragraph.

The methodology in EPRI Report NP-6041-SL uses an approach called the Conservative Deterministic Failure Margin (CDFM) methodology that when implemented yields a seismic capacity termed the High Confidence of a Low Probability of Failure, the acronym for which is HCLPF. This value contains significant conservative bias and is defined in the seismic probabilistic risk assessment (SPRA) to be the 95% confidence of a 5% probability of exceedance. Based on EPRI Report TR-103959, *Methodology for Developing Seismic*, Sections 2 and 3, the factor of 2.1 is the approximate conversion factor from a HCLPF developed using the CDFM methodology (also referred to as HCLPF<sub>84</sub>) to a median fragility for which overall logarithmic standard deviation,  $\beta_c$ , is 0.40 for US plant sites east of the Rocky Mountains. This value of the logarithmic standard deviation is identical to that used for the original Point Beach SPRA for the IPEEE assessments.

As part of the evaluation of the CST, a walkdown was performed to determine if there were any potential seismic interactions in the area. It was determined that the masonry wall on the Operations office at El. 44' was a potential interaction concern. Therefore, the fragility of the wall was also determined. The wall is constructed of unreinforced concrete masonry units. This capacity is based on the tensile strength of the mortar (32 psi) compared to the calculated mortar stress (20 psi) for the design basis event which is then factored by the 2.1 conversion factor described above.

The following equation shows the development of the wall's fragility:

$$\text{Wall } A_m = 0.12g \times (32/20) \times 2.1 = 0.40 \text{ g (PGA)}$$

Based on comparison of the two fragilities, the system fragility for the CST is therefore governed by the wall fragility of 0.40 g (PGA).

6. What effect does the seismic event have on Fire Water?

It was assumed in the original IPEEE submittal that the Fire System was seismically weak and was not credited as an AFW make-up source. No further analysis of this system was performed for this Significance Determination Process (SDP) evaluation. Therefore, Fire Water is still not credited. The IPEEE analysis showed that Service Water was a reliable water source for the AFW system upon a loss of the CST's. There would be little benefit to credit the use of Fire Water for a seismic event.

7. *Following a safety injection, would the Water Treatment (WT) continue to run or would it have to be restored? If the Water Treatment System must be restored following that safety injection, does procedural guidance exist?*

Following an SI, the water treatment plant would continue to supply demineralized water to the CSTs, assuming no loss of power to the plant due to the event. Service water supply to the temporary sand filter trailer would be lost due to closure of SW-2817 and/or SW-4478<sup>1</sup>. Because of the inventory in the clearwell<sup>2</sup>, demin flow would not be interrupted. Normal clearwell level is approx 54<sup>3</sup> inches yielding approx 51,000 gal above clearwell pump trip. This inventory could be used to maintain flow to the CST<sup>4</sup>.

Following SI reset, the SW supply to the sand filter trailer can be realigned by opening SW-2817 and SW-4478. Opening SW-2817 and SW-4478 is procedurally directed in EOP 1.1, SI Termination. No specific direction to align SW to the water treatment plant are provided in other EOPs following SI is reset. In those instances, opening SW-2817 and SW-4478 could be performed using skill of the craft.

Once SW flow is established to the filter trailer, plant operation is normal.

Start up of the plant following SI could be somewhat longer if clearwell level is allowed to lower until the clearwell pumps trip. In this case make up flow to the CSTs would stop and the plant would have to be started up. Startup could be 40 minutes to 2 hours.

---

<sup>1</sup> Ref M-2207 Sh 1

<sup>2</sup> Ref TLB-50

<sup>3</sup> A review of clearwell level recorder from 06/10/03 to 06/20/03 shows a nominal clearwell level of 78% (54.3") (51,486 gal above pump trip). A min level of 60% (38,220 gal above pump trip ) and a max level of 96% (64,752 gal above pump trip). Ref TLB-50 for T-119A

<sup>4</sup> Ref TLB-34

8. *Please provide the extent of equipment operation that is required to restore power and the Water Treatment returned to service. Is equipment restoration required? Does procedural guidance exist for an LOOP event?*

If the plant experienced a loss of offsite power, the temporary sand filter trailer<sup>5</sup>, pretreatment chemical injection<sup>6</sup>, pretreatment, the reverse osmosis units, and water treatment would lose power.

After offsite power is restored to B-07<sup>7</sup> and B-22<sup>8</sup> the plant could be restarted. Procedures, OI-73 and OI-73F do not specifically address recovery of the WT Plant following the postulated scenario. Power to 2B-02 would be restored using an existing procedure, AOP-18 in conjunction with AOP 0.1. The B-22 feeder breaker 2B52-42C, on 2B-02 would trip on under-voltage and require reset.<sup>9</sup> This action is not procedurally driven but would be performed from the control room using skill of the craft. Power to B-07 would be restored using AOP-18 with no breaker resets required. Individual pumps may require UV reset using Operator skill of the craft to recover the plant. The temporary sand filter trailer air operated valves would fail as is on loss of power to the portable air compressor. The trailer would likely drain to the clearwell. Upon restoration of flow, some throttling of the SW supply or alignment of the trailer may be required.

The time required to startup the water treatment plant is influenced by how long the plant has been off line. Generally, speaking the longer off line the longer the required rinse time for the softeners, RO membranes, and demineralizers. Discussions with qualified Auxiliary Operators produce an estimate of 40 minutes to 2 hours depending on the rinse time and impact evolutions in progress at the time of power loss. The simplified, general flow path for system start up is as follows: (note that some of these operations may be done in parallel) Start up multimedia trailer to supply filtered raw water to the clearwell. Rinse in and put a softener bed on line. Startup reverse osmosis units. Rinse in a cation demin and establish a vacuum in the deareator. Rinse in an anion and mixed bed.

9. *Please provide the status on the Margin Recovery for Auxiliary Feedwater.*

Sargent & Lundy (S&L) has been contracted to complete a study to restore design margins to the PBNP AFW System.

The following potential options have been identified for AFW System Margin Recovery:

*Make no physical modifications (i.e., recovery margin through refined analyses),*

*Make minor physical modifications (e.g., more accurate instrumentation to reduce impact of instrument inaccuracies on system margins),*

*Make major physical modifications (e.g., replace motor driven AFW pumps and motors), and*

*Make major system modifications (i.e., change the way that the system is designed to operate).*

---

<sup>5</sup> Ref Temp Mod 02-037, power from 74-L

<sup>6</sup> Ref Temp Mod 02-037, power from 74-L and B-71

<sup>7</sup> B-07 power is from 13.8KV bus H-01

<sup>8</sup> B-22 power is from 480V bus 2B-02 via 2A-02

<sup>9</sup> Ref AOP 0.1 Att A

These options are not mutually exclusive and the recommended approach for the AFW system margin recovery may include changes from more than one of these options.

For each of the options, S&L will perform technical feasibility study. For the options judged to be technically feasible, order of magnitude cost estimates will be developed.

This report is expected in August 2003.

After this report is received PBNP will consider the options and proceed with the most feasible recommendations.

Also: Work orders have been initiated to ensure that the entrance of valves MS-2005 and MS-2010 have rounded profile to minimize flow losses. An add sheet has been started to complete the work during U2R26. See OD for CR 00-1235 for more details.

*10. Provide the basis for crediting filling of a steam generator (S/G) with Cold Fire or Service Water considering a dry or near dry steam generator .*

In the event that normal AFW flow is unavailable due to pump failure, and other methods of restoring normal feedwater or condensate flow to the steam generators are not available, the steam generators may reach a dryout condition. In addition, if normal bleed and feed (using the high head SI pumps), or charging feed & bleed do not succeed in removing sufficient decay heat, critical safety procedures will instruct the operators to depressurize the steam generators and provide make-up flow by any means necessary. Using the Service Water system to provide flow through a seized AFW pump, cold lake water can be fed into a dry, hot steam generator.

The issue of thermal shock to the tubes and the shell has previously been considered in the preparation of the Severe Accident Management Guidance (SAMG) documents. The background document for SAG-1, "Inject into the Steam Generators", discusses this possibility, and advises to limit the reintroduction of feedwater into a dry steam generator to no more than 100 gpm for the first 10 minutes. This should limit the thermal stress developed in the tubes and the shell. In our MAAP analyses, the use of the service water system flow through an idle AFW pump has been shown to be approximately 90 gpm total, or 45 gpm per steam generator. Since this is well below the 100 gpm limit recommended in the SAMGs, severe thermal stresses are not expected to occur in the dry steam generators once SW flow is established.

*11. Taking into account that the SW Zurn strainer internals are not seismic, what affect will a seismic event have on the quality of water to the Auxiliary Feedwater system (considering low pressure injection). Would the SW Zurn strainer need to be bypassed?*

In March of this year an analysis was done to evaluate the seismic capability of the internals of Service Water Zurn strainers SW-2911-BS and SW-2912-BS. The analysis determined that the internal components of the strainer are rugged and adequately mounted and will not fail during or after a seismic event causing a blockage of flow. The analysis qualifies the convoluted screen, its mounting and mounting of the back wash arm. The operation of the backwash arm is not part of the qualification.

The evaluations are found in SQ-002126 and SQ-002127, which are provided at the back of this attachment.

*12. Please address the measure of certainty in the utilizing the Modular Accident Analysis Program (MAAP).*

The Modular Accident Analysis Program (MAAP), is a best-estimate, general-purpose severe accident code that can be used to predict transient behavior in the reactor coolant and secondary systems, core damage, and containment response. MAAP is widely used in the industry for performing thermal-hydraulic analyses to support PRA modeling, predict severe accident phenomenon, and to provide best-estimate transient behavior for various transients. Fauske & Associates (FAI), Inc developed MAAP, and maintain it under industry, EPRI, and DOE sponsorship.

MAAP is considered acceptable for supporting engineering bases for success criteria and event timing for quantification of Core Damage Frequency per ASME RA-S-2002. The standard recognizes the use of appropriate, realistic, best estimate analyses for thermal-hydraulic engineering bases.

MAAP has been benchmarked against experimental and industrial data. Some examples of these benchmarks include hydrogen mixing experiments at the decommissioned HDR reactor in Germany, fuel element behavior at the CORA test facility (also in Germany), and modeling of the Three Mile Island accident from initiation through core damage. Other benchmarking studies have also demonstrated the RCS modeling capabilities of MAAP (e.g., Davis-Besse Loss of Feedwater, Prairie Island steam generator tube rupture, and Crystal River stuck open PORV).

Although the MAAP code has not been explicitly benchmarked against Point Beach specific transients or analysis results, the MAAP parameter file is a Point Beach specific input originally developed for use under MAAP3, and later revised for use with MAAP4. Therefore, there is a high degree of confidence that the MAAP4 code will properly predict transient behavior of the Point Beach reactors.

*13. Provide a preliminary quantification of the risk increase of the Aux Feedwater orifice issue for internal events and seismic.*

Results of the preliminary quantification and a description of how the quantification was performed is included in Attachment 2. This attachment includes the event trees from the base Point Beach PRA model that were modified to account for this issue, the quantification by initiating event and sequence, and a detailed description of how the quantification was performed, again by initiator and sequence.

Attachment 5 is a summary of the MAAP analyses that were performed to support the success criteria for systems credited in the quantification. (preliminary information).

Attachment 6 is a summary of the development of human error probabilities used in the quantification. (preliminary information).

<b>SCREENING EVALUATION WORK SHEET (SEWS)</b>		GIP Rev 2, Corrected, 2/14/92 Status: Yes Sheet 1 of 10
ID : SW-2911-BS ( Rev. 1 )	Class : 0. Other	
Description : NORTH SERVICE WATER HEADER ZURN STRAINER		
Building : CWPH	Floor El. : 8.00	Room, Row/Col :
Manufacturer, Model, Etc. :		

**SEISMIC CAPACITY VS DEMAND**

1.	Elevation where equipment receives seismic input	8.00
2.	Elevation of seismic input below about 40' from grade (grade = 8.00)	N/A
3.	Equipment has fundamental frequency above about 8 Hz (est. frequency = 10.00)	N/A
4.	Capacity based on:	
5.	Demand based on:	

Does capacity exceed demand? Yes

**ANCHORAGE**

1.	The sizes and locations of anchors have been determined.	Yes
2.	Appropriate equipment characteristics have been determined (mass, CG, natural freq., damping, center of rotation).	Yes
3.	The type of anchorage is covered by the GIP.	Yes
4.	The adequacy of the anchorage installation has been evaluated (weld quality and length, nuts and washers, expansion anchor tightness, etc.)	Yes
5.	Factors affecting anchorage capacity or margin of safety have been considered: embedment length, anchor spacing, free-edge distance, concrete strength/condition, and concrete cracking.	Yes
6.	For bolted anchorages, any gaps under the base are less than 1/4 .	Yes
7.	Factors affecting essential relays have been considered: gaps under the base, capacity reduction for expansion anchors.	N/A
8.	The base has adequate stiffness and the effect of prying action on anchors has been considered.	Yes
9.	The strength of the equipment base and the load path to the CG is adequate.	Yes
10.	The adequacy of embedded steel, grout pads or large concrete pads have been evaluated.	Yes
11.	The anchorage capacity exceeds the demand.	Yes

Are anchorage requirements met? Yes

**INTERACTION EFFECTS**

1.	Soft targets are free from impact by nearby equipment or structures.	Yes
2.	If the equipment contains sensitive relays, it is free from all impact by nearby equipment or structures.	N/A
3.	Attached lines have adequate flexibility.	Yes
4.	Overhead equipment or distribution systems are not likely to collapse.	Yes
5.	No other adverse concerns were found.	Yes

Is equipment free of interaction effects? Yes

**IS EQUIPMENT SEISMICALLY ADEQUATE?** Yes

<b>SCREENING EVALUATION WORK SHEET (SEWS)</b>		GIP Rev 2, Corrected, 2/14/92 Status: Yes Sheet 2 of 10
ID : SW-2911-BS ( Rev. 1 )	Class : 0. Other	
Description : NORTH SERVICE WATER HEADER ZURN STRAINER		
Building : CWPH	Floor El. : 8.00	Room, Row/Col :
Manufacturer, Model, Etc. :		

### COMMENTS

The SRT is D. N. Carter & D. P. Brown on 3/6/2003

SEWS Revisions:

Rev. 0 - Original A-46 Evaluation

Rev. 1 - Clarification of scope of original evaluation.

References:

1. Sargent & Lundy Dwgs. B-4, B-5 & B-16
2. Spec G-236-06
3. S&L Form 1737-B
4. Zurn "STRAIN-O-MATIC" catalog (Manual #164) (Contained in CIM00612).
5. Zurn Industries Drawing 47736 (Contained in CIM00612)
6. Bill of Material for Zurn Figure 592-24", Model '67' (Attached)
7. BECH Drawing M-207, sheet 1, Rev. 63.

Description of Issue:

During the A-46 evaluation, the service water strainers were qualified as Equipment Class 0 which means that while no specific earthquake experience data exists for the type of equipment, the Seismic Review Team was able to qualify by analysis. An analysis of this type generally makes a judgment as to the ruggedness of the particular piece of equipment. The determination of ruggedness is based on a review of the equipment design. While the Rev. 0 SEWS provides the seismic qualification for the entire strainer and therefore implicitly covers the internal components, the evaluation does not explicitly address the seismic qualification of the internal components. This evaluation provides clarification that the internal components are seismically adequate to continue straining service water during and after a seismic event.

Description of Strainer:

The strainer consists of a cylindrical body which is anchored to the floor. Attached to the cylinder are two flanges 180 degrees apart. The service water pipes connect to the flanges. Inside the strainer, there is convoluted screen attached to a frame. The screen forms a 240 degree (approx.) arc. The screen is attached to the frame with 20 1/2"-13 hex head screws, nuts and washers. In addition there is a backwash arm inside the strainer. The backwash arm is attached to a shaft which penetrates the cover and base of the strainer. It is supported off bearings at each of these locations.

Seismic Evaluation of Strainer:

The 20 1/2"-13 screws will assure that the screen does not detach from the supporting frame. This number of screws is judged to be adequate to prevent the screen from dislodging from the supporting frame. The backwash arm spans between the top cover and the base of the strainer. This is approximately 47". The backwash arm is adequately supported to prevent it from a failure which would cause the service water to clog. Therefore, it is concluded that the service water strainer internal components will not fail during a seismic event causing clogging

<b>SCREENING EVALUATION WORK SHEET (SEWS)</b>		GIP Rev 2, Corrected, 2/14/92 Status: Yes Sheet 3 of 10
ID : SW-2911-BS ( Rev. 1 )	Class : 0. Other	
Description : NORTH SERVICE WATER HEADER ZURN STRAINER		
Building : CWPH	Floor El. : 8.00	Room, Row/Col :
Manufacturer, Model, Etc. :		

of the service water system. The backwash arm is the only moving part of the strainer. As documented in the Rev. 0 SEWS, the backwash arm control panel was not required to be seismically qualified. Therefore, the backwash arm is not qualified for function as part of this evaluation. This qualification only addresses the non moving iparts of the strainer and the mounting of the backwash arm.

Clarification of strainer model:

Per CHAMPS the strainer is a model no. 592A-24-70117. The '24' indicating that the attached pipes are 24" diameter. Per Ref. #7, the strainer is to be attached to 24" lines. The dimensions shown in Ref. #4 for a 24" strainer do not match field dimensions. A review of the bill of material for the strainers (Ref. #6) reveals that the dimensions for the strainer are comparable to the Size 18 or 20 strainer shown in Ref. #4. Therefore, the use of the dimensions and weight for the 18" strainer for the anchor analysis in the Rev. 0 SEWS is correct.

Revision 0 Notes:

Capacity:

The SRT estimated the fundamental frequency at about 10 Hz.

Anchorage:

The strainer is supported on four short (approx. 4") legs. The legs are anchored by 4 - 1" cast-in-place anchor bolts (1 bolt per leg) onto 2 concrete piers (2 legs per pier). The pier are 3'-9" long x 1'-0" wide x 18" high and 2'-9" apart (c/c).

The strain's dimensions are 43" diameter and 55" tall. The bolts are arranged in a 46-1/8" diameter bolt circle (DBC), such that the center of the DBC is at the center of the two piers. The weight of the strain is 4150# and the center of gravity can be assumed at about 30" above the piers.

The attached piping is well supported, so only the weight of the strainer needs to be accounted for in the anchor analysis.

Refer to Rev. 0 SEWS for Anchor Analysis.

Since, there is no floor response spectra available, use the peak of the ground response spectra for the anchorage analysis.

Other:

The SRT noted that there may be an interaction concern with the strainer control panels (RK-31 & RK-32). However, WEPCo determined that the strainers do not need to operate, they just need to maintain SW system integrity. Hence, the strainer control panel were deleted from the SSEL.

The seismic qualification for the strainer is the Rev. 0 & 1 SEWS.

This evaluationis identified as SQ-002126.

<b>SCREENING EVALUATION WORK SHEET (SEWS)</b>		GIP Rev 2, Corrected, 2/14/92 Status: Yes Sheet 4 of 10
ID : SW-2911-BS ( Rev. 1 )	Class : 0. Other	
Description : NORTH SERVICE WATER HEADER ZURN STRAINER		
Building : CWPH	Floor El. : 8.00	Room, Row/Col :
Manufacturer, Model, Etc. :		

Evaluated by:

Date:

*Dudley Cart*

3-6-03

*Douglas P. Brown*

3/7/03

- Attachment: BOM For Strainer Page 1
- Attachment: BOM for Strainer Page 2
- Attachment: BOM for Strainer Page 3
- Attachment: BOM for Strainer Page 4
- Attachment: BOM for Strainer Page 5
- Attachment: BOM for Strainer page 6

**SCREENING EVALUATION WORK SHEET (SEWS)**

GIP Rev 2, Corrected, 2/14/92  
 Status: Yes  
 Sheet 5 of 10

ID : SW-2911-BS ( Rev. 1 )	Class : 0. Other
Description : NORTH SERVICE WATER HEADER ZURN STRAINER	
Building : CWPB	Floor El. : 8.00
Room, Row/Col :	
Manufacturer, Model, Etc. :	

**BOM For Strainer Page 1**

W49-36-03 08:38 FROM-SEV GROUP 220-755-8838 7-274 0 02/97 E-581

592A

CUSTOMER DATA Bechtel Corporation  
 O.N. 6118-M-105-AC

ASSEMBLY 70117  
 ORDER No. 67-29173

PC	SIZE	ASSEMBLY NAME	COMPILED BY	CHECKED BY	DATE	UNITS		
066	24"	Strain-O-Matic	R.R.	H.N.	2/27/68	2		
PART NAME		MATERIAL		COST OR LOCATION	PART NUMBER	Per Ass'y	Per Ord.	pl 5
Furnish Assembly 592-24" Model 67								
Body Weldment 150# ASA Steel 46049-1-40 1								
Note: Coded Groove Dim. 23.565								
Cooperated Strainer Element S/S 46053-1-50 2								
1/8" Porf. on 3/16 S.O. #18 Ga. Fully annealed 40% Open								
Motors: 1 HP 230/460 Volt, 3 phase, 60 cycle 1								
1800 RPM, Ball bearing, T.B.F.C. 56c Frame								
Westinghouse Style No. 311P378								
Backwash Valve: 3" NPT Ball valve 1								
Hampshire Cat. No. 3" D14MT With Styl- St								
Safety-return operator No. ST-150-B5								
(To fail closed) and 3-Way air control								
solenoid Type 83164, unit to be furnished completely								
assembled. Available from Lake Erie Pipe & Supply.								
Differential Pressure Switch: United Electric 1								
Controls, Type I-27XB, Model 150, Stock #0644								
SBS #10-24 x 1/2 lg. Steel 21213-21-40 2								
Control Panel Nema 12 48098 1								
Control Panel Nameplate S/S 36167-1-50 1								
Rd. Fl. Scw. #4-40 x 1/2 lg. S/S 4								
Type 'F' Selftapping (Parker Kalon)								
Heater Elements for 460 Volt operation 3								
AlleneBradley Type N-9								
Nameplate Data:								
Prod. No. 592A Size 24" Rated pressure 150#								
Flanged 150# ASA Ref. No. 592A-24"-70117 Model '67'								
Control Panel Nameplate Data:								
Serial No. 48098, Nema 12								
REVISION DATA Original C.N. 46731								

# SCREENING EVALUATION WORK SHEET (SEWS)

GIP Rev 2, Corrected, 2/14/92  
 Status: Yes  
 Sheet 6 of 10

ID : SW-2911-BS ( Rev. 1 )

Class : 0. Other

Description : NORTH SERVICE WATER HEADER ZURN STRAINER

Building : CWPH

Floor El. : 8.00

Room, Row/Col :

Manufacturer, Model, Etc. :

## BOM for Strainer Page 2

WAR-06-09 09:09 FROM-SEN GROUP  
 JFN-13-0000 14:54

420-100-0000

14774 P 03/07 4-00



### BILL OF MATERIAL

MOURE	552-24"
Model	'57'
ASSEMBLY	
ORDER No.	

Sheet 2 of 2  
 OTHER DATA

PC	SIZE	ASSEMBLY NAME	COMPILED BY	CHECKED BY	DATE	UNITS
066	24"	Strain-0-Matic	RS	RS	3/4/68	
PART NAME	MATERIAL	COST OR LOCATION	PART NUMBER	Qty	Per Ord.	Per
Plug Nut	3/8-16 x 2.50 Jamson & Scarsion	S/S		20		
Plug Nut	3/8-16 x 1.25 Jamson & Scarsion	S/S		5		
(1) Port Assembly		Steel	36676-1-40	4		
Bottom Plate	7/8 x 5 x 3/8	Steel	36676-2-40	4		
Left Angle	L 2 1/2 x 2 1/2 x 1/2 x 12	Steel	36676-3-40	4		
Right Angle	R 2 1/2 x 2 1/2 x 1/2 x 12	Steel	36676-4-40	4		
Reducer Mount Assy		Steel	36678-1-40	1		
Plate	17-3/4 x 1 1/2 x 1"	Steel	36678-2-40	1		
Plate	5-1/8 x 3-3/8 x 1 1/2	Steel	36678-3-40	4		
Arm Assy		S/S	47644-1-50	1		
Side Wall	4 1/2 x 2 1/2 x 3/16	S/S	47644-2-50	2		
Top Plate	40-3/4 x 1-7/8 x 3/8	S/S	47644-3-50	1		
Keene Bar	4 1/2 x 2 x 1	S/S	47644-4-50	2		
Top Carrier	12-1/16 x 5-7/8 x 1/2	S/S	47618-1-50	1		
Bottom Carrier	12-1/16 x 5-7/8 x 1/2	S/S	47618-2-50	1		
Middle Carrier	12-1/16 x 5-7/8 x 1/2	S/S	47620-1-50	1		
Port Seal Assy		AS Steel	47653-1	2		
Seal		BRASS	47653-2-50	2		
Nut Plate		S/S	47653-3-50	2		
WAS	3/8-16 x 1 1/2	S/S	26050-44-50	12		
Lockwasher	3/8 Nom.	S/S	23751-2-50	12		
Port End Seal	1-15/16 x 2 1/2 x 3/16	S/S	47527-1-50	2		
WAS	1-20 x 5/8	S/S	26050-2-50	4		
Lockwasher	1/2 Nom.	S/S	23751-11-50	4		
Flat Washer	1/2 Nom.	S/S	14854-1-50	4		
Eye Bolt	3/4-10 NC	Steel	18815-2-40	2		
Cover Gasket		ASB	35175-64-94	1		
Vent Cock	1/2 NPT	BRASS	ASSV 64379	1		
Packing Set		Dyck & Rubber	35637-6-90	1		
Packing Gland	6 1/2 Dia x 1/2 thk	Steel	37269-1-40	1		
WAS	5/16-18 x 7/8	S/S	26050-23-50	4		
Lower Bearing	5/8-16 x 3/4	S/S	18006-72-50	2		
Spring Control	3/8 x 5/8 Dia x 3/16	BRASS	47631-1-30	1		

REVISION DATA. Revised and Rechecked CW 46753  
 REV. A.C.N. 47019 6/10/68 REV. D JN 14133 4/2/85  
 C 47020 7/3/68  
 47399 12/11/68

SCREENING EVALUATION WORK SHEET (SEWS)

GIP Rev 2, Corrected, 2/14/92  
 Status: Yes  
 Sheet 7 of 10

ID : SW-2911-BS ( Rev. 1 )

Class : 0. Other

Description : NORTH SERVICE WATER HEADER ZURN STRAINER

Building : CWPH

Floor El. : 8.00

Room, Row/Col :

Manufacturer, Model, Etc. :

BOM for Strainer Page 3

WAR-36-37 16:33 FROM-SEN GROUP  
 JRN-11-24430 16:54

320-755-8930

7-774 P 04/97 P-65\*

Model '67'

Sheet 7 of 5

ASSEMBLY

PART NAME	MATERIAL	UNIT	LAST REVISION	Per	Per
				Asfy.	Ord.
Body Nameplate	S/S		38136-1-50	1	
Inlet Tag	S/S		48150-1-50	1	
Escutcheon Pin	S/S		14861-1-50	6	
(2) Strain-O-Matic Decal				1	
Top Shear Pin Flange 5-3/4 Dia x 3/8 thk.	Steel		47628-1-60	1	
Key 3/4 Sq x 3/4 lg.	Keystock		22573-10-60	1	
SHSS 1/2-20 x 1/2	S/S		18006-45-50	1	
(3) Lower Shear Pin Flange 5-3/4 Dia x 1-5/8 thk.	Steel		47627-1-60	1	
Roll Pin 3/8 Dia x 1 1/2	Steel		45553-6-60	2	
Hydraulic Lubrication Fitting 1/8 NPT				1	
(Semmer-Warroc) Alemico Cat. No. 1610-B1					
Washer 1/4 Dia x 1/16 thk	Brass		47629-1-30	1	
Shear Pin 3/8 Dia x 1-3/4 lg.	Brass		47579-2-30	1	
Cotter Pin	Brass		6808-16-30	1	
Special Nur	Steel		47630-1-60	1	
(4) Cam Assy	Steel		47654-1-60	1	
Cam 7-3/4 x 3 1/2 x 1/2	Steel		47654-2-60	1	
Tube 1 1/2 O.D. x 1/8 WALL x 3 1/2	Steel		47654-3-60	1	
Collar	Steel		36406-5-60	1	
SHSS 1/2-13 x 5/8	Steel		18006-98-60	7	
Reducer	Winmith 8SPDM	Comm.		1	
Ratio 1720 to 1 per chest wdg.					
888M-55A-48 Hollow bore to be					
3" Dia.					
HMCS 5/8-11 x 1 1/2	Steel		26050-122-60	4	
Lockwasher 5/8 Nom.	Steel		23751-4-60	4	
Dowel Pin 1/2 Dia.	Steel		73927-3-60	2	
(5) Limit Switch	National Acme Co.	Comm.		1	
Cat. No. D-1200-X1-SS					
Operating Lever	National Acme Co.	Comm.		1	
Cat. No. D-1260X					
SHCS 1/2-20 x 1 1/2	Steel		21213-62-60	4	
Lockwasher 1/2 Num.	S/S		23751-11-60	4	
Nur 1/2 Hex.	Steel		14868-2-60	4	
Coupling	Lord Mfg. Co.	Comm.		1	
Cat. No. J-1211-S with 3/8 bore					
6 Std. keyway one end & 5/8 bore					
& Std. keyway other end					
Lower Support Ring	C.I.		18676-1-10	1	
Pipe Plug 1" NPT (See P.N. Bulletin 60-8)				1	

**SCREENING EVALUATION WORK SHEET (SEWS)**

GIP Rev 2, Corrected, 2/14/92  
 Status: Yes  
 Sheet 8 of 10

ID : SW-2911-BS ( Rev. 1 )      Class : 0. Other  
 Description : NORTH SERVICE WATER HEADER ZURN STRAINER  
 Building : CWPH      Floor El. : 8.00      Room, Row/Col :  
 Manufacturer, Model, Etc. :

**BOM for Strainer Page 4**

MAR-08-03 09:38 FROM-SEN GROUP 275-755-6930 7-774 P 05/07 F-691  
 JAN-13-2000 16:54 99100 Model '62'  
 sheet 3 of 5  
 ASSEMBLY

SIZE 1/2" ORDER No. UNITS LAST REVISION A

PART NAME	MATERIAL	COST OR LOCATION	PART NUMBER	Per Ass'y	Per Ord.	Q'ty
Spring		S/S	36510-1-50	8		
Motor spacer	6-3/4 Dia x 2" Lnk	Steel	37319-1-40	1		
WASCS	3/8-16 x 2 1/2	Steel	26050-50-40	4		
Inspection Port Cover	11 x 7 x 1 1/2	Steel	45719-1-50	1		
Gasket	1/8 Fbk	BRK	23452-10-90	1		
(A) WACS	7/8-9 x 2 1/2	Steel	26050-164-30	2		
Washer	7/8 Nom	Steel	14858-7-40	2		
Handhole Fitting	6 x 8 Type S	Steel		4		
	Innapa Forging Co. (Or equal)					
(7) Sash Chain	Size #40 (Approx 18" long)	Steel		4		
	American Chain Co.					
(7) WASCS	3/8-32 x 1/2	Steel	21211-6-40	8		
Straining element fasteners						
WACS	1/2-11 NC x 2"	S/S	26050-251-50	20		
Lockwasher	1/2 Nom	S/S	21751-3-50	20		
Washer	1/2 Nom	S/S	14858-5-50	20		
Mounting Nut	1-3/4 x 1 1/2 x 1/2	S/S	38850-1-50	4		
WACS	3/8-16 NC x 2-3/4	S/S	22628-44-50	4		
Furnish when convoluted straining element is specified						
Straining Element Assembly		S/S	46053-1-50	2		
Straining Element Screen (As spec. on order)		S/S	46053-2-50	2		
(8) Clamping Ring	26 1/2 O.D. x 2 3/4 I.D. x 3/4	S/S	48741	2		
(9) Locating Ring	26 1/2 O.D. x 2 3/4 I.D. x 3/8	S/S	38685	2		
Mounting Bar	2 1/2 x 2 x 1/2	S/S	45513-1-50	4		
Top Seal Ring		S.I.	37354-1-70	1		
FURNISH WITH EACH COMPLETE STRAINER						
ALIGNMENT FIXTURE		Steel	46661-1-40	1		
Alignment Tool Baseplate		S/S	46696-1-50	1		
Escutcheon Pin		S/S	14841-1-50	4		

PCD:ENG-13M67

**SCREENING EVALUATION WORK SHEET (SEWS)**

GIP Rev 2, Corrected, 2/14/92  
 Status: Yes  
 Sheet 9 of 10

ID : SW-2911-BS ( Rev. 1 )	Class : 0. Other
Description : NORTH SERVICE WATER HEADER ZURN STRAINER	
Building : CWPH	Floor El. : 8.00
Room, Row/Col :	
Manufacturer, Model, Etc. :	

**BOM for Strainer Page 5**

MAR-02-91 16:35 FROM: SEN GROUP 470-755-5981 1-774 P. 08/27 1-1991  
 JAN-13-2000 16:10  
 FIGURE 592--24"  
 Model 167  
 DRAWING

PART NAME	MATERIAL	COST OR LOCATION	PART NUMBER	QTY	REV	QTY	REV
Furnish for 125# ASA & 150# ASA Units							
Cover Weldment	Steel		37341-1-40	1			
Plate 31-3/4 Dia x 2" Thk.	SA516-55		37341-2-40	1			
Cover Machining Dwg. #37342-1							
Backwash Arm Weldment	As spec.		47651-1	1			
Drive Shaft Assy	As spec.		47644-1	1			
Shaft 3 1/2 Dia x 6 1/2	SA516-55		47644-2-40	1			
Discharge Tube 4" O.D. x 3/8 Wall x 16"	S/S		47644-3-50	1			
(10) Backwash Arm Machining Dwg. #47652-1							
Bearing Sleeve 3" O.D. x 1/2 Wall x 6 1/8	S/S		47650-5-50	1			
(11) Packing Sleeve 3-5/8 O.D. x 7/16 Wall x 3-3/8 L	S/S		47646-5-50	1			
(6) Cover Bolt 3/4-10 x 4 1/2	Steel		22086-58-90	24			
(6) Cover Nut 3/4-10 Hex.	Steel		14848-9-90	24			
Washer 3/4 Non	Steel		14858-8-40	24			
(12) Cutless Rubber Bearing	Comp.		35406-24-90	1			
(13) Body Weldment 150# ASA	As spec.		46049-1	1			
150# ASA Raised Flange Flange	Steel		35155-9-40	2			
(13) Body Weldment 125# ASA	As spec.		46049-2	1			
125# ASA Flat Face Flange	Steel		35157-9-40	2			
Shell 9/16 x 47-3/8 x 13 1/4	SA516-55		46052-2-40	1			
Nozzle 2 1/2" Size x 375 Wall x 9"	Steel		46052-3-40	1			
Case 1 1/2 x 46-3/8 x 8 1/2	Steel		47951-1-40	1			
Nozzle 2 1/2" Size x 375 Wall x 17"	Steel		47951-2-40	1			
Top Plate 41-7/8 Dia x 3" thk	SA516-55		48101-14-40	1			
Guide Blocks 2 x 2 x 1 1/2	Steel		48090-2-40	1			
Bottom Plate 41-7/8 Dia x 3/4 thk	SA516-55		48103-14-40	1			
Sleeve 6" O.D. x 3/4 Wall x 5 1/2	S/S		48074-1-50	1			
Flangeplate Bracket 6 1/2 x 11 1/2 x 1/8	Steel		26635-1-40	1			
Thread-O-Let 1/2 NPT	Steel		26635-1-40	2			
Handhole Ring 6 x 8 x 3/4 x 3	Steel			5			
Lift Eye 1-1/4 Dia x 1-1/4	Steel		48282-7-40	1			
Body Machining Dwg. #37358-1							
(1) Final Weldment Dwg. #37339-1							
(1) 150# ASA Backwash Flange 7 1/2 Dia x 1 1/2			36674-1-40	1			
(1) 150# ASA Blowoff Flange 7 1/2 Dia x 1 1/2			36673-1-40	1			
(1) 125# ASA Backwash Flange 7 1/2 Dia x 1 1/2			36674-2-40	1			
(1) 125# ASA Blowoff Flange 7 1/2 Dia x 1 1/2			36673-2-40	1			

**SCREENING EVALUATION WORK SHEET (SEWS)**

GIP Rev 2, Corrected, 2/14/92  
 Status: Yes  
 Sheet 10 of 10

ID : SW-2911-BS ( Rev. 1 )

Class : 0. Other

Description : NORTH SERVICE WATER HEADER ZURN STRAINER

Building : CWPB

Floor El. : 8.00

Room, Row/Col :

Manufacturer, Model, Etc. :

**BOM for Strainer page 6**

MAR-06-92 09:40 FROM:SEN GROUP

920-355-6336

T-774 P 07/07 P-69

Size 24"

Model 1071  
 ASSEMBLY

ORDER No. UNITS LAST REVISION

- Note 1: Parts to be added after body machining is completed. See dwg. 37339.
- Note 2: Locate decal over inlet nozzle.
- Note 3: Position lower shear pin flange on upper shaft end of reducer before reducer is assembled to strainer. Drill (2) 3/8" Dia holes as indicated on dwg. 47621, thru flange and reducer hollow bore. Match mark shear pin hole in top and bottom flanges at assy.
- Note 4: After cam has been properly positioned, insert one SESS into collar and tighten onto shaft. Matchmark backwash arm shaft and cam collar. Center punch shaft thru second set screw hole, insert second SESS in collar and tighten onto shaft.
- Note 5: Modify limit switch per drawing 35642
- Note 6: Fasteners to be per P.M. Bulletin #D-7
- Note 7: Attach mesh chain to all of the handhole fittings and handhole rings with #8-32 SECS.
- Note 8: Furnish 48141-1 for #20 Cage straining element.  
 Furnish 48141-3 for #18 Cage straining element.  
 Furnish 48141-2 for #16 Cage straining element.
- Note 9: Furnish 38685-1 for #20 Cage straining element  
 Furnish 38685-3 for #18 Cage straining element.  
 Furnish 38685-2 for #16 Cage straining element.
- Note 10: Bearing sleeve & packing sleeve are to be added after backwash arm machining is completed. Parts to be heated to 350°F & shrunk in place as shown on drawing 47652. Apply 1/8" bead of GE-RTV-102 Silicone rubber to bearing & packing sleeve seats on backwash arm immediately prior to shrinking sleeve onto shaft
- Note 11: Packing surface of backwash arm to be sprayed with Hercules Packing Co. (Super Boroulon) lubricant and air dried before assembly. Do not spray inside packing bore in cover.
- Note 12: At final assembly, the cutless rubber bearings should be lubricated with B.F. Goodrich (Rub-Lube) for cutless rubber bearing.
- Note 13: Paint all surfaces not exposed to internal fluid. Epoxy resin coat all surfaces exposed to internal fluid. Do not coat any stainless steel, non-ferrous, or cast iron parts.
- Note 14: Unless otherwise indicated, all material shown as stainless steel to be Type 304 (Or equal).

TOTAL P 07

<b>SCREENING EVALUATION WORK SHEET (SEWS)</b>		GIP Rev 2, Corrected, 2/14/92 Status: Yes Sheet 1 of 4
ID : SW-2912-BS ( Rev. 1 )	Class : 0. Other	
Description : SOUTH SERVICE WATER HEADER ZURN STRAINER		
Building : CWPH	Floor El. : 8.00	Room, Row/Col :
Manufacturer, Model, Etc. :		

**SEISMIC CAPACITY VS DEMAND**

1.	Elevation where equipment receives seismic input	8.00
2.	Elevation of seismic input below about 40' from grade (grade = 8.00)	N/A
3.	Equipment has fundamental frequency above about 8 Hz (est. frequency = 10.00)	N/A
4.	Capacity based on:	
5.	Demand based on:	

Does capacity exceed demand? Yes

**ANCHORAGE**

1.	The sizes and locations of anchors have been determined.	Yes
2.	Appropriate equipment characteristics have been determined (mass, CG, natural freq., damping, center of rotation).	Yes
3.	The type of anchorage is covered by the GIP.	Yes
4.	The adequacy of the anchorage installation has been evaluated (weld quality and length, nuts and washers, expansion anchor tightness, etc.)	Yes
5.	Factors affecting anchorage capacity or margin of safety have been considered: embedment length, anchor spacing, free-edge distance, concrete strength/condition, and concrete cracking.	Yes
6.	For bolted anchorages, any gaps under the base are less than 1/4 .	Yes
7.	Factors affecting essential relays have been considered: gaps under the base, capacity reduction for expansion anchors.	N/A
8.	The base has adequate stiffness and the effect of prying action on anchors has been considered.	Yes
9.	The strength of the equipment base and the load path to the CG is adequate.	Yes
10.	The adequacy of embedded steel, grout pads or large concrete pads have been evaluated.	Yes
11.	The anchorage capacity exceeds the demand.	Yes

Are anchorage requirements met? Yes

**INTERACTION EFFECTS**

1.	Soft targets are free from impact by nearby equipment or structures.	Yes
2.	If the equipment contains sensitive relays, it is free from all impact by nearby equipment or structures.	N/A
3.	Attached lines have adequate flexibility.	Yes
4.	Overhead equipment or distribution systems are not likely to collapse.	Yes
5.	No other adverse concerns were found.	Yes

Is equipment free of interaction effects? Yes

IS EQUIPMENT SEISMICALLY ADEQUATE? Yes

REC'D MAR 10 2003

<b>SCREENING EVALUATION WORK SHEET (SEWS)</b>		GIP Rev 2, Corrected, 2/14/92 Status: Yes Sheet 2 of 4
ID : SW-2912-BS ( Rev. 1 )	Class : 0. Other	
Description : SOUTH SERVICE WATER HEADER ZURN STRAINER		
Building : CWPH	Floor El. : 8.00	Room, Row/Col :
Manufacturer, Model, Etc. :		

### COMMENTS

The SRT is D. N. Carter & D. P. Brown on 3/6/2003

SEWS Revisions:

Rev. 0 - Original A-46 Evaluation

Rev. 1 - Clarification of scope of original evaluation.

References:

1. Sargent & Lundy Dwgs. B-4, B-5 & B-16
2. Spec G-236-06
3. S&L Form 1737-B
4. Zurn "STRAIN-O-MATIC" catalog (Manual #164) (Contained in CIM00612).
5. Zurn Industries Drawing 47736 (Contained in CIM00612)
6. Bill of Material for Zurn Figure 592-24", Model '67' (Attached to SEWS for SW-2911-BS)
7. BECH Drawing M-207, sheet 1, Rev. 63.

Description of Issue:

During the A-46 evaluation, the service water strainers were qualified as Equipment Class 0 which means that while no specific earthquake experience data exists for the type of equipment, the Seismic Review Team was able to qualify by analysis. An analysis of this type generally makes a judgment as to the ruggedness of the particular piece of equipment. The determination of ruggedness is based on a review of the equipment design. While the Rev. 0 SEWS provides the seismic qualification for the entire strainer and therefore implicitly covers the internal components, the evaluation does not explicitly address the seismic qualification of the internal components. This evaluation provides clarification that the internal components are seismically adequate to continue straining service water during and after a seismic event.

Description of Strainer:

The strainer consists of a cylindrical body which is anchored to the floor. Attached to the cylinder are two flanges 180 degrees apart. The service water pipes connect to the flanges. Inside the strainer, there is convoluted screen attached to a frame. The screen forms a 240 degree (approx.) arc. The screen is attached to the frame with 20 1/2"-13 hex head screws, nuts and washers. In addition there is a backwash arm inside the strainer. The backwash arm is attached to a shaft which penetrates the cover and base of the strainer. It is supported off bearings at each of these locations.

Seismic Evaluation of Strainer:

The 20 1/2"-13 screws will assure that the screen does not detach from the supporting frame. This number of screws is judged to be adequate to prevent the screen from dislodging from the supporting frame. The backwash arm spans between the top cover and the base of the strainer. This is approximately 47". The backwash arm is adequately supported to prevent it from a failure which would cause the service water to clog. Therefore, it is concluded that the service water strainer internal components will not fail during a seismic event causing clogging

<b>SCREENING EVALUATION WORK SHEET (SEWS)</b>		GIP Rev 2, Corrected, 2/14/92 Status: Yes Sheet 3 of 4
ID : SW-2912-BS ( Rev. 1 )	Class : 0. Other	
Description : SOUTH SERVICE WATER HEADER ZURN STRAINER		
Building : CWPH	Floor El. : 8.00	Room, Row/Col :
Manufacturer, Model, Etc. :		

of the service water system. The backwash arm is the only moving part of the strainer. As documented in the Rev. 0 SEWS, the backwash arm control panel was not required to be seismically qualified. Therefore, the backwash arm is not qualified for function as part of this evaluation. This qualification only addresses the non moving iparts of the strainer and the mounting of the backwash arm.

Clarification of strainer model:

Per CHAMPS the strainer is a model no. 592A-24-70117. The '24' indicating that the attached pipes are 24" diameter. Per Ref. #7, the strainer is to be attached to 24" lines. The dimensions shown in Ref. #4 for a 24" strainer do not match field dimensions. A review of the bill of material for the strainers (Ref. #6) reveals that the dimensions for the strainer are comparable to the Size 18 or 20 strainer shown in Ref. #4. Therefore, the use of the dimensions and weight for the 18" strainer for the anchor analysis in the Rev. 0 SEWS is correct.

Revision 0 Notes:

Capacity:

The SRT estimated the fundamental frequency at about 10 Hz.

Anchorage:

The strainer is supported on four short (approx. 4") legs. The legs are anchored by 4 - 1" cast-in-place anchor bolts (1 bolt per leg) onto 2 concrete piers (2 legs per pier). The pier are 3'-9" long x 1'-0" wide x 18" high and 2'-9" apart (c/c).

The strain's dimensions are 43" diameter and 55" tall. The bolts are arranged in a 46-1/8" diameter bolt circle (DBC), such that the center of the DBC is at the center of the two piers. The weight of the strain is 4150# and the center of gravity can be assumed at about 30" above the piers.

The attached piping is well supported, so only the weight of the strainer needs to be accounted for in the anchor analysis.

The anchor analysis is in the Rev. 0 SEWS for SW-2911-BS.

Since, there is no floor response spectra available, use the peak of the ground response spectra for the anchorage analysis. For anchorage analysis see SW-2911-BS.

Other:

The SRT noted that there may be an interaction concern with the strainer control panels (RK-31 & RK-32). However, WEPCo determined that the strainers do not need to operate, they just need to maintain SW system integrity. Hence, the strainer control panel were deleted from the SSEL.

The seismic qualification for the strainer is the Rev. 0 & 1 SEWS.

This evaluation is identified as SQ-002127.

<b>SCREENING EVALUATION WORK SHEET (SEWS)</b>		GIP Rev 2, Corrected, 2/14/92 Status: Yes Sheet 4 of 4
ID : SW-2912-BS ( Rev. 1 )	Class : 0. Other	
Description : SOUTH SERVICE WATER HEADER ZURN STRAINER		
Building : CWPH	Floor El. : 8.00	Room, Row/Col :
Manufacturer, Model, Etc. :		

Evaluated by:

Date:

*Dwight Carter*

3-6-03

*Douglas B Brown*

3/7/03

**ATTACHMENT 2**

**Qualification of the Risk Increase –**


**Point Beach AFW Orifice Issue (Preliminary)**

**POINT BEACH NUCLEAR PLANT, UNITS 1 AND 2**

## **Quantification of the Risk Increase**


### **Point Beach AFW Orifice Issue**

1. Modified PRA Model Event Trees – Showing New Top Events and Sequences
2. Sequence Quantification – Summary of Potentially Significant Initiating Events - Unit 2
3. Description of Sequence Quantification by Initiator

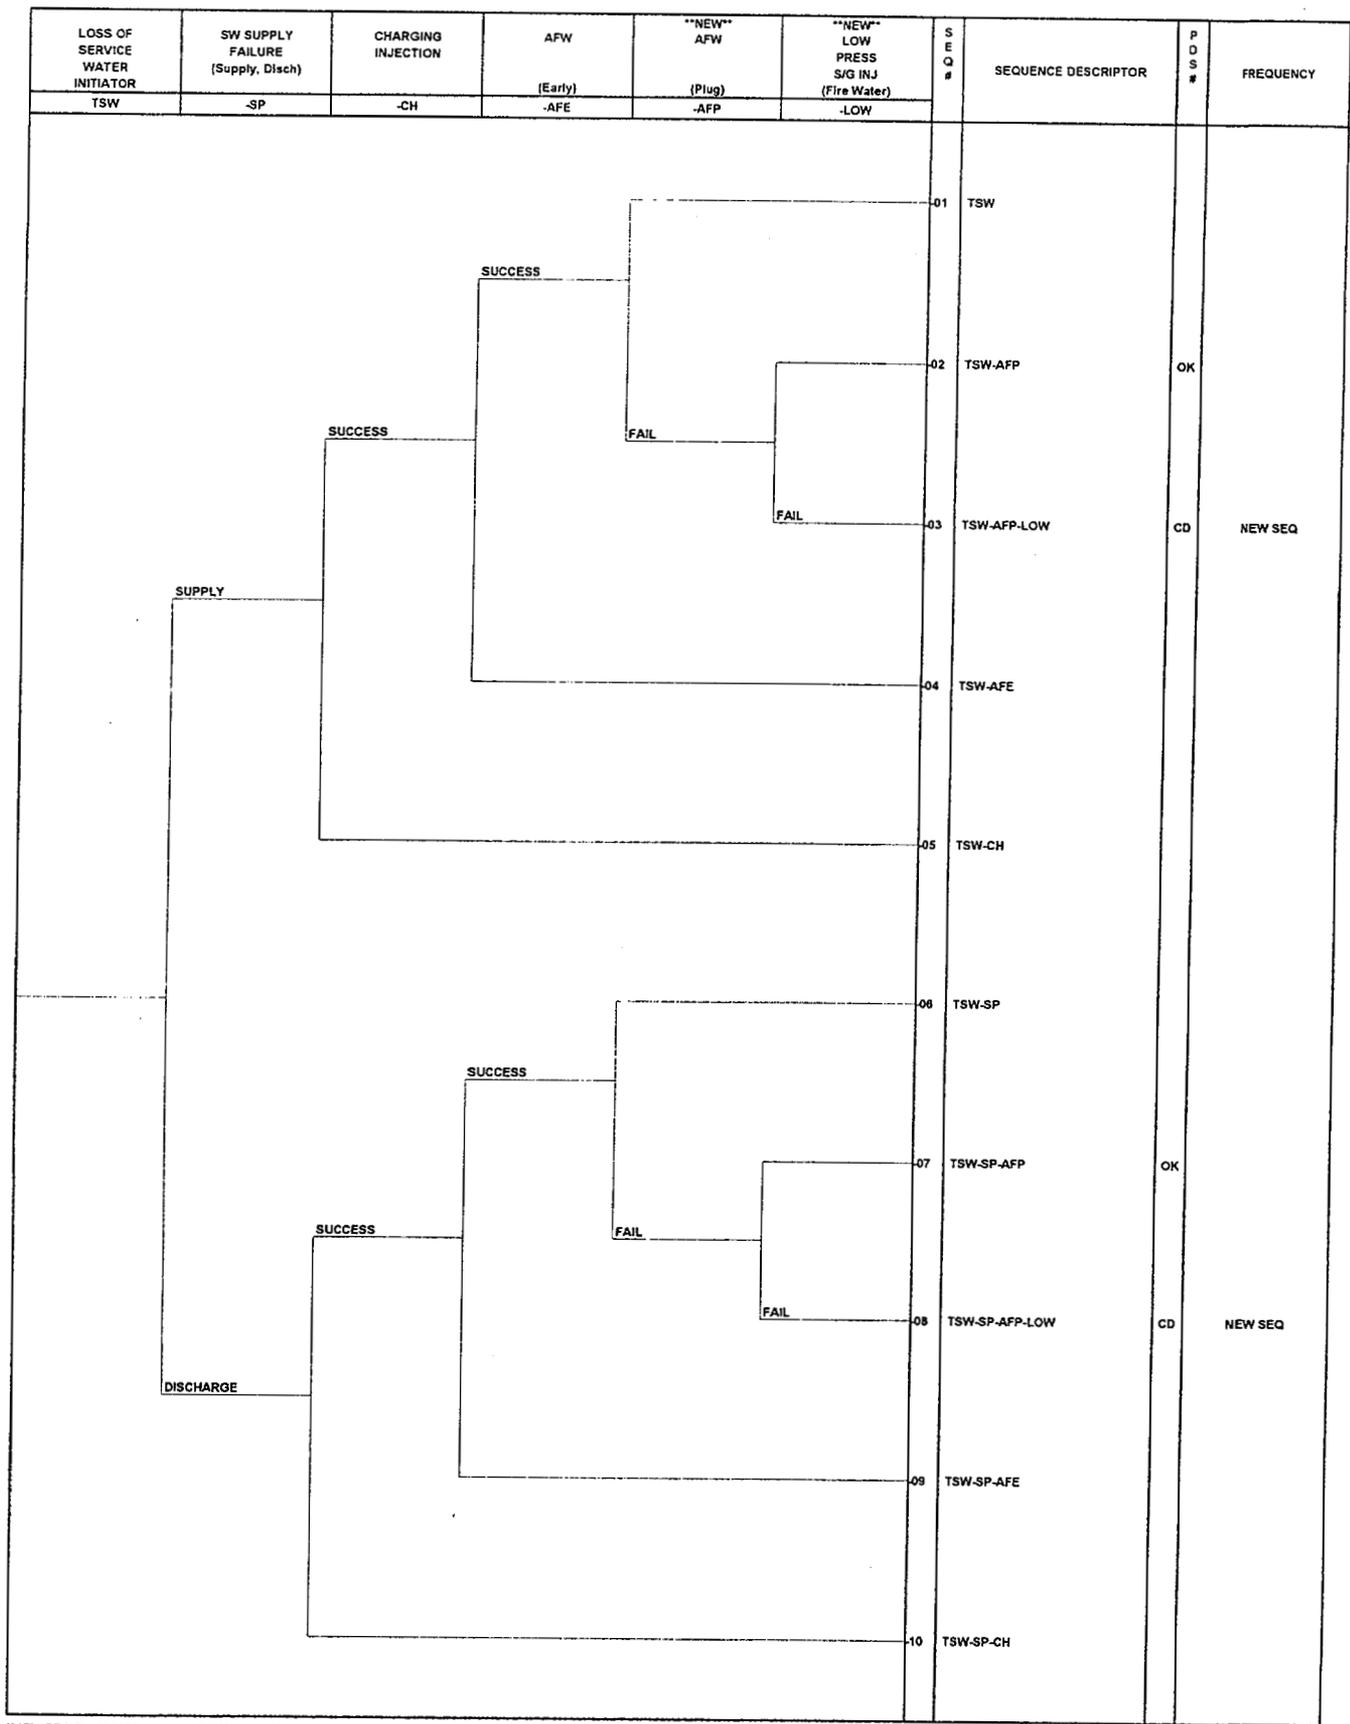

K:\FirePRA\Fire2\EVENTSW.evt 06/23/2003 14:28:24 WinNUPRA 2.1  
 Quantification Date: 12-05-97 2:07:47pm TOTAL CMF = 0.00E+000  
 Licensed to: PT-BEACH

NUCLEAR MANAGEMENT COMPANY POINT BEACH NUCLEAR PLANT
LOSS OF SERVICE WATER EVENT TREE

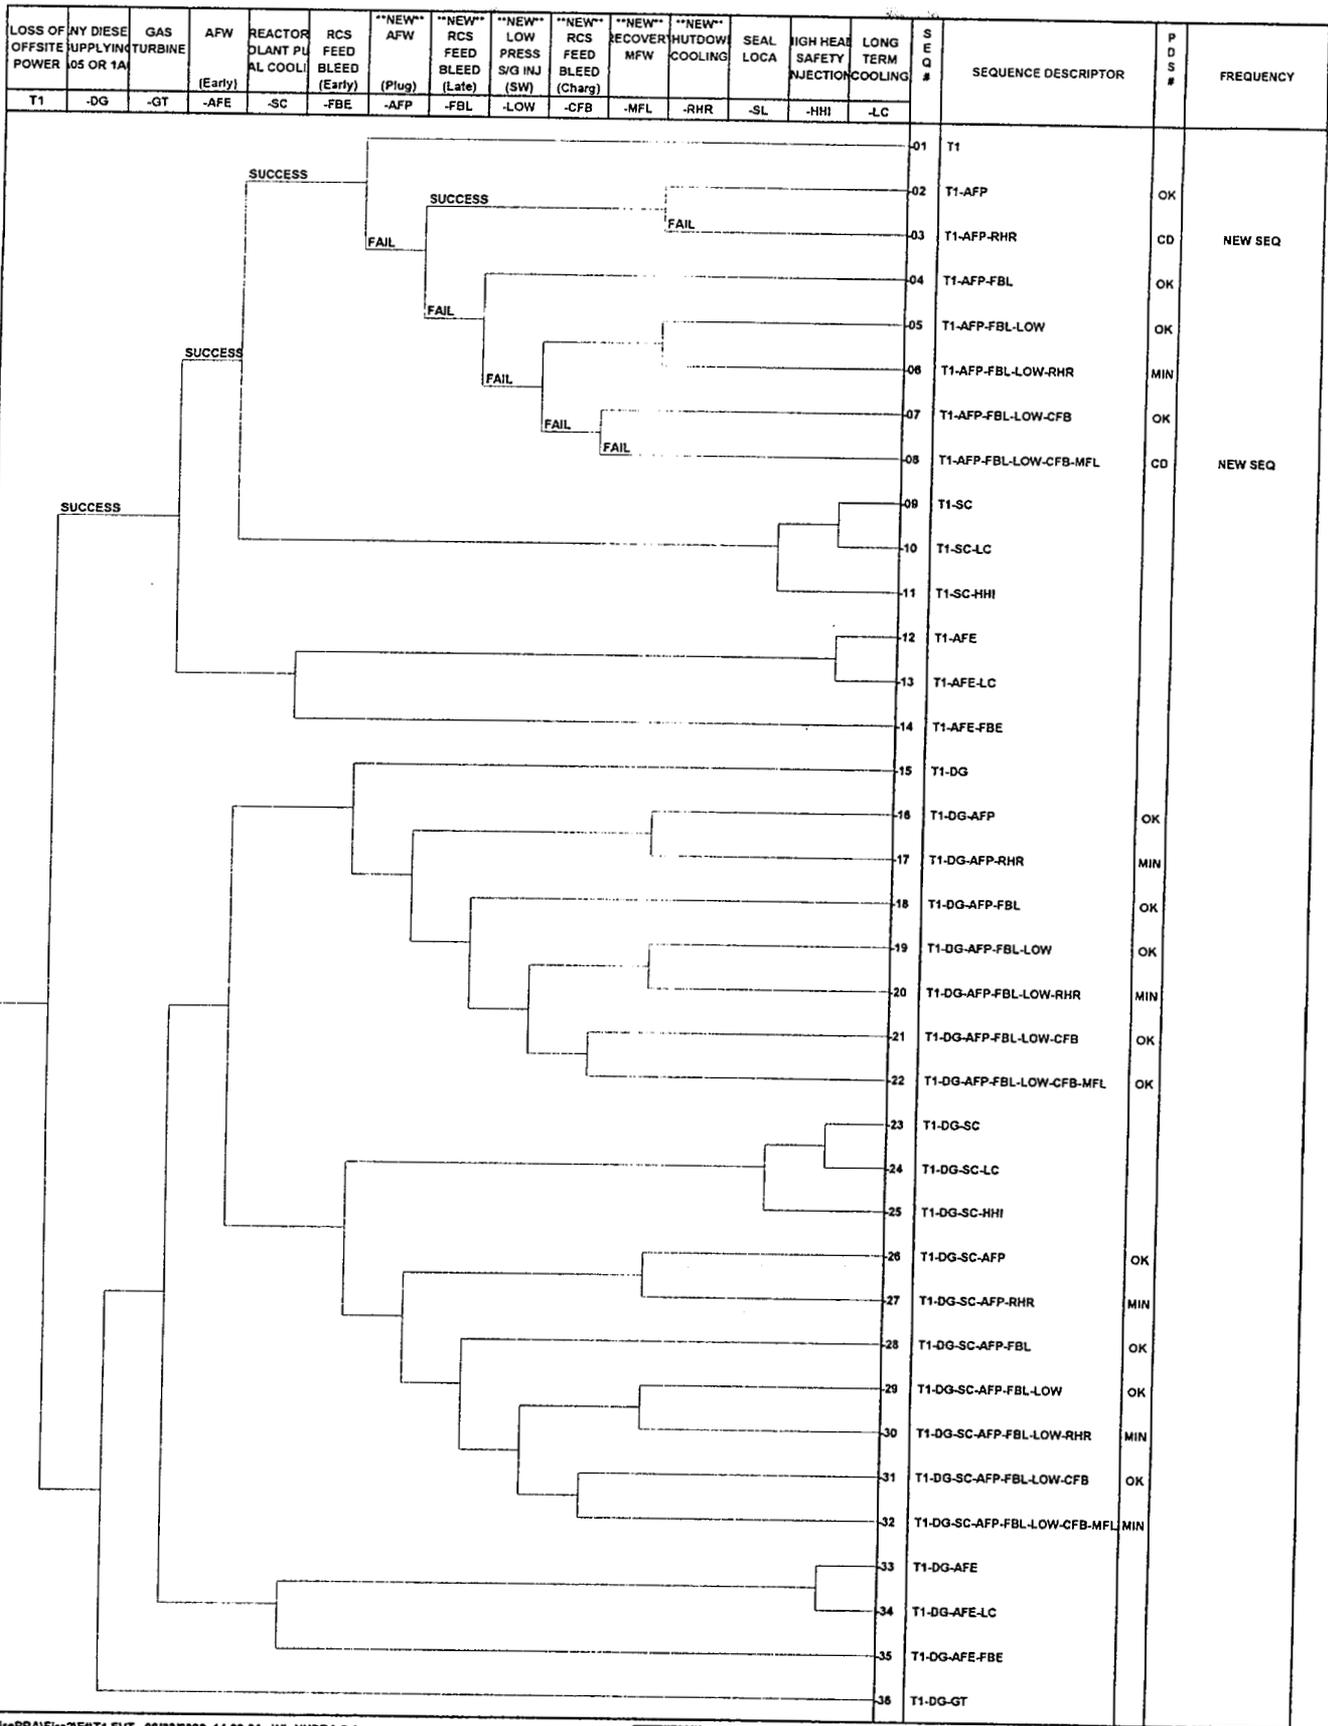


K:\FirePRA\Fire2\ERT1.EVT 06/23/2003 14:28:24 WinNUPRA 2.1  
 Quantification Date: 4-14-98 8:23:36am TOTAL CMF = 0.00E+000  
 Licensed to: PT-BEACH

NUCLEAR MANAGEMENT COMPANY POINT BEACH NUCLEAR PLANT
LOSS OF OFFSITE POWER EVENT TREE

LOSS OF INSTRUMENT AIR	OPERATOR CONTROLS CHARGING FLOW	AFW (Early)	PORV RECLOSURES	**NEW** AFW (Plug)	**NEW** LOW PRESS S/G INJ (SW)	**NEW** RCS FEED BLEED (Charg)	**NEW** SHUTDOWN COOLING	HIGH HEAD SAFETY INJECTION	LONG TERM COOLING	SEQ #	SEQUENCE DESCRIPTOR	PDS #	FREQUENCY
TIA	-OC	-AFE	-RC	-AFL	-LOW	-FBL	-RHR	-HHI	-LC				
										01	TIA		
			SUCCESS							02	TIA-AFL	OK	
			FAILURE							03	TIA-AFL-LOW	OK	
				FAILURE						04	TIA-AFL-LOW-RHR	CD	NEW SEQ
					FAILURE					05	TIA-AFL-LOW-FBL	CD	NEW SEQ
			SUCCESS							06	TIA-RC		
										07	TIA-RC-LC		
										08	TIA-RC-HHI		
			SUCCESS							09	TIA-AFE		
										10	TIA-OC		
										11	TIA-OC-AFL	OK	
										12	TIA-OC-AFL-LOW	OK	
										13	TIA-OC-AFL-LOW-RHR	MIN	
										14	TIA-OC-AFL-LOW-FBL	MIN	
										15	TIA-OC-RC		
										16	TIA-OC-RC-LC		
										17	TIA-OC-RC-HHI		
										18	TIA-OC-AFE		


K:\FirePRA\Fire2\ENTIA.evt 06/23/2003 14:28:24 WinNUPRA 2.1  
 Quantification Date: 12-05-97 2:04:59pm TOTAL CMF = 0.00E+000  
 Licensed to: PT-BEACH

WISCONSIN ELECTRIC POWER COMPANY POINT BEACH NUCLEAR PLANT  LOSS OF INSTRUMENT AIR EVENT TREE
--

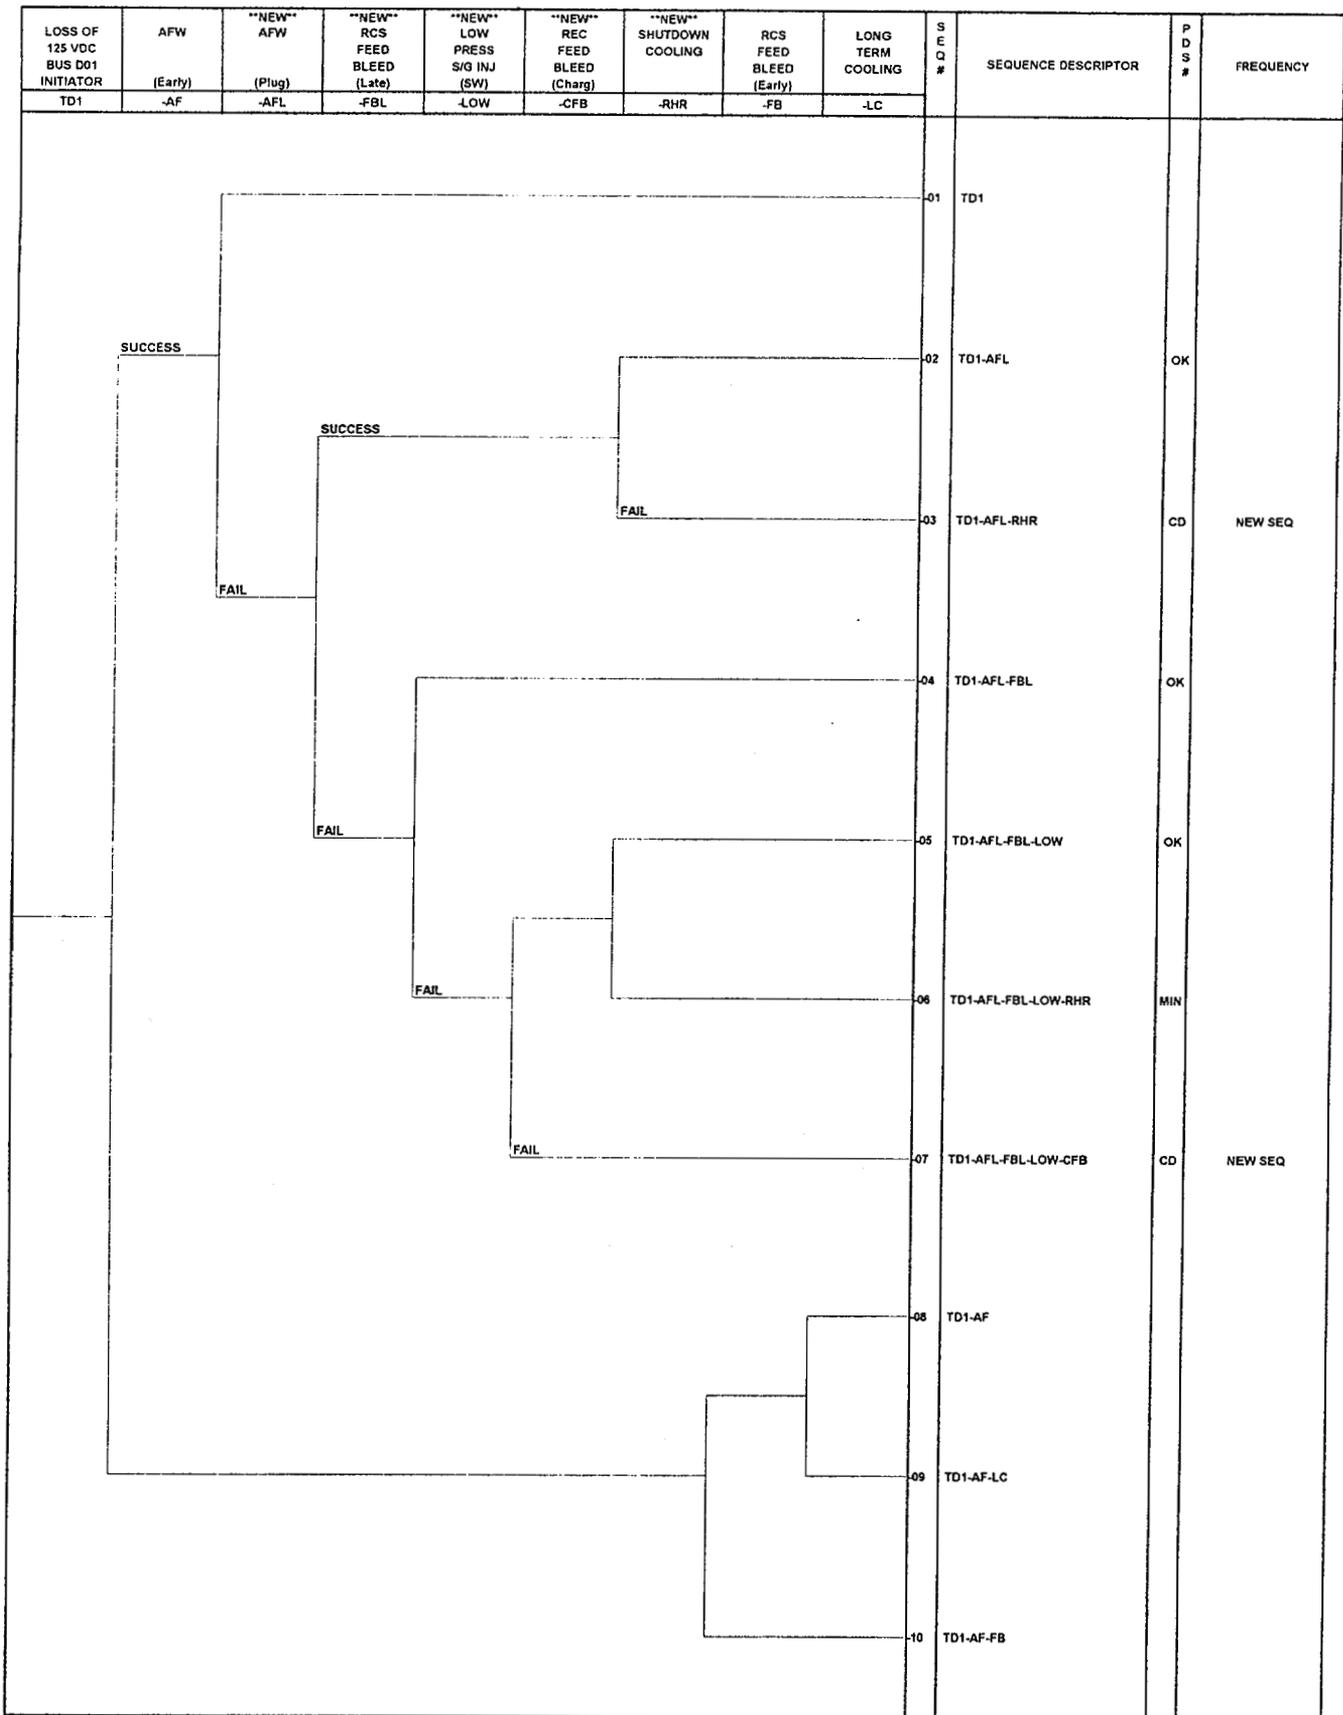


K:\FirePRA\FireZERTD1.evt 06/23/2003 14:28:24 WinNUPRA 2.1  
 Quantification Date: 12-05-97 2:02:01pm TOTAL CHF = 0.00E+000  
 Licensed to: PT-BEACH

NUCLEAR MANAGEMENT COMPANY  
 POINT BEACH NUCLEAR PLANT  
 LOSS OF 125 VDC BUS D01 EVENT TREE

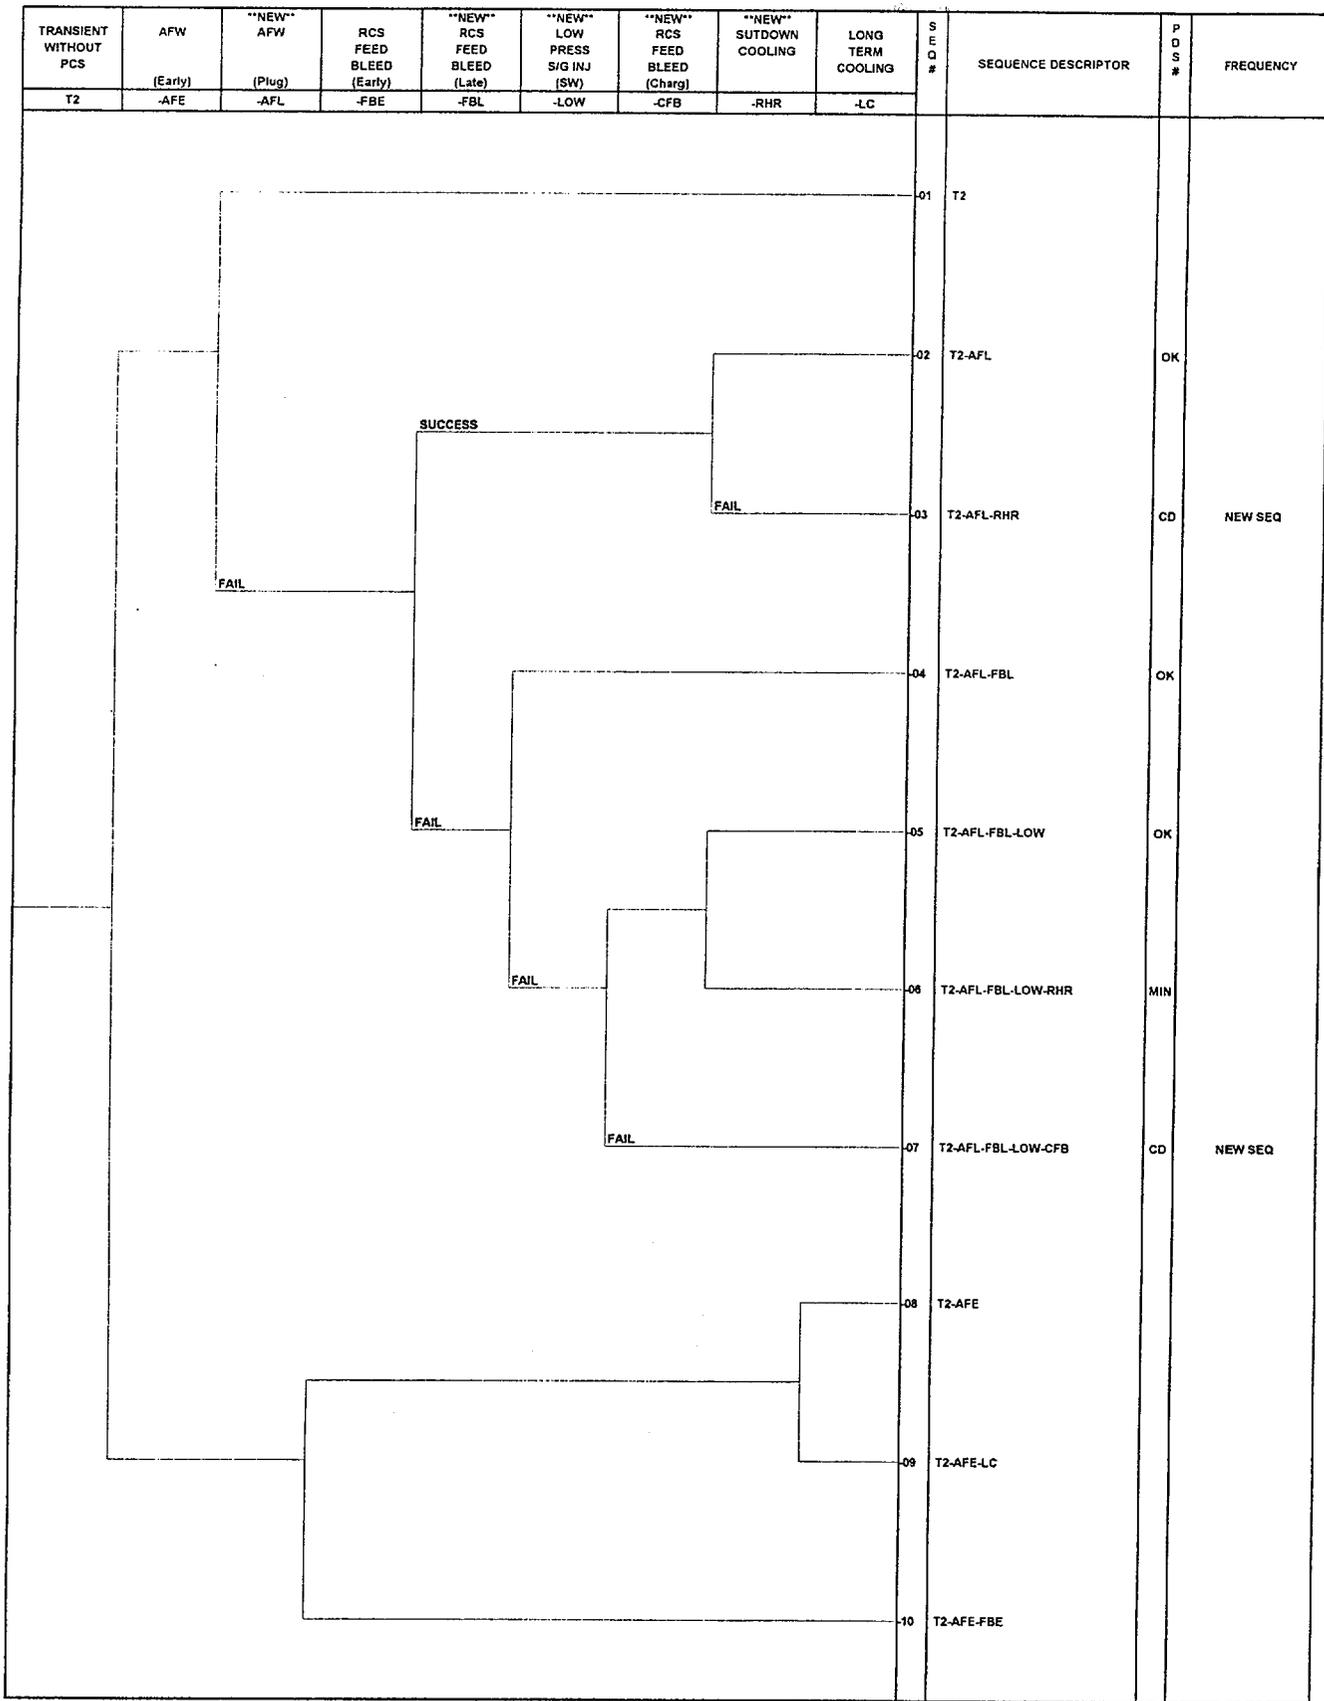

K:\FirePRA\Fire2\E1\T2.evt 06/23/2003 14:28:24 WinNUPRA 2.1  
 Quantification Date: 3-24-98 2:17:53pm TOTAL CMF = 0.00E+000  
 Licensed to: PT-BEACH

NUCLEAR MANAGEMENT COMPANY POINT BEACH NUCLEAR PLANT
TRANSIENT WITHOUT PCS AVAILABLE EVENT TREE

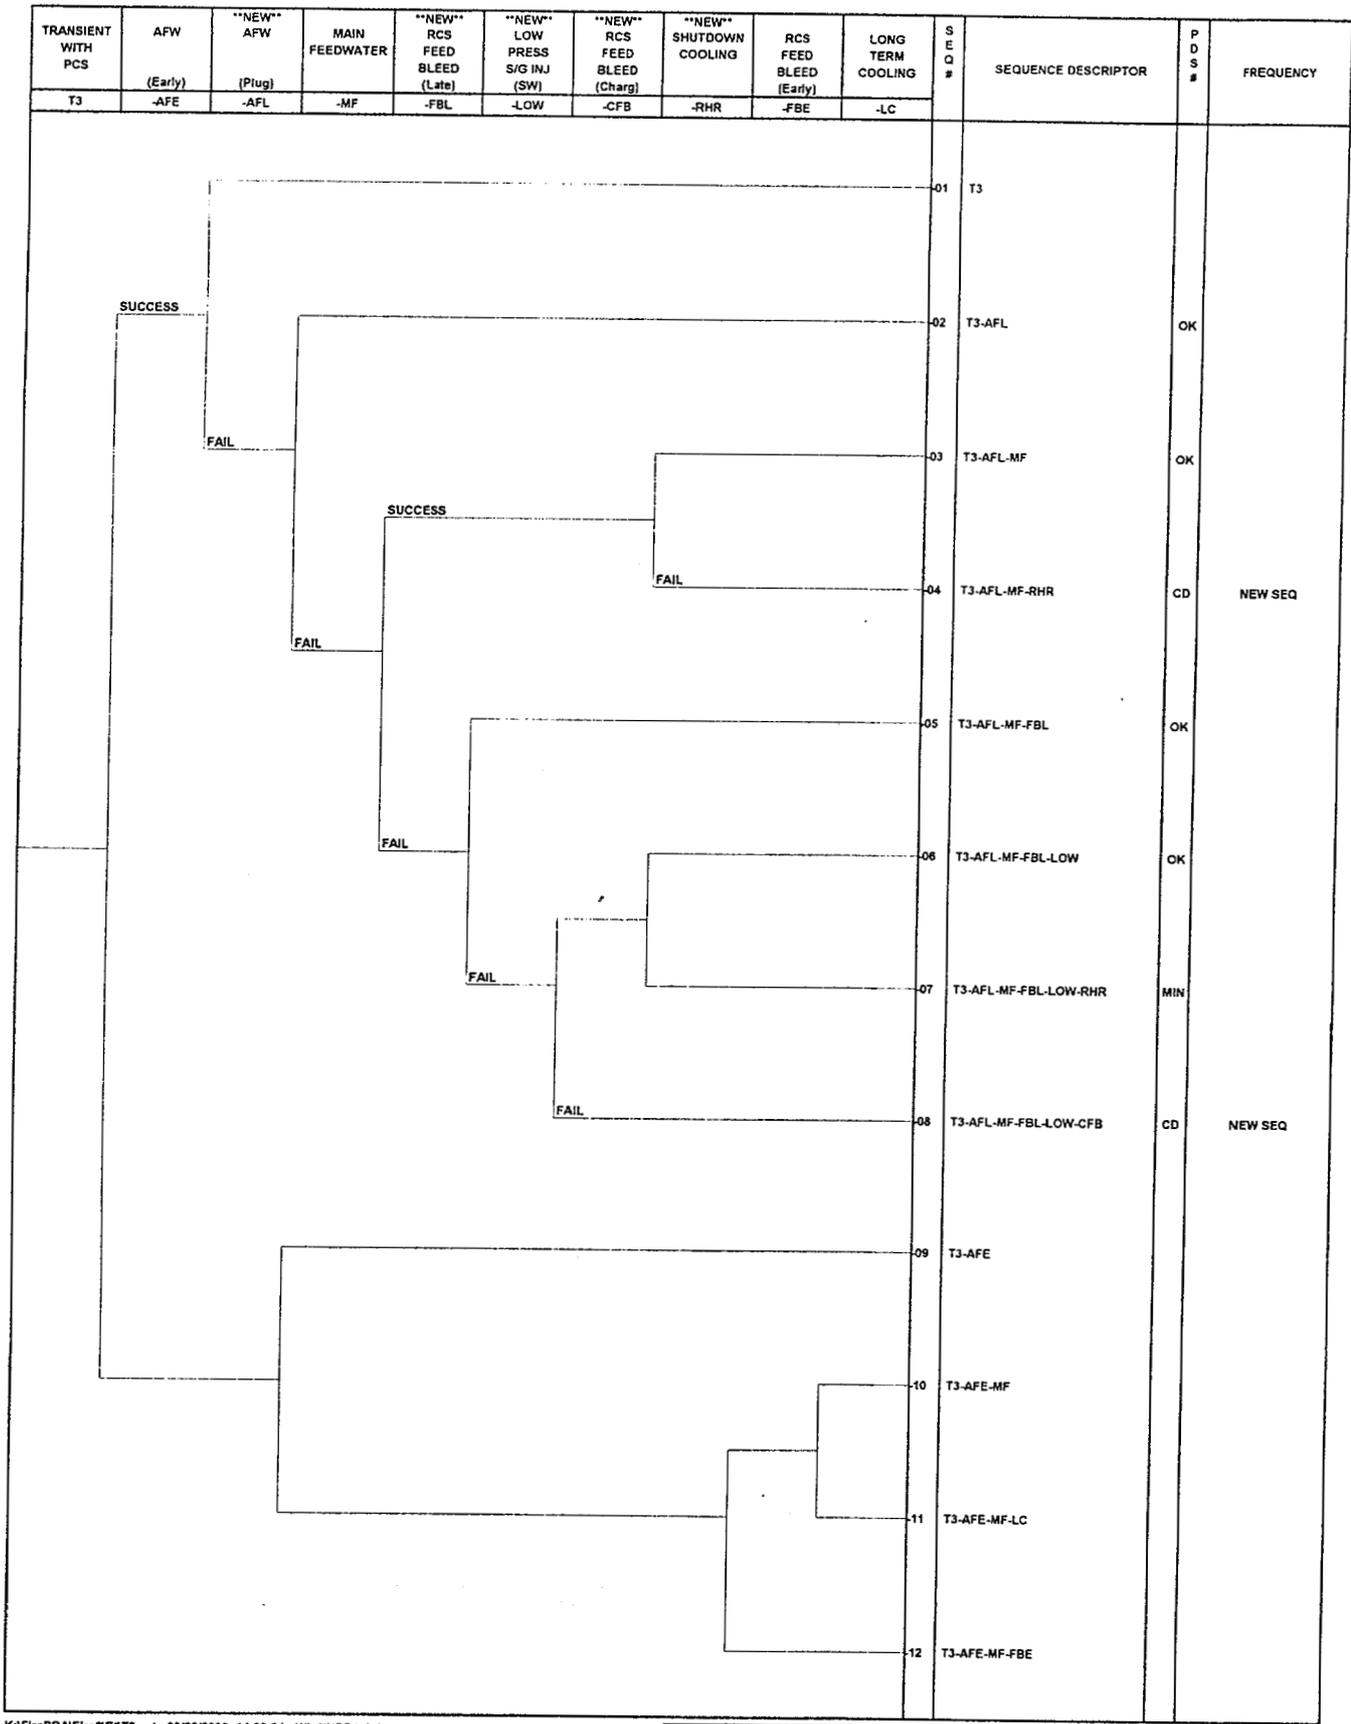

K:\FirePRA\Fire2\ET3.evt 06/23/2003 14:28:24 WinNUPRA 2.1  
 Quantification Date: 3-24-98 2:18:15pm TOTAL CMF = 0.00E+000  
 Licensed to: PT-BEACH

NUCLEAR MANAGEMENT COMPANY  
 POINT BEACH NUCLEAR PLANT  
 TRANSIENT WITH PCS EVENT TREE

**Summary of Potentially Significant Initiating Events - UNIT 2**

Loss of Service Water (TSW)	1.14E-06
Dual Unit Loss of Off-site Power (T1)	1.58E-05
Loss of Instrument Air (T1A)	5.15E-07
Loss of DC Bus D02 (TD2)	1.20E-05
Transient with Loss of Heat Sink (T2)	7.25E-06
Transient with Heat Sink (T3)	3.08E-07
Single Unit Loop (SLOOP)	1.48E-05
External Event - Seismic - (SEISMIC)	8.23E-06
<b>TOTAL</b>	<b>6.00E-05</b>

**Loss of Service Water (TSW)**

Sequence #3	5.48E-05	Failure	Service Water Supply
		Success	Charging
		Success	Aux Feedwater (Early Failure)
		Failure (Plug)	Aux Feedwater
	4.60E-02	Failure	Low Press. S/G Injection (via Fire Water)
	8.97E-07	Core Damage Probability	
	1.14E-06	Total Change in Core Damage Probability	

Sequence #8	5.37E-06	Failure	Service Water Supply
		Success	Charging
		Success	Aux Feedwater (Early Failure)
		Failure (Plug)	Aux Feedwater
	4.60E-02	Failure	Low Press. S/G Injection (via Fire Water)
	2.47E-07	Core Damage Probability	

**Dual Unit Loss of Off-site Power (T1)**

Sequence #3	7.10E-03	Failure	Initiating Event
		Success	Diesels
		Success	Aux Feedwater (Early Failure)
		Success	RCP Seal Cooling
	2.55E-01	Failure (Plug)	Aux Feedwater
	1.42E-02	Failure (Late)**	RCS Feed and Bleed
	1.00E+00	Failure	Low Press. S/G Injection (via Service Water)**
	1.54E-02	Failure (Charging)**	RCS Feed and Bleed
	5.99E-01	Failure (Recovery)**	Main Feed Water
	4.12E+01	HEP Deprecancy**	
	9.80E-06	Core Damage Probability	
	1.58E-05	Total Change in Core Damage Probability	
Sequence #8	7.10E-03	Failure	Initiating Event
		Success	Diesels
		Success	Aux Feedwater (Early Failure)
		Success	RCP Seal Cooling
	2.55E-01	Failure (Plug)	Aux Feedwater
	1.42E-02	Failure (Late)**	RCS Feed and Bleed
	1.00E+00	Failure	Low Press. S/G Injection (via Service Water)**
	1.54E-02	Failure (Charging)**	RCS Feed and Bleed
	5.99E-01	Failure (Recovery)**	Main Feed Water
	4.12E+01	HEP Deprecancy**	
	9.80E-06	Core Damage Probability	
	1.58E-05	Total Change in Core Damage Probability	
Sequence #3	1.31E-04	**Independent Failure Probability	
Sequence #8	5.41E-03	**Dependant Failure Probability	

Sequence #8	7.10E-03	Failure	Initiating Event
		Success	Diesels
		Success	Aux Feedwater (Early Failure)
		Success	RCP Seal Cooling
	2.55E-01	Failure (Plug)	Aux Feedwater
	3.32E-03	Failure	RCS Feed and Bleed (Late)
	6.01E-06	Core Damage Probability	

Loss of Instrument Air (T1A)

Sequence #4	6.80E-05	Failure	Initiating Event	Success	Control of Charging	Success	Aux Feedwater (Early Failure)	Failure	Aux Feedwater (Plug)	Failure	Low Press. S/G Injection (via Service Water)**	Failure	RCS Feed and Bleed (Charging)**	Success	HEP Dependency	Core Damage Probability	4.57E-07	Total Change in Core Damage Probability	5.15E-07
-------------	----------	---------	------------------	---------	---------------------	---------	-------------------------------	---------	----------------------	---------	--	---------	---------------------------------	---------	----------------	-------------------------	----------	---	----------

2.23E-02	**Independent Failure Probability
2.23E-02	**Dependant Failure Probability

Loss of DC Bus D02 (TD2)

Sequence #5	6.50E-05	Failure	Initiating Event	Success	Control of Charging	Success	Aux Feedwater (Early Failure)	Failure	Aux Feedwater (Plug)	Failure	Low Press. S/G Injection (via Service Water)	Failure	RCS Feed and Bleed (Charging)	Success	Shutdown Cooling	Core Damage Probability	5.80E-08
-------------	----------	---------	------------------	---------	---------------------	---------	-------------------------------	---------	----------------------	---------	--	---------	-------------------------------	---------	------------------	-------------------------	----------

4.71E-04	**Independent Failure Probability
1.02E-02	**Dependant Failure Probability

Transient with Loss of Heat Sink (T2)

Sequence #7	1.20E-03	Failure	Initiating Event	Success	Aux Feedwater (Early Failure)	Failure	Aux Feedwater (Plug)	Success	RCS Feed and Bleed (Late)	Failure	Shutdown Cooling	Core Damage Probability	5.77E-06
-------------	----------	---------	------------------	---------	-------------------------------	---------	----------------------	---------	---------------------------	---------	------------------	-------------------------	----------

Sequence #3	5.81E-02	Failure	Initiating Event	Success	Aux Feedwater (Early Failure)	Failure	Aux Feedwater (Plug)	Failure	RCS Feed and Bleed (Late)	Failure	Low Press. S/G Injection (via Service Water)**	Failure	RCS Feed and Bleed (Charging)**	Success	HEP Dependency	Core Damage Probability	4.59E-06	Total Change in Core Damage Probability	7.25E-06
-------------	----------	---------	------------------	---------	-------------------------------	---------	----------------------	---------	---------------------------	---------	--	---------	---------------------------------	---------	----------------	-------------------------	----------	---	----------

1.43E-04	**Independent Failure Probability
4.87E-03	**Dependant Failure Probability



Sequence #5	Failure	2.50E-04	Initiating Event	Success	Control of Charging	Success	Aux Feedwater (Early Failure)	Failure	Aux Feedwater (Plug)	3.10E-01	Failure	Low Press. S/G Injection (via Service Water)	Success	RCS Feed and Bleed (Charging)	Failure	Shutdown Cooling	2.90E-03	Core Damage Probability	2.25E-07
-------------	---------	----------	------------------	---------	------------------------	---------	----------------------------------	---------	-------------------------	----------	---------	--	---------	-------------------------------------	---------	---------------------	----------	----------------------------	----------

External Event - Seismic - >=32g (SEISMIC-HIGH)

	Failure	2.02E-05	Initiating Event	Success	Aux Feedwater (Early Failure)	Failure	Aux Feedwater (Plug)	3.10E-01	Failure	Low Press. S/G Injection (via Service Water)	1.00E+00	Failure	Core Damage Probability	6.27E-06
--	---------	----------	------------------	---------	----------------------------------	---------	-------------------------	----------	---------	--	----------	---------	----------------------------	----------

## Description of Sequence Quantification by Initiator

### LOSS OF SERVICE WATER

Loss of Service Water also results in a loss of Instrument Air due to lack of cooling for compressors. This makes the PORVs and Feed and Bleed using SI unavailable. SI is also not available for containment sump recirculation due to lack of cooling. Success for this event without the orifice plugging issue is by use of AFW from the CST initially, then by use of fire water to provide AFW suction supply and CST refill and cooling for the TDAFW pump. With the orifice issue, this will result in failure of AFW pumps that are allowed to run against a closed discharge valve. Charging feed and bleed is not credited for this initiator because SI is not available for RCS makeup when the Pressurizer safety valves fail open from passing water. Loss of Service Water also eliminates all means of cooling containment. Water Treatment is not available because it requires Instrument Air and Service Air for numerous valves and other functions.

### Sequence #3

Successes prior to the new branches: Charging injection for RCP seal cooling, AFW with suction from the CST.

<u>Event / Description</u>	<u>Quantification</u>								
<p><b>SW Supply</b></p> <p>Failure of the Service Water supply pumps or header</p>	<p>Base PRA model fault tree frequency for loss of SW supply.</p> <p><b>5.48E-05/yr</b></p>								
<p><b>Aux Feedwater (Plug)</b></p> <p>Probability that AFW does not fail early and that operators fail to prevent plugging of all available AFW pumps.</p>	<p>The random early failure of AFW is from the PRA model fault tree modified to remove late supply failures. If one pump fails randomly, it is assumed that the operators will not be able to recognize a common cause and will start a second pump, which will then also fail.</p> <p>The probability of operators failing to recognize the common cause of failures before all pumps are failed was quantified by an HRA event tree.</p> <p>For the time period when all AFW pumps were susceptible:</p> $6.43E-01 = (3.86E-01 * 1.0) + (6.14E-01 * 4.18E-01)$ <table style="margin-left: 40px;"> <tr> <td style="padding-right: 20px;">3.86E-01</td> <td>Fault tree quantification for any one AFW pump fails randomly given SW failure event</td> </tr> <tr> <td>1.0</td> <td>Assumed operator failure if one AFW pump fails randomly</td> </tr> <tr> <td>6.14E-01</td> <td>Complementary event - no AFW pumps fail randomly</td> </tr> <tr> <td>4.18E-01</td> <td>HEP for failure to recognize common cause failure due to plugging given no random failures occurred</td> </tr> </table>	3.86E-01	Fault tree quantification for any one AFW pump fails randomly given SW failure event	1.0	Assumed operator failure if one AFW pump fails randomly	6.14E-01	Complementary event - no AFW pumps fail randomly	4.18E-01	HEP for failure to recognize common cause failure due to plugging given no random failures occurred
3.86E-01	Fault tree quantification for any one AFW pump fails randomly given SW failure event								
1.0	Assumed operator failure if one AFW pump fails randomly								
6.14E-01	Complementary event - no AFW pumps fail randomly								
4.18E-01	HEP for failure to recognize common cause failure due to plugging given no random failures occurred								

<u>Event / Description</u>	<u>Quantification</u>
	<p>For the time period when only MDAFW pumps were susceptible:</p> <p>9.95E-02    Fault tree quantification for TDAFW pump fails randomly given SW failure event</p> <p>These values are then combined by the fraction of the year the pumps were susceptible to arrive at the final result:</p> <p><b>3.56E-01</b> = (6.43E-01*0.472) + (9.95E-02*0.528)</p>
<p><b>Low Press S/G Injection (Fire Water)</b></p> <p>Depressurize the SGs by manually opening the atmospheric steam dumps and inject using fire water through the failed AFW pumps.</p>	<p>This is the HEP for opening the atmospheric steam dumps and recognizing and eliminating the flow diversion for fire water to the CST. Hardware failures are not included because the fire water system had to succeed early or the AFW pumps would not have failed. Note that the loss of Service Water is the only event where this methodology is credited without charging feed and bleed.</p> <p><b>4.60E-02</b></p>

### Sequence #8

Successes prior to the new branches: Charging injection for RCP seal cooling, AFW with suction from the CST.

<u>Event / Description</u>	<u>Quantification</u>
<p><b>SW Discharge</b></p> <p>Failure of the Service Water discharge header.</p>	<p>Base PRA model fault tree frequency for loss of SW discharge.</p> <p><b>5.37E-06/yr</b></p>
<p><b>Aux Feedwater (Plug)</b></p> <p>Probability that AFW does not fail early and that operators fail to prevent plugging of all available AFW pumps.</p>	<p>For SW discharge failures, both turbine driven AFW pumps are failed because they have no cooling (fire water uses the same discharge flowpath as does SW). One motor driven AFW pump must be used on each unit. Since there is only one pump available on each unit, it is assumed that the operators will not be able to recognize a common cause in time to save either pump.</p> <p><b>1.00</b></p>
<p><b>Low Press S/G Injection (Fire Water)</b></p> <p>Depressurize the SGs by manually opening the atmospheric steam dumps and inject using fire water through the failed AFW pumps.</p>	<p>This is the HEP for opening the atmospheric steam dumps and recognizing and eliminating the flow diversion for fire water to the CST. Hardware failures are not included because the fire water system had to succeed early or the AFW pumps would not have failed. Note that the loss of Service Water is the only event where this methodology is credited without charging feed and bleed.</p> <p><b>4.60E-02</b></p>

## DUAL UNIT LOSS OF OFFSITE POWER

For this dual unit transient, restoration of offsite power must be accomplished with enough time remaining before the CST is drained to allow for restoration of Water Treatment. MAAP runs showed this time to be approximately 1.5 hours. A restoration of offsite power probability at one hour was therefore used.

### Sequence #3

Successes prior to the new branches: At least one diesel generator or the gas turbine, AFW with suction from the CST, RCP seal cooling.

<u>Event / Description</u>	<u>Quantification</u>
<b>T1 Initiating Event</b> Dual Unit loss of offsite power initiator	Frequency from the base PRA model.  <b>7.1E-03/yr</b>
<b>Aux Feedwater (Plug)</b> Probability that AFW does not fail early and that operators fail to prevent plugging of all available AFW pumps.	<p>The random early failure of AFW is from the PRA model fault tree modified to remove late supply failures. If one pump fails randomly, it is assumed that the operators will not be able to recognize a common cause and will start a second pump, which will also fail.</p> <p>Water Treatment is also credited here when offsite power is recovered before the CST is depleted. Water Treatment random failures are from a new fault tree. Recovery of offsite power probability at one hour is from the base PRA model.</p> <p>The probability of operators failing to recognize the common cause of failures before all pumps are failed was quantified by an HRA event tree.</p> <p>For the time period when all AFW pumps were susceptible:</p> $4.90E-01 = 5.83E-01 * [(2.26E-01 * 1.0) + (7.74E-01 * 7.95E-01)]$ <ul style="list-style-type: none"> <li>5.83E-01    Fault tree quantification for failure of Water Treatment following a DLOOP event - includes recovery of offsite power within 1 hour.</li> <li>2.26E-01    Fault tree quantification for any one AFW pump fails randomly given T1 initiating event</li> <li>1.0           Assumed operator failure if one AFW pump fails randomly</li> <li>7.74E-01    Complementary event - no AFW pumps fail randomly</li> <li>7.95E-01    HEP for failure to recognize common cause failure due to plugging given no random failures occurred</li> </ul> <p>For the time period when only MDAFW pumps were susceptible:</p> $4.45E-02 = 5.83E-01 * (7.64E-02 * 1.0)$

<u>Event / Description</u>	<u>Quantification</u>
	<p>5.83E-01    Fault tree quantification for failure of Water Treatment following a DLOOP event - includes recovery of offsite power within 1 hour.</p> <p>7.64E-02    Fault tree quantification for TDAFW pump fails randomly given T1 initiating event</p> <p>1.0            Assumed operator failure if one AFW pump fails randomly</p> <p>These values are then combined by the fraction of the year the pumps were susceptible to arrive at the final result:</p> <p><b>2.55E-01 =</b>        <math>(4.90E-01 * 0.472) + (4.45E-02 * 0.528)</math></p>
<p><b>RCS Feed and Bleed (Late)</b></p> <p>Failure of feed and bleed using SI after initial AFW success</p>	<p>Base PRA model fault tree quantification with an HEP for establishing feed and bleed using high pressure SI that takes credit for additional time available later in the event because decay heat is lower.</p> <p><b>1.42E-02</b></p>
<p><b>Low Press S/G Injection (Service Water)</b></p> <p>Depressurize the SGs by manually opening the atmospheric steam dumps and inject using service water through the failed AFW pumps.</p>	<p>This is the HEP for opening the atmospheric steam dumps as directed in procedure CSP-H.1, RNO column if the bleed portion of SI feed and bleed fails. Hardware failures are not included because the service water system had to succeed early or the AFW pumps would not have failed.</p> <p>For this event, this action is completely dependent on the action to establish feed and bleed using charging since both are required for success. This is because low pressure steam generator injection will eventually lead to an open Pressurizer safety valve and charging is required for RCS makeup.</p> <p><b>1.00</b></p>
<p><b>RCS Feed and Bleed (Charging )</b></p> <p>Feed and bleed using maximum charging flow and pressurizing the RCS up to the Pressurizer safety valve setpoint.</p>	<p>Base PRA model fault tree quantification with an HEP for maximizing charging flow and following the RNO column in CSP-H.1 if the bleed portion of SI feed and bleed fails (approximately 60% of the failures of SI feed and bleed). Charging feed and bleed is also credited as directed in CSP-C1 when the core exit temperature exceeds 700°F. This is credited when the feed portion of SI feed and bleed fails (the remaining 40% of the failures).</p> <p><b>1.54E-02</b></p>
<p><b>Main Feedwater (Recovery)</b></p> <p>Recovery of offsite power and Main Feedwater late</p>	<p>Recovery of offsite power given that it was not recovered earlier in time to restore Water Treatment. Probability is from the base PRA model. Random failure of Main Feedwater is also from the base PRA model fault tree. This method is only credited when following the RNO column of CSP-H.1 if the bleed portion of SI feed and bleed fails.</p> <p><b>5.99E-01</b></p>

<u>Event / Description</u>	<u>Quantification</u>
<b>HEP Dependency</b>	<p>This factor accounts algebraically for the dependencies between the human actions within these mitigating strategies. Complete dependency is assumed for the cognitive portion of the actions because they are all directed from the same procedure CSP-H.1. A medium dependency is assumed for the execution portions of the HEPs because they are directed by separate steps and sufficient time is available to complete all the actions. The result is a multiplier that is applied to the product of the independent failures.</p> <p><b>4.12E+01</b></p>

### Sequence #8

Successes prior to the new branches: : At least one diesel generator or the gas turbine, AFW with suction from the CST, RCP seal cooling.

<u>Event / Description</u>	<u>Quantification</u>
<p><b>T1 Initiating Event</b></p> <p>Dual Unit loss of offsite power initiator</p>	<p>Frequency from the base PRA model.</p> <p><b>7.1E-03/yr</b></p>
<p><b>Aux Feedwater (Plug)</b></p> <p>Probability that AFW does not fail early and that operators fail to prevent plugging of all available AFW pumps.</p>	<p>The random early failure of AFW is from the PRA model fault tree modified to remove late supply failures. If one pump fails randomly, it is assumed that the operators will not be able to recognize a common cause and will start a second pump, which will also fail.</p> <p>Water Treatment is also credited here when offsite power is recovered before the CST is depleted. Water Treatment random failures are from a new fault tree. Recovery of offsite power probability at one hour is from the base PRA model.</p> <p>The probability of operators failing to recognize the common cause of failures before all pumps are failed was quantified by an HRA event tree.</p> <p>For the time period when all AFW pumps were susceptible:</p> $4.90E-01 = 5.83E-01 * [(2.26E-01 * 1.0) + (7.74E-01 * 7.95E-01)]$ <p>5.83E-01    Fault tree quantification for failure of Water Treatment following a DLOOP event - includes recovery of offsite power within 1 hour.</p> <p>2.26E-01    Fault tree quantification for any one AFW pump fails randomly given T1 initiating event</p> <p>1.0            Assumed operator failure if one AFW pump fails randomly</p> <p>7.74E-01    Complementary event - no AFW pumps fail randomly</p>

<u>Event / Description</u>	<u>Quantification</u>
	<p style="text-align: center;">7.95E-01 HEP for failure to recognize common cause failure due to plugging given no random failures occurred</p> <p>For the time period when only MDAFW pumps were susceptible:</p> <p>4.45E-02 = 5.83E-01 * (7.64E-02 * 1.0)</p> <p>5.83E-01 Fault tree quantification for failure of Water Treatment following a DLOOP event - includes recovery of offsite power within 1 hour.</p> <p>7.64E-02 Fault tree quantification for TDAFW pump fails randomly given T1 initiating event</p> <p>1.0 Assumed operator failure if one AFW pump fails randomly</p> <p>These values are then combined by the fraction of the year the pumps were susceptible to arrive at the final result:</p> <p>2.55E-01 = (4.90E-01 * 0.472) + (4.45E-02 * 0.528)</p>
<b>RCS Feed and Bleed (Late)</b>	Success branch.
<b>Shutdown Cooling</b>  Closed cycle RCS cooling using the RHR system.	<p>This value is based upon a quantification of the base PRA model fault tree for RHR cooling. A high dependency recovery of test return valves that were left in the open position following the last flow test of RHR was also applied in this case because of time available.</p> <p><b>3.32E-03</b></p>

### LOSS OF INSTRUMENT AIR

In this event, Water Treatment is failed because it is dependent on both Instrument and Service Air supplies for operation. SI feed and bleed is also not available because the Pressurizer PORVs require instrument air to open. Opening of the Steam Generator atmospheric steam dumps requires local manual action because instrument air is not available.

**Sequence #4**

Successes prior to the new branches: Control of Charging flow (dependent on Instrument Air), and AFW with suction from the CST.

<u>Event / Description</u>	<u>Quantification</u>
<p><b>TIA Initiating Event</b></p> <p>Loss of Instrument Air Initiator</p>	<p>PRA model fault tree for the loss of instrument air initiator</p> <p>6.60E-05</p>
<p><b>Aux Feedwater (Plug)</b></p> <p>Probability that AFW does not fail early and that operators fail to prevent plugging of all available AFW pumps.</p>	<p>The random early failure of AFW is from the PRA model fault tree modified to remove late supply failures. If one pump fails randomly, it is assumed that the operators will not be able to recognize a common cause and will start a second pump, which will then also fail.</p> <p>The probability of operators failing to recognize the common cause of failures before all pumps are failed was quantified by an HRA event tree.</p> <p>For the time period when all AFW pumps were susceptible:</p> $5.77E-01 = (2.73E-01 * 1.0) + (7.27E-01 * 4.18E-01)$ <p>2.73E-01    Fault tree quantification for any one AFW pump fails randomly given IA failure event</p> <p>1.0            Assumed operator failure if one AFW pump fails randomly</p> <p>7.27E-01    Complementary event - no AFW pumps fail randomly</p> <p>4.18E-01    HEP for failure to recognize common cause failure due to plugging given no random failures occurred</p> <p>For the time period when only MDAFW pumps were susceptible:</p> <p>7.22E-02    Fault tree quantification for TDAFW pump fails randomly given IA failure event</p> <p>These values are then combined by the fraction of the year the pumps were susceptible to arrive at the final result:</p> $3.10E-01 = (5.77E-01 * 0.472) + (7.22E-02 * 0.528)$

<u>Event / Description</u>	<u>Quantification</u>
<p><b>Low Press S/G Injection (Service Water)</b></p> <p>Depressurize the SGs by manually opening the atmospheric steam dumps and inject using service water through the failed AFW pumps.</p>	<p>This is the HEP for opening the atmospheric steam dumps as directed in procedure CSP-H.1, RNO column if the bleed portion of SI feed and bleed fails. Hardware failures are not included because the service water system had to succeed early or the AFW pumps would not have failed.</p> <p>For this event, this action is completely dependent on the action to establish feed and bleed using charging since both are required for success. This is because low pressure steam generator injection will eventually lead to an open Pressurizer safety valve and charging is required for RCS makeup.</p> <p><b>1.00</b></p>
<p><b>RCS Feed and Bleed (Charging )</b></p> <p>Feed and bleed using maximum charging flow and pressurizing the RCS up to the Pressurizer safety valve setpoint.</p>	<p>Base PRA model fault tree quantification with an HEP for maximizing charging flow and following the RNO column in CSP-H.1 because the bleed portion of SI feed and bleed fails due to not having instrument air available for the Pressurizer PORVs.</p> <p><b>2.23E-02</b></p>
<p><b>HEP Dependency</b></p>	<p>Because low pressure steam generator injection is already completely dependent on the charging feed and bleed action, no other dependencies need to be applied.</p> <p><b>1.00</b></p>

### Sequence #5

Successes prior to the new branches: Control of Charging flow (dependent on Instrument Air), and AFW with suction from the CST.

<u>Event / Description</u>	<u>Quantification</u>
<p><b>TIA Initiating Event</b></p> <p>Loss of Instrument Air Initiator</p>	<p>PRA model fault tree for the loss of instrument air initiator</p> <p>6.60E-05</p>
<p><b>Aux Feedwater (Plug)</b></p> <p>Probability that AFW does not fail early and that operators fail to prevent plugging of all available AFW pumps.</p>	<p>The random early failure of AFW is from the PRA model fault tree modified to remove late supply failures. If one pump fails randomly, it is assumed that the operators will not be able to recognize a common cause and will start a second pump, which will then also fail.</p> <p>The probability of operators failing to recognize the common cause of failures before all pumps are failed was quantified by an HRA event tree.</p> <p>For the time period when all AFW pumps were susceptible:</p> <p><math>5.77E-01 = (2.73E-01 * 1.0) + (7.27E-01 * 4.18E-01)</math></p>

<u>Event / Description</u>	<u>Quantification</u>
	<p>2.73E-01 Fault tree quantification for any one AFW pump fails randomly given IA failure event</p> <p>1.0 Assumed operator failure if one AFW pump fails randomly</p> <p>7.27E-01 Complementary event - no AFW pumps fail randomly</p> <p>4.18E-01 HEP for failure to recognize common cause failure due to plugging given no random failures occurred</p> <p>For the time period when only MDAFW pumps were susceptible:</p> <p>7.22E-02 Fault tree quantification for TDAFW pump fails randomly given IA failure event</p> <p>These values are then combined by the fraction of the year the pumps were susceptible to arrive at the final result:</p> <p><b>3.10E-01 = (5.77E-01*0.472) + (7.22E-02*0.528)</b></p>
<p><b>Low Press S/G Injection (Service Water)</b></p> <p>Depressurize the SGs by manually opening the atmospheric steam dumps and inject using service water through the failed AFW pumps.</p>	<p>This is the HEP for opening the atmospheric steam dumps as directed in procedure CSP-H.1, RNO column if the bleed portion of SI feed and bleed fails. Hardware failures are not included because the service water system had to succeed early or the AFW pumps would not have failed.</p> <p>For this event, this action is completely dependent on the action to establish feed and bleed using charging since both are required for success. This is because low pressure steam generator injection will eventually lead to an open Pressurizer safety valve and charging is required for RCS makeup.</p> <p><b>1.00</b></p>
<p><b>RCS Feed and Bleed (Charging )</b></p>	<p>Success branch</p>
<p><b>Shutdown Cooling</b></p> <p>Closed cycle RCS cooling using the RHR system.</p>	<p>This value is based upon a quantification of the base PRA model fault tree for RHR cooling. A high dependency recovery of test return valves that were left in the open position following the last flow test of RHR was also applied in this case because of the time available.</p> <p><b>2.90E-03</b></p>

### LOSS OF DC BUS D02

Loss of DC Bus D02 on Unit 2 leads directly to a reactor trip. It also causes a loss of Main Feedwater because the feedwater regulating valves require power from this DC bus to function. The Water Treatment System is not available because it is dependent on DC power from D02.

**Sequence #3**

Successes prior to the new branches: AFW with suction from the CST.

<u>Event / Description</u>	<u>Quantification</u>
<p><b>TD2 Initiating Event</b></p> <p>Loss of DC bus D02</p>	<p>PRA model fault tree for loss of DC bus D02 initiator</p> <p><b>1.20E-03</b></p>
<p><b>Aux Feedwater (Plug)</b></p> <p>Probability that AFW does not fail early and that operators fail to prevent plugging of all available AFW pumps.</p>	<p>If one AFW pump fails randomly, it is assumed that the operators will not be able to recognize a common cause and will start a second pump, which will then also fail.</p> <p>The random early failure of the TDAFW pump is from the PRA model fault tree modified to remove late supply failures.</p> <p>For the time period when all AFW pumps were susceptible:</p> <p>1.00 For a loss of D02 event, one MDAFW pump is failed because it has no control power. Even though Unit 1 will still likely have Main Feedwater available and two AFW pumps will be available to Unit 2, it is assumed that the Operators will not be able to diagnose the plugging problem before the second pump is also failed.</p> <p>For the time period when only MDAFW pumps were susceptible:</p> <p>6.49E-02 Fault tree quantification for TDAFW pump fails randomly given D02 failure event</p> <p>These values are then combined by the fraction of the year the pumps were susceptible to arrive at the final result:</p> <p><b>5.06E-01 = (1.00*0.472) + (6.49E-02*0.528)</b></p>
<p><b>RCS Feed and Bleed (Late)</b></p> <p>Failure of feed and bleed using SI after initial AFW success</p>	<p>Base PRA model fault tree quantification with an HEP for establishing feed and bleed using high pressure SI that takes credit for additional time available later in the event because decay heat is lower.</p> <p><b>2.11E-02</b></p>
<p><b>Low Press S/G Injection (Service Water)</b></p> <p>Depressurize the SGs by manually opening the atmospheric steam dumps and inject using service water through the failed AFW pumps.</p>	<p>This is the HEP for opening the atmospheric steam dumps as directed in procedure CSP-H.1, RNO column if the bleed portion of SI feed and bleed fails. Hardware failures are not included because the service water system had to succeed early or the AFW pumps would not have failed.</p> <p>For this event, this action is completely dependent on the action to establish feed and bleed using charging since both are required for success. This is because low pressure steam generator injection will eventually lead to an open Pressurizer safety valve and charging is required for RCS makeup.</p> <p><b>1.00</b></p>

<u>Event / Description</u>	<u>Quantification</u>
<p><b>RCS Feed and Bleed (Charging)</b></p> <p>Feed and bleed using maximum charging flow and pressurizing the RCS up to the Pressurizer safety valve setpoint.</p>	<p>Base PRA model fault tree quantification with an HEP for maximizing charging flow and following the RNO column in CSP-H.1 if the bleed portion of SI feed and bleed fails (approximately 40% of the failures of SI feed and bleed for the TD2 event). Charging feed and bleed is also credited as directed in CSP-C1 when the core exit temperature exceeds 700°F. This is credited when the feed portion of SI feed and bleed fails (the remaining 60% of the failures).</p> <p><b>2.24E-02</b></p>
<p><b>HEP Dependency</b></p>	<p>This factor accounts algebraically for the dependencies between the human actions within these mitigating strategies. Complete dependency is assumed for the cognitive portion of the actions because they are all directed from the same procedure CSP-H.1. A medium dependency is assumed for the execution portions of the HEPs because they are directed by separate steps and sufficient time is available to complete all the actions. The result is a multiplier that is applied to the product of the independent failures.</p> <p><b>2.16E+01</b></p>

### Sequence #7

Successes prior to the new branches: AFW with suction from the CST.

<u>Event / Description</u>	<u>Quantification</u>
<p><b>TD2 Initiating Event</b></p> <p>Loss of DC bus D02</p>	<p>PRA model fault tree for loss of DC bus D02 initiator</p> <p><b>1.20E-03</b></p>
<p><b>Aux Feedwater (Plug)</b></p> <p>Probability that AFW does not fail early and that operators fail to prevent plugging of all available AFW pumps.</p>	<p>If one AFW pump fails randomly, it is assumed that the operators will not be able to recognize a common cause and will start a second pump, which will then also fail.</p> <p>The random early failure of the TDAFW pump is from the PRA model fault tree modified to remove late supply failures.</p> <p>For the time period when all AFW pumps were susceptible:</p> <p>1.00 For a loss of D02 event, one MDAFW pump is failed because it has no control power. Even though Unit 1 will still likely have Main Feedwater available and two AFW pumps will be available to Unit 2, it is assumed that the Operators will not be able to diagnose the plugging problem before the second pump is also failed.</p> <p>For the time period when only MDAFW pumps were susceptible:</p> <p>6.49E-02 Fault tree quantification for TDAFW pump fails randomly given D02 failure event</p> <p>These values are then combined by the fraction of the year the pumps were susceptible</p>

<u>Event / Description</u>	<u>Quantification</u>
	to arrive at the final result:  $5.06E-01 = (1.00*0.472) + (6.49E-02*0.528)$
<b>RCS Feed and Bleed (Late)</b>	Success branch for SI feed and bleed.
<b>Shutdown Cooling</b>  Closed cycle RCS cooling using the RHR system.	This value is based upon a quantification of the base PRA model fault tree for RHR cooling given a loss of D02. A high dependency recovery of test return valves that were left in the open position following the last flow test of RHR was also applied in this case because of the time available.  $9.50E-03$

### TRANSIENT WITHOUT HEAT SINK

The only time this transient is a concern is if Main Feedwater is not available. If Main Feedwater does not succeed, then Aux Feedwater would be needed and is susceptible to plugging.

### Sequence #3

Successes prior to the new branches: AFW with suction from the CST.

<u>Event / Description</u>	<u>Quantification</u>
<b>Modified T2 Initiating Event</b>  Trip with a loss of heat sink as modified to include only the fraction of events where Main Feedwater is not available.	The base T2 initiator frequency from the PRA model was reduced to the fraction of events where main feed is lost to initiate the event and by the fraction of events where main feedwater fails randomly. The random MFW failure probability is from a quantification of the base PRA model fault tree.  $5.81E-02 = (1-7.70E-01)*(1.90E-01) + (7.70E-01)*(1.90E-01)*(9.48E-02)$  1.90E-01 T2 initiating event frequency from the base PRA model.  7.70E-01 Fraction of T2 events that are not loss of MFW from the base PRA model  9.48E-02 Random failure probability of MFW from base PRA model fault tree quantification. This includes hardware failures and the HEP for hotwell refill using the Fire Water System
<b>Aux Feedwater (Plug)</b>  Probability that AFW does not fail early and that operators fail to prevent plugging of all available AFW pumps.	The random early failure of AFW is from the PRA model fault tree modified to remove late supply failures. If one pump fails randomly, it is assumed that the operators will not be able to recognize a common cause and will start a second pump, which will also fail.  Water Treatment is also credited here. Water Treatment random failures are from a new fault tree.

<u>Event / Description</u>	<u>Quantification</u>
	<p>The probability of operators failing to recognize the common cause of failures before all pumps are failed was quantified by an HRA event tree.</p> <p>For the time period when all AFW pumps were susceptible:</p> $3.20E-02 = 3.31E-02 * [(1.68E-01 * 1.0) + (8.32E-01 * 9.61E-01)]$ <p>3.31E-02    Fault tree quantification for failure of Water Treatment following a T2 event.</p> <p>1.68E-01    Fault tree quantification for any one AFW pump fails randomly given T2 initiating event</p> <p>1.0            Assumed operator failure if one AFW pump fails randomly</p> <p>8.32E-01    Complementary event - no AFW pumps fail randomly</p> <p>9.61E-01    HEP for failure to recognize common cause failure due to plugging given no random failures occurred</p> <p>For the time period when only MDAFW pumps were susceptible:</p> $2.15E-03 = 3.31E-02 * (6.49E-02 * 1.0)$ <p>3.31E-02    Fault tree quantification for failure of Water Treatment following a T2 event.</p> <p>6.49E-02    Fault tree quantification for TDAFW pump fails randomly given T2 initiating event</p> <p>1.0            Assumed operator failure if one AFW pump fails randomly</p> <p>These values are then combined by the fraction of the year the pumps were susceptible to arrive at the final result:</p> $1.63E-02 = (3.20E-02 * 0.472) + (2.15E-03 * 0.528)$
<p><b>RCS Feed and Bleed (Late)</b></p> <p>Failure of feed and bleed using SI after initial AFW success</p>	<p>Base PRA model fault tree quantification with an HEP for establishing feed and bleed using high pressure SI that takes credit for additional time available later in the event because decay heat is lower.</p> <p><b>1.12E-02</b></p>

<u>Event / Description</u>	<u>Quantification</u>
<p><b>Low Press S/G Injection (Service Water)</b></p> <p>Depressurize the SGs by manually opening the atmospheric steam dumps and inject using service water through the failed AFW pumps.</p>	<p>This is the HEP for opening the atmospheric steam dumps as directed in procedure CSP-H.1, RNO column if the bleed portion of SI feed and bleed fails. Hardware failures are not included because the service water system had to succeed early or the AFW pumps would not have failed.</p> <p>For this event, this action is completely dependent on the action to establish feed and bleed using charging since both are required for success. This is because low pressure steam generator injection will eventually lead to an open Pressurizer safety valve and charging is required for RCS makeup.</p> <p><b>1.00</b></p>
<p><b>RCS Feed and Bleed (Charging )</b></p> <p>Feed and bleed using maximum charging flow and pressurizing the RCS up to the Pressurizer safety valve setpoint.</p>	<p>Base PRA model fault tree quantification with an HEP for maximizing charging flow and following the RNO column in CSP-H.1 if the bleed portion of SI feed and bleed fails (approximately 40% of the failures of SI feed and bleed for the TD2 event). Charging feed and bleed is also credited as directed in CSP-C1 when the core exit temperature exceeds 700°F. This is credited when the feed portion of SI feed and bleed fails (the remaining 60% of the failures).</p> <p><b>1.27E-02</b></p>
<p><b>HEP Dependency</b></p>	<p>This factor accounts algebraically for the dependencies between the human actions within these mitigating strategies. Complete dependency is assumed for the cognitive portion of the actions because they are all directed from the same procedure CSP-H.1. A medium dependency is assumed for the execution portions of the HEPs because they are directed by separate steps and sufficient time is available to complete all the actions. The result is a multiplier that is applied to the product of the independent failures.</p> <p><b>3.40E+01</b></p>

**Sequence #7**

Successes prior to the new branches: AFW with suction from the CST.

<u>Event / Description</u>	<u>Quantification</u>
<p><b>Modified T2 Initiating Event</b></p> <p>Trip with a loss of heat sink as modified to include only the fraction of events where Main Feedwater is not available.</p>	<p>The base T2 initiator frequency from the PRA model was reduced to the fraction of events where main feed is lost to initiate the event and by the fraction of events where main feedwater fails randomly. The random MFW failure probability is from a quantification of the base PRA model fault tree.</p> <p><math>5.81E-02 = (1-7.70E-01)*(1.90E-01) + (7.70E-01)*(1.90E-01)*(9.48E-02)</math></p> <p>1.90E-01 T2 initiating event frequency from the base PRA model.</p> <p>7.70E-01 Fraction of T2 events that are not loss of MFW from the base PRA model</p> <p>9.48E-02 Random failure probability of MFW from base PRA model fault tree quantification. This includes hardware failures and the HEP for hotwell refill using the Fire Water System</p>
<p><b>Aux Feedwater (Plug)</b></p> <p>Probability that AFW does not fail early and that operators fail to prevent plugging of all available AFW pumps.</p>	<p>The random early failure of AFW is from the PRA model fault tree modified to remove late supply failures. If one pump fails randomly, it is assumed that the operators will not be able to recognize a common cause and will start a second pump, which will also fail.</p> <p>Water Treatment is also credited here. Water Treatment random failures are from a new fault tree.</p> <p>The probability of operators failing to recognize the common cause of failures before all pumps are failed was quantified by an HRA event tree.</p> <p>For the time period when all AFW pumps were susceptible:</p> <p><math>3.20E-02 = 3.31E-02 * [(1.68E-01 * 1.0) + (8.32E-01 * 9.61E-01)]</math></p> <p>3.31E-02 Fault tree quantification for failure of Water Treatment following a T2 event.</p> <p>1.68E-01 Fault tree quantification for any one AFW pump fails randomly given T2 initiating event</p> <p>1.0 Assumed operator failure if one AFW pump fails randomly</p> <p>8.32E-01 Complementary event - no AFW pumps fail randomly</p> <p>9.61E-01 HEP for failure to recognize common cause failure due to plugging given no random failures occurred</p> <p>For the time period when only MDAFW pumps were susceptible:</p> <p><math>2.15E-03 = 3.31E-02 * (6.49E-02 * 1.0)</math></p>

<u>Event / Description</u>	<u>Quantification</u>
	<p>3.31E-02 Fault tree quantification for failure of Water Treatment following a T2 event.</p> <p>6.49E-02 Fault tree quantification for TDAFW pump fails randomly given T2 initiating event</p> <p>1.0 Assumed operator failure if one AFW pump fails randomly</p> <p>These values are then combined by the fraction of the year the pumps were susceptible to arrive at the final result:</p> <p><b>1.63E-02 = (3.20E-02*0.472) + (2.15E-03*0.528)</b></p>
<b>RCS Feed and Bleed (Late)</b>	Success branch for SI feed and bleed.
<b>Shutdown Cooling</b>  Closed cycle RCS cooling using the RHR system.	<p>This value is based upon a quantification of the base PRA model fault tree for RHR cooling given a T2 event. A high dependency recovery of test return valves that were left in the open position following the last flow test of RHR was also applied in this case because of the time available.</p> <p><b>2.81E-03</b></p>

## TRANSIENT WITH HEAT SINK

### Sequence #3

Successes prior to the new branches: AFW with suction from the CST.

<u>Event / Description</u>	<u>Quantification</u>
<b>T3 Initiating Event</b>  Trip where the Main Condenser heat sink and Main Feedwater are still available.	<p>Frequency from the base PRA model.</p> <p><b>6.60E-01</b></p>
<b>Aux Feedwater (Plug)</b>  Probability that AFW does not fail early and that operators fail to prevent plugging of all available AFW pumps.	<p>The random early failure of AFW is from the PRA model fault tree modified to remove late supply failures. If one pump fails randomly, it is assumed that the operators will not be able to recognize a common cause and will start a second pump, which will also fail.</p> <p>Water Treatment is also credited here. Water Treatment random failures are from a new fault tree.</p> <p>The probability of operators failing to recognize the common cause of failures before</p>

<u>Event / Description</u>	<u>Quantification</u>
	<p>all pumps are failed was quantified by an HRA event tree.</p> <p>For the time period when all AFW pumps were susceptible:</p> $3.20E-02 = 3.31E-02 * [(1.68E-01 * 1.0) + (8.32E-01 * 9.61E-01)]$ <ul style="list-style-type: none"> <li>3.31E-02 Fault tree quantification for failure of Water Treatment following a T2 event.</li> <li>1.68E-01 Fault tree quantification for any one AFW pump fails randomly given T2 initiating event</li> <li>1.0 Assumed operator failure if one AFW pump fails randomly</li> <li>8.32E-01 Complementary event - no AFW pumps fail randomly</li> <li>9.61E-01 HEP for failure to recognize common cause failure due to plugging given no random failures occurred</li> </ul> <p>For the time period when only MDAFW pumps were susceptible:</p> $2.15E-03 = 3.31E-02 * (6.49E-02 * 1.0)$ <ul style="list-style-type: none"> <li>3.31E-02 Fault tree quantification for failure of Water Treatment following a T2 event.</li> <li>6.49E-02 Fault tree quantification for TDAFW pump fails randomly given T2 initiating event</li> <li>1.0 Assumed operator failure if one AFW pump fails randomly</li> </ul> <p>These values are then combined by the fraction of the year the pumps were susceptible to arrive at the final result:</p> $1.63E-02 = (3.20E-02 * 0.472) + (2.15E-03 * 0.528)$
<p><b>Main Feedwater</b></p> <p>Main Feedwater fails to continue to run following a general plant trip.</p>	<p>Random failure probability from the base PRA model fault tree quantification.</p> <p><b>3.74E-03</b></p>
<p><b>RCS Feed and Bleed (Late)</b></p> <p>Failure of feed and bleed using SI after initial AFW success</p>	<p>Base PRA model fault tree quantification with an HEP for establishing feed and bleed using high pressure SI that takes credit for additional time available later in the event because decay heat is lower.</p> <p><b>1.12E-02</b></p>

<u>Event / Description</u>	<u>Quantification</u>
<p><b>Low Press S/G Injection (Service Water)</b></p> <p>Depressurize the SGs by manually opening the atmospheric steam dumps and inject using service water through the failed AFW pumps.</p>	<p>This is the HEP for opening the atmospheric steam dumps as directed in procedure CSP-H.1, RNO column if the bleed portion of SI feed and bleed fails. Hardware failures are not included because the service water system had to succeed early or the AFW pumps would not have failed.</p> <p>For this event, this action is completely dependent on the action to establish feed and bleed using charging since both are required for success. This is because low pressure steam generator injection will eventually lead to an open Pressurizer safety valve and charging is required for RCS makeup.</p> <p><b>1.00</b></p>
<p><b>RCS Feed and Bleed (Charging)</b></p> <p>Feed and bleed using maximum charging flow and pressurizing the RCS up to the Pressurizer safety valve setpoint.</p>	<p>Base PRA model fault tree quantification with an HEP for maximizing charging flow and following the RNO column in CSP-H.1 if the bleed portion of SI feed and bleed fails (approximately 40% of the failures of SI feed and bleed for the TD2 event). Charging feed and bleed is also credited as directed in CSP-C1 when the core exit temperature exceeds 700°F. This is credited when the feed portion of SI feed and bleed fails (the remaining 60% of the failures).</p> <p><b>1.27E-02</b></p>
<p><b>HEP Dependency</b></p>	<p>This factor accounts algebraically for the dependencies between the human actions within these mitigating strategies. Complete dependency is assumed for the cognitive portion of the actions because they are all directed from the same procedure CSP-H.1. A medium dependency is assumed for the execution portions of the HEPs because they are directed by separate steps and sufficient time is available to complete all the actions. The result is a multiplier that is applied to the product of the independent failures.</p> <p><b>3.40E+01</b></p>

### Sequence #7

Successes prior to the new branches: AFW with suction from the CST.

<u>Event / Description</u>	<u>Quantification</u>
<p><b>T3 Initiating Event</b></p> <p>Trip where the Main Condenser heat sink and Main Feedwater are still available.</p>	<p>Frequency from the base PRA model.</p> <p><b>6.60E-01</b></p>
<p><b>Aux Feedwater (Plug)</b></p> <p>Probability that AFW does not fail early and that operators fail to prevent plugging of all</p>	<p>The random early failure of AFW is from the PRA model fault tree modified to remove late supply failures. If one pump fails randomly, it is assumed that the operators will not be able to recognize a common cause and will start a second pump, which will also fail.</p>

<u>Event / Description</u>	<u>Quantification</u>
available AFW pumps.	<p>Water Treatment is also credited here. Water Treatment random failures are from a new fault tree.</p> <p>The probability of operators failing to recognize the common cause of failures before all pumps are failed was quantified by an HRA event tree.</p> <p>For the time period when all AFW pumps were susceptible:</p> $3.20E-02 = 3.31E-02 * [(1.68E-01 * 1.0) + (8.32E-01 * 9.61E-01)]$ <p style="margin-left: 40px;">3.31E-02    Fault tree quantification for failure of Water Treatment following a T2 event.</p> <p style="margin-left: 40px;">1.68E-01    Fault tree quantification for any one AFW pump fails randomly given T2 initiating event</p> <p style="margin-left: 40px;">1.0            Assumed operator failure if one AFW pump fails randomly</p> <p style="margin-left: 40px;">8.32E-01    Complementary event - no AFW pumps fail randomly</p> <p style="margin-left: 40px;">9.61E-01    HEP for failure to recognize common cause failure due to plugging given no random failures occurred</p> <p>For the time period when only MDAFW pumps were susceptible:</p> $2.15E-03 = 3.31E-02 * (6.49E-02 * 1.0)$ <p style="margin-left: 40px;">3.31E-02    Fault tree quantification for failure of Water Treatment following a T2 event.</p> <p style="margin-left: 40px;">6.49E-02    Fault tree quantification for TDAFW pump fails randomly given T2 initiating event</p> <p style="margin-left: 40px;">1.0            Assumed operator failure if one AFW pump fails randomly</p> <p>These values are then combined by the fraction of the year the pumps were susceptible to arrive at the final result:</p> $1.63E-02 = (3.20E-02 * 0.472) + (2.15E-03 * 0.528)$
<b>RCS Feed and Bleed (Late)</b>	Success branch for SI feed and bleed.
<b>Main Feedwater</b> Main Feedwater fails to continue to run following a general plant trip.	Random failure probability from the base PRA model fault tree quantification.  <b>3.74E-03</b>

<u>Event / Description</u>	<u>Quantification</u>
<p><b>Shutdown Cooling</b></p> <p>Closed cycle RCS cooling using the RHR system.</p>	<p>This value is based upon a quantification of the base PRA model fault tree for RHR cooling given a T2 event. A high dependency recovery of test return valves that were left in the open position following the last flow test of RHR was also applied in this case because of the time available.</p> <p><b>2.81E-03</b></p>

### **SINGLE UNIT LOOP**

On Unit 2, this event results in a loss of Water Treatment because the primary AC power for the system comes from Unit 2 balance of plant sources. For this single unit transient, restoration of offsite power must be accomplished with enough time remaining before the CST is drained to allow for restoration of Water Treatment. MAAP runs showed this time to be approximately 4.8 hours. A restoration of offsite power probability at four hours was therefore used.

### **Sequence #3**

Successes prior to the new branches: AFW with suction from the CST.

<u>Event / Description</u>	<u>Quantification</u>
<p><b>SLOOP</b></p> <p>Single unit loss of offsite power.</p>	<p>Fraction of T2 events that are SLOOP from the base PRA model.</p> <p><b>2.39E-02 = (1.9E-01 * 1.26E-01)</b></p> <p>1.90E-01 T2 initiating event frequency from the base PRA model.</p> <p>1.26E-01 Fraction of T2 events that are from a single unit loss of offsite power from data analysis for the base PRA model</p>
<p><b>Aux Feedwater (Plug)</b></p> <p>Probability that AFW does not fail early and that operators fail to prevent plugging of all available AFW pumps.</p>	<p>The random early failure of AFW is from the PRA model fault tree modified to remove late supply failures. If one pump fails randomly, it is assumed that the operators will not be able to recognize a common cause and will start a second pump, which will also fail.</p> <p>Water Treatment and Main Feedwater are also credited here when offsite power is recovered before the CST is depleted. Water Treatment random failures are from a new fault tree. Main Feedwater failure probability is from the base PRA model fault tree and hotwell makeup using fire water. Recovery of offsite power probability at four hours is from the base PRA model.</p> <p>The probability of operators failing to recognize the common cause of failures before all pumps are failed was quantified by an HRA event tree.</p> <p>For the time period when all AFW pumps were susceptible:</p> <p><b>1.33E-01 = 1.38E-01 * [(2.26E-01 * 1.0) + (7.74E-01 * 9.61E-01)]</b></p>

<u>Event / Description</u>	<u>Quantification</u>
	<p>1.38E-01 = 1.30E-01 + (2.90E-02 * 2.61E-01)</p> <p>1.30E-01 Failure to recover offsite power in 4 hours</p> <p>2.90E-02 Failure of Water Treatment</p> <p>2.61E-01 Failure of Main Feedwater or hotwell makeup using water from the Fire Protection System.</p> <p>2.26E-01 Fault tree quantification for any one AFW pump fails randomly given T1 initiating event</p> <p>1.0 Assumed operator failure if one AFW pump fails randomly</p> <p>7.74E-01 Complementary event - no AFW pumps fail randomly</p> <p>9.61E-01 HEP for failure to recognize common cause failure due to plugging given no random failures occurred</p> <p>For the time period when only MDAFW pumps were susceptible:</p> <p>1.05E-02 = 1.38E-01 * (7.64E-02 * 1.0)</p> <p>1.38E-01 = 1.30E-01 + (2.90E-02 * 2.61E-01)</p> <p>1.30E-01 Failure to recover offsite power in 4 hours</p> <p>2.90E-02 Failure of Water Treatment</p> <p>2.61E-01 Failure of Main Feedwater or hotwell makeup using water from the Fire Protection System.</p> <p>7.64E-02 Fault tree quantification for TDAFW pump fails randomly given T1 initiating event</p> <p>1.0 Assumed operator failure if one AFW pump fails randomly</p> <p>These values are then combined by the fraction of the year the pumps were susceptible to arrive at the final result:</p> <p><b>6.85E-02 = (1.33E-01*0.472) + (1.05E-02*0.528)</b></p>
<p><b>RCS Feed and Bleed (Late)</b></p> <p>Failure of feed and bleed using SI after initial AFW success</p>	<p>Base PRA model fault tree quantification with an HEP for establishing feed and bleed using high pressure SI that takes credit for additional time available later in the event because decay heat is lower.</p> <p><b>1.42E-02</b></p>

<u>Event / Description</u>	<u>Quantification</u>
<p><b>Low Press S/G Injection (Service Water)</b></p> <p>Depressurize the SGs by manually opening the atmospheric steam dumps and inject using service water through the failed AFW pumps.</p>	<p>This is the HEP for opening the atmospheric steam dumps as directed in procedure CSP-H.1, RNO column if the bleed portion of SI feed and bleed fails. Hardware failures are not included because the service water system had to succeed early or the AFW pumps would not have failed.</p> <p>For this event, this action is completely dependent on the action to establish feed and bleed using charging since both are required for success. This is because low pressure steam generator injection will eventually lead to an open Pressurizer safety valve and charging is required for RCS makeup.</p> <p><b>1.00</b></p>
<p><b>RCS Feed and Bleed (Charging)</b></p> <p>Feed and bleed using maximum charging flow and pressurizing the RCS up to the Pressurizer safety valve setpoint.</p>	<p>Base PRA model fault tree quantification with an HEP for maximizing charging flow and following the RNO column in CSP-H.1 if the bleed portion of SI feed and bleed fails (approximately 40% of the failures of SI feed and bleed for the TD2 event). Charging feed and bleed is also credited as directed in CSP-C1 when the core exit temperature exceeds 700°F. This is credited when the feed portion of SI feed and bleed fails (the remaining 60% of the failures).</p> <p><b>1.54E-02</b></p>
<p><b>HEP Dependency</b></p>	<p>This factor accounts algebraically for the dependencies between the human actions within these mitigating strategies. Complete dependency is assumed for the cognitive portion of the actions because they are all directed from the same procedure CSP-H.1. A medium dependency is assumed for the execution portions of the HEPs because they are directed by separate steps and sufficient time is available to complete all the actions. The result is a multiplier that is applied to the product of the independent failures.</p> <p><b>2.61E+01</b></p>

### Sequence #7

Successes prior to the new branches: AFW with suction from the CST.

<u>Event / Description</u>	<u>Quantification</u>
<p><b>SLOOP</b></p> <p>Single unit loss of offsite power.</p>	<p>Fraction of T2 events that are SLOOP from the base PRA model.</p> <p><b>2.39E-02 = (1.9E-01 * 1.26E-01)</b></p> <p>1.90E-01 T2 initiating event frequency from the base PRA model.</p> <p>1.26E-01 Fraction of T2 events that are from a single unit loss of offsite power from data analysis for the base PRA model</p>
<p><b>Aux Feedwater (Plug)</b></p> <p>Probability that AFW does not fail early and</p>	<p>The random early failure of AFW is from the PRA model fault tree modified to remove late supply failures. If one pump fails randomly, it is assumed that the operators will not be able to recognize a common cause and will start a second pump, which will also</p>

<u>Event / Description</u>	<u>Quantification</u>
<p>that operators fail to prevent plugging of all available AFW pumps.</p>	<p>fail.</p> <p>Water Treatment and Main Feedwater are also credited here when offsite power is recovered before the CST is depleted. Water Treatment random failures are from a new fault tree. Main Feedwater failure probability is from the base PRA model fault tree and hotwell makeup using fire water. Recovery of offsite power probability at four hours is from the base PRA model.</p> <p>The probability of operators failing to recognize the common cause of failures before all pumps are failed was quantified by an HRA event tree.</p> <p>For the time period when all AFW pumps were susceptible:</p> $1.33E-01 = 1.38E-01 * [(2.26E-01 * 1.0) + (7.74E-01 * 9.61E-01)]$ $1.38E-01 = 1.30E-01 + (2.90E-02 * 2.61E-01)$ <ul style="list-style-type: none"> <li>1.30E-01 Failure to recover offsite power in 4 hours</li> <li>2.90E-02 Failure of Water Treatment</li> <li>2.61E-01 Failure of Main Feedwater or hotwell makeup using water from the Fire Protection System.</li> </ul> <ul style="list-style-type: none"> <li>2.26E-01 Fault tree quantification for any one AFW pump fails randomly given T1 initiating event</li> <li>1.0 Assumed operator failure if one AFW pump fails randomly</li> <li>7.74E-01 Complementary event - no AFW pumps fail randomly</li> <li>9.61E-01 HEP for failure to recognize common cause failure due to plugging given no random failures occurred</li> </ul> <p>For the time period when only MDAFW pumps were susceptible:</p> $1.05E-02 = 1.38E-01 * (7.64E-02 * 1.0)$ $1.38E-01 = 1.30E-01 + (2.90E-02 * 2.61E-01)$ <ul style="list-style-type: none"> <li>1.30E-01 Failure to recover offsite power in 4 hours</li> <li>2.90E-02 Failure of Water Treatment</li> <li>2.61E-01 Failure of Main Feedwater or hotwell makeup using water from the Fire Protection System.</li> </ul> <ul style="list-style-type: none"> <li>7.64E-02 Fault tree quantification for TDAFW pump fails randomly given T1 initiating event</li> <li>1.0 Assumed operator failure if one AFW pump fails randomly</li> </ul>

<u>Event / Description</u>	<u>Quantification</u>
	<p>These values are then combined by the fraction of the year the pumps were susceptible to arrive at the final result:</p> $6.85E-02 = (1.33E-01 * 0.472) + (1.05E-02 * 0.528)$
<b>RCS Feed and Bleed (Late)</b>	Success branch for SI feed and bleed.
<b>Shutdown Cooling</b>  Closed cycle RCS cooling using the RHR system.	<p>This value is based upon a quantification of the base PRA model fault tree for RHR cooling given a T1 event. A high dependency recovery of test return valves that were left in the open position following the last flow test of RHR was also applied in this case because of the time available.</p> <p><b>3.32E-03</b></p>

### **SEISMIC EVENT – LOW**

Walkdowns of critical equipment were performed by seismic experts to support this risk evaluation. The observations made on these walkdowns confirmed that instrument air would be lost in a seismic event above an operating basis earthquake. However, these walkdowns also confirmed that the CST and AFW suction piping from the CST would survive intact an event of magnitude almost up to a safe shutdown earthquake. This means that AFW with suction from the CST can be credited until CST inventory is depleted. Also surviving intact up to this magnitude is the charging system (although charging normally relies on instrument air to increase pump speed above minimum). Charging feed and bleed can then also be credited. The seismic event frequency where a different response is required is determined by the fragility of the SI system. The low magnitude seismic events are where SI is still available.

#### **Sequence #4**

Successes prior to the new branches: Control of Charging flow (dependent on Instrument Air), and AFW with suction from the CST.

<u>Event / Description</u>	<u>Quantification</u>
<b>Seismic-Low</b>  Lower magnitude seismic event above the operating basis earthquake but where SI/RHR is still available.	<p>Based on the SI fragility curve from the seismic PRA done for the IPEEE.</p> <p><b>2.50E-04/yr</b></p>
<b>Aux Feedwater (Plug)</b>  Probability that AFW does not fail early and	<p>The random early failure of AFW is from the PRA model fault tree modified to remove late supply failures. If one pump fails randomly, it is assumed that the operators will not be able to recognize a common cause and will start a second pump, which will then</p>

<u>Event / Description</u>	<u>Quantification</u>
<p>that operators fail to prevent plugging of all available AFW pumps.</p>	<p>also fail.</p> <p>The probability of operators failing to recognize the common cause of failures before all pumps are failed was quantified by an HRA event tree.</p> <p>For the time period when all AFW pumps were susceptible:</p> $5.77E-01 = (2.73E-01 * 1.0) + (7.27E-01 * 4.18E-01)$ <p style="margin-left: 40px;">2.73E-01    Fault tree quantification for any one AFW pump fails randomly given IA failure event</p> <p style="margin-left: 40px;">1.0            Assumed operator failure if one AFW pump fails randomly</p> <p style="margin-left: 40px;">7.27E-01    Complementary event - no AFW pumps fail randomly</p> <p style="margin-left: 40px;">4.18E-01    HEP for failure to recognize common cause failure due to plugging given no random failures occurred</p> <p>For the time period when only MDAFW pumps were susceptible:</p> <p>7.22E-02    Fault tree quantification for TDAFW pump fails randomly given IA failure event</p> <p>These values are then combined by the fraction of the year the pumps were susceptible to arrive at the final result:</p> $3.10E-01 = (5.77E-01 * 0.472) + (7.22E-02 * 0.528)$
<p><b>Low Press S/G Injection (Service Water)</b></p> <p>Depressurize the SGs by manually opening the atmospheric steam dumps and inject using service water through the failed AFW pumps.</p>	<p>This is the HEP for opening the atmospheric steam dumps as directed in procedure CSP-H.1, RNO column if the bleed portion of SI feed and bleed fails. Hardware failures are not included because the service water system had to succeed early or the AFW pumps would not have failed.</p> <p>For this event, this action is completely dependent on the action to establish feed and bleed using charging since both are required for success. This is because low pressure steam generator injection will eventually lead to an open Pressurizer safety valve and charging is required for RCS makeup.</p> <p><b>1.00</b></p>
<p><b>RCS Feed and Bleed (Charging)</b></p> <p>Feed and bleed using maximum charging flow and pressurizing the RCS up to the Pressurizer safety valve setpoint.</p>	<p>Base PRA model fault tree quantification with an HEP for maximizing charging flow and following the RNO column in CSP-H.1 because the bleed portion of SI feed and bleed fails due to not having instrument air available for the Pressurizer PORVs.</p> <p><b>2.23E-02</b></p>

<u>Event / Description</u>	<u>Quantification</u>
<b>HEP Dependency</b>	Because low pressure steam generator injection is already completely dependent on the charging feed and bleed action, no other dependencies need to be applied.  1.00

### Sequence #5

Successes prior to the new branches: Control of Charging flow (dependent on Instrument Air), and AFW with suction from the CST.

<u>Event / Description</u>	<u>Quantification</u>
<b>Seismic-Low</b>  Lower magnitude seismic event above the operating basis earthquake but where SI/RHR is still available.	Based on the SI fragility curve from the seismic PRA done for the IPEEE.  2.50E-04/yr
<b>Aux Feedwater (Plug)</b>  Probability that AFW does not fail early and that operators fail to prevent plugging of all available AFW pumps.	<p>The random early failure of AFW is from the PRA model fault tree modified to remove late supply failures. If one pump fails randomly, it is assumed that the operators will not be able to recognize a common cause and will start a second pump, which will then also fail.</p> <p>The probability of operators failing to recognize the common cause of failures before all pumps are failed was quantified by an HRA event tree.</p> <p>For the time period when all AFW pumps were susceptible:</p> $5.77E-01 = (2.73E-01 * 1.0) + (7.27E-01 * 4.18E-01)$ <p style="margin-left: 40px;">2.73E-01    Fault tree quantification for any one AFW pump fails randomly given IA failure event</p> <p style="margin-left: 40px;">1.0            Assumed operator failure if one AFW pump fails randomly</p> <p style="margin-left: 40px;">7.27E-01    Complementary event - no AFW pumps fail randomly</p> <p style="margin-left: 40px;">4.18E-01    HEP for failure to recognize common cause failure due to plugging given no random failures occurred</p> <p>For the time period when only MDAFW pumps were susceptible:</p> <p>7.22E-02    Fault tree quantification for TDAFW pump fails randomly given IA failure event</p> <p>These values are then combined by the fraction of the year the pumps were susceptible to arrive at the final result:</p>

<u>Event / Description</u>	<u>Quantification</u>
	$3.10E-01 = (5.77E-01 * 0.472) + (7.22E-02 * 0.528)$
<p><b>Low Press S/G Injection (Service Water)</b></p> <p>Depressurize the SGs by manually opening the atmospheric steam dumps and inject using service water through the failed AFW pumps.</p>	<p>This is the HEP for opening the atmospheric steam dumps as directed in procedure CSP-H.1, RNO column if the bleed portion of SI feed and bleed fails. Hardware failures are not included because the service water system had to succeed early or the AFW pumps would not have failed.</p> <p>For this event, this action is completely dependent on the action to establish feed and bleed using charging since both are required for success. This is because low pressure steam generator injection will eventually lead to an open Pressurizer safety valve and charging is required for RCS makeup.</p> <p><b>1.00</b></p>
<b>RCS Feed and Bleed (Charging )</b>	Success branch
<p><b>Shutdown Cooling</b></p> <p>Closed cycle RCS cooling using the RHR system.</p>	<p>This value is based upon a quantification of the base PRA model fault tree for RHR cooling. A high dependency recovery of test return valves that were left in the open position following the last flow test of RHR was also applied in this case because of the time available.</p> <p><b>2.90E-03</b></p>

### SEISMIC EVENT – HIGH

These seismic events are those above the magnitude where SI fails but where AFW with suction from the CST is still intact.

Successes prior to the new branches: AFW with suction from the CST.

<u>Event / Description</u>	<u>Quantification</u>
<p><b>Seismic Event - High</b></p> <p>Seismic event large enough to fail SI/RHR but less than the AFW failure magnitude.</p>	<p>Based on the AFW and SI fragility curves from the seismic PRA done for the IPEEE, with additional information provided by walkdowns of the CST and AFW suction piping.</p> <p>2.02E-05</p>
<p><b>Aux Feedwater (Plug)</b></p> <p>Probability that AFW does not fail early and that operators fail to prevent plugging of all available AFW pumps.</p>	<p>The random early failure of AFW is from the PRA model fault tree modified to remove late supply failures. If one pump fails randomly, it is assumed that the operators will not be able to recognize a common cause and will start a second pump, which will then also fail.</p> <p>The probability of operators failing to recognize the common cause of failures before all pumps are failed was quantified by an HRA event tree.</p> <p>For the time period when all AFW pumps were susceptible:</p>

<u>Event / Description</u>	<u>Quantification</u>
	<p><math>5.77E-01 = (2.73E-01 * 1.0) + (7.27E-01 * 4.18E-01)</math></p> <p>2.73E-01    Fault tree quantification for any one AFW pump fails randomly given IA failure event</p> <p>1.0            Assumed operator failure if one AFW pump fails randomly</p> <p>7.27E-01    Complementary event - no AFW pumps fail randomly</p> <p>4.18E-01    HEP for failure to recognize common cause failure due to plugging given no random failures occurred</p> <p>For the time period when only MDAFW pumps were susceptible:</p> <p>7.22E-02    Fault tree quantification for TDAFW pump fails randomly given IA failure event</p> <p>These values are then combined by the fraction of the year the pumps were susceptible to arrive at the final result:</p> <p><math>3.10E-01 = (5.77E-01*0.472) + (7.22E-02*0.528)</math></p>
<p><b>Low Press S/G Injection (Service Water)</b></p> <p>Depressurize the SGs by manually opening the atmospheric steam dumps and inject using service water through the failed AFW pumps.</p>	<p>This is the HEP for opening the atmospheric steam dumps as directed in procedure CSP-H.1, RNO column if the bleed portion of SI feed and bleed fails. Hardware failures are not included because the service water system had to succeed early or the AFW pumps would not have failed.</p> <p>For this event, this action is completely dependent on the action to establish feed and bleed using charging since both are required for success. This is because low pressure steam generator injection will eventually lead to an open Pressurizer safety valve and charging is required for RCS makeup.</p> <p><b>1.00</b></p>

## **Internal Events Screened from Further Consideration**

### **Large LOCA**

AFW is not used in response to this event.

### **Medium LOCA**

The mission time for AFW in this event is less than one hour. CST volume is sufficient for this period of time, so swap of the suction to Service Water or Fire Protection water is not required and the AFW pumps would not be failed.

### **Small LOCA**

MAAP analysis of this event has demonstrated that, following initial success of AFW, cooldown through the break with an SI pump injecting is sufficient to reach RCS conditions where RHR can be placed into service before core uncover occurs. For cases where SI is not available, injection using the charging pumps is also sufficient to prevent core damage.

### **Excessive LOCA**

The reactor pressure vessel rupture event leads directly to core damage. AFW is not credited.

### **Interfacing Systems LOCA**

An unisolated interfacing systems rupture will lead directly to core damage. AFW is not credited.

### **Steam Generator Tube Rupture**

Similar to the Small LOCA, MAAP analysis has shown that with an SI pump injecting, cooldown through the ruptured tube and the atmospheric steam dump is sufficient to reach RCS conditions where RHR can be placed into service before core uncover occurs. For cases where SI is not available, injection using the charging pumps is also sufficient to prevent core damage. Feed and bleed conditions are never reached because the ruptured tube keeps the affected steam generator filled above the level that would cause the operators to initiate it.

### **Loss of DC Bus D01**

On Unit 2, Main Feedwater is still available for this event and AFW would only be used if MFW was to fail randomly. The initiating event frequency and plant response will be similar to that for a loss of Bus D02 except that availability of Main Feedwater will reduce it by at least an order of magnitude.

### **Station Blackout**

The SBO initiating event frequency is low enough to bring this event to less than 1% of the total change in CDP.

### **Steam Line Break Outside Containment**

A preliminary quantification the delta CDP for this event showed it to be less than 1% of the total.

**Feed Line or Steam Line Break Inside Containment**

A preliminary quantification the delta CDP for this event showed it to be less than 1% of the total.

**Loss of Component Cooling Water**

A preliminary quantification the delta CDP for this event showed it to be less than 1% of the total.

**ATTACHMENT 3**

**Calculation of Availability/Reliability of the Water Treatment System (Final)**

**POINT BEACH NUCLEAR PLANT, UNITS 1 AND 2**

Point Beach Nuclear Plant  
**CALCULATION COVER SHEET**

<b>Calculation/Addendum Number:</b> 2003-0053	<b>Title of Calculation/Addendum:</b> Water Treatment System Reliability and Availability for AFW Orifice Issue Risk
--	---

**System (CHAMPS Identifier Codes):**  
None

<input checked="" type="checkbox"/> <b>Original Calculation/Addendum</b>	<input type="checkbox"/> <b>Supersedes Calculation/Addendum</b>
<input type="checkbox"/> <b>Revised Calculation/Addendum Revision #</b> _____	_____

<b>QA Scope</b> <input type="checkbox"/> Yes <input checked="" type="checkbox"/> No  <b>Discipline</b> <input type="checkbox"/> CIV <input type="checkbox"/> NUC <input type="checkbox"/> ELEC <input type="checkbox"/> COMP <input type="checkbox"/> I&C <input type="checkbox"/> CHEM/RAD <input type="checkbox"/> MECH <input type="checkbox"/> SYST <input checked="" type="checkbox"/> PRA	<b>Associated Documents:</b> <u>None</u> _____ _____
	<b>Superseded By Calculation/Addendum #</b> <u>None</u> _____

<b>This Calculation has been reviewed in accordance with NP 7.2.4. The review was accomplished by one or a combination of the following (check all that apply):</b>	<b>Reviewers' Initials</b>
<input type="checkbox"/> A review of a representative sample of repetitive calculations.	
<input type="checkbox"/> A review of the calculation against a similar calculation previously performed.	
<input checked="" type="checkbox"/> A detailed review of the original calculation.	<i>Jm</i>
<input type="checkbox"/> A review by an alternate, simplified, or approximate method of calculation.	

Preparer	Reviewer	Discipline	Name	Signature	Date
<input checked="" type="checkbox"/>	<input type="checkbox"/>	PRA	Paul Knoespel	<i>[Signature]</i>	6/26/03
<input type="checkbox"/>	<input checked="" type="checkbox"/>	PRA	James Masterlark	<i>[Signature]</i>	6/26/03
<input type="checkbox"/>	<input type="checkbox"/>				
<input type="checkbox"/>	<input type="checkbox"/>				
<input type="checkbox"/>	<input type="checkbox"/>				
<input type="checkbox"/>	<input type="checkbox"/>				
<input type="checkbox"/>	<input type="checkbox"/>				

**Approver:**    **Printed Name:** RICHARD P. WOOD  
**Signature:**    *[Signature]*  
**Date:**         6/26/2003



### Comments And Resolution

<b>Reviewer Comments:</b>	<b>Resolution:</b>
<p>Common mode failures for components in the Water Treatment system could be significant and need to be included in the hardware failures.</p>	<p>Common mode failures were added using generic common mode factors. The total hardware failure probability increased by a little more than double, but is still dominated by test and maintenance unavailability and support system failures.</p> <div style="text-align: right; margin-top: 10px;">  </div>

## 1.0 PURPOSE

The purpose of this calculation is to determine a probability that the Water Treatment System will not be available during a 24 hour time period following a plant trip or accident. This probability includes both an equipment maintenance unavailability component and an equipment reliability component. The result of this calculation are used as an input to the Auxiliary Feedwater (AFW) recirculation orifice issue Phase 3 Significance Determination Process (SDP) risk calculation.

The scope of this calculation is Non-QA. It is a PRA calculation that is being performed using standard industry PRA guidance. Specifically:

- Another technically qualified person shall review the calculation. However, this review is not required to be independent.
- Inputs and Assumptions shall be reviewed and be reasonable for the scenario being analyzed (best-estimate). Inputs and Assumptions are not required to be validated.
- Inputs and assumptions already contained within the revision of the PRA model being used to support this calculation are not required to be documented here. Changes to the inputs and assumptions specific to this calculation shall be documented in the inputs and assumptions section of this calculation.
- The PRA software programs used to support this calculation are best-estimate tools and are not required to meet the criteria of Appendix A of NP 7.2.4.
- References used to support this calculation are to be documented. This includes the revision of the PRA model supporting the calculation.

Acronyms used in this calculation:

AFW	Auxiliary Feedwater
CST	Condensate Storage Tank
DLOOP	Dual Unit Loss of Offsite Power
HEP	Human Error Probability
HRA	Human Reliability Analysis
MOV	Motor Operated Valve
P&ID	Piping and Instrument Diagram
SI	Safety Injection
SLOOP	Single Unit Loss of Offsite Power

## 2.0 METHODOLOGY

The failure probability of the Water Treatment System was determined in this calculation by a simplified fault tree analysis because detailed results of individual component importances within the system were not needed – only a final failure probability was required. The failure of the system itself was determined from a table of component failure probabilities. This value was then input to the fault tree, where test and maintenance unavailability and human error probability were added and the required support system fault trees were linked in.

Hardware failure probabilities within the system itself were determined by use of a failure modes table of components within the various trains of the system (Attachment B). Failures within the various trains were summed together and then multiplied together to find the failure probability of all of the redundant paths. This method was continued through the entire system to determine a final hardware failure probability for Water Treatment.

The fault tree that was used to link in the support system failures is shown in Attachment A. This fault tree was developed from the P&IDs [References 5.4 through 5.7] for support system information and from the Point Beach CHAMPS database [Reference 5.8] for component electrical power supply information. The fault tree was quantified using the WinNUPRA PRA software [Reference 5.3] for two different top gates: Water Treatment failure with and SI signal present and Water Treatment failure with no SI signal present. These two values provided the final result.

### 3.0 ACCEPTANCE CRITERIA

The results of this calculation are the probability that the Water Treatment System will be unavailable at any time during a 24 hour time period when required to help mitigate an accident. No acceptance criteria apply.

### 4.0 ASSUMPTIONS

- 4.1 It is assumed that the portions of the Point Beach PRA Model used in this calculation provide probability results that are of sufficient accuracy for the purpose of this evaluation. The PRA model version used for this calculation is Revision 3.07 dated 01/09/2003. This model has not yet undergone final review and the documentation is thus still in draft form. However, the results from the model have been reviewed and are considered to be reasonable, and no significant changes are expected to result from the final review.
- 4.2 It is assumed that including only the major flowpath components for the Water Treatment System will provide a reasonable estimate of the failure probability for the entire system. These major flowpath elements include pumps, check valves, air operated valves, and their respective power supplies and support systems. The failure probability for control circuits, filters, and chemical addition components are small compared to the major component failure probabilities and can therefore be neglected without affecting the results to any significant degree.
- 4.3 It is assumed that the maintenance unavailability for the Water Treatment System (i.e., times when the entire system was off line and no water makeup was available) is no more than 3.5 days per year or about 0.01. This value is based on an interview of a Plant Manager and another SRO in November 2002. No plant log records of Water Treatment System unavailability are available. System Engineer notes from November 2001 through October 2002 did not indicate any time that the entire system was unavailable. Only portions of the multi-train system were noted as being unavailable. The System Engineer confirmed that the 0.01 value for test and maintenance unavailability was bounding in a teleconference held on 06/16/2003. See also the tabulation of component unavailability events in Appendix E.
- 4.4 It is assumed that the generic industry data for component reliabilities also apply to the Water Treatment System component reliabilities. This is standard PRA practice for systems for which little or no plant specific data is available.
- 4.5 It is assumed that a human error probability for the Operator failing to maintain CST level from the Water Treatment System following events where a Safety Injection Signal is not received is 1.0E-03. This is a nominal HEP for an operator to read a gauge and control flow manually given feedback from the Control Room operator that the CST level will continue to fall if the action is not done properly.
- 4.6 It is assumed that the Water Treatment System is required to operate for a 24 hour time period following a plant trip or accident. This is consistent with the mission time assumed for other support systems in the Point Beach PRA Model.
- 4.7 It is assumed that the generic common cause terms from NUREG/CR-5485 are sufficient to evaluate the magnitude of the common cause failures in this calculation. This is consistent with the philosophy used for the Point Beach PRA Model for systems that do not have specific terms.

### 5.0 REFERENCES

- 5.1 Point Beach PRA Model Revision 3.05, dated 09/12/2002.
- 5.2 Point Beach PRA Model Data Analysis Notebook, PRA 4.0, Draft.
- 5.3 WinNUPRA Version 2.1, SCIENTECH, Inc.
- 5.4 Point Beach P&ID M-210 Sheet 1, Plant Make-Up Water Treatment System Pretreatment System, Revision 16, 03/01/2003
- 5.5 Point Beach P&ID M-210 Sheet 2, Plant Make-Up Water Treatment System Demineralizer System, Revision 19, 01/18/2003

- 5.6 Point Beach P&ID WSC D96G0901, Water Treatment Reverse Osmosis System, Revision 09, 03/25/2000
- 5.7 Point Beach P&ID M-2207 Sheet 1, Service Water, Revision 54, 06/17/2000
- 5.8 Point Beach CHAMPS (Component History and Maintenance Planning System) Database
- 5.9 Guidelines on Modeling Common Cause Failures in Probabilistic Risk Assessment, NUREG/CR-5485, November 1998.

## 6.0 INPUTS

- 6.1 The following support system fault trees from Revision 3.05 of the Point Beach PRA Model were linked into the Water Treatment System fault tree developed for this calculation: Instrument Air (IA.lgc), Service Water (SWS.lgc), 480 V MCC 2B32 (2B32.lgc), 480 V MCC 2B42 (2B42.lgc), 480 V Bus 2B02 (2B02.lgc), 4 KV Bus 1A02 (1A02.lgc), and 13.8 KV Bus H01 (H01.lgc). These fault trees also link to their own respective support system fault trees. By Assumption 4.1, all of these fault tree models and their basic event data inputs are incorporated into this calculation by reference and are not evaluated further here.
- 6.2 From Assumption 4.3, the test and maintenance unavailability of the Water Treatment System is 0.01.
- 6.3 A human error probability for the operator failing to restore the Water Treatment System following a Safety Injection signal is 3.9E-03. This is from the HRA report prepared by SCIENTECH for the Auxiliary Feedwater orifice issue response.
- 6.4 From Assumption 4.5, a human error probability for failure to maintain CST level using the Water Treatment System for events where an SI signal was not received is 1.0E-03.
- 6.5 The following generic industry component failure probabilities are taken from Table 8 of Reference 5.2:
 

Electrical Panel Loss of Power	1.00E-07/hr
Electrical Bus Loss of Power	1.00E-07/hr
Electric Power Transformer Fault	8.10E-07/hr
Air Operated Valve Failure to Open	1.74E-03
Check Valve Failure to Open	5.00E-05
Check Valve Failure to Close	1.00E-03
Motor Driven Pump Failure to Start	1.40E-03
Motor Driven Pump Failure to Run	3.40E-05/hr
- 6.6 The following plant specific component failure probabilities are taken from Table 5 in Reference 5.2:
 

Service Water MOV failure to open	2.00E-03
-----------------------------------	----------
- 6.7 The following generic common mode failure terms were extracted from Table 5-11 in Reference 5.9:
 

Demand Failures:	
2 / 2 components -	4.70E-02
3 / 3 components -	7.19E-02
Run Failures:	
2 / 2 components -	2.35E-02
3 / 3 components -	3.73E-02

## 7.0 CALCULATION

As described in the Methodology section, this calculation is divided into two distinct parts: to determine the hardware failure probability for the system and to link in the support system failures, human error probabilities, and test and maintenance unavailability.

The hardware failure probability for the Water Treatment System was determined using a table of component failure modes and probabilities that were combined in a manner to account for parallel flow paths. The table is shown in Attachment B. Some of the component failure probability values in the table are derived from those in Input 6.5 and these are calculated below. The component failure probabilities that are taken directly from those in Input 6.5 are not repeated below.

Reverse Osmosis Units -	<p>This failure probability is a combination of pump failure to start and failure to run for 24 hours for the booster pump and high pressure pump in each of the three units.</p> $2*(1.40E-03 + 3.40E-05/hr*24hrs) = 4.43E-03$
WT-702A, B, and C Check Valves	<p>These Clearwell Pump discharge check valves may need to cycle open or closed if pumps are swapped during the 24 hour run, so the failure probabilities for one cycle open and closed were used.</p> $(1.00E-03 + 5.00E-05) = 1.05E-03$
P95A, B, and C Clearwell Pumps -	<p>This failure probability is a combination of pump failure to start and failure to run for 24 hours.</p> $(1.40E-03 + 3.40E-05/hr*24hrs) = 2.22E-03$
P56A, B, and C Deaerator Vacuum Pumps -	<p>This failure probability is a combination of pump failure to start and failure to run for 24 hours.</p> $(1.40E-03 + 3.40E-05/hr*24hrs) = 2.22E-03$
P44A, B, and C Deaerator Water Pumps -	<p>This failure probability is a combination of pump failure to start and failure to run for 24 hours.</p> $(1.40E-03 + 3.40E-05/hr*24hrs) = 2.22E-03$
WT-709A, B, and C Check Valves	<p>These Deaerator outlet check valves may need to cycle open or closed if pumps are swapped during the 24 hour run, so the failure probabilities for one cycle open and closed were used.</p> $(1.00E-03 + 5.00E-05) = 1.05E-03$

The "Combined Probability" column in Attachment B takes into account the multiple failures that need to occur in redundant components for a failure in the flowpath to occur. For sections of the system with two redundant flowpaths, the individual component probabilities in each train are first summed and then squared to arrive at the combined probability for that section. For sections of the system with three redundant flowpaths, the individual component probabilities in each train are first summed and then cubed to arrive at the combined probability for that section.

### Double Failures:

Mixed Bed Valves	$(1.74E-03 + 1.74E-03)^2 = 1.21E-05$
Product Transfer Pumps	$(1.05E-03 + 2.22E-03)^2 = 1.07E-05$

Triple Failures:

Cation Valves	$(1.74E-03 + 1.74E-03)^3 = 4.21E-08$
Reverse Osmosis Units	$(4.43E-03)^3 = 8.71E-08$
Clearwell Pumps	$(1.05E-03 + 2.22E-03)^3 = 3.48E-08$
Water Softener Valves	$(1.74E-03 + 1.74E-03)^3 = 4.21E-08$
Gravity Filter Valves	$(1.74E-03 + 1.74E-03)^3 = 4.21E-08$
Deaerator Vacuum Pumps	$(2.22E-03)^3 = 1.09E-08$
Deaerator Water Pumps	$(1.05E-03 + 2.22E-03)^3 = 3.48E-08$
Anion Valves	$(1.74E-03 + 1.74E-03)^3 = 4.21E-08$

The common mode portion of the failure calculation is shown below.

Double Failures:

Mixed Bed Valves	$(1.74E-03 * 4.70E-02) * 4 \text{ combinations}$ $= 3.27E-04$
Product Transfer Pumps	$(1.05E-03 * 4.70E-02) + (1.40E-03 * 4.70E-02) + (8.16E-04 * 2.35E-02)$ $= 1.34E-04$

Triple Failures:

Cation Valves	$(1.74E-03 * 7.19E-02) * 8 \text{ combinations}$ $= 1.00E-03$
Reverse Osmosis Units	$[(1.40E-03 * 7.19E-02) + (8.16E-04 * 3.73E-02)] * 8 \text{ combinations}$ $= 1.05E-03$
Clearwell Pumps	$(1.05E-03 * 7.19E-02) + (1.40E-03 * 7.19E-02) + (8.16E-04 * 3.73E-02)$ $= 2.07E-04$
Water Softener Valves	$(1.74E-03 * 7.19E-02) * 8 \text{ combinations}$ $= 1.00E-03$
Gravity Filter Valves	$(1.74E-03 * 7.19E-02) * 8 \text{ combinations}$ $= 1.00E-03$
Deaerator Vacuum Pumps	$(1.40E-03 * 7.19E-02) + (8.16E-04 * 3.73E-02)$ $= 1.31E-04$
Deaerator Water Pumps	$(1.05E-03 * 7.19E-02) + (1.40E-03 * 7.19E-02) + (8.16E-04 * 3.73E-02)$ $= 2.07E-04$
Anion Valves	$(1.74E-03 * 7.19E-02) * 8 \text{ combinations}$ $= 1.00E-03$

The single, double, and triple failures were added together with the common mode failures for each section to arrive at the total failure probability for the system. As shown on the table in Attachment B, the Water Treatment hardware failure probability is  $8.56E-03$ .

The next step is to quantify the fault tree for Water Treatment using the above derived value for hardware failures and other inputs and linked support systems. The fault tree, shown in Attachment A, has two top gates. The first, on page 1 at location 0-0, provides the failure probability for Water Treatment when an SI initiation signal caused isolation of Service Water from Water Treatment. The second top gate, on page 2 at location 0-0, is for continued Water Treatment System operation following a plant trip where an SI did not occur. A generic initiating event with a frequency value of 1.0 is ANDed in just below each of these two top gates. The reason for this generic initiator is to eliminate cutsets in the power supply train that only occur for LOOP or SBO events. These cutsets, which involve failures of diesel generators or the gas turbine, are not valid for this quantification because offsite power must be available or be restored for Water Treatment to function. For the SLOOP and DLOOP events, the restoration of offsite power is dealt with outside of this calculation.

The two top gates of the Water Treatment fault tree were quantified with a cutoff value of  $1.0E-10$ . A listing of the top 100 core failure cutsets are listed in Appendix C for cases where a Safety Injection signal causes isolation of the Service Water supply, and in Appendix D for cases where there is no SI signal received.


## 8.0 RESULTS AND CONCLUSIONS

Quantification of the fault tree model for the Water Treatment System provided the following probability results for system reliability and unavailability:


5.12E-02	for events where an SI signal occurs
2.67E-02	for events where an SI signal does not occur

Note that these probability results do not include the probability of restoring offsite power and the human error probability to re-start Water Treatment after a loss of offsite power event. These will need to be factored in to the above results for the SLOOP and DLOOP events for a complete probability that the Water Treatment System is unavailable following these events.


### APPENDIX A Water Treatment System Fault Tree

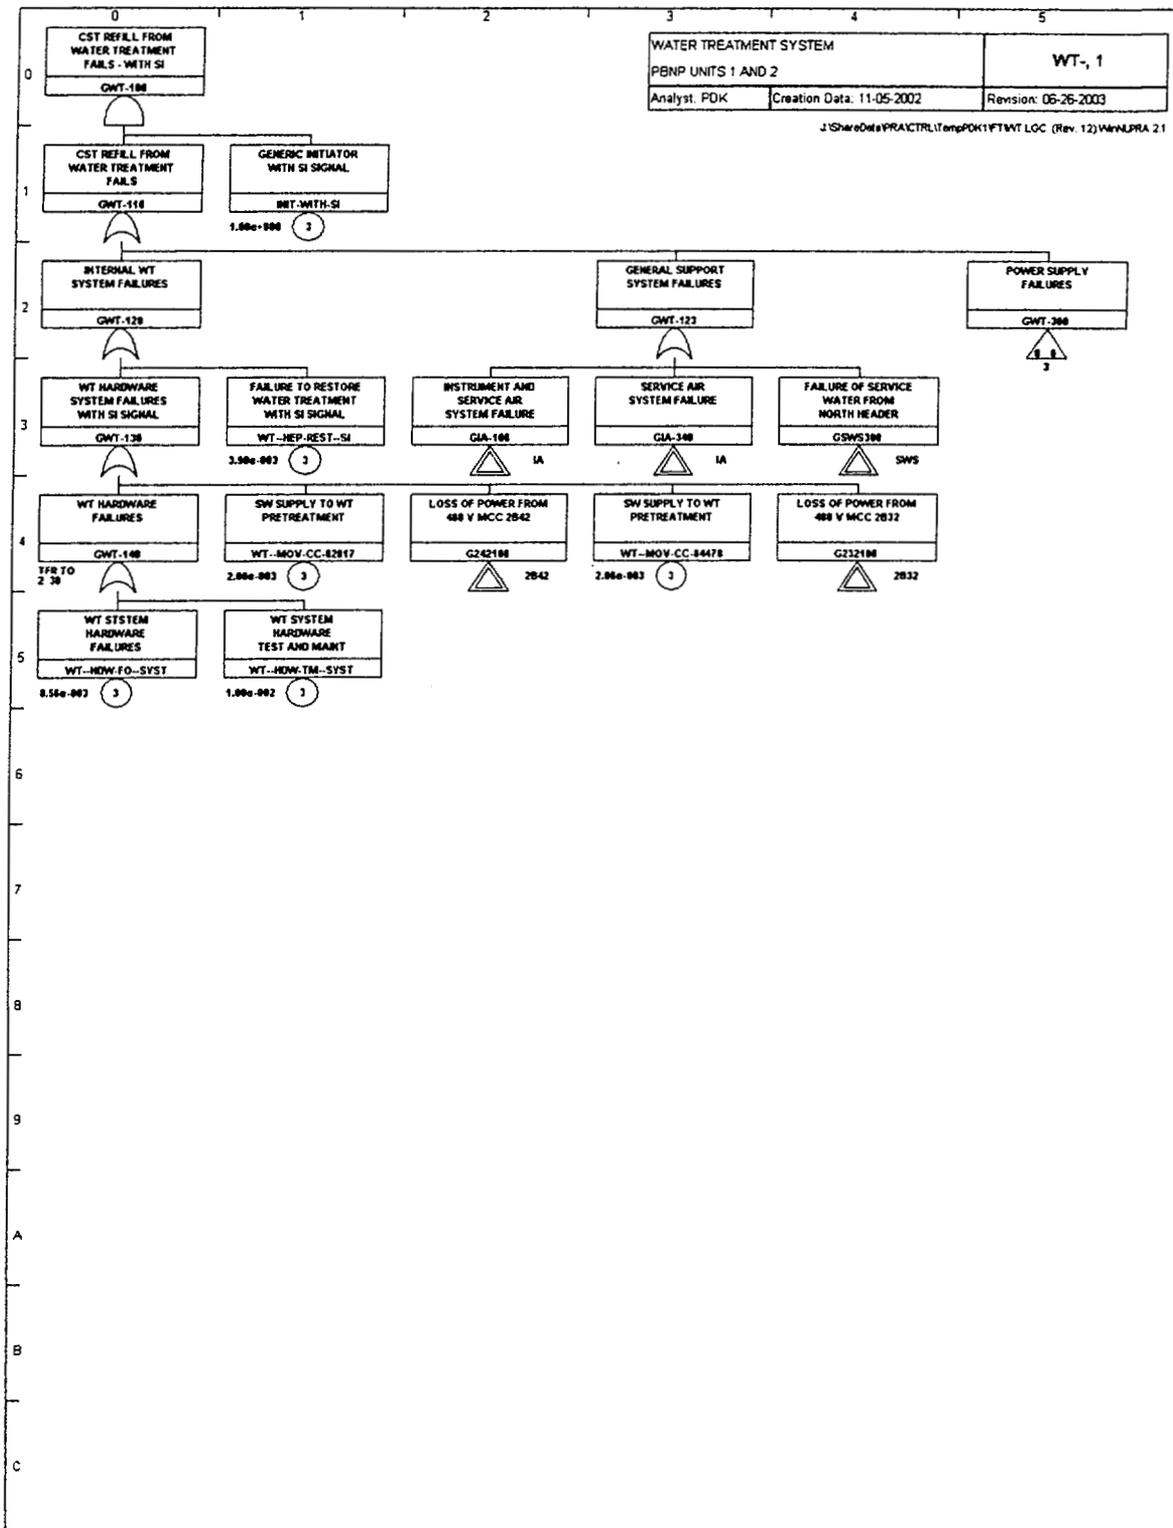

### APPENDIX A Water Treatment System Fault Tree

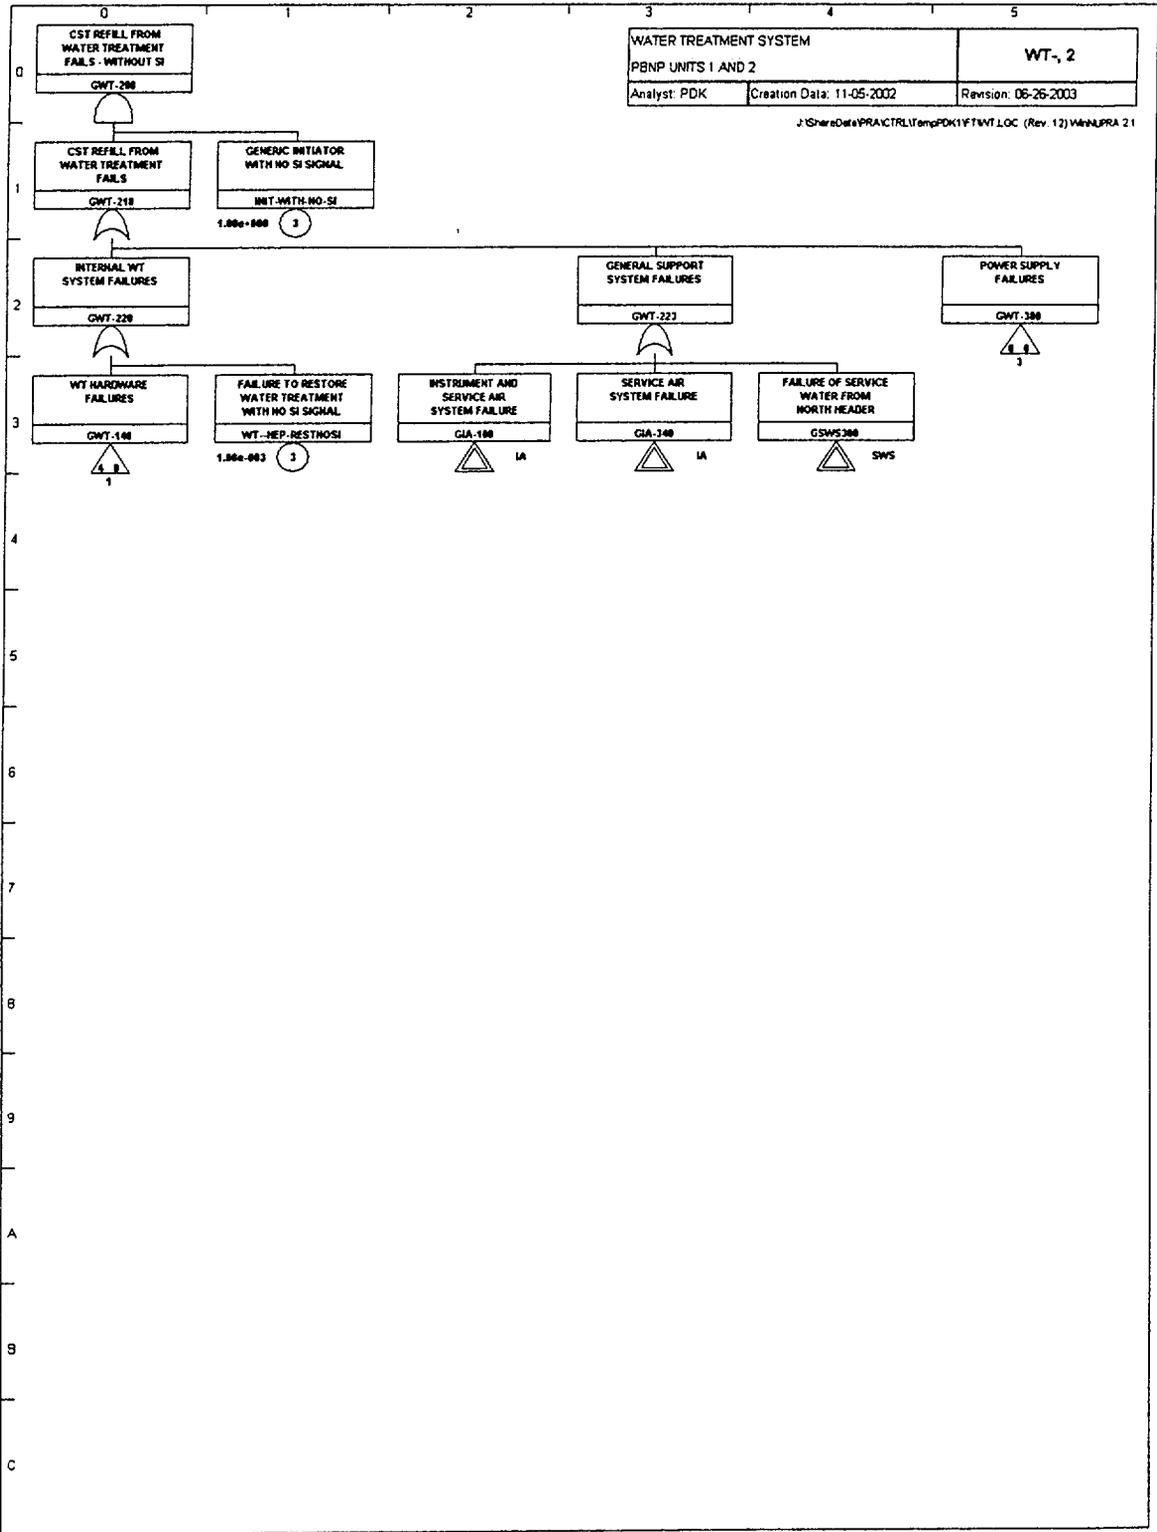

### APPENDIX A Water Treatment System Fault Tree

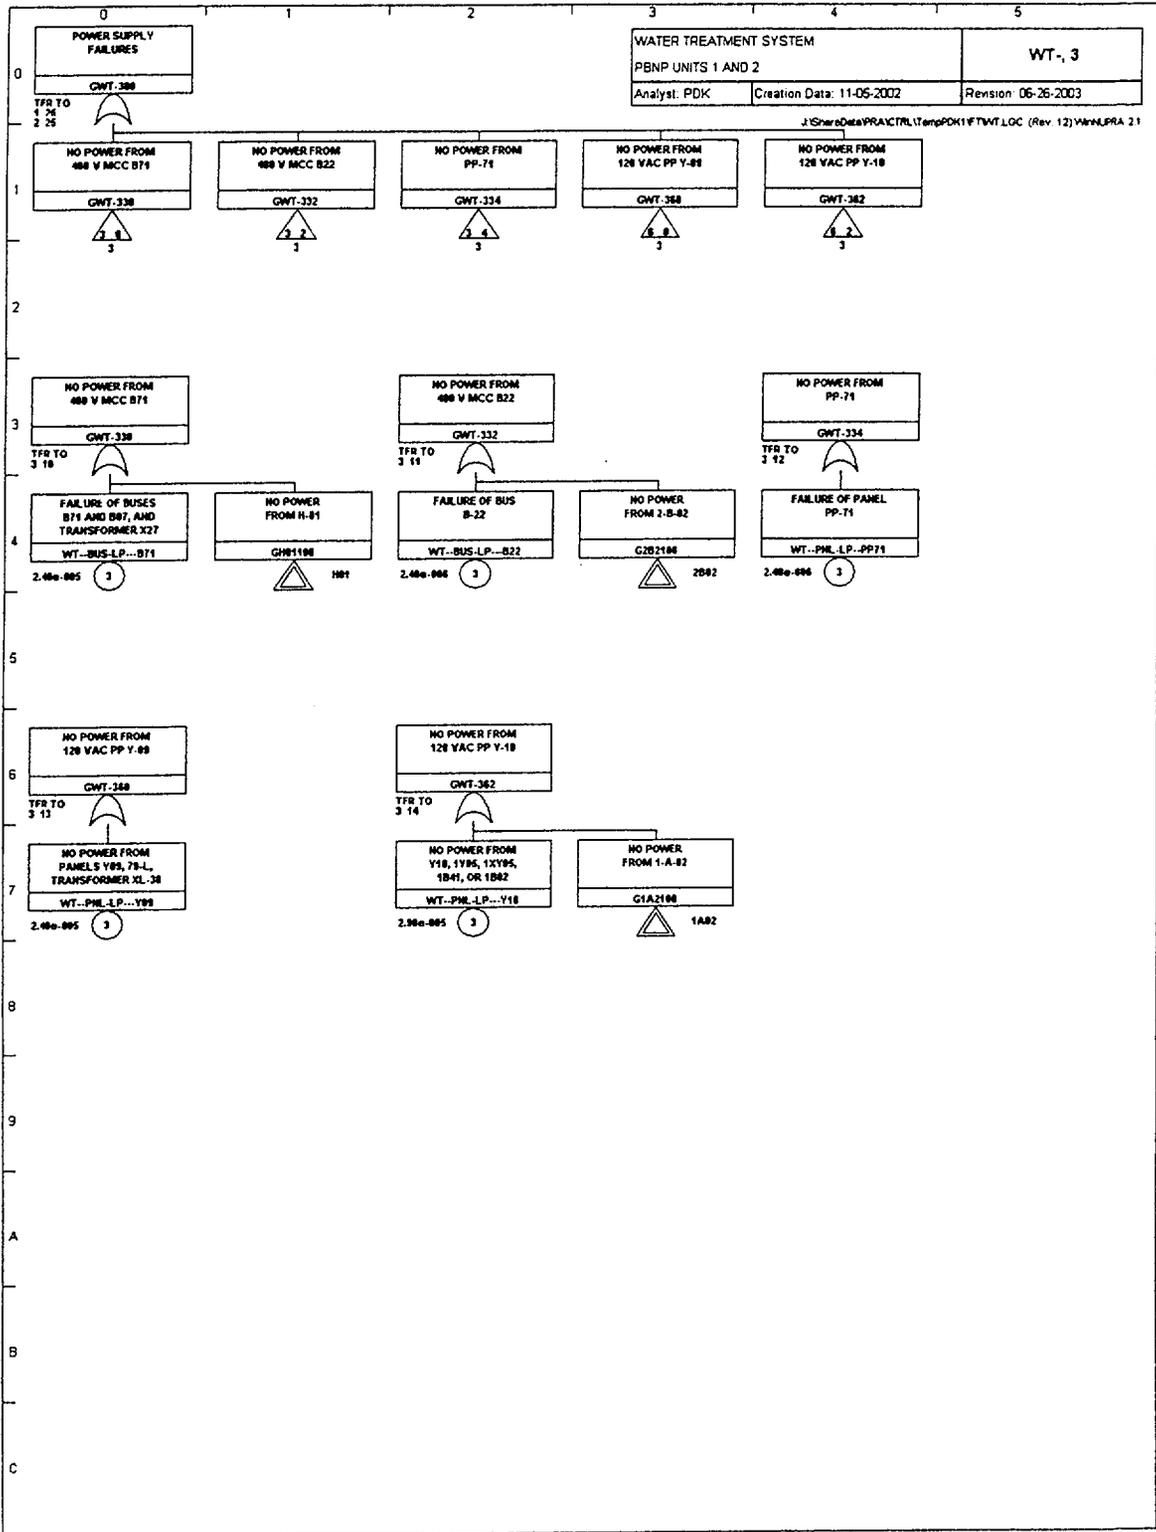

**APPENDIX B**  
**Water Treatment System Equipment Failure Modes Quantification**

Component	Dependency	Valve Position/Component Notes	Mode	Component Prob.	Combined Prob.
<b>Single Failures:</b>					
WT-9058 Mixed Effluent Control AOV	IA	NO, trips on no P-44 A, B or C	CC	1.74E-03	1.74E-03
WT-9027 Clarifier Tank Inlet Control AOV	IA	NO	CC	1.74E-03	1.74E-03
<b>Double Failures:</b>					
WT 9273 A, B mixed bed Inlet AOV	Y-10 C-212 PLC	Normally open when online. Fail closed on loss of power.	CC	1.74E-03	
U-8 A, B Mixed Bed	Y-10 C-212 PLC				
WT 9288 A, B mixed bed Outlet AOV	Y-10 C-212 PLC	NO, trips on high cond.		1.74E-03	1.21E-05
Common Mode					
WT 677 A, B Product Transfer Pump Check	Passive	Discharge check valve. Opens with transfer pump flow. Normally operating. System bypass fails open.	CC	1.05E-03	
P-239 A, B Product Transfer Pump	PP-71				
Common Mode				2.22E-03	1.07E-05
Common Mode					1.34E-04
<b>Triple Failures:</b>					
WT 9240 A, B, C cation Inlet AOV	Y-10 C-212 PLC	Normally open when online. Fail closed on loss of power.	CC	1.74E-03	
U-10 A, B, C Cation Bed	Y-10 C-212 PLC				
WT 9249 A, B, C cation Outlet AOV	Y-10 C-212 PLC	Normally open when online. Fail closed on loss of power.	CC	1.74E-03	4.21E-08
Common Mode					

APPENDIX B  
Water Treatment System Equipment Failure Modes Quantification

Component	Dependency	Valve Position/Component Notes	Mode	Component Prob.	Combined Prob.
Reverse Osmosis Units	PP-71	Nomally operating based on flow demand. Isolation valves fail shut on loss of power. System bypass fails open.		4.43E-03	8.71E-08
	Common Mode				1.05E-03
WT 702 A, B, C Clearwell Pump Check	Passive	Discharge check valve. Opens with clearwell pump flow.	CC	1.05E-03	
P-95 A, B, & C Clearwell pumps	B-71	NR, trip on low clearwell level		2.22E-03	3.48E-08
	Common Mode				2.07E-04
WT 9228 A, B, C Water Softener Inlet AOV	Y09 C-210 PLC	Nomally open if demin is online. Fails shut on loss of power.	CC	1.74E-03	
U-13 A, B, C Water Softener	Y09 C-210 PLC	Online as selected by operator.			
WT 9237 A, B, C Water Softener Outlet AOV	Y09 C-210 PLC	Nomally open if demin is online. Fails shut on loss of power.	CC	1.74E-03	4.21E-08
	Common Mode				1.00E-03
WT 9035 A, B, C Filter Inlet AOV	IA, C-210	Closed With Pretreatment filter trailer in service.		1.74E-03	
F-68 A, B, C Gravity Filter	C-210	Offline With Pretreatment filter trailer in service.			
WT 9034 A, B, C Filter Outlet AOV	IA, C-210	Closed With Pretreatment filter trailer in service.		1.74E-03	4.21E-08
	Common Mode				1.00E-03

**APPENDIX B**  
**Water Treatment System Equipment Failure Modes Quantification**

Component	Dependency	Valve Position/Component Notes	Mode	Component Prob.	Combined Prob.
P-56 A, B & C Dearator Vacuum Pumps	B-22	One pump normally inservice. Loss of pump will cause low vacuum alarm.		2.22E-03	1.09E-08
Common Mode					1.31E-04
P-44 A, B & C Dearator Water Pumps	B-22	One or two NR, trip on dearator lvl or anion OOS		2.22E-03	
WT 709 A, B, C Dearator Outlet Check	Passive	Discharge check valve. Opens with deaerator pump flow.	CC	1.05E-03	3.48E-08
Common Mode					2.07E-04
WT 9254 A, B, C Anion Inlet AOV	Y-10 C-212 PLC	Normally open when online. Fail closed on loss of power.	CC	1.74E-03	
U-14 A, B, C Anion Bed	Y-10 C-212 PLC	Online as selected by operator.			
WT 9269 A, B, C Anion Outlet AOV	Y-10 C-212 PLC	Normally open when online. Fail closed on loss of power.	CC	1.74E-03	4.21E-08
Common Mode					1.00E-03
<b>TOTALSYSTEM FAILURE PROBABILITY</b>					<b>8.56E-03</b>

APPENDIX C  
Water Treatment System Fault Tree Quantification – With SI Signal  
Top 100 Cutsets

=====  
WinNUPRA 2.1 Licensed to: PT-BEACH  
WTSI.EQP File created: 06-26-2003  
=====

Equation File = WTSI.EQN  
Basic Event Data file referenced = WT.BED  
Number of cut sets in equation = 500  
Top event unavailability (rare event) = 5.126E-002

1	1.0000E-002	INIT-WITH-SI	WT--HDW-TM--SYST	
2	8.5600E-003	INIT-WITH-SI	WT--HDW-FO--SYST	
3	6.9800E-003	480-BS--TM--2B04	INIT-WITH-SI	
4	6.9800E-003	480-BS--TM--2B03	INIT-WITH-SI	
5	4.4756E-003	INIT-WITH-SI	SA--K---TM-0003A	SA--K---TM-0003B
6	3.9000E-003	INIT-WITH-SI	WT--HEP-REST--SI	
7	2.2000E-003	480-MCC-TM--2B32	INIT-WITH-SI	
8	2.2000E-003	480-MCC-TM--2B42	INIT-WITH-SI	
9	2.0000E-003	INIT-WITH-SI	WT--MOV-CC-02817	
10	2.0000E-003	INIT-WITH-SI	WT--MOV-CC-04478	
11	5.7274E-004	416-BKR-001A5255	INIT-WITH-SI	
12	3.0000E-004	ESF-REL-FT-86B2B	INIT-WITH-SI	
13	1.8457E-004	138-HEP-STARTG05	345-GRD-LP--LOSP	INIT-WITH-SI
14	1.3848E-004	INIT-WITH-SI	SA--K---FS-0003B	SA--K---TM-0003A
15	1.3721E-004	INIT-WITH-SI	SA--K---TM-0003A	SW--SOV-CC-2832B
16	9.8191E-005	INIT-WITH-SI	SA--K---FR-0003A	SA--K---TM-0003B
17	9.8191E-005	INIT-WITH-SI	SA--K---FR-0003B	SA--K---TM-0003A
18	7.8940E-005	138-GT--FS---G05	345-GRD-LP--LOSP	INIT-WITH-SI
19	7.3545E-005	138-GT--TM---G05	345-GRD-LP--LOSP	INIT-WITH-SI
20	2.9000E-005	INIT-WITH-SI	WT--PNL-LP---Y10	
21	2.4000E-005	INIT-WITH-SI	WT--PNL-LP---Y09	
22	2.4000E-005	INIT-WITH-SI	WT--BUS-LP---B71	
23	2.3419E-005	138-GT--FR---G05	345-GRD-LP--LOSP	INIT-WITH-SI
24	2.2100E-005	416-BKR-CM003755	INIT-WITH-SI	
25	1.4100E-005	ESF-REL-CM-86GX1	INIT-WITH-SI	
26	7.6109E-006	480-BKR-CO25235C	INIT-WITH-SI	
27	7.6109E-006	480-BKR-CO25231B	INIT-WITH-SI	
28	7.6109E-006	416-BKR-CO1A5255	INIT-WITH-SI	
29	6.6100E-006	416-BS--TM--2A02	480-HEP-2B042B02	INIT-WITH-SI
30	6.5169E-006	INIT-WITH-SI	SA--F---PG-0035B	SA--K---TM-0003A
31	6.5169E-006	INIT-WITH-SI	SA--F---PG-0035A	SA--K---TM-0003B
32	5.9631E-006	125-HEP-EOP10-08	345-GRD-LP--LOSP	INIT-WITH-SI
33	5.1000E-006	INIT-WITH-SI	SW--MDP-CM-RPUMP	
34	3.7858E-006	416-BS--TM--2A02	480-BKR-0025226C	INIT-WITH-SI
35	3.3450E-006	INIT-WITH-SI	SA--K---TM-0003A	SW--CKV-CC-HX50B
36	3.1078E-006	125-FU--SO2705F2	INIT-WITH-SI	
37	3.1078E-006	125-FU--SO2703F2	INIT-WITH-SI	
38	3.1078E-006	125-FU--SO2703F1	INIT-WITH-SI	
39	3.1078E-006	125-FU--SO0208F1	INIT-WITH-SI	
40	3.1078E-006	125-FU--SO0208F2	INIT-WITH-SI	
41	3.1078E-006	125-FU--SO2705F1	INIT-WITH-SI	
42	3.0382E-006	INIT-WITH-SI	SA--K---FR-0003A	SA--K---FS-0003B
43	3.0102E-006	INIT-WITH-SI	SA--K---FR-0003A	SW--SOV-CC-2832B
44	2.6800E-006	INIT-WITH-SI	SA--K---TM-0003A	SW--SOV-OC-2832B
45	2.6800E-006	INIT-WITH-SI	SA--K---TM-0003B	SW--SOV-OC-2832A
46	2.5840E-006	INIT-WITH-SI	SA--K---TM-0003A	SW--AOV-OC-2836B
47	2.5840E-006	INIT-WITH-SI	SA--K---TM-0003B	SW--AOV-OC-2836A
48	2.4000E-006	INIT-WITH-SI	WT--BUS-LP---B22	
49	2.4000E-006	INIT-WITH-SI	WT--PNL-LP--PP71	
50	2.4000E-006	125-BS--LP---D13	INIT-WITH-SI	

## APPENDIX C

Water Treatment System Fault Tree Quantification – With SI Signal  
Top 100 Cutsets

51	2.4000E-006	480-MCC-LP--2B32	INIT-WITH-SI		
52	2.4000E-006	480-BS--LP--2B03	INIT-WITH-SI		
53	2.4000E-006	138-BS--LP---H01	INIT-WITH-SI		
54	2.4000E-006	125-BS--LP---D02	INIT-WITH-SI		
55	2.4000E-006	480-BS--LP--2B02	INIT-WITH-SI		
56	2.4000E-006	480-BS--LP--2B04	INIT-WITH-SI		
57	2.4000E-006	416-BS--LP--1A04	INIT-WITH-SI		
58	2.4000E-006	480-MCC-LP--2B42	INIT-WITH-SI		
59	2.4000E-006	416-BS--LP--1A02	INIT-WITH-SI		
60	2.1542E-006	INIT-WITH-SI	SA--K---FR-0003A	SA--K---FR-0003B	
61	1.6056E-006	INIT-WITH-SI	SA--HX--IL-0050B	SA--K---TM-0003A	
62	1.6056E-006	INIT-WITH-SI	SA--HX--IL-0050A	SA--K---TM-0003B	
63	1.2989E-006	480-X---LP-2XY06	INIT-WITH-SI	SA--K---TM-0003A	
64	8.1318E-007	138-BKR-OOH52G05	345-GRD-LP--LOSP	INIT-WITH-SI	
65	8.1318E-007	138-BKR-OOH52-10	345-GRD-LP--LOSP	INIT-WITH-SI	
66	5.7274E-007	416-BKR-OO2A5248	480-HEP-2B042B02	INIT-WITH-SI	
67	5.0917E-007	480-BKR-CO-429DR	INIT-WITH-SI	SA--K---TM-0003A	
68	5.0000E-007	ESF-REL-SA-86A02	INIT-WITH-SI		
69	5.0000E-007	ESF-REL-SA-25A04	INIT-WITH-SI		
70	5.0000E-007	ESF-REL-SA-2SI12	INIT-WITH-SI		
71	5.0000E-007	ESF-REL-SA-2SI22	INIT-WITH-SI		
72	4.7269E-007	INIT-WITH-SI	SW--CKV-OO---32C	SW--MDP-FR---32C	
73	4.7269E-007	INIT-WITH-SI	SW--CKV-OO---32F	SW--MDP-FR---32F	
74	4.7269E-007	INIT-WITH-SI	SW--CKV-OO---32A	SW--MDP-FR---32A	
75	3.2804E-007	416-BKR-OO2A5248	480-BKR-OO25226C	INIT-WITH-SI	
76	2.2054E-007	125-HEP-D305-D02	125-INV-LP--0D08	INIT-WITH-SI	
77	2.0164E-007	INIT-WITH-SI	SA--F---PG-0035A	SA--K---FS-0003B	
78	1.9978E-007	INIT-WITH-SI	SA--F---PG-0035A	SW--SOV-CC-2832B	
79	1.7400E-007	INIT-WITH-SI	SW--CKV-CO---32D	SW--MDP-TM---32D	
80	1.7400E-007	INIT-WITH-SI	SW--CKV-CO---32E	SW--MDP-TM---32E	
81	1.7400E-007	INIT-WITH-SI	SW--CKV-CO---32B	SW--MDP-TM---32B	
82	1.6056E-007	480-BS--LP--1B04	INIT-WITH-SI	SA--K---TM-0003B	
83	1.6056E-007	120-BS--LP-02Y06	INIT-WITH-SI	SA--K---TM-0003A	
84	1.4297E-007	INIT-WITH-SI	SA--F---PG-0035B	SA--K---FR-0003A	
85	1.4297E-007	INIT-WITH-SI	SA--F---PG-0035A	SA--K---FR-0003B	
86	1.2949E-007	1251FU--SO0203F2	INIT-WITH-SI		
87	1.2949E-007	1251FU--SO0203F1	INIT-WITH-SI		
88	1.2949E-007	1251FU--SO0208F1	INIT-WITH-SI		
89	1.2949E-007	1251FU--SO0208F2	INIT-WITH-SI		
90	1.0877E-007	125-FU--SO3013F2	125-HEP-D06--D02	INIT-WITH-SI	
91	1.0877E-007	125-FU--SO3013F1	125-HEP-D06--D02	INIT-WITH-SI	
92	1.0000E-007	1251BS--LP---D13	INIT-WITH-SI		
93	1.0000E-007	1251BS--LP---D27	INIT-WITH-SI		
94	1.0000E-007	1251BS--LP---D02	INIT-WITH-SI		
95	9.0000E-008	ESF-REL-FT-86TG1	ESF-REL-FT-86X01	INIT-WITH-SI	
96	8.8342E-008	125-HEP--D50-D53	138-HEP-STARTG05	138-X---LP--1X03	
		INIT-WITH-SI			
97	8.2924E-008	INIT-WITH-SI	SA--K---FS-0003B	SW--SOV-OC-2832A	
98	8.2160E-008	INIT-WITH-SI	SW--SOV-CC-2832B	SW--SOV-OC-2832A	
99	7.9952E-008	INIT-WITH-SI	SA--K---FS-0003B	SW--AOV-OC-2836A	
100	7.9215E-008	IA--AOV-OC-00187	IA--SOV-CC-3000S	INIT-WITH-SI	

APPENDIX D  
 Water Treatment System Fault Tree Quantification – Without SI Signal  
 Top 100 Cutsets

=====  
 WinNUPRA 2.1 Licensed to: PT-BEACH  
 WTNO.EQP File created: 06-26-2003  
 =====

Equation File = WTNO.EQN  
 Basic Event Data file referenced = WT.BED  
 Number of cut sets in equation = 737  
 Top event unavailability (rare event) = 2.666E-002

1	1.0000E-002	INIT-WITH-NO-SI	WT--HDW-TM--SYST	
2	8.5600E-003	INIT-WITH-NO-SI	WT--HDW-FO--SYST	
3	4.4756E-003	INIT-WITH-NO-SI	SA--K---TM-0003A	SA--K---TM-0003B
4	1.0000E-003	INIT-WITH-NO-SI	WT--HEP-RESTNOSI	
5	5.7274E-004	416-BKR-OO1A5255	INIT-WITH-NO-SI	
6	4.6696E-004	480-BS--TM--2B04	INIT-WITH-NO-SI	SA--K---TM-0003A
7	3.0000E-004	ESF-REL-FT-86B2B	INIT-WITH-NO-SI	
8	1.8457E-004	138-HEP-STARTG05	345-GRD-LP--LOSP	INIT-WITH-NO-SI
9	1.4718E-004	480-MCC-TM--2B42	INIT-WITH-NO-SI	SA--K---TM-0003A
10	1.3848E-004	INIT-WITH-NO-SI	SA--K---FS-0003B	SA--K---TM-0003A
11	1.3721E-004	INIT-WITH-NO-SI	SA--K---TM-0003A	SW--SOV-CC-2832B
12	9.8191E-005	INIT-WITH-NO-SI	SA--K---FR-0003B	SA--K---TM-0003A
13	9.8191E-005	INIT-WITH-NO-SI	SA--K---FR-0003A	SA--K---TM-0003B
14	7.8940E-005	138-GT--FS---G05	345-GRD-LP--LOSP	INIT-WITH-NO-SI
15	7.3545E-005	138-GT--TM---G05	345-GRD-LP--LOSP	INIT-WITH-NO-SI
16	4.6138E-005	416-BS--TM--2A02	480-BS--TM--2B04	INIT-WITH-NO-SI
17	2.9000E-005	INIT-WITH-NO-SI	WT--PNL-LP---Y10	
18	2.4000E-005	INIT-WITH-NO-SI	WT--PNL-LP---Y09	
19	2.4000E-005	INIT-WITH-NO-SI	WT--BUS-LP---B71	
20	2.3419E-005	138-GT--FR---G05	345-GRD-LP--LOSP	INIT-WITH-NO-SI
21	2.2100E-005	416-BKR-CMOO3755	INIT-WITH-NO-SI	
22	1.4100E-005	ESF-REL-CM-86GX1	INIT-WITH-NO-SI	
23	1.0245E-005	480-BS--TM--2B04	INIT-WITH-NO-SI	SA--K---FR-0003A
24	7.6109E-006	416-BKR-CO1A5255	INIT-WITH-NO-SI	
25	6.9800E-006	480-BS--TM--2B03	INIT-WITH-NO-SI	SW--CKV-OO---32F
26	6.6100E-006	416-BS--TM--2A02	480-HEP-2B042B02	INIT-WITH-NO-SI
27	6.5169E-006	INIT-WITH-NO-SI	SA--F---PG-0035A	SA--K---TM-0003B
28	6.5169E-006	INIT-WITH-NO-SI	SA--F---PG-0035B	SA--K---TM-0003A
29	5.9631E-006	125-HEP-EOP10-08	345-GRD-LP--LOSP	INIT-WITH-NO-SI
30	5.1000E-006	INIT-WITH-NO-SI	SW--MDP-CM-RPUMP	
31	3.9978E-006	416-BKR-OO2A5248	480-BS--TM--2B04	INIT-WITH-NO-SI
32	3.7858E-006	416-BS--TM--2A02	480-BKR-OO25226C	INIT-WITH-NO-SI
33	3.3450E-006	INIT-WITH-NO-SI	SA--K---TM-0003A	SW--CKV-CC-HX50B
34	3.2290E-006	480-MCC-TM--2B42	INIT-WITH-NO-SI	SA--K---FR-0003A
35	3.1078E-006	125-FU--SO2703F2	INIT-WITH-NO-SI	
36	3.1078E-006	125-FU--SO2705F2	INIT-WITH-NO-SI	
37	3.1078E-006	125-FU--SO2703F1	INIT-WITH-NO-SI	
38	3.1078E-006	125-FU--SO0208F1	INIT-WITH-NO-SI	
39	3.1078E-006	125-FU--SO0208F2	INIT-WITH-NO-SI	
40	3.1078E-006	125-FU--SO2705F1	INIT-WITH-NO-SI	
41	3.0382E-006	INIT-WITH-NO-SI	SA--K---FR-0003A	SA--K---FS-0003B
42	3.0102E-006	INIT-WITH-NO-SI	SA--K---FR-0003A	SW--SOV-CC-2832B
43	2.6800E-006	INIT-WITH-NO-SI	SA--K---TM-0003B	SW--SOV-OC-2832A
44	2.6800E-006	INIT-WITH-NO-SI	SA--K---TM-0003A	SW--SOV-OC-2832B
45	2.5840E-006	INIT-WITH-NO-SI	SA--K---TM-0003B	SW--AOV-OC-2836A
46	2.5840E-006	INIT-WITH-NO-SI	SA--K---TM-0003A	SW--AOV-OC-2836B
47	2.4000E-006	INIT-WITH-NO-SI	WT--BUS-LP---B22	
48	2.4000E-006	INIT-WITH-NO-SI	WT--PNL-LP--PP71	
49	2.4000E-006	138-BS--LP---H01	INIT-WITH-NO-SI	
50	2.4000E-006	480-BS--LP--2B02	INIT-WITH-NO-SI	

APPENDIX D  
Water Treatment System Fault Tree Quantification – Without SI Signal  
Top 100 Cutsets

51	2.4000E-006	416-BS--LP--1A02	INIT-WITH-NO-SI	
52	2.4000E-006	416-BS--LP--1A04	INIT-WITH-NO-SI	
53	2.4000E-006	125-BS--LP---D02	INIT-WITH-NO-SI	
54	2.4000E-006	125-BS--LP---D13	INIT-WITH-NO-SI	
55	2.1542E-006	INIT-WITH-NO-SI	SA--K---FR-0003A	SA--K---FR-0003B
56	1.6056E-006	INIT-WITH-NO-SI	SA--HX--IL-0050B	SA--K---TM-0003A
57	1.6056E-006	INIT-WITH-NO-SI	SA--HX--IL-0050A	SA--K---TM-0003B
58	1.2989E-006	480-X---LP-2XY06	INIT-WITH-NO-SI	SA--K---TM-0003A
59	8.1318E-007	138-BKR-OOH52-10	345-GRD-LP--LOSP	INIT-WITH-NO-SI
60	8.1318E-007	138-BKR-OOH52G05	345-GRD-LP--LOSP	INIT-WITH-NO-SI
61	6.7994E-007	480-BS--TM--2B04	INIT-WITH-NO-SI	SA--F---PG-0035A
62	5.7274E-007	416-BKR-OO2A5248	480-HEP-2B042B02	INIT-WITH-NO-SI
63	5.3746E-007	125-HEP-1B49D301	480-BS--TM--2B03	480-MCC-TM--2B49 INIT-WITH-NO-SI
64	5.0917E-007	480-BKR-CO-429DR	INIT-WITH-NO-SI	SA--K---TM-0003A
65	5.0917E-007	480-BKR-CO25231B	INIT-WITH-NO-SI	SA--K---TM-0003A
66	5.0000E-007	ESF-REL-SA-86A02	INIT-WITH-NO-SI	
67	5.0000E-007	ESF-REL-SA-25A04	INIT-WITH-NO-SI	
68	5.0000E-007	ESF-REL-SA-2SI22	INIT-WITH-NO-SI	
69	5.0000E-007	ESF-REL-SA-2SI12	INIT-WITH-NO-SI	
70	4.7269E-007	INIT-WITH-NO-SI	SW--CKV-OO---32F	SW--MDP-FR---32F
71	4.7269E-007	INIT-WITH-NO-SI	SW--CKV-OO---32A	SW--MDP-FR---32A
72	4.7269E-007	INIT-WITH-NO-SI	SW--CKV-OO---32C	SW--MDP-FR---32C
73	3.2804E-007	416-BKR-OO2A5248	480-BKR-OO25226C	INIT-WITH-NO-SI
74	2.7962E-007	480-BS--TM--2B04	INIT-WITH-NO-SI	SW--SOV-OC-2832A
75	2.6960E-007	480-BS--TM--2B04	INIT-WITH-NO-SI	SW--AOV-OC-2836A
76	2.2054E-007	125-HEP-D305-D02	125-INV-LP--0D08	INIT-WITH-NO-SI
77	2.1431E-007	480-MCC-TM--2B42	INIT-WITH-NO-SI	SA--F---PG-0035A
78	2.0164E-007	INIT-WITH-NO-SI	SA--F---PG-0035A	SA--K---FS-0003B
79	1.9978E-007	INIT-WITH-NO-SI	SA--F---PG-0035A	SW--SOV-CC-2832B
80	1.7400E-007	INIT-WITH-NO-SI	SW--CKV-CO---32E	SW--MDP-TM---32E
81	1.7400E-007	INIT-WITH-NO-SI	SW--CKV-CO---32D	SW--MDP-TM---32D
82	1.7400E-007	INIT-WITH-NO-SI	SW--CKV-CO---32B	SW--MDP-TM---32B
83	1.6752E-007	480-BS--TM--2B04	INIT-WITH-NO-SI	SA--HX--IL-0050A
84	1.6056E-007	480-BS--LP--1B04	INIT-WITH-NO-SI	SA--K---TM-0003B
85	1.6056E-007	120-BS--LP-02Y06	INIT-WITH-NO-SI	SA--K---TM-0003A
86	1.6056E-007	480-BS--LP--2B04	INIT-WITH-NO-SI	SA--K---TM-0003A
87	1.6056E-007	480-MCC-LP--2B42	INIT-WITH-NO-SI	SA--K---TM-0003A
88	1.5426E-007	416-BKR-CMOO4448	480-BS--TM--2B04	INIT-WITH-NO-SI
89	1.4297E-007	INIT-WITH-NO-SI	SA--F---PG-0035B	SA--K---FR-0003A
90	1.4297E-007	INIT-WITH-NO-SI	SA--F---PG-0035A	SA--K---FR-0003B
91	1.3552E-007	416-X---LP--2X12	480-BS--TM--2B04	INIT-WITH-NO-SI
92	1.2949E-007	1251FU--SO0208F2	INIT-WITH-NO-SI	
93	1.2949E-007	1251FU--SO0203F2	INIT-WITH-NO-SI	
94	1.2949E-007	1251FU--SO0203F1	INIT-WITH-NO-SI	
95	1.2949E-007	1251FU--SO0208F1	INIT-WITH-NO-SI	
96	1.0877E-007	125-FU--SO3013F1	125-HEP-D06--D02	INIT-WITH-NO-SI
97	1.0877E-007	125-FU--SO3013F2	125-HEP-D06--D02	INIT-WITH-NO-SI
98	1.0000E-007	1251BS--LP---D02	INIT-WITH-NO-SI	
99	1.0000E-007	1251BS--LP---D13	INIT-WITH-NO-SI	
100	1.0000E-007	1251BS--LP---D27	INIT-WITH-NO-SI	

APPENDIX E  
Water Treatment System Component Unavailability Events  
from System Engineer Events Log

Maintenance unavailability for the Water Treatment System is difficult to quantify from the usual plant record sources used for a PRA because it is a non-safety related, non-Maintenance Rule system. As was stated in Assumption 4.3, a maintenance unavailability value of 1.0E-02 was assumed for this calculation. System Engineer notes on individual occurrences were reviewed in order to provide additional justification that the assumption was valid. Relevant entries are reproduced in the table starting on the next page. These notes deal primarily with the reverse osmosis units which are serviced by the vendor. Plant records for maintenance on these units are spotty because of the vendor contract.

Plant work history records from CHAMPS on other components in the Water Treatment System from September 2000 through the present were also reviewed. The most frequently worked components in the main process stream appear to have been the Deaerator Water Pumps, 0-P-044A, B, and C, and the Deaerator Vacuum Pumps, 0-P-056A, B, and C, which together had 33 occurrences of work being performed ranging from oil changes to pump replacement. If 8 hours of unavailability per occurrence is assumed, this results in a maintenance unavailability for these components of:

$$(33 * 8 \text{ hours}) / (6 \text{ pumps} * 2.5 \text{ years} * 8760 \text{ hours/year}) = 2.01\text{E-}03 / \text{pump}$$

From the data in the table that follows, an unavailability per reverse osmosis unit can also be determined. Summing up the unavailability time for each of the three units and dividing by the 2.5 year time period provides the following results:

For U-17A      233.5 hours / (2.5 years \* 8760 hours/year) = 1.1E-02

For U-17B      148 hours / (2.5 years \* 8760 hours/year) = 6.8E-03

For U-17C      194 hours / (2.5 years \* 8760 hours/year) = 8.9E-03

Except for reverse osmosis unit U-17A, individual unavailability values for these components is less than the assumed system unavailability. Because these components are in parallel trains that provide redundancy, work on these individual components will not lead directly to system unavailability. Two occurrences of system unavailability due to maintenance on a single component were recorded for replacement of valves 0-WT-00101C and 0-WT-00301B. The estimated time to replace these valves also totaled much less than the assumed 1.0E-02 system unavailability. Therefore, the assumed value for system unavailability is sufficient to also account for component unavailability combined with random failures in the other trains.

APPENDIX E  
Water Treatment System Component Unavailability Events  
from System Engineer Events Log

Date/time	CHAMPS ID	Component	Event description.	Estimated Unavailable Hours	Unavailable Component
9/6/00 12:00	P-238A	Pump	Replaced the "A" RO unit's feed pump and motor. Work was done at about 1730.	5.5	U-17A
9/15/00 14:00	U-17C	RO	Replaced the membranes in the "C" RO unit due to low flow that was discovered on 9/8/00.	8	U-17C
9/25/00 6:25	P-236B	Pump	B RO unit chemical feed pump seized. Fixed the same day. Pump flow switch problem causing RO not to run due to interlock.	8	U-17B
10/8/00 8:29	U-17A	RO	"A" RO tripped on high pressure. RO unit taken offline until membrane is changed..	-	-
10/10/00 8:26	U-17A	RO	Changed out membranes in "A" RO skid.	48	U-17A
11/15/00 8:30	U-17B	RO Skid	Changed out membranes in "B" RO skid.	8	U-17B
11/28/00 10:00	P-237C	Pump	Replaced booster pump.	4	U-17C
12/8/00 8:48	P-237C	Pump	Replaced fuses for P-237C-M. Two fuses were blown with the left fuse still OK. Replaced all three fuses.	2	U-17C
1/12/01 9:00	P-238B	Pump	Operations noted that lower bearing on motor was very hot and you could smell smoke.	-	-
1/17/01 10:30	P-238B	Pump	Due to a hot lower bearing found on 1/12, we replaced the P-238B motor.	4	U-17B
2/6/01 22:55	P-237C	Pump	Booster pump failure. Replaced fuses.	2	U-17B
2/15/01 5:15	P-237C	Pump	Thermal overload tripped. Skid output only 85 gpm without booster pump. "C" skid set to Lag2.	-	-
2/19/01 14:00	P-237C	Pump	Replaced Fuse Block and fuses. Motor trip may have been in intermediate position. Pump back in service.	4	U-17C
2/25/01 9:44	P-238B	Pump	Pump tripped on low suction pressure. No fuse or overload problems. Filters may have been changed since trip.	-	-
2/26/01 8:25	P-238B	Pump	Checked pump trip problem. Found that WT-09148, pump suction AOV, wasn't opening.	-	-
2/27/01 14:35	P-238B	Pump	Found bad solenoid coil on WT-9148B. Looks like the water that ran on the solenoid from the leak on WT-659B may have caused it.	72	U-17B
3/23/01 12:30	P-237C	Pump	Turned on booster pump to increase flow and got failure alarm. Reset alarm and turned booster pump off. Getting 80 gpm out of C skid without booster pump.	-	-

APPENDIX E  
Water Treatment System Component Unavailability Events  
from System Engineer Events Log

Date/time	CHAMPS ID	Component	Event description.	Estimated Unavailable Hours	Unavailable Component
3/26/01 12:00	P-237C	Pump	Replaced fuses and reset overload and pump ran.	2	-
3/27/01 10:00	P-237C	Pump	Operator found P-237C not running with no alarm and switch in auto.	-	--
4/2/01 2:30	U-17A	RO Skid	Operator found no power to "A" skid. They checked fuses and supply breaker and found no problems.	-	-
4/2/01 7:30	U-17A	RO Skid	Turned disconnect to on and power switch to on and skid started up.	-	-
4/4/01 11:30	U-17A	RO Skid	Found problem with U-17A power. Terminal connector for stepdown transformer was broken and arcing. Lead was reattached from below so the cable won't be a problem in the future. The cable in the other two skids isn't long enough to affect the transformer connections.	48	U-17A
4/6/01 8:30	U-17C	RO Skid	Replaced 8040-LHY-CPA3 membranes with 8040-UHY-ESPA membranes. 6.5 Month Run Time	8	U-17C
4/6/01 8:30	P-237C	Pump	Repaired pump. Found two fuses blown. Replaced 14 guage wire to pump with 12 guage as in other units. Worked on contactor/overload unit.	-	-
4/6/01 13:00	U-17A	RO Skid	Replaced 8040-LHY-CPA3 membranes with 8040-UHY-ESPA membranes. 6 Month Run Time	8	U-17A
6/14/01 6:00	WT-00101C	Valve	WT plant shutdown for replacement of WT-101C.	8	WT
7/12/01 9:30	U-17C	RO Skid	Informed by operations that we had a fuse blow on U-17C. When it was replaced, it blew again. The only 8 Amp fuse on the drawing is FU-9, off the transformer, which supplies control power. Looking into when they can get the transformer and replace it.	-	-
7/16/01 12:15	U-17C	RO Skid	While waiting for tagout to replace transformer, found the "C" skid antiscalant mixer was seized. After disconnecting it, the RO unit ran without blowing 8 amp fuse. The power for this mixer comes off the outlet circuit. RO unit is operational, but the mixer doesn't work. If antiscalant needs to be batched, it will need to be manually agitated.	100	U-17C
7/17/01 17:00	U-17B	RO Skid	Membranes changed out.	8	U-17B
10/18/01 14:30	U-17A	RO Skid	Replaced membrane.	8	U-17A
10/23/01 13:30	U-17C	RO Skid	Replaced membrane.	8	U-17C
11/28/01 14:00	U-17B	RO Skid	Replaced membrane.	8	U-17B

APPENDIX E  
Water Treatment System Component Unavailability Events  
from System Engineer Events Log

Date/time	CHAMPS ID	Component	Event description.	Estimated Unavailable Hours	Unavailable Component
12/19/01 15:00	U-17A	RO Skid	Replaced CPA-3 membranes with ESPA membranes. Couldn't seal F-225A on the west end. Found scratch in O-ring seating surface of filter housing. This crack will have to be filled in the future. It will most likely require the membranes to be unloaded so the surface can be dry.	8	U-17A
12/19/01 15:00	U-17B	RO Skid	Repaired leaks.	4	U-17B
12/20/01 11:00	U-17A	RO Skid	Failed PMT. WO returned to status 75 and new tagout being prepared. Need to get repair kit to fill scratch in membrane vessel F-225A on sealing surface. Will schedule repair once kit is available.	-	-
12/23/01 12:55	P-238C	Pump	Both pumps failure. One Phase blown. Replaced 60 amp fuses.	2	U-17C
12/23/01 12:55	P-237C	Pump	Both pumps failure. One Phase blown. Replaced 60 amp fuses.	-	-
12/23/01 12:55	U-17A	RO Skid	F-231A leak on west end. Repaired leak.	4	U-17A
12/23/01 16:40	U-17B	RO Skid	F-232B east end leak. Repaired leak.	4	U-17B
12/23/01 16:40	P-237C	Pump	Booster pump failure. One phase blown. Replaced 15 Amp fuses. Found one loose wire.	2	U-17C
1/7/02 8:00	P-236C	Pump	Leak repaired.	4	U-17C
1/21/02 0:00	U-17B	RO Skid	Replaced Quad Ring in F-232B.	4	U-17B
2/9/02 12:00	P-237C	Pump	P-237C-M tripped and motor was hot. P-237C turned off and "C" skid run in Lag 2.	-	-
2/11/02 11:00	P-237C	Pump	Ran "C" RO unit without booster pump. Got ~94 gpm without booster pump. WT AO to put "C" RO back on normal rotation.	-	-
2/14/02 12:00	P-237C	Pump	Found the left fuse blown and the thermal overload tripped. Returned P-237C to service after it running about 4 hours without any problems.	4	U-17C
2/17/02 8:00	P-237C	Pump	Pump tripped again. Told operations to run skid with booster pump turned off.	-	-
2/18/02 8:00	P-237C	Pump	Looked at pump. Found overload tripped again. Operator heard that right fuse was blown and was replaced. Had operations turn booster pump off and run skid.	-	-
3/11/02 10:00	P-044C	Pump	P-44C being overhauled due to bearing failure. Outboard (Double row) bearing was destroyed.	8	P-44C

APPENDIX E  
Water Treatment System Component Unavailability Events  
from System Engineer Events Log

Date/time	CHAMPS ID	Component	Event description.	Estimated Unavailable Hours	Unavailable Component
3/26/02 11:00	P-236B	Pump	Fixed leak on pump. Was discharge flow switch.	4	U-17B
3/26/02 12:30	U-17A	RO Skid	Replaced quad rings on F-227A east and west, and F-230 east. No leaks.	4	U-17A
3/26/02 16:30	P-237A	Pump	Pump tripped again. Told operations to run skid with booster pump turned off.	-	-
4/16/02 14:00	P-152-Z	Pump	Repairing speed controller on P-152.	-	-
4/22/02 7:30	P-152-Z	Pump	Returned to service.	-	-
7/2/02 13:30	P-237A	Pump	Replaced pump and fuses due to pump tripping in the past. (see 3/26/02 entry) Fuse block not changed.	4	U-17A
7/25/02 0:00	P-236A	PUMP	Antiscalant pump didn't run. Suspect flow switch problem.	-	-
9/4/02 12:20	U-17C	RO Skid	Membrane change from ESPA-1 to CPA-3 membranes. No leaks after replacement. Flow meter for reject repaired and pH meter probe changed. Membranes lasted just over 10 months between cleanings. Initial pressure was ~165 at 66F.	8	U-17C
10/22/02 0:00	P-237A	Pump	Pump still blows fuses. Concluded that new pump is needed.	2	U-17A
11/11/02 12:00	P-236A	Pump	Replaced pump. Have been having problems with skid tripping on antiscalant flow. After several other attempts to solve the problem, the pump capacity was checked and found to be low, along with it making noise.	4	U-17A
11/13/02 0:00	P-237A	Pump	Replaced Pump. Was tripping/blowing fuses.	4	U-17A
11/13/02 0:00	U-17B	RO Skid	Replaced membranes with ESPA membranes.	8	U-17B
11/21/02 0:00	U-17C	RO Skid	Skid tripped offline with no alarm at C-212. Ops found the booster pump overload tripped and reset it earlier. No power to panel or instrumentation. Found 1 main fuse blown and 1 booster pump fuse blown. Replace all three phase's fuses on main and booster pump. Restarted and it ran fine all day.	8	U-17C
12/5/02 0:00	P-237B	Pump	Reported that B-RO Booster pump trouble alarm coming in repeatedly.	-	-
12/11/2002	P-237C	Pump	Replaced Pump.	8	U-17C
12/11/2002	P-237B	Pump	Trouble shot pump. Found all fuses OK. Thermal overload tripped. Possible problem with TOL.	8	U-17B
1/9/03 0:00	U-17A	RO Skid	Repaired F-227A. Removed half shim and added whole shim.	4	U-17A

APPENDIX E  
Water Treatment System Component Unavailability Events  
from System Engineer Events Log

Date/time	CHAMPS ID	Component	Event description.	Estimated Unavailable Hours	Unavailable Component
1/10/03 0:00	U-17C	RO Skid	Repaired leak on F-230C.	4	U-17C
1/12/03 0:00	P-237A	Pump	A-RO Booster pump tripped.	-	-
1/15/03 0:00	P-237A	Pump	Replaced fuses and reset overload. One phase blown and overload tripped probably due to subsequent startup attempts on 2 phases.	72	U-17A
1/15/03 0:00	P-237B	Pump	Replace contactor and overload modules.	4	U-17B
1/21/03 0:00	U-17C	RO Skid	Replaced CPA-3 Membranes with ESPA membranes.	8	U-17C
1/21/03 0:00	P-237C	Pump	Replace overload module with more compatible one than installed on 12/18/02.	-	-
1/23/03 0:00	WT-301B	Valve	Water treatment shutdown to replace this valve.	8	WT
3/12/03 0:00	U-17A	RO Skid	Replaced ESPA Membranes with CPA-3 Membranes.	8	U-17A
3/12/03 0:00	P-237B	RO Skid	Replaced 15 amp fuses for booster pump with 17.5 amp fuses.	2	U-17B
3/12/03 0:00	P-237C	RO Skid	Replaced 15 amp fuses for booster pump with 17.5 amp fuses.	2	U-17C
3/12/03 0:00	P-237A	RO Skid	Replaced Booster pump overload and fuses with 17.5 amp fuses.	2	U-17A
04/15/2003	U-17C	RO Skid	Replaced ESPA Membranes With Cleaned ESPA Membranes	8	U-17C

**ATTACHMENT 4**

**Hydraulic Calculation for Injecting Low-Pressure Water**

**Into the Steam Generators (Final)**

**POINT BEACH NUCLEAR PLANT, UNITS 1 AND 2**

Point Beach Nuclear Plant  
CALCULATION COVER SHEET

<b>Calculation/Addendum Number:</b> 2003-0021	<b>Title of Calculation/Addendum:</b> Estimate of Service Water Flow to Each Steam Generator Through the Turbine-Driven Auxiliary Feedwater Pumps
--	--

**System (CHAMPS Identifier Codes):**  
AF, SW, FP

Original Calculation/Addendum       Supersedes Calculation/Addendum  
 Revised Calculation/Addendum Revision # \_\_\_\_\_

<b>QA Scope</b> <input type="checkbox"/> Yes <input checked="" type="checkbox"/> No  <b>Discipline</b> <input type="checkbox"/> CIV <input type="checkbox"/> NUC <input type="checkbox"/> ELEC <input type="checkbox"/> COMP <input type="checkbox"/> I&C <input type="checkbox"/> CHEM/RAD <input checked="" type="checkbox"/> MECH <input type="checkbox"/> SYST	<b>Associated Documents:</b> _____ _____ <b>Superseded By Calculation/Addendum #</b> _____ _____
--	---

<b>This Calculation has been reviewed in accordance with NP 7.2.4. The review was accomplished by one or a combination of the following (check all that apply):</b>	<b>Reviewers' Initials</b>
<input type="checkbox"/> A review of a representative sample of repetitive calculations.	
<input type="checkbox"/> A review of the calculation against a similar calculation previously performed.	
<input checked="" type="checkbox"/> A detailed review of the original calculation.	jo 6/12/03
<input type="checkbox"/> A review by an alternate, simplified, or approximate method of calculation.	

Preparer	Reviewer	Discipline	Name	Signature	Date
<input checked="" type="checkbox"/>	<input type="checkbox"/>	M	Jeremy J. Fischer		6/12/03
<input type="checkbox"/>	<input checked="" type="checkbox"/>	M	John R. Olvera		6/12/03
<input type="checkbox"/>	<input type="checkbox"/>				
<input type="checkbox"/>	<input type="checkbox"/>				
<input type="checkbox"/>	<input type="checkbox"/>				
<input type="checkbox"/>	<input type="checkbox"/>				
<input type="checkbox"/>	<input type="checkbox"/>				
<input type="checkbox"/>	<input type="checkbox"/>				

**Approver:**      **Printed Name:** Jane L. Marcan  
**Signature:**      
**Date:**            6/15/03

ECD JUN 23 2003    Emg 6/20/03  
 REC'D JUN 20 2003  
 PBF-1608    Revision 5 01/10/01

### Calculation Page Inventory

Section or Attachment	Page #(s)	Revision	Section or Attachment	Page #(s)	Revision
Cover Sheet	1	0			
Page Inventory	2	0			
Comments	3	0			
Purpose	4	0			
Assumptions	4	0			
References	4	0			
Attachments	4	0			
Inputs	5	0			
Acceptance Criteria	5	0			
Methodology	5-6	0			
Calculation	7	0			
Results	7-8	0			
Conclusion	8	0			
Attachment 1	1-1	0			
Attachment 2	1-5	0			
Attachment 3	1-1	0			

### Comments And Resolution

Reviewer Comments:	Resolution:
<i>No comments. - Jan 6/12/03</i>	

## Purpose

The purpose of this non-QA scope calculation is to estimate Service Water (SW) flow to each Steam Generator (SG) at various SG pressures when the Auxiliary Feedwater (AFW) pumps are not running. While each steam generator could potentially receive service water through both the Turbine Driven (TDAFW) and Motor Driven (MDAFW) pumps, only flow through the TDAFW pump will be considered. This is conservative since crediting flow through MDAFW pumps in addition to flow through the TDAFW pumps would increase flow per SG. The results of this calculation will be used to support a Probabilistic Risk Assessment (PRA) effort to quantify Core Damage Frequency (CDF) associated with LER 266/2002-033-00.

This is a non-QA scope calculation and is developed consistent with good engineering practices and documented as appropriate for the task at hand.

## Assumptions

### *Validated Assumptions*

1. It is assumed that service water header pressure is at 68 psig. **Basis:** During normal system operation, service water system pressure as read on PI-2844/2845 is maintained between 50 psig and 90 psig [Reference 1]. Additionally, during the valve misposition event, which introduced service water into the steam generators, service water pressure was at 68 psig [Reference 2]. This pressure is typical for normal operation. Service water pressure is maximized during an accident.
2. It is assumed that the steam generators were at atmospheric pressure, 0 psig, during the valve misposition event, which introduced service water into the steam generators [Reference 2]. **Basis:** Reactor coolant temperature recorded during the event indicates 92°F [Input 8], which is not adequate to induce secondary boiling.

### *Unvalidated Assumptions*

None.

## References

1. OI-70, Rev. 43, "Service Water System Operation"
2. CR 99-0575 "Service Water Introduced to SG During IT-295 Valve Stroke Test"
3. Crane Technical Paper 410, "Flow of Fluids Through Valves, Fittings, and Pipes"
4. Johnston Pump Company, "Pump Performance Characteristics" dated 12/8/2000
5. PT 0-PT-FP-004 "Annual Fire Pump Capacity Test" dated 7/19/2002
6. Bechtel Drawings P-113 Sheets 2 and 3 Revision 1, "Service Water Supply Header"
7. Bechtel Drawing P-212 Revision 8, "Feedwater System Loop A&B"
8. Bechtel Drawing P-117 Revision 10, "Aux Feedwater Pump Suction From Condensate Storage Tanks"
9. Bechtel Drawing P-113 Sheet 4 Revision 2 "Service Water AFW Pump Supply Header"
10. Bechtel Drawing P-113 Sheet 1 Revision 1 "Service Water North and South Supply Header"

## Attachments

1. CR 99-0575 [Reference 2]
2. Historical Data Log Report
3. Service Water Pump Performance [Reference 4]

## Inputs

1.	Service water header pressure,	68 psig	[Assumption 1]
2.	Service water flow through 2P29 during misposition event <sup>1,2</sup> ,	86 gpm	[Attachment 2]
3.	Steam generator pressure during misposition event,	0 psig	[Assumption 2]
4.	Plant elevation of PI-2844/2845,	19 ft	[Reference 6]
5.	Plant elevation of 2HX1A/B feedwater nozzle (average),	77 ft	[Reference 7]
6.	Density of water at 60°F,	62.4 lb/ft <sup>3</sup>	[Reference 3, page A-6]
7.	Plant elevation of AFW pump inlet,	10 ft	[Reference 8]
8.	Reactor coolant temperature,	92°F	[Attachment 2]

## Acceptance Criteria

None.

## Methodology

Bernoulli's theorem [Reference 3, Equation 3-1] can be applied to the modeled system boundaries (ie, AFW pump inlet and steam generator) and the piping and components located between these boundaries. This principle can be used to estimate service water flow to each steam generator at various steam generator pressures when the auxiliary feedwater pumps are not running. For this scenario, Bernoulli's theorem comprises of water pressure available at the AFW pump inlet, elevation pressure losses, dynamic pressure losses, and steam generator pressure. The piping located between the SW header pressure indicator and the AFW pump inlet will not be included within the modeled system boundaries because the majority of this piping is 6 inches or larger in diameter and less than 300 ft in length [References 6, 8, 9, 10], which will produce negligible dynamic pressure losses for the flow rates (no greater than 86 gpm) considered in this calculation. These losses are negligible because 100 gpm of 60°F water flowing through a 6 inch schedule 40 pipe only produces a 0.036 psid pressure drop [Reference 3, page B-14]. Velocity head differences between the system boundaries will be neglected because of the low flow rates and relatively large pipe diameters. By determining dynamic pressure losses at specified flow rates, steam generator pressure can be determined for these flow rates from the following relationship,

$$SG \text{ Pressure} = \text{Pressure available at the AFW pump} - \text{Elevation Pressure Loss} - \text{Dynamic Pressure Loss}$$

### ***Water Pressure Available at the AFW Pump***

Pressurized water can be supplied to the AFW pump inlet by the service water or fire water systems. Supply by the service water system is bounding for the purposes of this calculation due to the lower head developed by the service water pumps at the specified flow rates. For this calculation, the service water pressure available at the AFW pump inlet will be fixed at 68 psig [Input 1]. It is appropriate to fix the water pressure available at the AFW pump inlet given the pump head development capabilities of the service water and fire water pumps at the specified flow rates [Attachment 3, References 5].

$$\text{Pressure available at the AFW pump} = \underline{68 \text{ psig}}$$

<sup>1</sup> The lowest value sum of flow rates to each steam generator (40.1 gpm and 45.9 gpm) [Attachment 2] during the valve misposition event [Reference 2] will be used for this input. This is conservative, as it will increase the calculated system flow resistance.

<sup>2</sup> Instrument uncertainty will not be considered, as this is a best estimate, non-design basis calculation. Investigation has identified no process measurement biases.

### ***Elevation Pressure Loss***

The difference in elevation between the steam generator feedwater nozzle and the AFW pump inlet is 67 ft (77 ft – 10 ft) [Inputs 5, 7]. This elevation loss can be expressed in units of pressure as follows [Reference 3, Equation 3-23<sup>3</sup>; Input 6],

$$\text{Elevation pressure loss (psid)} = \Delta Z (\rho / 144) = (67 \text{ ft}) ((62.4 \text{ lb/ft}^3) / (144 \text{ in}^2 / \text{ft}^2)) = \underline{29 \text{ psid}}$$

Any elevation difference between the steam generator feedwater nozzle and the steam generator internal ring header is more than compensated for by neglecting the 9 ft elevation difference between the service water header and the AFW pump inlet [Inputs 4, 7].

### ***Dynamic Pressure Loss***

Plant data [Attachments 1, 2] is used to determine pressure losses due to flow through the AFW pump (when it is not running) and SG feeding nozzles, pipe friction (minimal due to the low flow rates and relatively large flow areas), changes in direction of flow path, obstructions in flow path, and sudden or gradual changes in the cross-section and shape of the flow path of the flowing water. Flow coefficient,  $C_v$ , is a convenient method of expressing pressure loss versus flow characteristics as follows.

$$C_v = Q \sqrt{\frac{\rho}{\Delta P (62.4)}}$$

This flow coefficient is calculated using plant data, which provides the maximum flow at atmospheric steam generator conditions. Therefore, a high confidence level can be associated with the  $C_v$  determined at this data point. In absence of additional data points between maximum flow (86 gpm) and shutoff (0 gpm), the  $C_v$  calculated using plant data (maximum flow) will be used to extrapolate dynamic pressure loss,  $\Delta P$ , at less than maximum flow rates. This approach considers the  $C_v$  value to be constant at specified flow rates (i.e., dynamic losses are proportional to the square of flow rate). This is an estimation using actual plant data with Darcy's Formula to approximate a flow versus pressure relationship.

$$\Delta P_2 = \Delta P_1 \left( \frac{Q_2}{Q_1} \right)^2$$

Given the low flow rates and relatively large flow areas, the dynamic losses due to friction resulting from actual flowpath length are minor compared to the losses from directional changes, obstructions, expansions, and contractions in components such as the AFW pump. Therefore, the  $C_v$  is considered to be relatively insensitive to changes in non-turbulent friction factors associated with the specified flow rates [Reference 3 Page 2-8].

### ***SG Pressure***

The allowable steam generator pressure for each specified flow rate is determined by deducting the elevation and dynamic pressure losses from the water pressure available at the AFW pump inlet.

$$\text{SG Pressure} = \text{Pressure available at the AFW pump} - \text{Elevation Pressure Loss} - \text{Dynamic Pressure Loss}$$

<sup>3</sup> $\Delta Z$  is substituted for  $h_L$  of Reference 3 Equation 3-23.

## Calculation

Water pressure available at the AFW pump and elevation pressure loss have been determined in the methodology section of this calculation to be 68 psig and 29 psid respectively.

### *Dynamic Pressure Loss*

#### Dynamic Pressure Loss at Plant Data Point

To determine dynamic pressure loss,  $\Delta P$ , using plant data, SG pressure and elevation pressure loss must be deducted from the SW header pressure. Substituting these values produces 39 psid (68 psig – 29 psid – 0 psig) [Inputs 1, 3, elevation loss is determined in the methodology section]. This pressure loss occurs at a total flow rate of 86 gpm [Input 2]. It should be noted that SG level was at normal level during the misposition event [Attachment 2]. Neglecting the additional elevation pressure loss produces a conservatively lower  $C_v$ .

$$C_v = 86 \text{ gpm} \sqrt{\frac{62.4 \text{ lb/cu. ft}}{39 \text{ psid}(62.4)}} = 13.8$$

#### Dynamic Pressure Loss at Specified Flows

The  $C_v$  calculated at the plant data point is used to extrapolate dynamic pressure loss,  $\Delta P$ , at specified total flow rates of 0, 10, 20, 30, 40, 50, 60, 70, and 80 gpm.

$$\Delta P = 39 \text{ psid} \left( \frac{Q}{86 \text{ gpm}} \right)^2 = 0 \text{ psid}$$


### *SG Pressure*

SG pressure is the difference between SW header pressure, 68 psig [Input 1] and the sum of all losses in the system at total flow rates of 0, 10, 20, 30, 40, 50, 60, 70, 80, and 86 gpm. Flow to each SG will be approximately half of the total flow rate as demonstrated by plant data [Attachment 2].

## Results

Total Flow (gpm)	0	10	20	30	40	50	60	70	80	86
Flow per SG (gpm)	0	5	10	15	20	25	30	35	40	43
Water pressure available at the AFW pump (psig)	68	68	68	68	68	68	68	68	68	68
Elevation pressure loss (psid)	29	29	29	29	29	29	29	29	29	29
Dynamic pressure loss (psid)	0	0.53	2.11	4.75	8.44	13.18	18.98	25.84	33.75	39.0
SG pressure (psig)	39.0	38.5	36.9	34.3	30.6	25.8	20.0	13.2	5.3	0.0

SW Flow to Each SG vs. SG Pressure

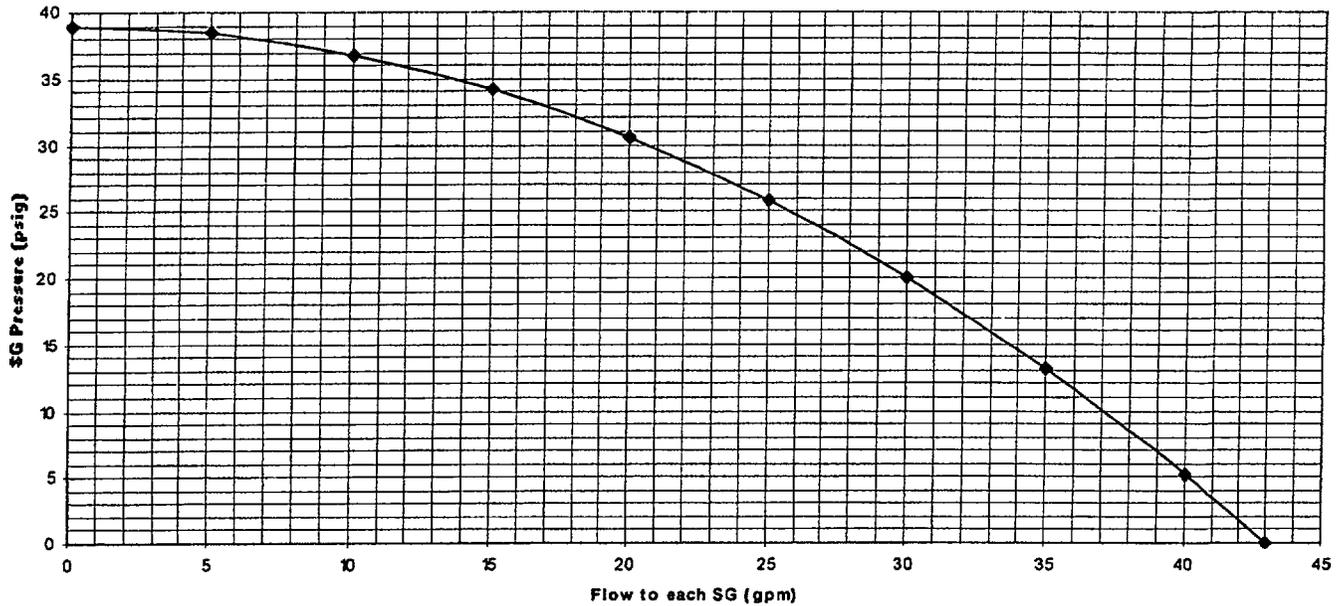

## Conclusions

This non-QA scope calculation and its results will be used to support a Probabilistic Risk Assessment (PRA) effort to quantify Core Damage Frequency (CDF) associated with LER 266/2002-033-00. A high level of confidence can be placed in the maximum flow value (86 gpm at atmospheric steam generator pressure) as it is based on information from the plant historical data log report. Extrapolation of the flow versus pressure relationship between the plant data point (maximum flow) and shutoff (0 gpm) is based on an estimation using this plant data. While each steam generator could potentially receive service water through both the Turbine Driven pumps and the Motor Driven pumps, only flow through the Turbine Driven pumps has been considered in this calculation. Neglecting flow contributions from the Motor Driven pump is conservative as it reduces the available cooling water flow rates to each steam generator.

CONDITION REPORTS (CRs)  
CR 99-0575

PAGE: 1 of 5  
DATE: 08/24/99

STATUS: CLOSED UNIT: 0 SYSTEM: AF INITIATED: 02/17/99 CLOSED: 08/24/99 MSS #:  
INITIATOR: HERB BENEUD ADMINISTRATOR: TOM SHELEY ISSUE MANAGER: BRIAN OGRADY  
NUMBER OF OPEN ACTIONS : 0 NUMBER OF CLOSED ACTIONS : 5 TOTAL NUMBER OF ACTIONS : 5

Service Water Introduced To SG During IT-295 Valve Stroke Test

DESCRIPTION:

During performance of IT-295 (manual valve stroke for the Aux Feed Pump discharge and service water supply valve Unit #2) Service water was introduced through 2P29 and into discharge piping leading to 2HX 1A+B. Service water press in the AFW pump room was 68 psig. Per step 4.5.8 2AF-4006 was opened by handwheel. SW was blown down per step 4.5.10 through 2AF-63. Step 4.5.11 shuts 2AF-4006. Another operator then mentioned 2P29 was spinning during the flush but had stopped. The piping leading to 2HX1A+B steam generators was cold to the touch and damp with sweat just like the SW piping and 2P-29 suction line. Discharge piping coming from P38 A was warm to the touch as other ambient temp piping.

Other problem noted: Per step 4.5.11 we cannot "Disengage" 2AF-4006 handwheel with power breaker open per step 4.5.6.

Significance:

SW is not desirable water chemistry for steam generators.

Corrective actions:

Test terminated. Operations is developing a plan to flush the feed water flow path, and possibility of draining the steam generators of contaminants.

Recommendations:

IT 295 needs to be corrected

Screener Comment:

None (PJM)

PLA comment:

IT-290 and 295 have been placed on admin hold.

STATUS UPDATE:

(02/19/99 JRA1) In addition to the investigation associated with the RCE, I have inter- viewed the personnel who wrote, reviewed, and performed this procedure. A meeting was held including the Ops Manager, Procedures Programs Manager, Ops Corrective Action Specialist, and Ops Procedure Lead. The event was reviewed for the purpose of assessing the vulnerability of the organization to another similar event, and to determine whether any prompt preemptive actions should be taken. Decisions were made to meet with the procedure writers as a group to reinforce the expectation for quality and discover what additional resources were needed to support that level of performance; to meet with each Operating crew and clarify expectations for procedure reviews, pre-job briefs, communication, procedure adherence, and self- checking; and to establish a team of individuals to perform detailed reviews of major procedures yet to be performed prior to end of U2R23. These short-term actions will be supplemented by additional intermediate- term actions directed at improving the procedure review process.

(08/24/99 TPS) All corrective actions out of the RCE have been completed.

SCREENED BY : TOM SHELEY DATE: 02/18/99 COMMITMENT.....(Y/N): N  
REGULATORY REPORTABLE.....(Y/N): N TS VIOLATION.....(Y/N): N 10 CFR 21.....(Y/N): N  
TS LCO.....(Y/N): N OPERABILITY IMPACT PER TS.(Y/N): N JCO REQUIRED.....(Y/N): N  
MSS REVIEW.....(Y/N): N SCAQ.....(Y/N): N OPERABILITY DETERMINATION.(Y/N): N

SUPPORTING DETERMINATIONS:

This event is not reportable, nor is it a Tech Spec violation.

TRENDING INFORMATION:

WHEN: First Quarter 1999

WHO: OPERATIONS

WHY: INADEQUATE PROGRAM MONITORING OR MANAGEMENT

INADEQUATE JOB SKILLS, WORK PRACTICE OR DECISION MAKING

WRONG ASSUMPTION

WHAT: PROCEDURE REVIEW INADEQUATE

INADEQUATE INTERFACE AMONG ORGANIZATION

LACK OF INFORMATION VALIDATION / VERIFICATION

OPERATIONS PROCEDURE

SYSTEM: AUXILIARY FEEDWATER

Human error within the technical review process. The SRO applied poor judgment in assuming the plant conditons would be adequate to support the test. See RCE 99-041 for additional why code, and trending.

REFERENCES: LEVEL B IT-290 IT-295  
RTS S13 OEVEL B OM 1.1  
OM 1.0 NP 1.1.3 OM 1.4  
NP 1.1.3 OM 4.3.7

POINT BEACH 2  
 WISCONSIN ELECTRIC POWER  
 HISTORICAL DATA LOG REPORT

A231

REQUESTED FROM STATION 11  
 ON 2 / 18 / 99 AT 00:53:07

THIS REPORT SPANS THE TIME PERIOD FROM  
 02/17/99 AT 12:00:00 TO 02/17/99 AT 14:00:00  
 WITH A TIMESTEP OF 60 SECOND(S)  
 MEDIUM: DISK RESOLUTION: HIGH

LOG NUMBER	POINT ID	UNITS	DESCRIPTION
1	LT461	PCNT	STEAM GENERATOR LEVEL 2A-1 RED
2	LT471	PCNT	STEAM GENERATOR LEVEL 2B-1 YLW
3	FT4036	GPM	SG A AUX FEED FLOW
4	FT4037	GPM	SG B AUX FEED FLOW
5	FT128	GPM	CHARGING LINE FLOW
6	LT433	PCNT	PRESSURIZER LEVEL COLD CAL
7	T451A	DEGF	RCS WIDE RANGE TEMP COLD LEG B
8	PT420A	PSIG	RCS WR PRESSURE LOOP A

REASONS WHY DATA MAY BE UNAVAILABLE:

1. DATA WAS NEVER RECORDED  
 THIS COULD OCCUR DURING A COMPUTER FAILURE, POWER FAILURE OR DISK PROTECTION.  
 COMPUTER MESSAGE: 'NO DATA'
2. DATA WAS OUT OF RANGE  
 THIS MEANS A READING WAS NOT OBTAINED FROM THE INSTRUMENT RECEIVING THE DATA.  
 COMPUTER MESSAGE: 'CONV/ERR'

TIME	DATE	"A" LT46T	"B" LT47T	"A" FT4036	"B" FT4037	F1128	L1433	L451A	PT4211A
12:00:00	02/17/99	64.0	63.5	0.6	0.3	18.4	100.4	92	155
12:01:00	02/17/99	64.0	63.5	0.6	0.3	18.3	100.4	92	155
12:02:00	02/17/99	64.0	63.5	0.6	0.3	25.2	100.5	92	178
12:03:00	02/17/99	64.0	63.5	0.6	0.3	24.7	100.5	92	218
NO DATA									
12:05:00	02/17/99	64.0	63.5	0.6	0.3	24.4	100.7	92	363
12:06:00	02/17/99	64.0	63.5	0.6	0.3	24.6	100.8	92	359
12:07:00	02/17/99	64.0	63.5	0.6	0.3	24.4	100.8	92	374
12:08:00	02/17/99	64.0	63.5	0.6	0.3	24.4	100.8	92	373
12:09:00	02/17/99	64.0	63.5	0.6	0.3	24.4	100.8	92	370
12:10:00	02/17/99	64.0	63.5	0.6	0.3	24.5	100.8	92	370
12:11:00	02/17/99	64.0	63.5	0.6	0.3	24.4	100.8	92	373
12:12:00	02/17/99	64.0	63.5	0.6	0.3	24.4	100.8	92	375
12:13:00	02/17/99	64.0	63.5	0.6	0.3	24.1	100.8	92	376
12:14:00	02/17/99	64.0	63.5	0.5	0.3	24.1	100.8	92	377
12:15:00	02/17/99	64.0	63.5	0.6	0.3	24.2	100.8	92	376
12:16:00	02/17/99	64.0	63.5	0.6	0.3	24.1	100.8	92	376
12:17:00	02/17/99	64.0	63.5	0.6	0.3	24.1	100.8	92	375
12:18:00	02/17/99	64.0	63.5	0.6	0.3	24.2	100.8	92	375
12:19:00	02/17/99	64.0	63.5	0.6	0.3	24.2	100.8	92	375
12:20:00	02/17/99	64.0	63.5	0.6	0.3	24.2	100.8	92	376
12:21:00	02/17/99	64.0	63.5	0.6	0.3	24.1	100.8	92	376
12:22:00	02/17/99	64.0	63.5	0.6	0.3	24.3	100.8	92	376
12:23:00	02/17/99	64.0	63.5	0.6	0.3	24.3	100.8	92	376
12:24:00	02/17/99	64.0	63.5	0.6	0.3	24.2	100.8	92	376
12:25:00	02/17/99	64.0	63.5	0.6	0.3	24.3	100.8	92	376
12:26:00	02/17/99	64.3	63.9	45.2	48.9	24.3	100.8	92	376
12:27:00	02/17/99	64.7	64.3	43.8	48.0	24.4	100.8	92	376
12:28:00	02/17/99	65.0	64.7	43.4	47.0	24.4	100.8	92	376
12:29:00	02/17/99	65.4	65.0	40.1	45.9	24.5	100.8	92	376
12:30:00	02/17/99	65.7	65.3	0.1	0.2	24.4	100.8	92	376
12:31:00	02/17/99	65.7	65.3	0.2	-0.1	24.5	100.8	92	376
12:32:00	02/17/99	65.7	65.3	0.4	0.2	24.4	100.8	92	376
12:33:00	02/17/99	65.8	65.3	0.5	0.2	24.5	100.8	92	376
12:34:00	02/17/99	65.8	65.3	0.5	0.3	24.4	100.8	92	376
12:35:00	02/17/99	65.8	65.3	0.6	0.3	24.5	100.8	92	376
12:36:00	02/17/99	65.8	65.3	0.6	0.3	24.4	100.8	92	376
12:37:00	02/17/99	65.8	65.3	0.6	0.3	24.5	100.8	92	376
12:38:00	02/17/99	65.8	65.3	0.6	0.3	24.4	100.8	92	375
12:39:00	02/17/99	65.8	65.3	0.6	0.3	24.4	100.8	92	376
12:40:00	02/17/99	65.8	65.3	0.6	0.3	24.5	100.8	92	375
12:41:00	02/17/99	65.7	65.3	0.6	0.3	24.4	100.8	92	376
12:42:00	02/17/99	65.7	65.3	0.6	0.3	24.4	100.8	92	375
12:43:00	02/17/99	65.7	65.3	0.5	0.3	24.2	100.8	92	376
12:44:00	02/17/99	65.7	65.3	0.6	0.3	24.3	100.8	92	375
12:45:00	02/17/99	65.7	65.3	0.6	0.3	24.3	100.8	92	375
12:46:00	02/17/99	65.7	65.3	0.6	0.3	24.2	100.8	92	375
12:47:00	02/17/99	65.7	65.3	0.6	0.3	24.2	100.8	92	376
12:48:00	02/17/99	65.7	65.3	0.6	0.3	24.2	100.8	92	375
12:49:00	02/17/99	65.7	65.3	0.6	0.3	24.3	100.8	92	376
12:50:00	02/17/99	65.7	65.3	0.6	0.3	24.3	100.8	92	375

SW flow to S/G's

We assumed 5 minutes total time due to level change and 1 minute interval of data. We took average of the 4 values and multiplied by 5.

TIME	DATE	LT461	LT471	FT4036	FT4037	FT128	LT433	T451A	PT420A	A274
1:00	02/17/99	65.7	65.2	0.6	0.3	24.4	100.8	95	313	
1:00	02/17/99	65.6	65.2	0.6	0.3	24.4	100.8	95	314	
13:44:00	02/17/99	65.6	65.2	0.6	0.3	24.4	100.8	96	310	

TIME	DATE	LT461	LT471	FT4036	FT4037	FT128	LT433	T451A	PT420A	A273
13:51:00	02/17/99	65.7	65.3	0.6	0.3	24.2	100.8	92	376	
13:52:00	02/17/99	65.7	65.3	0.5	0.3	24.4	100.8	92	375	
13:53:00	02/17/99	65.7	65.3	0.5	0.3	24.4	100.8	92	376	
12:54:00	02/17/99	65.7	65.3	0.6	0.3	24.4	100.8	92	376	
12:55:00	02/17/99	65.7	65.3	0.6	0.3	24.4	100.8	92	376	
12:56:00	02/17/99	65.7	65.3	0.6	0.3	24.4	100.8	92	376	
12:57:00	02/17/99	65.7	65.3	0.5	0.3	24.4	100.8	92	376	
12:58:00	02/17/99	65.7	65.3	0.6	0.3	24.4	100.8	92	376	
12:59:00	02/17/99	65.7	65.3	0.5	0.3	24.4	100.8	92	376	
13:00:00	02/17/99	65.7	65.3	0.6	0.3	24.4	100.8	92	376	
13:01:00	02/17/99	65.6	65.3	0.6	0.3	24.4	100.8	92	376	
13:02:00	02/17/99	65.6	65.3	0.6	0.3	24.5	100.8	92	376	
13:03:00	02/17/99	65.6	65.2	0.6	0.3	24.4	100.8	92	376	
13:04:00	02/17/99	65.6	65.3	0.6	0.3	24.4	100.8	92	376	
13:05:00	02/17/99	65.6	65.2	0.6	0.3	24.3	100.8	92	376	
13:06:00	02/17/99	65.6	65.2	0.6	0.3	24.4	100.8	92	376	
13:07:00	02/17/99	65.6	65.2	0.6	0.3	24.4	100.8	92	376	
13:08:00	02/17/99	65.6	65.2	0.6	0.2	24.5	100.8	92	376	
13:09:00	02/17/99	65.6	65.2	0.5	0.3	24.4	100.8	92	375	
13:10:00	02/17/99	65.6	65.2	0.6	0.3	24.5	100.8	92	376	
13:11:00	02/17/99	65.6	65.2	0.6	0.2	24.4	100.8	92	375	
13:12:00	02/17/99	65.6	65.2	0.5	0.3	24.4	100.8	92	376	
13:13:00	02/17/99	65.6	65.2	0.6	0.3	24.4	100.8	92	375	
13:14:00	02/17/99	65.6	65.2	0.6	0.3	24.4	100.8	92	376	
13:15:00	02/17/99	65.6	65.2	0.6	0.3	24.5	100.8	92	375	
13:16:00	02/17/99	65.6	65.2	0.6	0.3	24.4	100.8	92	376	
13:17:00	02/17/99	65.6	65.2	0.6	0.2	24.3	100.8	91	375	
13:18:00	02/17/99	65.6	65.2	0.6	0.3	24.3	100.8	91	376	
13:19:00	02/17/99	65.7	65.2	0.6	0.3	24.3	100.8	91	375	
13:20:00	02/17/99	65.7	65.2	0.6	0.3	24.3	100.8	91	376	
13:21:00	02/17/99	65.7	65.2	0.6	0.3	24.3	100.8	91	375	
13:22:00	02/17/99	65.7	65.2	0.6	0.3	24.3	100.8	91	376	
13:23:00	02/17/99	65.7	65.2	0.6	0.3	24.3	100.8	91	376	
13:24:00	02/17/99	65.7	65.2	0.5	0.3	24.4	100.8	91	376	
13:25:00	02/17/99	65.7	65.2	0.6	0.3	24.4	100.8	91	376	
13:26:00	02/17/99	65.7	65.2	0.6	0.3	24.4	100.8	91	376	
13:27:00	02/17/99	65.7	65.2	0.6	0.3	24.4	100.8	91	376	
13:28:00	02/17/99	65.7	65.2	0.6	0.3	24.4	100.8	91	376	
13:29:00	02/17/99	65.7	65.2	0.6	0.3	24.4	100.8	91	376	
13:30:00	02/17/99	65.7	65.2	0.6	0.3	24.4	100.8	91	376	
13:31:00	02/17/99	65.7	65.2	0.6	0.3	24.4	100.8	91	376	
13:32:00	02/17/99	65.7	65.2	0.6	0.3	24.4	100.8	91	376	
13:33:00	02/17/99	65.7	65.2	0.5	0.3	24.4	100.8	91	376	
13:34:00	02/17/99	65.7	65.2	0.6	0.3	24.4	100.8	91	376	
13:35:00	02/17/99	65.7	65.2	0.5	0.3	24.4	100.8	91	371	
13:36:00	02/17/99	65.6	65.2	0.6	0.3	24.6	100.8	92	306	
13:37:00	02/17/99	65.7	65.2	0.6	0.3	24.5	100.8	92	313	
13:38:00	02/17/99	65.7	65.2	0.6	0.3	24.5	100.8	93	316	
13:39:00	02/17/99	65.7	65.2	0.6	0.3	24.5	100.8	93	311	
13:40:00	02/17/99	65.7	65.2	0.6	0.3	24.5	100.8	94	309	
13:41:00	02/17/99	65.7	65.2	0.6	0.3	24.4	100.8	94	311	

TIME	DATE	LT461	LT471	FI4036	FI4037	FI128	LT433	T451A	PI470A
1:00	02/17/99	65.7	65.3	0.6	0.3	24.2	100.8	92	376
2:00	02/17/99	65.7	65.3	0.5	0.3	24.4	100.8	92	375
12:53:00	02/17/99	65.7	65.3	0.5	0.3	24.4	100.8	92	376
12:54:00	02/17/99	65.7	65.3	0.6	0.3	24.4	100.8	92	376
12:55:00	02/17/99	65.7	65.3	0.6	0.3	24.4	100.8	92	376
12:56:00	02/17/99	65.7	65.3	0.6	0.3	24.4	100.8	92	376
12:57:00	02/17/99	65.7	65.3	0.5	0.3	24.4	100.8	92	376
12:58:00	02/17/99	65.7	65.3	0.6	0.3	24.4	100.8	92	376
12:59:00	02/17/99	65.7	65.3	0.5	0.3	24.4	100.8	92	376
13:00:00	02/17/99	65.7	65.3	0.6	0.3	24.4	100.8	92	376
13:01:00	02/17/99	65.6	65.3	0.6	0.3	24.4	100.8	92	376
13:02:00	02/17/99	65.6	65.3	0.6	0.3	24.5	100.8	92	376
13:03:00	02/17/99	65.6	65.3	0.6	0.3	24.4	100.8	92	376
13:04:00	02/17/99	65.6	65.3	0.6	0.3	24.4	100.8	92	376
13:05:00	02/17/99	65.6	65.3	0.6	0.3	24.3	100.8	92	376
13:06:00	02/17/99	65.6	65.3	0.6	0.3	24.4	100.8	92	376
13:07:00	02/17/99	65.6	65.3	0.6	0.3	24.4	100.8	92	376
13:08:00	02/17/99	65.6	65.3	0.6	0.2	24.5	100.8	92	376
13:09:00	02/17/99	65.6	65.3	0.5	0.3	24.4	100.8	92	375
13:10:00	02/17/99	65.6	65.3	0.6	0.3	24.5	100.8	92	376
13:11:00	02/17/99	65.6	65.3	0.6	0.2	24.4	100.8	92	375
13:12:00	02/17/99	65.6	65.3	0.5	0.3	24.4	100.8	92	376
13:13:00	02/17/99	65.6	65.3	0.6	0.3	24.4	100.8	92	375
13:14:00	02/17/99	65.6	65.3	0.6	0.3	24.4	100.8	92	376
13:15:00	02/17/99	65.6	65.3	0.6	0.3	24.5	100.8	92	375
13:16:00	02/17/99	65.6	65.3	0.6	0.3	24.4	100.8	92	376
13:17:00	02/17/99	65.6	65.3	0.6	0.2	24.3	100.8	91	375
13:18:00	02/17/99	65.6	65.3	0.6	0.3	24.3	100.8	91	376
13:19:00	02/17/99	65.6	65.3	0.6	0.3	24.3	100.8	91	375
13:20:00	02/17/99	65.7	65.3	0.6	0.3	24.3	100.8	91	376
13:21:00	02/17/99	65.7	65.3	0.6	0.3	24.3	100.8	91	375
13:22:00	02/17/99	65.7	65.3	0.6	0.3	24.3	100.8	91	376
13:23:00	02/17/99	65.7	65.3	0.6	0.3	24.3	100.8	91	376
13:24:00	02/17/99	65.7	65.3	0.5	0.3	24.4	100.8	91	376
13:25:00	02/17/99	65.7	65.3	0.6	0.3	24.4	100.8	91	376
13:26:00	02/17/99	65.7	65.3	0.6	0.3	24.4	100.8	91	376
13:27:00	02/17/99	65.7	65.3	0.6	0.3	24.4	100.8	91	376
13:28:00	02/17/99	65.7	65.3	0.6	0.3	24.4	100.8	91	376
13:29:00	02/17/99	65.7	65.3	0.6	0.3	24.4	100.8	91	376
13:30:00	02/17/99	65.7	65.3	0.6	0.3	24.4	100.8	91	376
13:31:00	02/17/99	65.7	65.3	0.6	0.3	24.4	100.8	91	376
13:32:00	02/17/99	65.7	65.3	0.6	0.3	24.4	100.8	91	376
13:33:00	02/17/99	65.7	65.3	0.5	0.3	24.4	100.8	91	376
13:34:00	02/17/99	65.7	65.3	0.6	0.3	24.4	100.8	91	376
13:35:00	02/17/99	65.7	65.3	0.5	0.3	24.4	100.8	91	371
13:36:00	02/17/99	65.6	65.3	0.6	0.3	24.6	100.8	92	306
13:37:00	02/17/99	65.7	65.3	0.6	0.3	24.5	100.8	92	313
13:38:00	02/17/99	65.7	65.3	0.6	0.3	24.5	100.8	93	316
13:39:00	02/17/99	65.7	65.3	0.6	0.3	24.5	100.8	93	311
13:40:00	02/17/99	65.7	65.3	0.6	0.3	24.5	100.8	94	309
13:41:00	02/17/99	65.7	65.3	0.6	0.3	24.4	100.8	94	311

TIME	DATE	L1461	L1471	FT4036	FT4037	F1128	L1473	T451A	P1420A	A234
1:00	02/17/99	65.7	65.2	0.6	0.3	24.4	100.8	95	313	
3:00	02/17/99	65.6	65.2	0.6	0.3	24.4	100.8	95	314	
13:44:00	02/17/99	65.6	65.2	0.6	0.3	24.4	100.8	96	310	
13:45:00	02/17/99	65.6	65.2	0.6	0.3	24.3	100.7	96	358	
13:46:00	02/17/99	65.6	65.2	0.6	0.3	24.3	100.7	95	334	
13:47:00	02/17/99	65.6	65.2	0.6	0.3	17.1	100.6	94	262	
13:48:00	02/17/99	65.6	65.2	0.6	0.3	17.3	100.5	94	220	
13:49:00	02/17/99	65.6	65.2	0.5	0.3	17.1	100.5	93	194	
13:50:00	02/17/99	65.6	65.2	0.6	0.3	17.6	100.4	93	175	
13:51:00	02/17/99	65.7	65.2	0.6	0.3	17.5	100.4	93	164	
13:52:00	02/17/99	65.7	65.2	0.6	0.2	17.6	100.4	93	157	
13:53:00	02/17/99	65.7	65.2	0.6	0.3	17.6	100.4	93	151	
13:54:00	02/17/99	65.7	65.2	0.6	0.3	17.7	100.4	93	147	
13:55:00	02/17/99	65.7	65.2	0.6	0.3	17.6	100.4	93	144	
13:56:00	02/17/99	65.7	65.2	0.6	0.3	17.7	100.4	94	141	
13:57:00	02/17/99	65.7	65.2	0.6	0.3	17.6	100.4	94	140	
13:58:00	02/17/99	65.7	65.2	0.5	0.3	17.6	100.4	94	139	
13:59:00	02/17/99	65.7	65.2	0.6	0.3	17.6	100.4	94	139	
14:00:00	02/17/99	65.7	65.2	0.5	0.3	17.7	100.4	94	140	

END OF DATA

**ATTACHMENT 5**

**Summary of MAAP Analysis (Preliminary)**

**POINT BEACH NUCLEAR PLANT, UNITS 1 AND 2**

## Attachment 5

### Event Timeline & Accident Sequence Success Criteria Analyses Using The MAAP Computer Code

#### Purpose

The analyses provide input for various transients to determine 1) the acceptability of postulated transients defined in the Point Beach Probabilistic Risk Assessment (PRA) analysis, with respect to operator actions and available equipment and, 2) timing information of key events to be used for the purposes of Human Error Probability (HEP) calculations.

The intended use of the analyses is to support specific accident sequences used in the PRA analysis of the AFW recirculation orifice issue for the purposes described above.

#### Methodology

The analyses are performed using the Modular Accident Analysis Program (MAAP), version 4.0.4. MAAP is a best-estimate, general-purpose severe accident code that can be used to predict transient behavior in the reactor coolant and secondary systems, core damage, and containment response. MAAP is widely used in the industry for performing thermal-hydraulic analyses to support PRA modeling, predict severe accident phenomenon, and to provide best-estimate transient behavior for various transients. Fauske & Associates, Inc (FAI) developed MAAP, and maintains it under industry and EPRI sponsorship. MAAP has been benchmarked extensively against experimental and industrial data, and is considered acceptable for PRA support applications.

A MAAP model for a particular plant is documented in a plant specific parameter file. A parameter file for Point Beach was developed for earlier PRA applications for use with the MAAP3 code. FAI later revised the parameter file for use with MAAP code version 4.0.4. This is the version of the Point Beach parameter file that is used for these analyses. Changes to the model for a specific analysis are implemented using an input file. The input file allows changes to the parameter file values, modeling of initiating events, modeling of operator interventions, and specification of outputs.

Three types of analyses are performed to determine the effect of specific recovery actions:

1. Base case. For this scenario, the AFW system takes suction from the Condensate Storage Tank (CST) and draws it down to the low-low level (eight foot indicated level). The AFW suction is then transferred by procedure to the Service Water (SW) system. It is assumed that the AFW pumps fail immediately upon transfer to

## DRAFT

- the SW system. After the steam generators boil down to the 55" wide range level, charging feed & bleed is initiated.
2. The use of an additional volume of condensate from the water treatment system's clearwell is credited. Manual alignment of this source of clean water is required, but is not modeled in the MAAP analyses. The use of this water extends the time for which AFW is delivered to the steam generators. The impact on the analysis results is 1) to extend the time available for cooldown to RHR conditions and, 2) to allow additional decrease in the decay heat level, which improves the effectiveness of the charging feed and bleed operation if required.
  3. Credit is given for using the SW system to flow water through an idle AFW pump into the steam generators. This is an operation that may be attempted after all other possible options to get water into the steam generators have failed. It involves performing a rapid depressurization of the steam generators and aligning either SW or firewater into the AFW pump suction piping. The SW header pressure is sufficient to overcome the head difference from the AFW pumps to the steam generators once the secondary pressure drops low enough.

The following are the accident scenarios that are analyzed;

1. *Dual unit loss of offsite power (DLOOP)*. This event causes both units to lose power to all station auxiliaries. It is essentially a loss of normal feedwater with a concurrent reactor trip and reactor coolant pump trip. AFW flow for each unit is assumed to only draw on its respective condensate storage tank (CST) inventory.
2. *Single unit loss of normal feedwater (SLONF)*. This event is similar to the dual-unit event, except that the reactor coolant pumps are assumed to remain on initially, and the inventory of both CST's is available for use on the affected unit. The reactor is allowed to trip on low-low steam generator level.
3. *Small break loss of coolant accident (SBLOCA)*. Three sizes are analyzed; 1/2 inch, 1 inch, and 2 inches. Smaller breaks are within the make-up capability of the charging system, and the ECCS safety injection pumps mitigate larger breaks. This accident scenario does not use charging feed & bleed in the same way as DLOOP and SLONF since charging and SI pumps may already be in service, and a leak path from the RCS is already established. However, the intact steam generator is modeled to be available for decay heat removal and cooldown.
4. *Steam generator tube rupture (SGTR)*. This accident scenario does not use charging feed & bleed in the same way as DLOOP and SLONF since charging and SI pumps may already be in service, and a leak path from the RCS is already established. However, the intact steam generator is modeled to be available for decay heat removal and cooldown.

## Acceptance Criteria

The criterion for acceptable results is that the peak core node temperature remains less than 1800 °F. A brief uncovering of the core is acceptable as long as this temperature criterion is met.

## DRAFT

### Inputs & Assumptions

The major assumptions used in these analyses are as follows;

1. It is assumed that the LOAC event causes a coincident loss of normal feedwater, a reactor coolant pump trip, and a reactor/turbine trip. Basis: In a dual unit LOAC, the loss of AC power would likely cause a plant-wide failure of all plant loads not powered from emergency power. The same is true for a single unit event, but the loss of power is restricted to a single unit's loads.
2. It is assumed that the units are thermal-hydraulically identical for the purposes of this calculation. Basis: In reality, if a dual-unit LOAC occurs, there will be differences in various parameters such as reactor trip times, relief valve setpoints and flow capacities, etc. As a result, AFW flows will not be symmetrical. However, for calculating the CST drain-down time, it is conservative to assume that AFW flow is split symmetrically between all four steam generators. Under this condition, all steam generators will have to be refilled to and maintained at the operating level, maximizing the usage of the CST inventory.
3. It is assumed that the inventories of both CSTs are available to both units. Basis: The CSTs are normally aligned such that they are hydraulically connected for operational purposes (e.g., to allow the inventory to be accessed from either tank, and to prevent level surging transients ("sloshing"). This doesn't affect the dual unit analysis since the units are assumed to behave symmetrically, but does allow the inventory of two tanks to be used for the single unit events.
4. It is assumed that the AFW flow is modeled for this MAAP analysis as a combination of flow from the MDAFW pumps and the TDAFW pump for each unit. For a dual unit event, each steam generator may receive  $(260 + 100 + 100)/2$  GPM = 230 gpm. For a single unit event, each steam generator may receive  $(260 + 200 + 200)/2$  gpm = 330 gpm. (see Inputs 7 & 8). However, the analysis will limit the total AFW flow if the SG level approaches the normal water level, and throttle the flow back to zero as needed.

Nominal operating conditions and setpoints are used as inputs for all of the analyses.

1. Rated thermal power is 1518.5 MWt.
2. Initial steam generator water mass corresponds to a nominal operating level (64% NR).
3. The nominal and initial pressurizer pressures are 2250 psia.
4. When modeled, the pressurizer sprays are fully open at 2325 psia.
5. When modeled, the pressurizer heaters are fully on at 2235 psia.
6. The nominal CST level is 17.05 ft for the dual-unit case, and 16.0 ft for the single-unit case. These values are based on a review of operational data for a one-year period, and are determined at a 95% confidence level.

## DRAFT

7. The AFW TD pumps provide a nominal flow of 260 gpm at 1200 psia. Even though the design capacity of the TDAFW pumps is 400 gpm, they are throttled to provide a total flow of 260 gpm. MAAP uses nominal values for the constant flow AFW feature.
8. The AFW MD pumps provide a nominal flow of 200 gpm at 1200 psia. MAAP uses nominal values for the constant flow AFW feature.
9. Flow capacity of one charging pump is 60.5 gpm.
10. The low-low level setpoint in the CST is at 8 ft indicated level.
11. The flow of service water into the steam generators through an idle AFW pump has been estimated from plant data (PBNP calculation 2003-0021, Revision 0).
12. The clearwell inventory available for transfer to the CSTs is assumed to be at 60 inches. Normally, the clearwell is kept above this level.

## Results

The summary of results is provided in the Table 1. The table gives a brief description of the transient, timing results for the CST drain down, time to reach RHR cut-in conditions or sump recirculation criteria (as applicable), and time to initiate charging feed and bleed (if applicable). Values given as ">24 hrs" indicate that the long term cooling criteria had not been met within the analysis time of 24 hours. However, in these cases the results indicate stable or decreasing temperatures. The table also gives the peak core node temperature reached, or trend if temperature does not increase during the transient, and a time to core damage (if applicable). Note that these are draft results that are subject to change pending validation of the inputs and the analyses.

### *Dual Unit Loss of Offsite Power*

The CST is drained down to the 8-foot level at approximately 1.5 hours. The use of charging feed and bleed (initiated at 4.8 hours) provides enough decay heat removal to maintain core cooling well below the acceptance criteria of 1800 °F. A sensitivity analysis examined delaying the initiation of charging feed and bleed by one hour. The result showed a minor increase in the peak core node temperature.

Use of Service Water (SW) injection into the steam generators under low pressure results in the core remaining covered, and in a lower peak core node temperature.

### *Single Unit Loss of Normal Feedwater*

The CST is drained down to the 8-foot level at approximately 2.2 hours presuming the reactor trips on a low-low level steam generator level. The use of charging feed and bleed (initiated at 5.7 hours) provides enough decay heat removal to maintain core cooling well below the acceptance criteria of 1800 °F.

A loss of all normal feedwater may occur as a result of failure of the buses that supply power to the main feedwater pumps, reactor coolant pumps, and reactor trip breakers. A

## DRAFT

sensitivity analysis was therefore also performed that credited an immediate reactor trip and reactor coolant pump trip. In this case, the CST drain down time was approximately 4.8 hours. The use of charging feed and bleed (initiated at 8.8 hours) provides enough decay heat removal to maintain core cooling well below the acceptance criteria of 1800 °F.

The use of Service Water (SW) injection into the steam generators under low pressure results in part of the core becoming uncovered for a period of time. However, the peak core node temperature remains well below the acceptance criteria of 1800 °F.

The use of additional clean water from the make-up water treatment plant clearwell allowed sufficient cooling to reach the RHR cut-in temperature in approximately 5 hours. The cooldown was assumed to begin 30 minutes after the initiating event, and progressed at a rate of approximately 50 °F/hr.

### *Small Break Loss of Coolant Accident*

This analysis assumed three small break sizes (1/2", 1", and 2"), both with and without the high pressure safety injection (SI) pumps available. The cases where the SI pumps were available resulted in adequate core cooling with no drain down of the CST to the 8-foot level. For cases in which the SI pumps were unavailable, the two larger breaks (2" and 1") resulted in a peak core node temperature excursion, but remained well below the acceptance criteria of 1800 °F using charging injection. The peak core node temperature for the smallest break (1/2") remained stable or decreasing.

### *Steam Generator Tube Rupture*

The SGTR accident by default will use high head SI pumps and charging pumps as needed to maintain reactor coolant inventory. It also requires the AFW system to cool down the intact SG to allow the RHR system to be used for heat removal, thus terminating any further steam releases to the environment. This analysis is primarily concerned with the ability to maintain core cooling and inventory.

The base case results show that the CST will drain down to the 8-foot level in approximately 3.6 hours. This assumes that the cool down begins 30 minutes after the event occurs and assumes a cool down rate of 100 °F/hr. The use of the clearwell inventory to augment the CST inventory predicts that the RHR cut-in temperature is reached in 8.5 hrs. The use of the SW injection into the steam generators under low pressure results in the core remaining covered, and in decreasing peak core node temperature.

DRAFT

<b>Table 1 - MAAP Analyses Timing &amp; Success Criteria Results</b>						
<b>Run #</b>	<b>Description</b>	<b>Time to drain CST to 8 feet</b>	<b>Time to RHR Cut-In or Sump Recirc.</b>	<b>Time to initiate charging F &amp; B</b>	<b>Peak core node temperature</b>	<b>Time to core damage</b>
<b><i>DLOOP Case</i></b>						
1a	F & B w/60 gpm charging flow	1.5 hrs	>24 hrs	4.8 hrs	1031 °F	None
1b	No F & B	1.5 hrs	N/A	N/A	> 1800 °F	7.9 hrs
1c	F & B delayed one hour	1.5 hrs	>24 hrs	4.8 hrs	1037 °F	None
1d	Use of SW through idle AFW pump	1.5 hrs	>24 hrs	N/A	696 °F	None
<b><i>SLONF Case</i></b>						
2a	F & B w/60 gpm charging flow	2.2 hrs	N/A	5.7 hrs	1037 °F	None
2aa	F & B w/60 gpm charging flow – Prompt Rx & RCP trip	4.8 hrs	N/A	8.8 hrs	985 °F	None
2b	No F & B	2.2 hrs	N/A	N/A	>1800 °F	8.9 hrs
2c	Use of SW through idle AFW pump	2.2 hrs	>24 hrs	N/A	1011 °F	None
2d	Use of clearwell inventory	N/A	5 hrs	N/A	N/A	None
<b><i>SBLOCA Case</i></b>						
3a	2" break w/HPI	Remains > 8'	3.3 hrs for xfr to sump recirc.	N/A	Decreasing	None
3b	2" break w/o HPI	Remains > 8'	>24 hrs for xfr to sump recirc.	N/A	1162 °F	None

DRAFT

<b>Table 1 - MAAP Analyses Timing &amp; Success Criteria Results</b>						
<b>Run #</b>	<b>Description</b>	<b>Time to drain CST to 8 feet</b>	<b>Time to RHR Cut-In or Sump Recirc.</b>	<b>Time to initiate charging F &amp; B</b>	<b>Peak core node temperature</b>	<b>Time to core damage</b>
3c	1" break w/HPI	Remains > 8'	5.8 hrs for xfr to sump recirc.	N/A	Decreasing	None
3d	1" break w/o HPI	Remains > 8'	>24 hrs for xfr to sump recirc	N/A	1061 °F	None
3e	½" break w/HPI	5.1 hrs	>24 hrs for xfr to sump recirc.	N/A	Decreasing	None
3f	½" break w/o HPI	4.0 hrs	>24 hrs for xfr to sump recirc	N/A	Decreasing	None
<b><i>SGTR Case</i></b>						
4a	Base case	3.6 hrs	> 24 hrs	N/A	Decreasing	None
4b	Use of clearwell inventory	N/A	8.5 hrs	N/A	N/A	None
4c	Use of SW through idle AFW pump	3.6 hrs	> 24 hrs	N/A	Decreasing	None

**ATTACHMENT 6**

**Summary of Human Error Analysis (Preliminary)**

**POINT BEACH NUCLEAR PLANT, UNITS 1 AND 2**

- 1 Human Error Probability Development .....2
  - 1.1 General Approach .....2
  - 1.2 Quantification .....2
    - 1.2.1 Stress .....3
    - 1.2.2 Recovery .....4
    - 1.2.3 Dependencies .....5
- 2 Results.....8
  - 2.1 Failure to control AFW pump flow .....8
    - 2.1.1 Single unit event.....9
    - 2.1.2 Dual unit event .....9
    - 2.1.3 Loss of instrument air .....10
  - 2.2 Loss of heat sink.....15
    - 2.2.1 Cognition to enter CSP-H.1 .....19
    - 2.2.2 Cognition to enter Feed and Bleed.....20
    - 2.2.3 Feed and bleed .....21
    - 2.2.4 Feed and bleed using charging in CSP-H.1 .....22
    - 2.2.5 Cognition to enter CSP-C.1 .....23
    - 2.2.6 Feed and bleed using charging in CSP-C.1 .....24
    - 2.2.7 Supply S/G with service water given instruction .....25
    - 2.2.8 Supply S/G with service water given no specific instruction .....26
    - 2.2.9 Supply S/G with fire water given instruction .....27
    - 2.2.10 Isolate fire water diversion paths .....28

# 1 Human Error Probability Development

## 1.1 General Approach

Post-initiator human interactions occur after an initiating event and consist of a cognitive element and an execution element. The cognitive element includes detection, diagnosis and decision-making, while the execution element consists of manipulation tasks. Post-initiator human interactions occur in response to some cue; the cue may be the initiating event itself, an alarm, a procedural step or an observation. Post-initiator human interactions are dynamic and subject to time constraints, which is assumed to increase the level of dependency between members of the crew. This will increase the joint probabilities of failure. Stress generally increases the probability failure. Some performance shaping factors may mitigate the stress level thus decreasing the probability of failure, while other performance shaping factors may aggravate the stress level thus increasing the probability of failure. Post-initiator human interactions are analyzed in a cue-response time framework.

The general approach to the post-initiator HRA is as follows:

- IDENTIFY through a systematic review of the relevant procedures the set of operator responses required for each of the accident sequences.
- DEFINE human failure events that represent the impact of not properly performing the required responses, consistent with the structure and level of detail of the accident sequences.
- ASSESS the probability of each HFE using a well-defined and self-consistent process that addresses the plant-specific and scenario-specific influences on human performance, and addresses potential dependencies between human failure events in the same accident sequence
- ASSESS recovery actions (at the cutset or scenario level) and model only if it has been demonstrated that the action is plausible and feasible for those scenarios to which they are applied. Estimates of probabilities of failure shall address dependency on prior human failures in the scenario

## 1.2 Quantification

A general framework for analyzing post-initiator human errors is shown in Figure 1-1. In response to a cue, a cognitive error, denoted as  $p_c$ , can lead to failure of the human interaction if not recovered. If cognition is successful, an execution error, denoted as  $p_E$ , can lead to failure of the human interaction if not recovered. The cognitive HEPs are analyzed and quantified using the cause based decision tree method (CBDTM) [EPRI TR-100259], while the execution HEPs are analyzed and quantified using the technique for human error rate prediction

(THERP) [NUREG/CR-1278] embodied in the EPRI *HRA Calculator*<sup>TM</sup> version 2.01.

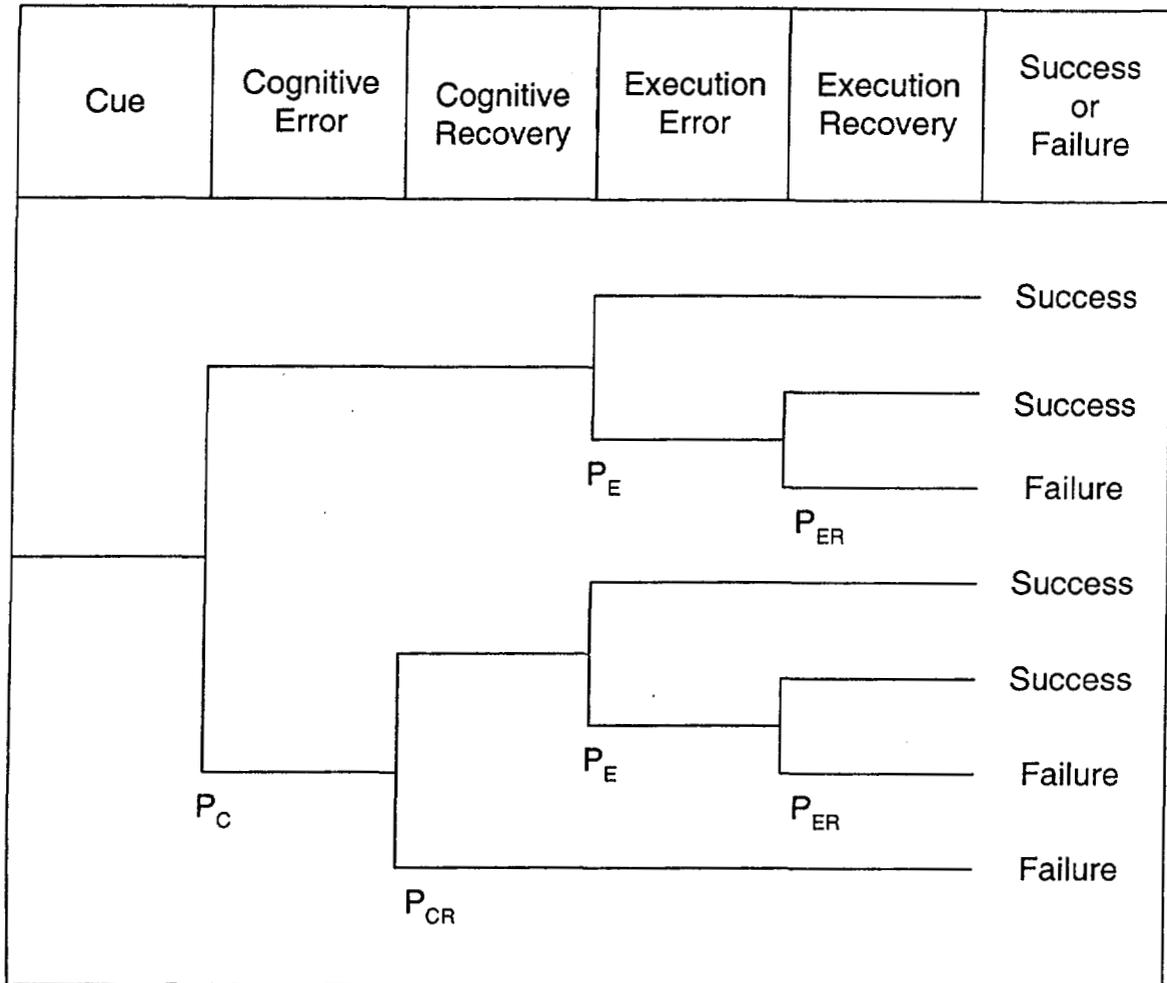


Figure 1-1: Assessment of Post-Initiator Human Error Probabilities

**1.2.1 Stress**

Operators are usually highly skilled in performing the necessary tasks - most having more than ten years experience and each having more than 6 months experience. In most cases, optimum stress is applied due to the level of experience, the nature of the event and lack of being unduly challenged in performing the procedure-directed tasks. Some events, however, result in a high stress situation. For example, a steam generator tube rupture (SGTR) event would in general result in a high stress situation and the nominal human error probabilities would be modified as appropriate.

Application of stress factors in HRAs tends to be quite subjective, and can vary considerably between analyses. The following is suggested to consider stress more objectively:

- a. Optimum stress (x1) is usually applied to tasks directed by the emergency operating procedures (EOPs). In some cases, such as steam generator tube rupture, the stress level is judged higher and a moderate stress (x2) is applied.
- b. Moderate stress (x2) is usually applied to task directed by the critical safety function (CSP) or emergency contingency action (ECA) procedures.
- c. Extreme stress (x5) is applied if additional human interaction is required because of subsequent equipment failure whilst in an FR or ECA.

The above stress guidelines are based on how far the plant is from core damage. These stress levels can be further increased if it is judged that there are further aggravating factors. For example, if the operator has reached the last step in a CSP procedure before core damage would occur should the step fail, extreme stress would be warranted. If there is a fire which causes the initiating event and impacts the instrumentation required to mitigate, a higher stress level than those given above would be justified.

The stress multipliers are applied to the execution HEPs only, as the impact of stress on cognition is implicitly accounted for in the CBDTM by considering the factors that would increase or decrease stress e.g. low vs. high workload.

### 1.2.2 Recovery

Recovery is only credited if there is a definite cue or alarm to alert the operator to revisit the decision. The operators must also receive training on the recovery. Examples include, a circular path through the procedure (but taking care that this does not allow self-recovery from error modes that represent misunderstanding), an alarm (except where already credited in the decision tree), or the STA following the critical safety function status trees.

It is assumed that each operator is responsible for completing specific tasks. Crew composition varies from site to site. Generally, there is a Control Room Supervisor (CRS), Reactor Operator (RO) and a Balance of Plant Operator (BOP) who are normally in the control room; there is a Shift Supervisor (SS) and a Shift Engineer (SE, who is also the STA) on each operating crew. The RO and BOP operators are familiar with the operations and controls in the entire control room; each is assigned one position for a shift, but can be rotated to the other position on a different shift. For non-time critical actions where the extra crew members are not specifically assigned to other tasks, a recovery factor for the extra crew member is generally credited. Credit for STA actions, generally Critical Safety Function Status Tree related, should not be assumed until 15 minutes after the initiating event occurs.

The time variable enters the analysis through application of recovery factors such

as extra crew, STA review, and shift change. Recovery may be accomplished by the same crew member who initially executed the critical steps or it could be by other crew members, the STA, ERF or the next shift. Recovery by other crew members, the STA, ERF or the next shift could only be credited when it is certain that they would be in the CR. The Emergency Response Facility (ERF) Review recovery factor is not applied if the human interaction takes place less than 1 hour into the sequence, or if the time available for the human interaction is less than 1 hour. The Technical Support Center (TSC) and Operations Support Center (OSC) are typically manned within one hour of an emergency plan declaration. Usually, recovery factors are effective at the times shown in Table 1-1.

**Table 1-1: When Recovery Factors Could Be Credited**

Recovery Factor	Time Effective
Other Crew	On multi-unit plants with physically adjacent control rooms, crew from the <i>unaffected</i> unit/s can be credited at any time. If the initiating event affects all units (e.g. LOOP), crew from the other unit should not be credited.
STA	15 minutes after reactor trip.
ERF	1 hour after reactor trip.
Shift Change	6 hours after reactor trip given 8 hour shifts 9 hours after reactor trip given 12 hour shifts

Although multiple instances for recovery can typically be identified, it is prudent to only credit the single, most certain recovery factor – especially when the time window is less than an hour. This may be slightly conservative, but it is more defensible. If the time window is very long (several hours), the application of multiple recoveries is more defensible. However, for the sake of consistency in the HRA, it is advisable to adhere to policy of crediting a single recovery factor only.

### 1.2.3 Dependencies

#### 1.2.3.1 Dependency within the same HFE

Dependency within the same HFE is applicable whenever recovery factors are credited or when there are redundant actions. Redundant actions are actions along an alternative success path. For example, in a case where the operator is required to manually start RHR where only one train of RHR is required, there

may be separate steps in the procedure that direct the operator to first start train A and later to start train B. The starting of train B is redundant to the starting of train A, because only 1 train is required. The operator needs to fail both steps in order to fail the action. In the quantification of the action, the dependency between the failure of the first step and the failure of the second step need to be considered.

The determination of the level of dependence between two actions is not an exact science and remains quite subjective. Many factors may influence the level of dependence such as timing, location, procedure and the relationship between persons performing the actions. These factors should be discussed and reviewed by plant operations personnel. For post-initiator actions, timing is deemed the important underlying factor. The SCIENTECH guidance is to establish a minimum level of dependence based on the timing, and to adjust this level of dependence higher if additional factors influencing dependencies are identified. The minimum level of dependence based on timing between human interactions is shown in Figure 1-2.

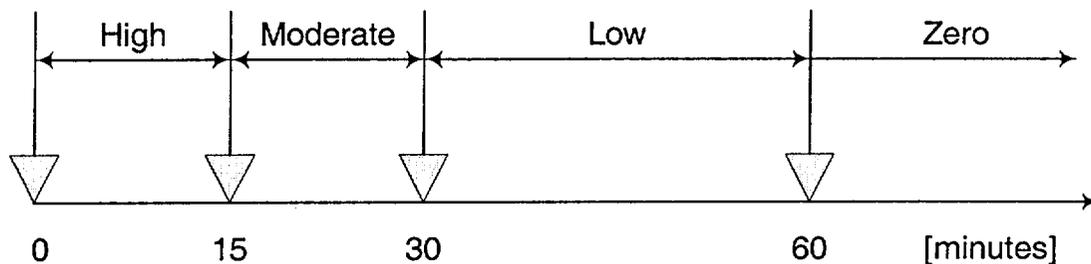


Figure 1-2: Level of Dependence as a Function of Time

The conditional probability of one action given another action, within the same HFE, is usually quantified by determining the *level* of dependency and then applying the formulas from THERP Table 20-17 that are reproduced below in Table 1-2.

Table 1-2: Conditional Probability Equations

Level of Dependence	Conditional Probability Equation ( $N = \text{HEP}$ )	Approximate Value for Small $N$
Zero dependence (ZD)	$N$	$N$
Low Dependence (LD)	$\frac{1+19N}{20}$	0.05

**Table 1-2: Conditional Probability Equations**

Level of Dependence	Conditional Probability Equation ( $N = \text{HEP}$ )	Approximate Value for Small $N$
Medium dependence (MD)	$\frac{1 + 6N}{7}$	0.14
High Dependence (HD)	$\frac{1 + N}{2}$	0.5
Complete Dependence (CD)	1.0	1.0

### 1.2.3.2 Dependency between different HFEs

Dependencies between different HFEs are important to consider where such HFEs occur in the same cutset or accident sequence. If dependencies are not considered, the cutset probabilities, and hence the top event probability, can be significantly underestimated. Dependencies may be identified and examined during the initial review of event tree sequences, during operator interviews, and during review of cutsets with multiple operator actions.

The first step in the cutset review is to identify the cutsets with HFE combinations. There are various procedures for doing so. Typically, all HEPs will be set to 1.0 to identify cutsets with the highest risk achievement worth HFE combinations. This also serves to identify cutsets with probabilities that remain below some truncation limit even with all HEPs set to 1.0, and therefore does not warrant any further analyses. The procedure for identifying HFE combinations could be iterative.

The second step is to screen the important combinations of HFEs identified above. Generally, pre-initiator HFEs and post-initiator HFEs could be considered independent. However, there are cases such as with miscalibration of instrumentation channels, where the post-initiator HFE would be increased because of the miscalibration. Pre-initiators are also generally considered independent of each other.

The third step is to analyze each HFE combination that cannot be screened out. Factors that can cause dependencies between HFEs are:

- Common cues
- Relatively short time separation between HFEs
- Same location
- Same person performing actions
- Same procedure
- Staffing resources

A combination of post-initiator HFEs is first analyzed to determine if there is a common cue. If so, a common cognitive element should be modeled for them. This would entail modeling a cognitive HFE as a separate basic event and replacing each dependent basic event with an OR gate that has in its domain the common cognitive HFE and the "independent" part of the dependent HFE.

The conditional probabilities of dependent HFEs can be quantified either by explicit analysis or by applying the conditional probability equations of Table 1-2 above. However, explicit analysis is always the preferred method, especially for important combinations.

## **2 Results**

### **2.1 Failure to control AFW pump flow**

A potential AFW pump common cause failure mechanism had been identified due to the design of the recirculation line orifices. The concern was that if the AFW suction had to be switched to the service water system, the orifices might have clogged, as the service water strainer mesh is 1/8 inch while the AFW orifice channel holes were much smaller. AFW suction has to be switched to service water on condensate storage tank low-low level (8 feet level). This level would have been reached within approximately 1.5 hours in the event of a dual unit loss of offsite power. In a single unit scenario, this level would have been reached in approximately 4.5 hours. Had AFW pump suction been switched over and the orifices of the running pump/s clogged, the running AFW pump/s would have failed.

Given a scenario where the running pump/s failed on switchover to service water, there would have been some potential for the operators to diagnose the cause of the failure/s and to then control the remaining pump/s in a stop-start (batch) mode. In stop-start mode, the operators would fill the S/Gs to 64% (NR) and then stop the pump/s. When the S/G levels had boiled off to 29% (NR), the operators would restart the pumps and fill the S/Gs again. This control regime would not have depended on recirculation flow, so orifice blocking would not have constituted a failure mode. Running the remaining pumps in a stop-start control regime would have been the only successful strategy to prevent the failure of all AFW pumps and hence loss of the AFW system.

In the event that a running pump/s had failed on switchover to service water, the diagnosis of the cause of failure would have been complicated by the lack of any direct indications to the cause. Recirculation flow rate is not indicated in the control room, but a local flow indicator is provided on each recirculation line. The only flow indication in the control room is on forward flow to the S/Gs. Had a pump failed due to a blocked orifice in the recirculation line, the local flow indicator would have been of no use after the failure. The operators would have had to diagnose the cause from indirect indications and cues.

The HEPs for failure to diagnose the cause of the running AFW pump failures and implementing a start-stop running regime in mitigation are summarized in Table 2-1 and discussed in the following sub-sections.

Event	HEP
Single unit event	1.0
Dual unit event	0.8
Loss of Instrument Air	0.4

### 2.1.1 Single unit event

The diagnosis of the cause of failure and mitigating control strategy for a single unit event is examined in the decision tree in Figure 2-1. The initiating event is postulated as a loss of offsite power that is not recovered within 4 hours requiring AFW suction switchover to service water. After switchover to service water, the running TDAFW pump is assumed to fail. Given the TDAFW pump failure, it is deemed that the operators would in, most cases, not diagnose that service water is related to the failure ( $P_{\text{cog}} = 0.84$ ) – as the failure of a single pump would most probably be ascribed to random causes. Given that the operators would not diagnose service water as related to the cause of failure, it is deemed that they would start both the standby MDAFW pumps without any delay ( $P_{\text{cog}} = 0.99$ ). This sequence constitutes the dominant sequence ( $P_{\text{cog}} = 0.83$ ). If the operators diagnose that service water is related to the cause of failure, it is deemed that they would delay starting the standby MDAFW pumps in most cases ( $P_{\text{cog}} = 0.89$ ), or in some cases, they may declare the AFW inoperable ( $P_{\text{cog}} = 0.1$ ). If the operators delay the start of the standby MDAFW pumps, they would have approximately an hour for diagnosis before they would be procedurally required to start the pumps on S/G NR 29% level. During this hour available for diagnosis, it is deemed that, most of the time, the operators would not diagnose that the orifices are blocked ( $P_{\text{cog}} = 0.73$ ). No credit is given to the TSC for diagnosis as complete dependence is assumed. Given that the crew would not diagnose blocked orifices, they would start the MDAFW pumps and throttle flow as soon as S/G levels are recovered – leading to failure of the MDAFW pumps and loss of the AFW system. The total probability of cognitive failure is calculated as  $0.961 \approx 1.0$ .

### 2.1.2 Dual unit event

The diagnosis of the cause of failure and mitigating control strategy for a dual unit event is examined in the decision tree in Figure 2-2. The initiating event is postulated as a dual loss of offsite power that is not recovered within 1.5 hours requiring AFW suction switchover to service water. After switchover to service water, the running TDAFW pumps are assumed to fail. Given the failure of the

TDAFW pumps, it would be unlikely for the operators not to diagnose that service water is related to the failure ( $P_{\text{cog}} = 0.16$ ) – as the failure of both pumps in quick succession would most probably be ascribed to common causes. If the operators would not diagnose service water as related to the cause of failure, they would start both the standby MDAFW pumps without any delay ( $P_{\text{cog}} = 0.99$ ). In most cases, the operators would diagnose that service water is related to the failure ( $P_{\text{cog}} = 0.84$ ). Given that the operators would diagnose service water as related to the cause of failure, they would delay the start of the standby MDAFW pumps in most cases ( $P_{\text{cog}} = 0.89$ ), or in some cases, they may declare the AFW inoperable ( $P_{\text{cog}} = 0.1$ ). If the operators delay the start of the standby MDAFW pumps, they would have approximately an hour for diagnosis before they would be procedurally required to start the pumps on S/G NR 29% level. During this hour available for diagnosis, it is deemed that, most of the time, the operators would not diagnose that the orifices are blocked ( $P_{\text{cog}} = 0.73$ ). No credit is given to the TSC for diagnosis as complete dependence is assumed. Given that the crew would not diagnose blocked orifices, they would start the MDAFW pumps and throttle flow as soon as S/G levels are recovered – leading to failure of the MDAFW pumps and loss of the AFW system. The total probability of cognitive failure is calculated as  $0.795 \approx 0.8$ .

### 2.1.3 Loss of instrument air

The diagnosis of the cause of failure and mitigating control strategy for a loss of instrument air (dual unit) is examined in the decision tree in Figure 2-3. On a loss of instrument air, the operators were instructed per the foldout page of E-0 (and some other E procedures) to operate the AFW system in a stop-start mode – relying on forward indicated flow only:

#### AFW MINIMUM FLOW REQUIREMENTS

IF any AFW pump min-recirc valve fails shut OR annunciator C01 A 1-9, INSTRUMENT AIR HEADER PRESSURE LOW in alarm, THEN monitor and maintain minimum AFW flow or stop the affected AFW pump as necessary to control S/G levels.

- P-38A minimum flow – GREATER THAN 50 GPM
- P-38B minimum flow – GREATER THAN 50 GPM
- P-29 minimum flow – GREATER THAN 75 GPM

The basis for the above statement was to mitigate against closure of the AFW recirculation line valves. The problem with the AFW recirculation line valves had been identified prior to the issue with the blocking of the orifices. The blocking of the orifices would have resulted in a similar failure mode as would closure of the recirculation line valves – although the operator would have had no direct indications that the orifices had been blocked. The unintended benefit of the above continuous action statement was that in the event of loss of instrument air, the operators would have run the AFW pumps in a stop/start regime, which would also have mitigated against blocking of the orifices.

Per the loss of instrument air procedure, the operators are instructed to gag open the recirculation flow isolation valves. With these valves gagged open, it would not have been necessary to run the AFW system in accordance with the continuous action statement anymore. However, the operators may have regarded the continuous action statement to remain valid even after the valves were gagged open – continuing to run the AFW in a stop-start mode. Based on the operator interviews, it is deemed that there is a 50/50 chance that the operators would have continued running the AFW in a stop/start mode. This guarantees success in approximately 50% of cases. If the operators had reverted to throttled flow, the running TDAFW pumps would have failed on switchover to service water, and the decision logic following from this node on is the same as in the decision tree for the dual unit event. The total probability of cognitive failure is  $0.418 \approx 0.4$ .

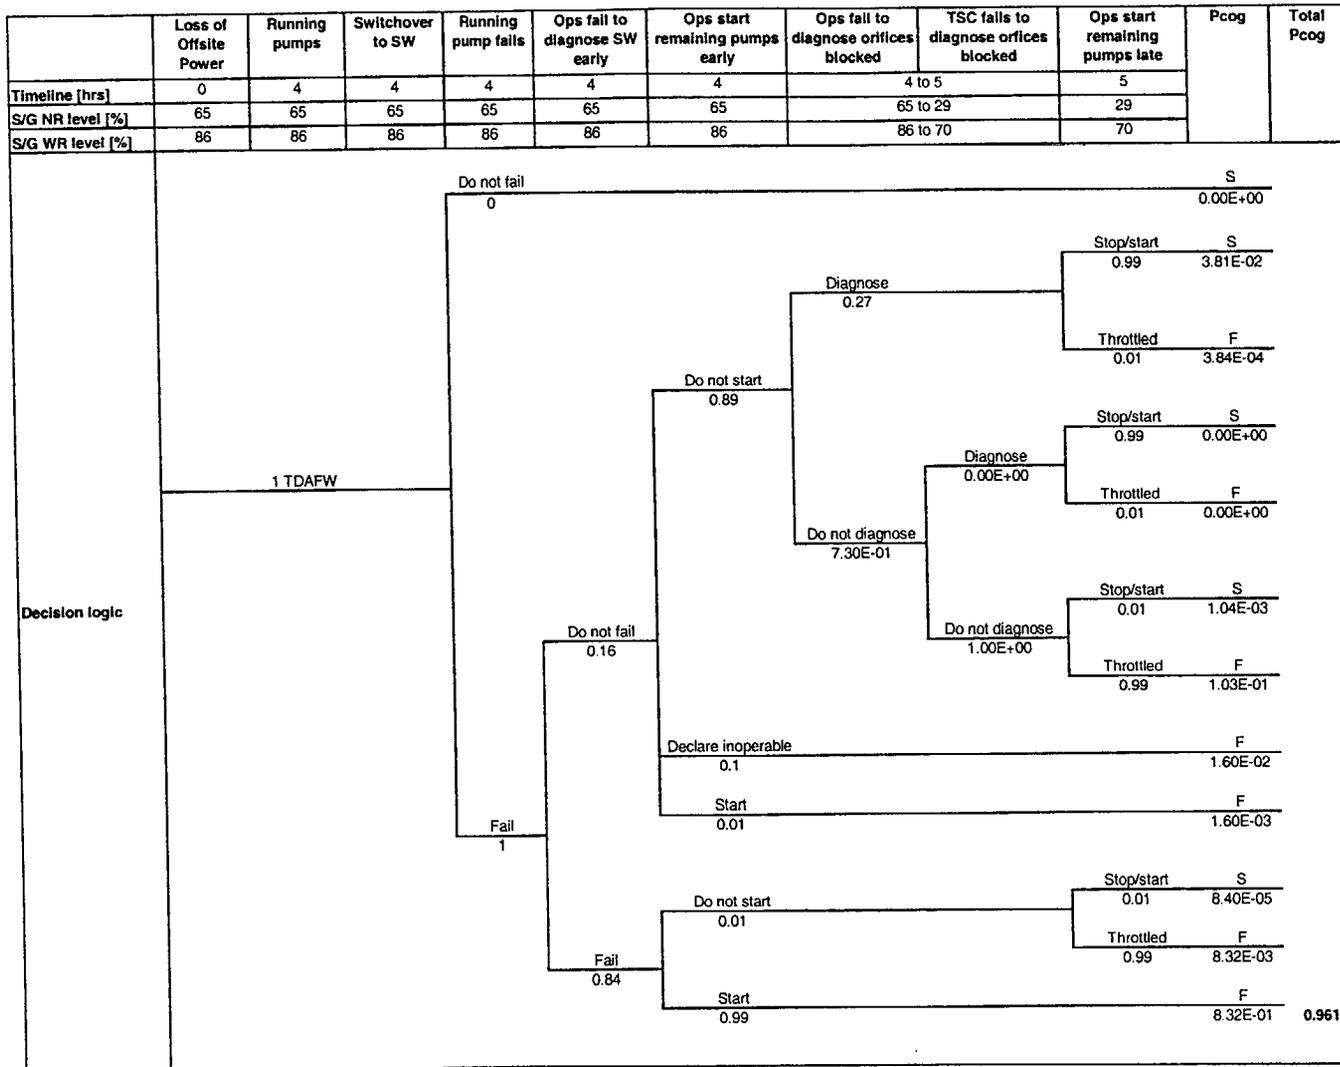


Figure 2-1: Decision logic for failure to control AFW pump flow given a single unit event

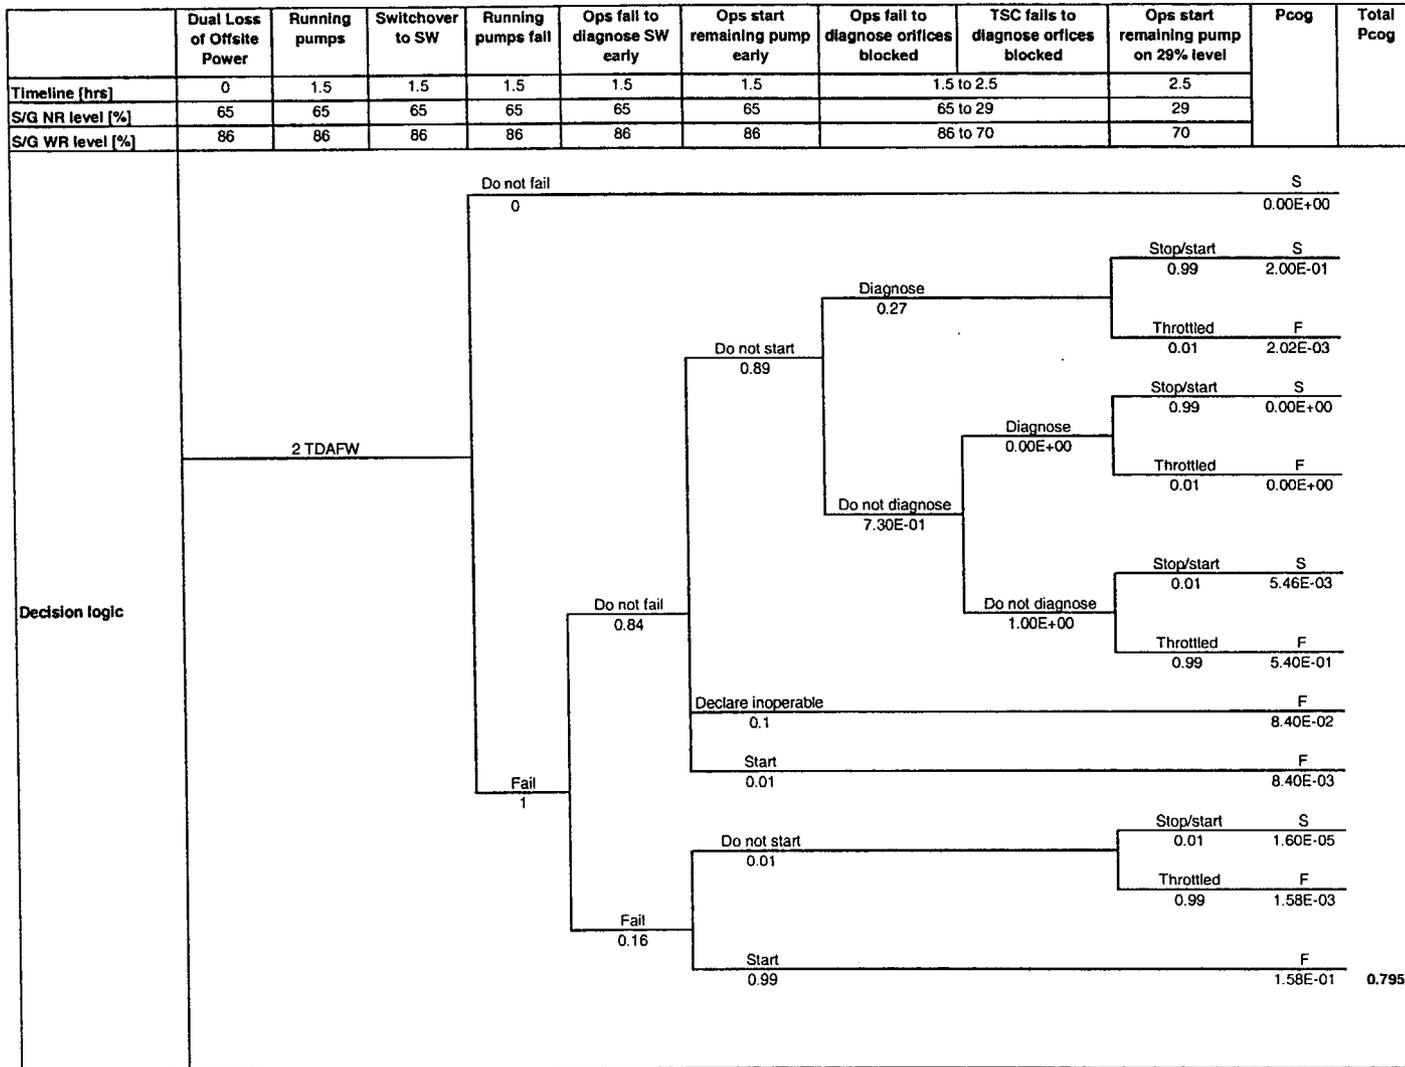


Figure 2-2: Decision logic for failure to control AFW pump flow given a dual unit event



## 2.2 Loss of heat sink

The accident scenarios that are impacted by the orifice plugging issue are scenarios where main feedwater, condensate and make-up to the condensate storage tank are unavailable – requiring the use of AFW and switchover of AFW suction to service water on CST low-low level. Following the failure of the AFW system on switchover to service water, the loss of heat sink procedure (CSP-H.1) is entered on S/G NR level < 29% with total feed flow to the S/Gs less than 200 gpm. The operator actions of interest are those required by CSP-H.1 (and CSP-C.1 in some cases).

The loss of heat sink timeline is based on a dual unit loss of offsite power event. This is most limiting on the time windows as the loss of AFW occurs after approximately an hour-and-a-half when decay heat load is relatively high (compared to single unit events where the switchover occurs after 4 hours). The timeline with time windows are summarized in Table 2-2. The relatively long time windows are the primary mitigating factor in the human reliability analysis as more time is available for cognition, execution and recovery of human errors.

Parameter	Procedure and step	Timeline	Time Window [minutes]
CST level < 13.5'	n/a	20 min	77
CST level < 8'	AOP-23	97 min	77
SG 29% NR	CSP-H.1 steps 1 to 26	2.9 hrs	114
SG 55" WR	CSP-H.1 steps 27 to 38	4.8 hrs	96
SG dry		6.4 hrs	90
RCS T > 700 F + RVLVL < 25'	Enter CSP-C.1	7.2 hrs	42
RCS T > 1800F		7.9 hrs	0

The main decision points and transfers in CSP-H.1 are shown in Figure 2-4. In the first part of the procedure, the operators will be trying to restore AFW, main feedwater and condensate. If condensate remains unavailable, the operators are returned to step 1 and they will keep iterating through the procedure until the entry conditions for feed and bleed are met. When RCS feed and bleed criteria are met, they will transfer to step 27. If an RCS feed path cannot be established, for example if SI is unavailable, the procedure transfers them back to step 1. Assuming a verbatim compliance with procedures, the operators will remain in this iterative loop until the entry criteria for CSP-C.1 are met via the critical function status trees. If an RCS feed path is established, the operators proceed to establish an RCS bleed path by opening the PORVs. If all the PORVs can not be opened, the operators are instructed in the RNO column of step 38 to align

any source (service water, fire water) to an S/G and to depressurize that S/G. Continuing in the procedure, the operators are instructed to maximize charging. In step 46 the operators are instructed to align any available water source to the S/Gs.

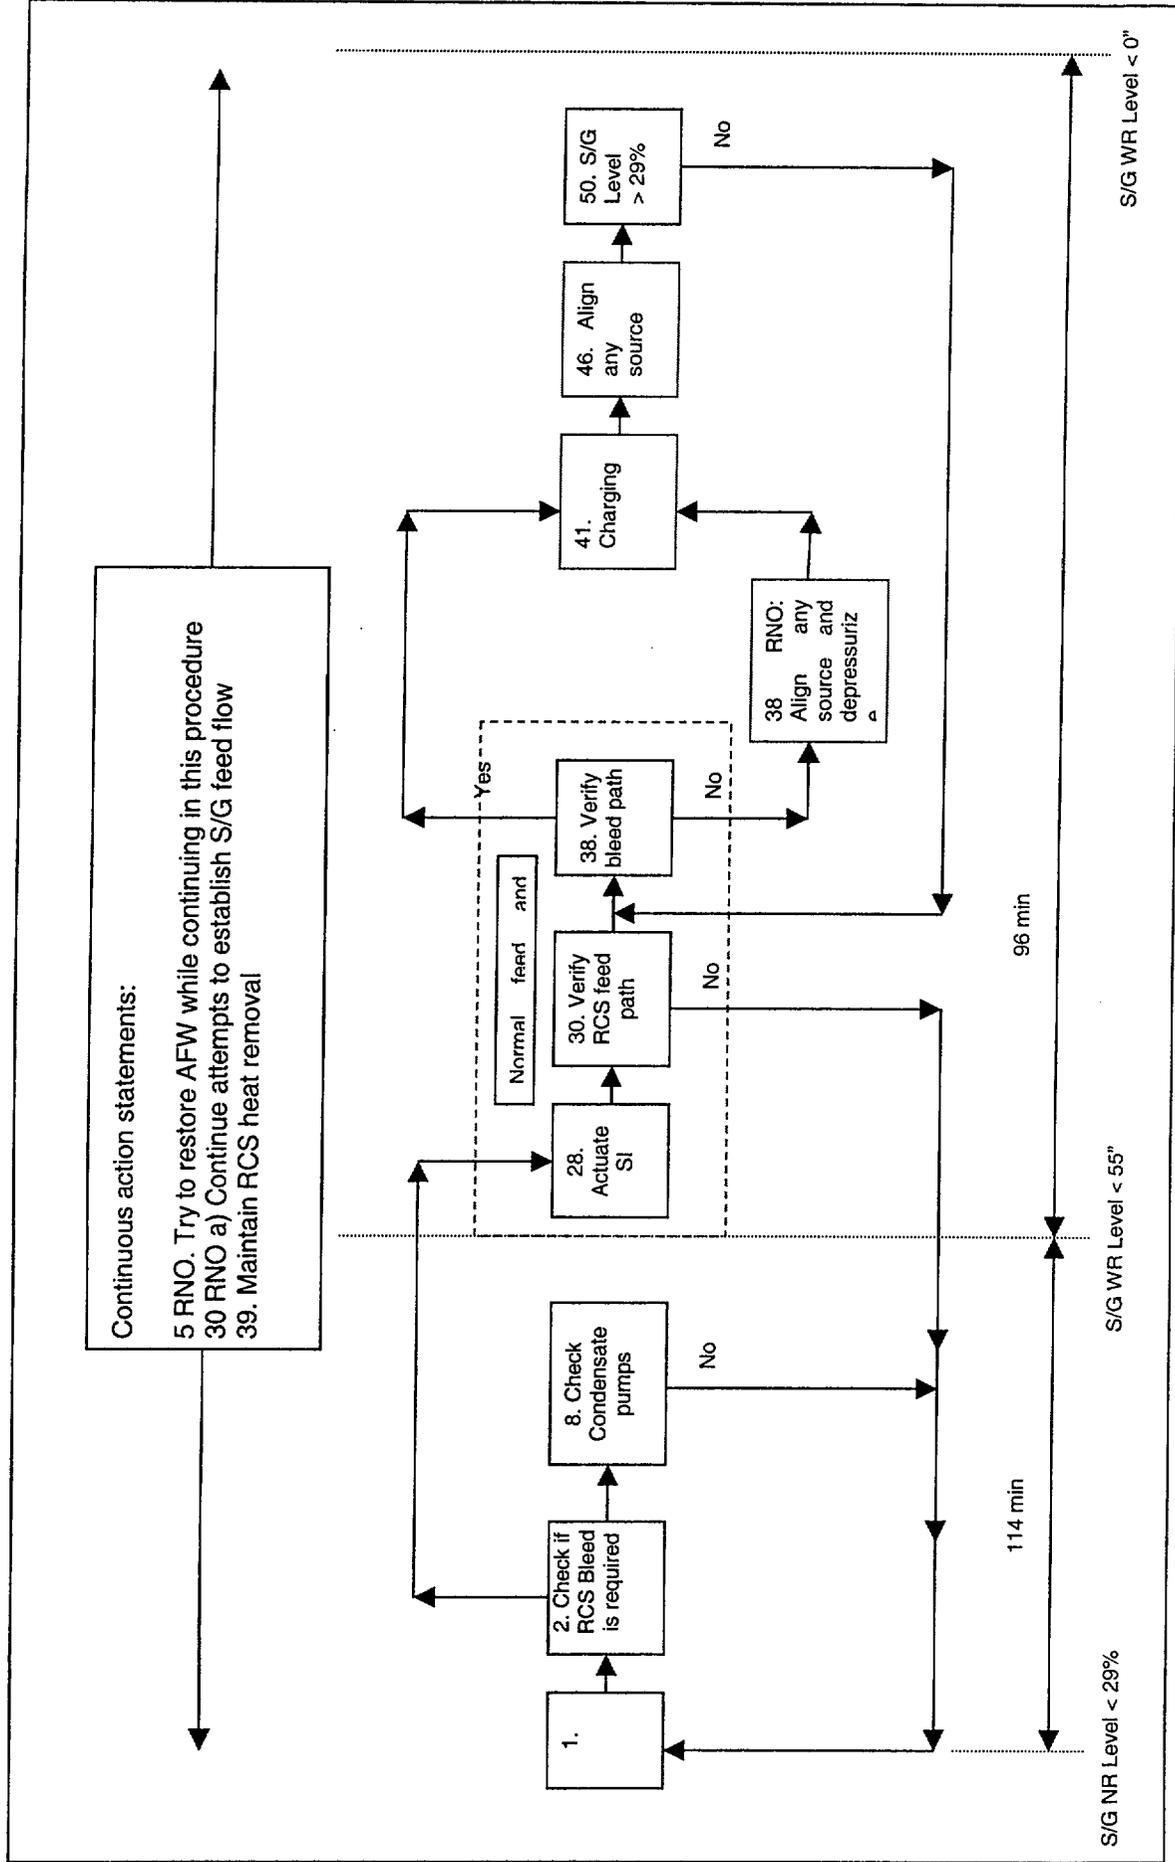


Figure 2-4: CSP-H.1 Flow Chart

The main operator actions credited in loss of heatsink scenarios are:

- Cognition to enter CSP-H.1
- Cognition to enter feed and bleed
- Feed and bleed
- Feed and bleed using charging
- Cognition to enter CSP-C.1
- Feed and bleed using charging in CSP-C.1
- Depressurization of an S/G to allow service water injection
- Depressurization of an S/G to allow fire water injection
- Isolation of fire water diversion flow paths

The main operator action HEPs with error factors and dependency levels used for recovery are summarized in Table 2-3. These dependency levels are used between the initial failure mechanism and the recovery mechanism within the human failure event itself. For example, the cognitive error by the crew to enter the feed and bleed part of CSP-H.1 may be recovered by the ERF with some level of dependence between the crew and ERF accounted for. A high stress level was used in the quantification of the execution part of all these HEPs.

<b>Table 2-3: Loss of Heatsink Operator Action HEPs</b>				
Basic Event ID	Description	Recovery Dependence	HEP	EF
COG-CSP-H.1	Operators fail to enter CSP-H.1	LD	1.20E-03	5
COG-CSP-H.1-F&B	Operators fail to go to F&B	LD	1.30E-03	5
FEEDANDBLEED-MD	Operators fail to establish feed and bleed	MD	9.60E-03	5
FEEDANDBLEED-SI-MD	Operators fail to establish feed and bleed given SI	MD	8.40E-03	5
FB-CHARGING-MD	Operators fail to establish charging	MD	9.90E-03	5
OP- COG-CSP-C.1	Operators fail to enter CSP-C.1	HD	1.10E-02	5
FB-CHARGING-CSP-C.1	Operators fail to establish charging in CSP-C.1	CD	3.80E-02	
OP-SG-SUPPLY-SW-MD	Operators fail to depressurize S/G for service water	MD	1.80E-02	5
OP-SG-SUPPLY-FW-MD	Operators fail to depressurize S/G for fire water	MD	2.00E-02	5
OP-SG-SUPPLY-FIRE-IS	Operators fail to isolate fire water diversion path	MD	2.60E-02	5
OP-SG-SW-SUPPLY-COG-MD	Operators fail to diagnose need for S/G depressurization	MD	3.50E-02	5

The main operator actions are briefly summarized in the following sub-sections:

## 2.2.1 Cognition to enter CSP-H.1

Table 2-4: COG CSP H.1 SUMMARY

Analysis Results:	without Recovery	with Recovery
$P_{COR}$	1.9e-02	1.2e-03
Total HEP		1.2e-03
Error Factor		5

### HFE Scenario Description

Initiating event: Loss of Instrument Air

Accident sequence: E-0, E-0.1, loss of AFW on CST suction switchover to service water at 1.5 hrs, S/G boil down to 29% at 2.5 hours, entry into CSP-H.1 required

Preceding equipment failures: Water Treatment refill of CST unavailable. All AFW pumps failed due to blocked flow restricting orifices in the pump recirculation lines on switchover to Service Water.

**Success criterion:** Enter CSP-H.1

### Related Human Interactions:

The following actions are dependent on this HFE:

- Hotwell make-up using firewater
- Locally opening feedwater regulating bypass valve

**Procedure and step governing HI:** Cognitive: CSP - ST.0, Figure 3

**Cue:** NARROW RANGE LEVEL IN ANY S/G GREATER THAN [51%] 29% (Yes/No)

## 2.2.2 Cognition to enter Feed and Bleed

**Table 2-5: COG-CSP-H.1 F&B SUMMARY**

<b>Analysis Results:</b>	<b>without Recovery</b>	<b>with Recovery</b>
<b>P<sub>cog</sub></b>	2.1e-02	1.3e-03
<b>Total HEP</b>		1.3e-03
<b>Error Factor</b>		5

### HFE Scenario Description

Initiating event: Dual unit loss of offsite power.

Event sequence: E-0, E-0.1, loss of AFW on CST suction switchover to service water at 1.5 hrs, S/G boil down to 29% at 2.5 hours, entry into CSP-H.1, S/G boil down to 55" at 5 hrs requiring feed and bleed.

**Success criterion:** Go to step 27 in CSP-H.1

### Related Human Interactions

This HFE is completely dependent on the cognitive HEP for entering CSP-H.1 (COG-CSP-H.1)

The following actions are completely dependent on this HFE:

- Feed and bleed using SI and PORVs (FEEDANDBLEED-MD)
- Feed and bleed using PORVs given that SI is running (FEEDANDBLEED-SI-MD)
- Feed and bleed using charging (FB-CHARGING-MD)
- SI actuation given charging feed and bleed success (ACTUATE-SI)
- Depressurization of an S/G and supply using service water (OP-SG-SUPPLY-SW-MD)
- Depressurization of an S/G and supply fire water (OP-SG-SUPPLY-FW-MD)
- Isolation of CST given fire water success (OP-SG-SUPPLY-FIRE-IS)

**Procedure and step governing HI:** Cognitive: CSP-H.1 step 2

### Cue:

- o Wide range level in both S/Gs -  
LESS THAN  
[145 INCHES] 55 INCHES
- OR
- o RCS pressure - GREATER THAN  
2335 PSIG DUE TO LOSS OF  
SECONDARY HEAT SINK

### 2.2.3 Feed and bleed

Table 2-6: FEEDANDBLEED-MD SUMMARY

Analysis Results:	without Recovery	with Recovery
$P_{exe}$	6.3e-02	9.6e-03
Total HEP		9.6e-03
Error Factor		5

**HFE Scenario Description:**

Initiating event: Dual unit loss of offsite power

Accident sequence: E-0, E-0.1, loss of AFW on CST suction switchover to service water at 1.5 hrs, S/G boil down to 29% at 2.5 hours, entry into CSP-H.1. S/G boil down to 55" at 5 hrs

Preceding equipment failures: Water Treatment refill of CST unavailable. All AFW pumps failed due to blocked flow restricting orifices in the pump recirculation lines on switchover to Service Water.

RCPs are stopped.

**Related Human Interactions:**

Feed and bleed using charging

**Procedure and step governing HI:**

Execution: CSP-H.1

**2.2.4 Feed and bleed using charging in CSP-H.1**

**Table 2-7: FB-CHARGING-MD SUMMARY**

<b>Analysis Results:</b>	<b>without Recovery</b>	<b>with Recovery</b>
<b>P<sub>exe</sub></b>	6.5e-02	9.9e-03
<b>Total HEP</b>		9.9e-03
<b>Error Factor</b>		5

**HFE Scenario Description:**

Initiating event: Dual unit loss of offsite power.

Event sequence: E-0, E-0.1, loss of AFW on CST suction switchover to service water at 1.5 hrs, S/G boil down to 29% at 2.5 hours, entry into CSP-H.1, S/G boil down to 55" at 5 hrs, normal feed and bleed failure.

**Success criterion:** Establish feed using charging to pump against the primary safety relief valves as bleed.

**Related Human Interactions:**

This HFE depends on the cognitive: CSP-H.1 step 2  
Feed and bleed using SI and PORVs

**Performance Shaping Factors:**

Relatively long time window from S/G low-low level in both S/Gs at 5 hours to core damage at 7.9 hours Feed and bleed initiation can be delayed for an hour after CSP-H.1 entry and still be successful. More than an hour is therefore available for recovery.

**Procedure and step governing HI:** Execution: CSP-H.1 steps 40 + 41

## 2.2.5 Cognition to enter CSP-C.1

**Table 2-8: COG-CSP-C.1 SUMMARY**

<b>Analysis Results:</b>	<b>without Recovery</b>	<b>with Recovery</b>
<b>P<sub>cog</sub></b>	2.1e-02	1.1e-02
<b>Total HEP</b>		1.1e-02
<b>Error Factor</b>		5

### **HFE Scenario Description:**

The operators may get into a do loop in CSP-H.1 in the feed and bleed section if SI fails. On RCS high temperature though, the critical function status trees will get them into C.1 where they will be instructed to maximize charging. Although they will also be instructed to blow down the S/Gs to atmospheric when RCS core exit temp > 1200 F, this will be too late to prevent core damage.

**Related Human Interactions:** Feed and bleed in CSP-H.1

**Procedure and step governing HI:** CSP-ST.0 Figure 2

**Cue:** RCS high temperature.

**2.2.6 Feed and bleed using charging in CSP-C.1**

**Table 2-9: FB-CHARGING-CSP-C.1 SUMMARY**

<b>Analysis Results:</b>	<b>without Recovery</b>	<b>with Recovery</b>
<b>P<sub>exe</sub></b>	3.8e-02	3.8e-02
<b>Total HEP</b>		3.8e-02
<b>Error Factor</b>		5

**HFE Scenario Description:**

The operators may get into a do loop in CSP-H.1 in the feed and bleed section if SI fails. On RCS high temperature though, the critical function status trees will get them into C.1 where they will be instructed to maximize charging. Although they will also be instructed to blow down the S/Gs to atmospheric when RCS core exit temp > 1200 F, this will be too late to prevent core damage.

**Related Human Interactions:**

This HFE completely depends on cognitive success for entering CSP-C.1

**Procedure and step governing HI:** CSP-C.1 step 3a

**2.2.7 Supply S/G with service water given instruction**

**Table 2-10: OP-SG-SUPPLY-SW-MD SUMMARY**

<b>Analysis Results:</b>	<b>without Recovery</b>	<b>with Recovery</b>
<b>P<sub>cog</sub></b>	1.4e-01	1.6e-02
<b>P<sub>exe</sub></b>	1.3e-02	2.0e-03
<b>Total HEP</b>		1.8e-02
<b>Error Factor</b>		5

**HFE Scenario Description:**

IE: Loss of instrument air

Initial conditions: PORVs unavailable due to loss of IA. Recovery of nitrogen supply inside containment not credited. AFW failed due to orifice blocking due to switchover of suction to service water on CST 8 feet level per AOP-23. Main feedwater and condensate unavailable due to loss of IA. The operators end up in the feed & bleed section of CSP-H.1. If an RCS bleed path can not be established, the operators are instructed to align any available water source to an S/G and to depressurize the S/G as required.

Success criteria: Verify service water is available - this is a given as service water was used before as a source to AFW. Depressurize an S/G to allow service water to inject

**Related Human Interactions:** Feed and bleed

**Procedure and step governing HI:** CSP-H.1 step 38 R.N.O.

**Cue:**

PZR PORVs - EITHER ONE NOT OPEN

Service water availability: N Supply Header pressure; PI-2844 on C01, S Supply Header pressure: PI-2845 on C01

Injection path to S/G via AFW: AFW valve status indications

**2.2.8 Supply S/G with service water given no specific instruction**

**Table 2-11: OP-SG-SUPPLY-COG-MD SUMMARY**

<b>Analysis Results:</b>	<b>without Recovery</b>	<b>with Recovery</b>
<b>P<sub>cog</sub></b>	2.0e-01	6.5e-02
<b>P<sub>exe</sub></b>	0.0e+00	0.0e+00
<b>Total HEP</b>		6.5e-02
<b>Error Factor</b>		5

**HFE Scenario Description:**

IE: TIA

Accident sequence: On CST 8 feet level, operators are required to switch AFW suction to service water (SW) per AOP-23. Due to AFW pump recirculation orifice blocking, the AFW pumps fail after switchover to SW. However, the SW system remains aligned to the AFW suction. Per CSP-H.1 step 46, the operators are required to supply the S/Gs with any source of water. With SW already aligned, the S/G can be supplied with service water directly if it is sufficiently depressurized.

**Success criterion:** Depressurize one S/G to allow SW to inject.

**Related Human Interactions:**

Switchover to service water on CST 8 feet level  
Feed and bleed

**Performance Shaping Factors:**

Depressurization of an S/G is part of the fundamental operator skills set.

**Procedure and step governing HI:** CSP-H.1 step 46

**Cue:** Align available water source to one S/G

- Any water source

### 2.2.9 Supply S/G with fire water given instruction

Table 2-12: OP-SG-SUPPLY-FW-MD SUMMARY

Analysis Results:	without Recovery	with Recovery
$P_{cog}$	1.5e-01	1.8e-02
$P_{exe}$	1.3e-02	2.0e-03
<b>Total HEP</b>		2.0e-02
<b>Error Factor</b>		5

**HFE Scenario Description:**

IE: Loss of service water

Initial conditions: Loss of IA due to loss of service water. PORVs unavailable due to loss of IA. Recovery of nitrogen supply inside containment not credited. AFW failed due to orifice blocking due to switchover of suction to fire water on CST 8 feet level per AOP-23. Main feedwater and condensate unavailable due to loss of IA. The operators end up in the feed & bleed section of CSP-H.1. If an RCS bleed path can not be established, the operators are instructed to align any available water source to an S/G and to depressurize the S/G as required.

**Success criteria:** Verify fire water is available - this is a given as fire water was used before as a source to AFW. Depressurize an S/G as necessary to inject fire water.

**Related Human Interactions:**

Feed and bleed  
Isolation of fire water diversion flow paths

**Performance Shaping Factors:**

High stress due to CSP-H.1  
Long time window

**Procedure and step governing HI:** CSP-H.1 step 38 R.N.O.

**Cue:**

Both PORVS are not open.  
Fire water availability: Pressure indicators on back panels  
Injection path to S/G via AFW: AFW valve status indications

**2.2.10 Isolate fire water diversion paths**

**Table 2-13: OP-SG-SUPPLY-FIRE-IS SUMMARY**

<b>Analysis Results:</b>	<b>without Recovery</b>	<b>with Recovery</b>
<b>P<sub>cog</sub></b>	1.2e-01	2.5e-02
<b>P<sub>exe</sub></b>	4.0e-03	5.9e-04
<b>Total HEP</b>		2.6e-02
<b>Error Factor</b>		5

**HFE Scenario Description:**

IE: Loss of service water

Initial conditions: Loss of IA due to loss of service water. PORVs unavailable due to loss of IA. Recovery of nitrogen supply inside containment not credited. AFW failed due to orifice blocking due to switchover of suction to fire water on CST 8 feet level per AOP-23. Main feedwater and condensate unavailable due to loss of IA. The operators end up in the feed & bleed section of CSP-H.1. If an RCS bleed path can not be established, the operators are instructed to align any available water source to an S/G and to depressurize the S/G as required.

Success criteria: Verify fire water is available - this is a given as fire water was used before as a source to AFW. However, in order to pump through the stationary AFW pumps, the CSTs need to be isolated locally from the AFW suction header. The operators must realize that they are not getting flow into the S/G because of the fire water flow diversion taking place.

**Related Human Interactions:** OP-SG-SUPPLY-FIRE

**Procedure and step governing HI:** CSP-H.1 step 38 R.N.O.