

MANUAL HARD COPY DISTRIBUTION
DOCUMENT TRANSMITTAL 2003-29643

USER INFORMATION:

Name: ~~GERLACH*ROSE M~~ EMPL#: 28401 CA#: 0363

Address: ~~NUCSA~~

Phone#: ~~254-3194~~

TRANSMITTAL INFORMATION:

TO: ~~GERLACH*ROSE M~~ 06/24/2003

LOCATION: DOCUMENT CONTROL DESK

FROM: NUCLEAR RECORDS DOCUMENT CONTROL CENTER (NUCSA-2)

THE FOLLOWING CHANGES HAVE OCCURRED TO THE HARDCOPY OR ELECTRONIC MANUAL ASSIGNED TO YOU:

115 - 115 - CHEMISTRY SAMPLING TEAM: EMERGENCY PLAN-POSITION SPECIFIC PROCEDURE

REMOVE MANUAL TABLE OF CONTENTS DATE: 04/16/2003

ADD MANUAL TABLE OF CONTENTS DATE: 06/23/2003

CATEGORY: PROCEDURES TYPE: EP

ID: EP-PS-115


REPLACE: REV:14

REPLACE: REV:14


UPDATES FOR HARD COPY MANUALS WILL BE DISTRIBUTED WITHIN 5 DAYS IN ACCORDANCE WITH DEPARTMENT PROCEDURES. PLEASE MAKE ALL CHANGES AND ACKNOWLEDGE COMPLETE IN YOUR NIMS INBOX UPON RECEIPT OF HARD COPY. FOR ELECTRONIC MANUAL USERS, ELECTRONICALLY REVIEW THE APPROPRIATE DOCUMENTS AND ACKNOWLEDGE COMPLETE IN YOUR NIMS INBOX.

A045

**EMERGENCY ORGANIZATION
CONTROL ROOM**

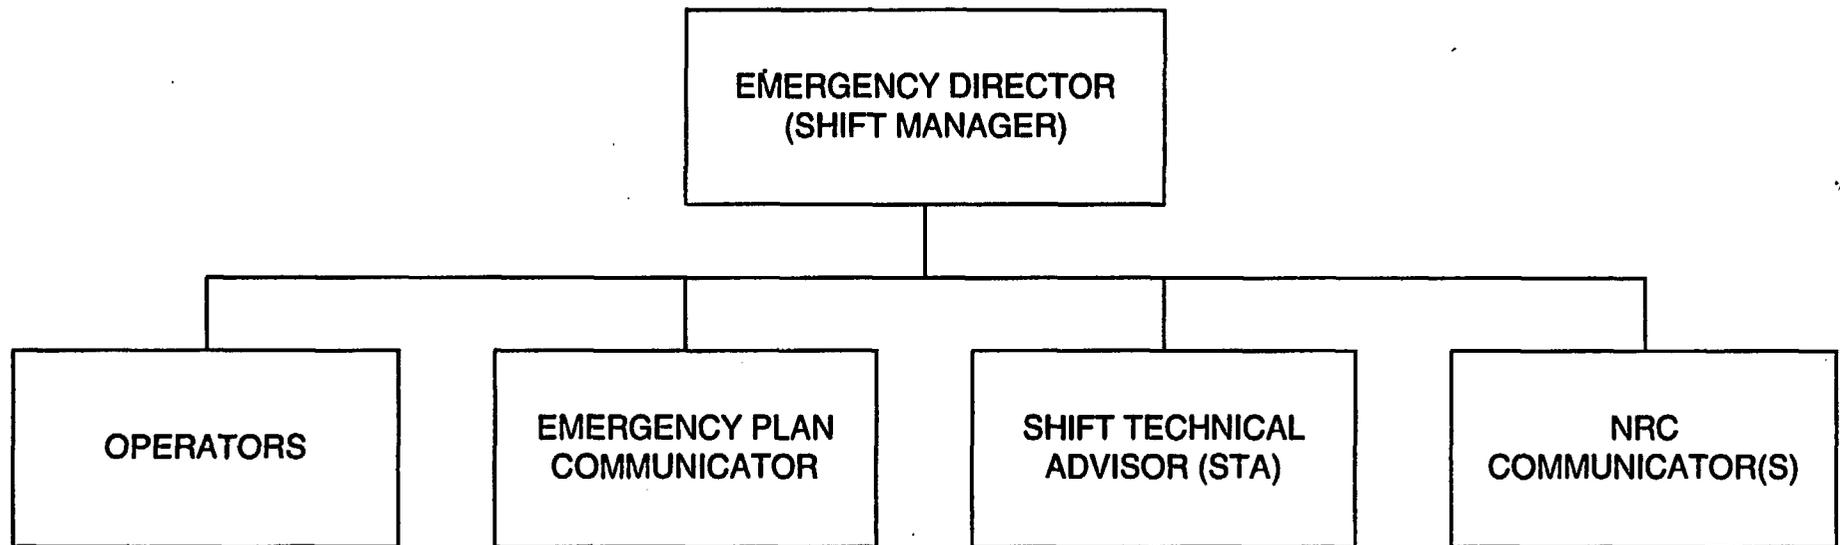

TSC ORGANIZATION

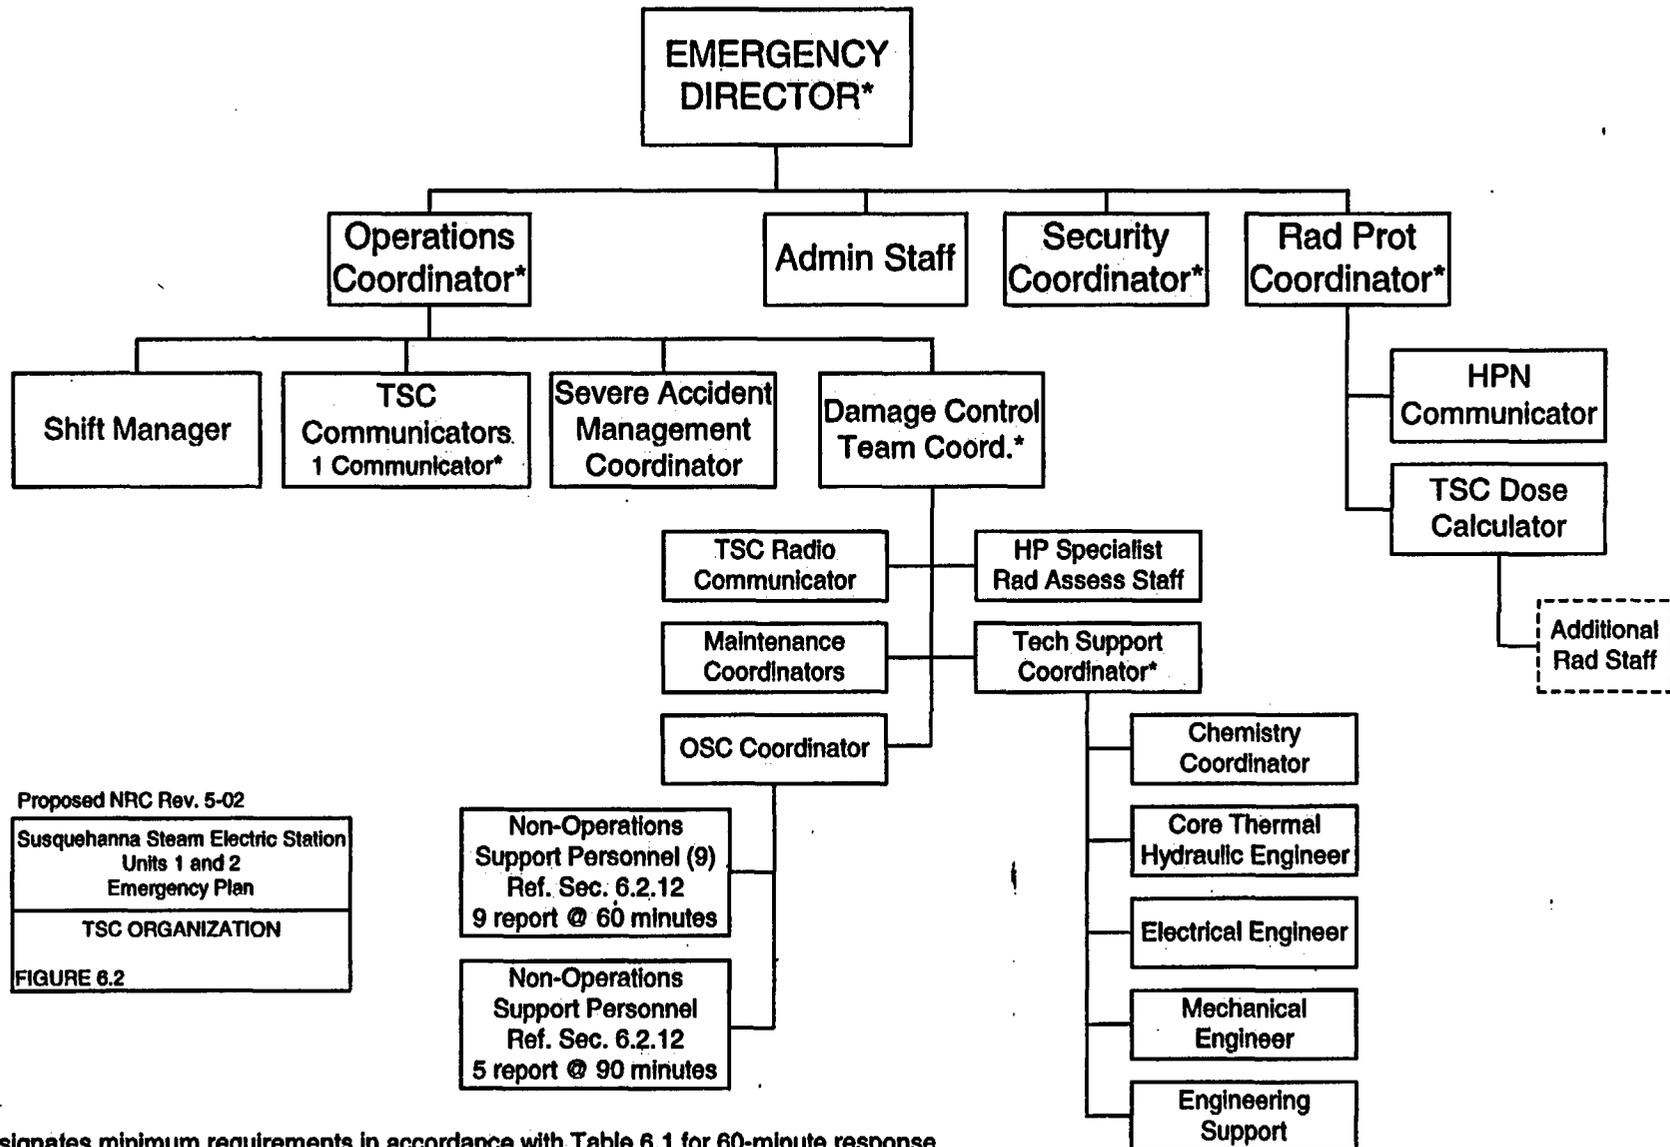


Proposed NRC Rev. 5-02
Susquehanna Steam Electric Station
Units 1 and 2
Emergency Plan
TSC ORGANIZATION
FIGURE 6.2

Designates minimum requirements in accordance with Table 6.1 for 60-minute response.

----- Individuals may be located in the OSC, TSC, or Field.

* Designates positions required for TSC activation.

EOF ORGANIZATION

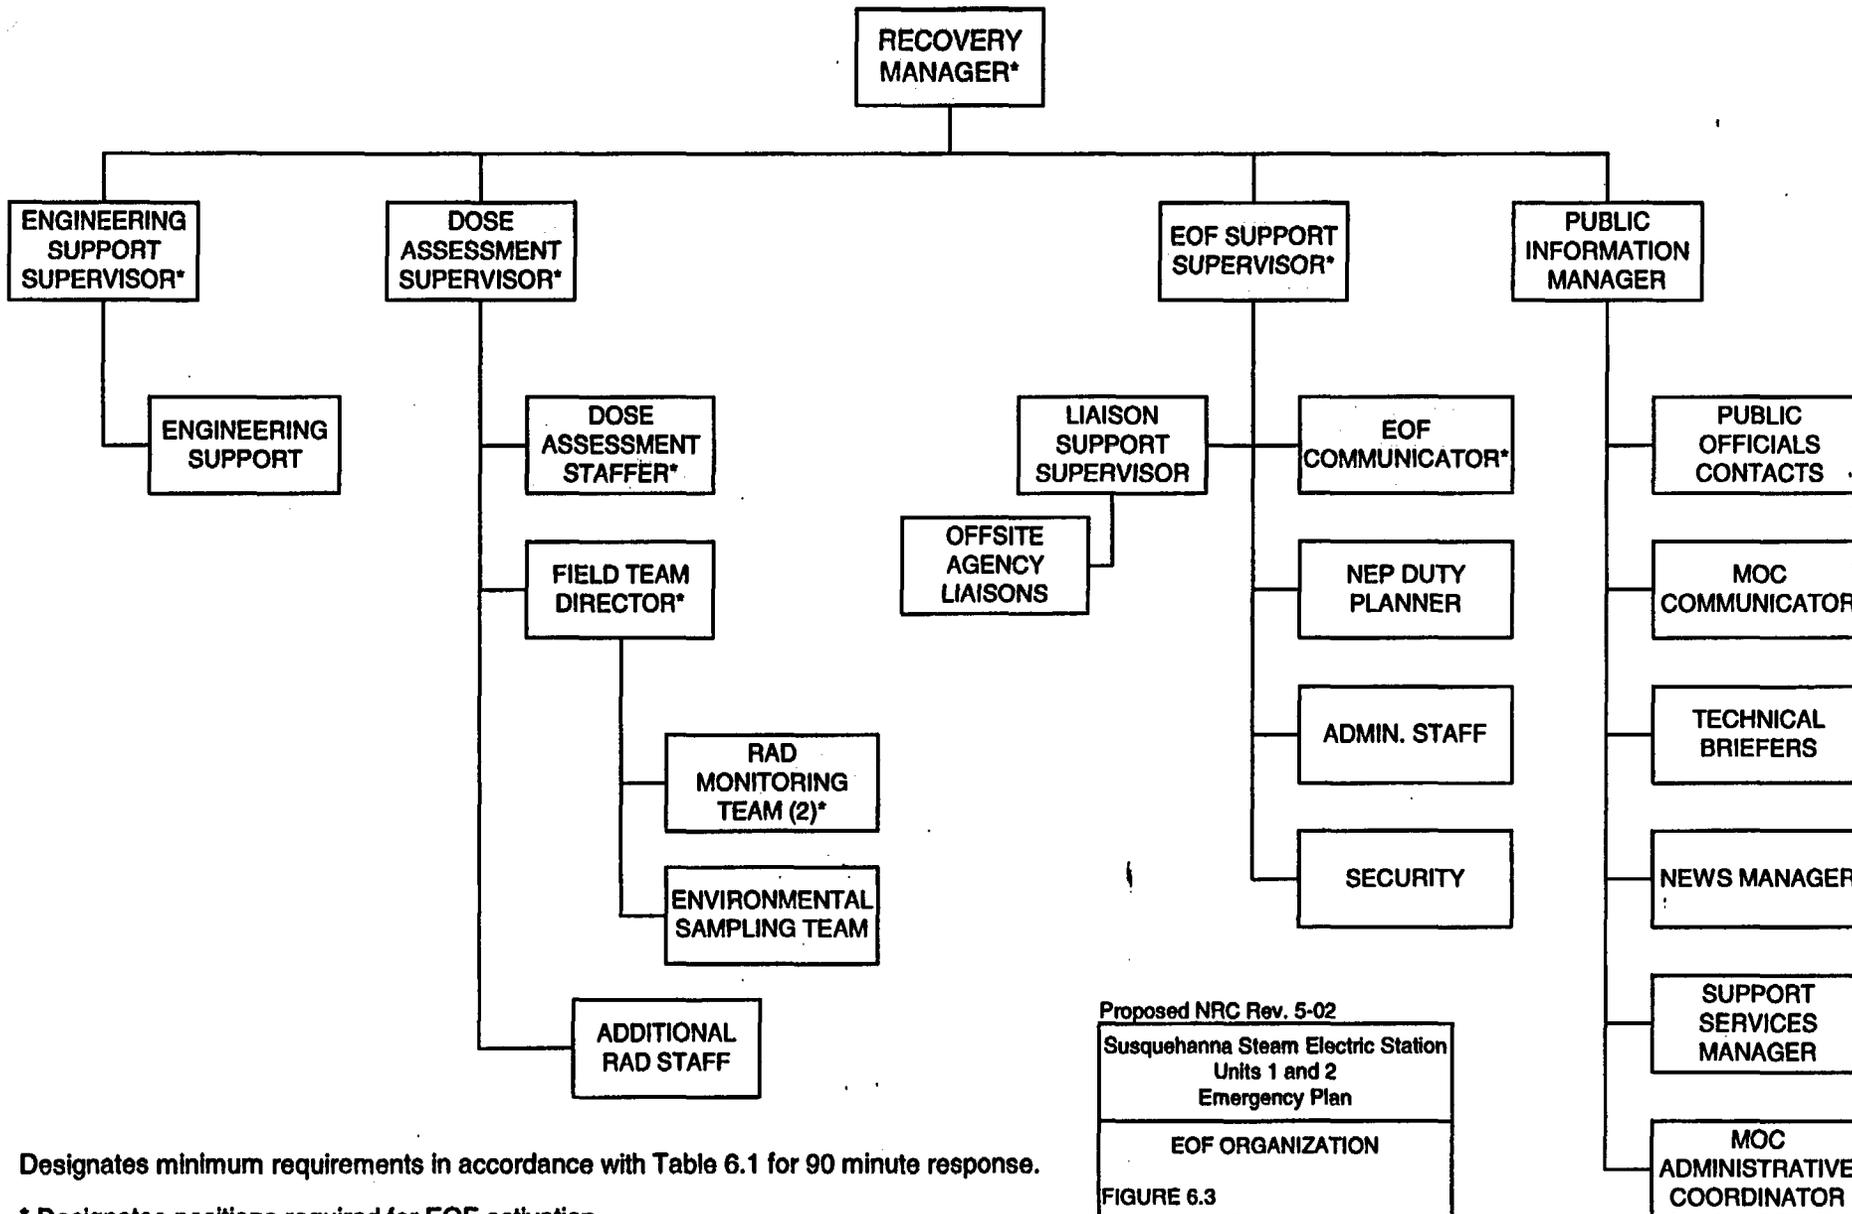

Designates minimum requirements in accordance with Table 6.1 for 90 minute response.

* Designates positions required for EOF activation.

Proposed NRC Rev. 5-02
Susquehanna Steam Electric Station
Units 1 and 2
Emergency Plan
EOF ORGANIZATION
FIGURE 6.3