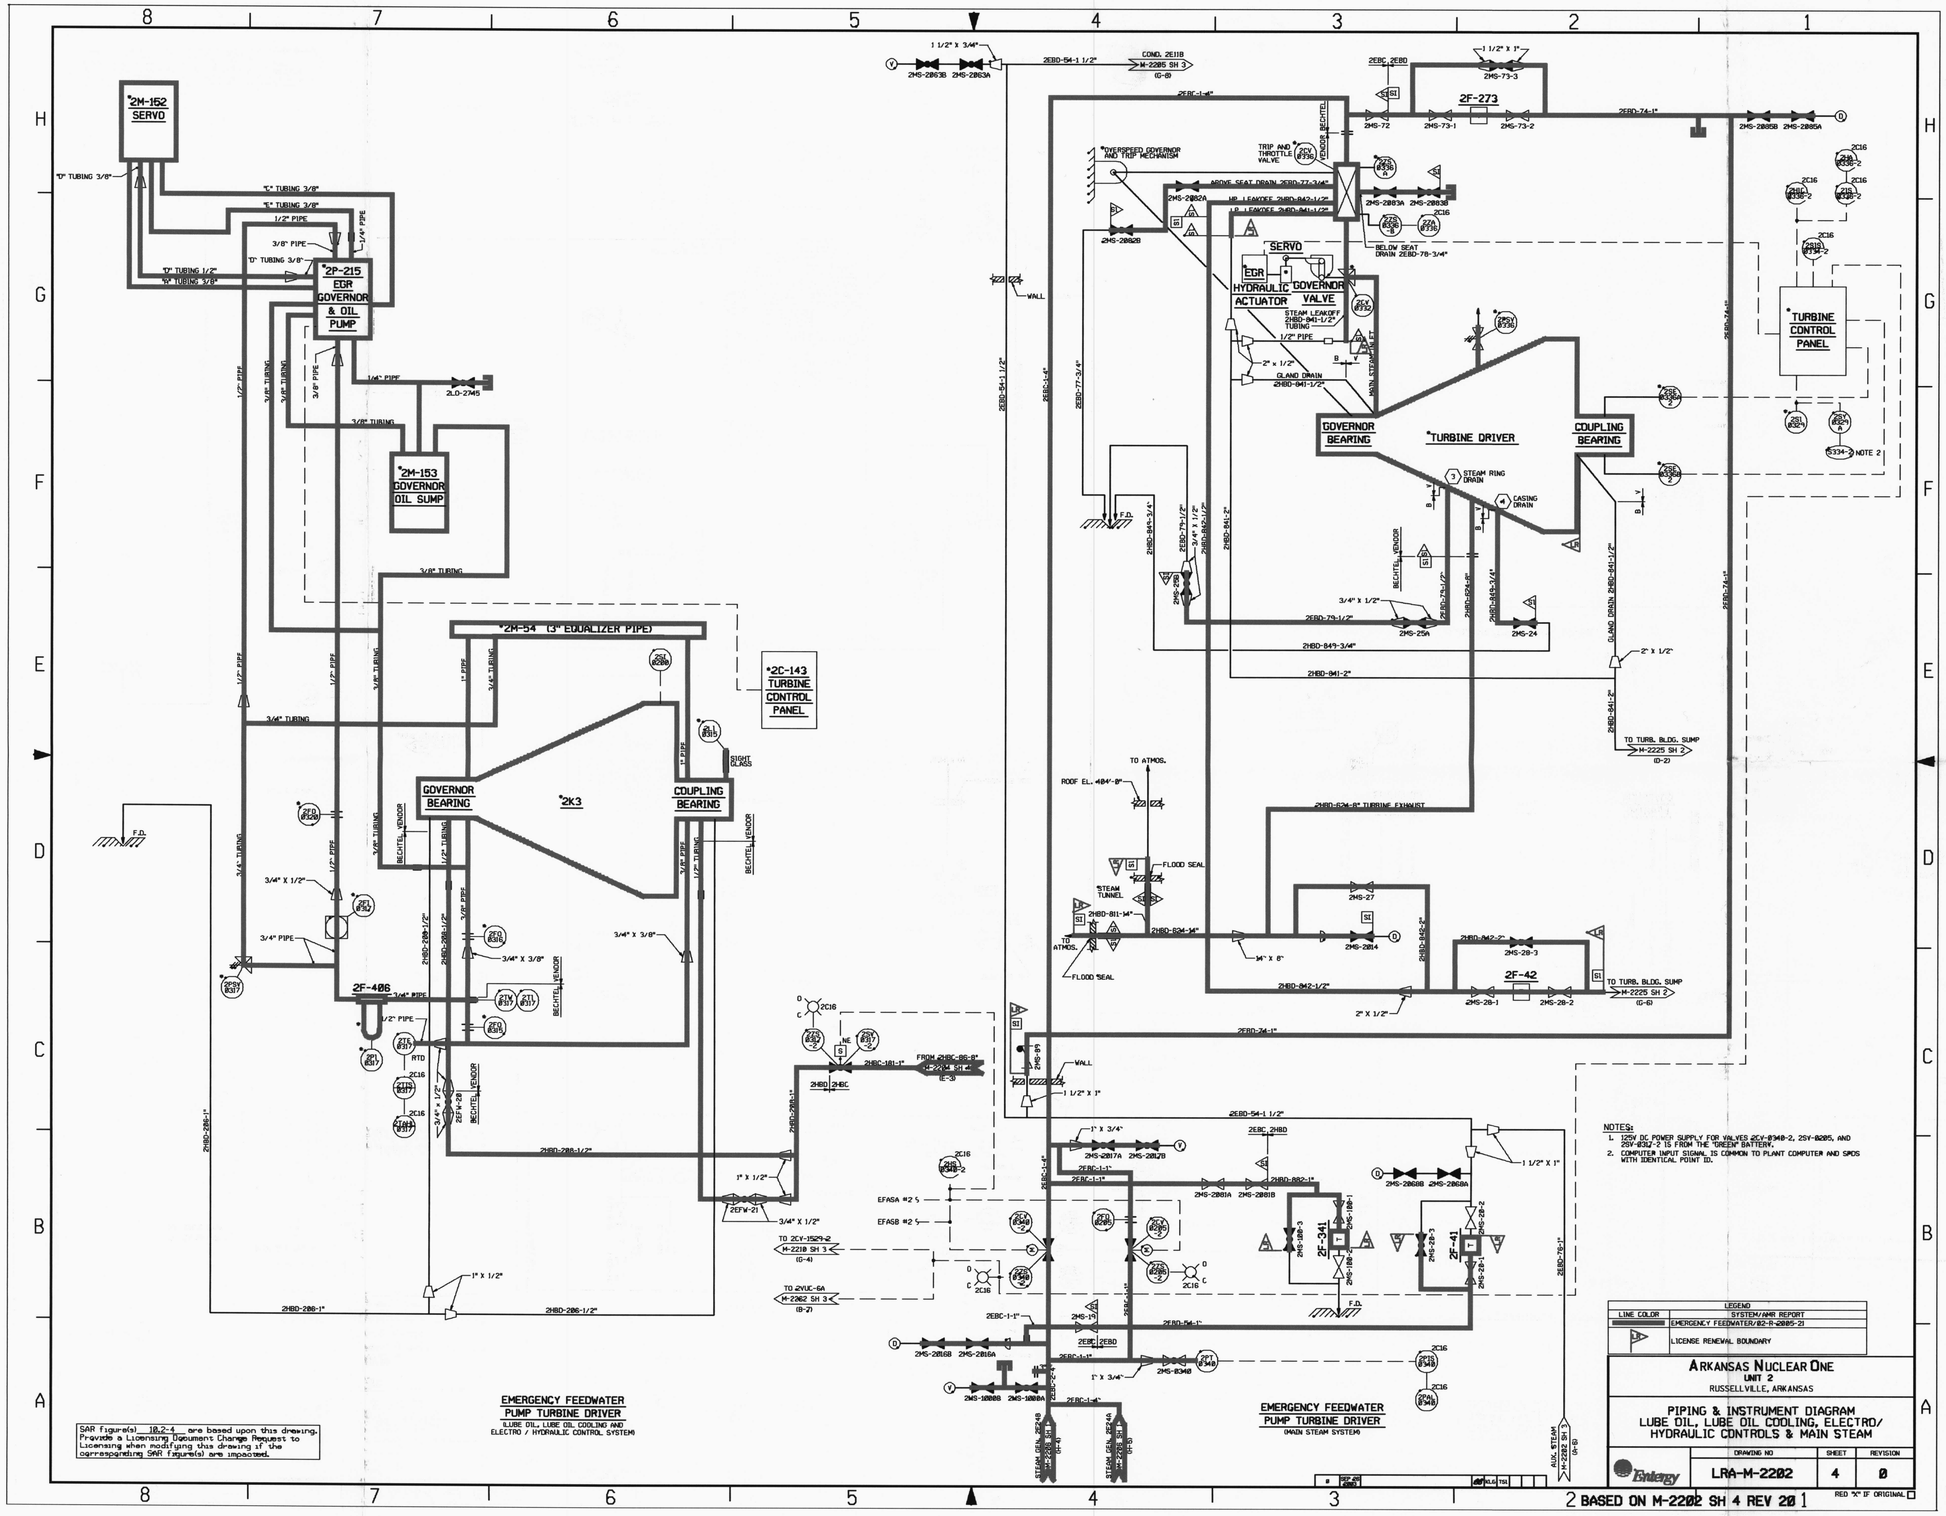

NOTES:
1. 125V DC POWER SUPPLY FOR VALVES 2CV-0340-2, 2SY-0205, AND 2SY-0312-2 IS FROM THE "GREEN" BATTERY.
2. COMPUTER INPUT SIGNAL IS COMMON TO PLANT COMPUTER AND SPDS WITH IDENTICAL POINT ID.

SAR figure(s) 10.2-4 are based upon this drawing. Provide a Licensing Document Change Request to Licensing when modifying this drawing if the corresponding SAR figure(s) are impacted.

LEGEND	
LINE COLOR	SYSTEM/AMR REPORT
	EMERGENCY FEEDWATER/02-R-2005-21
LR	LICENSE RENEWAL BOUNDARY

ARKANSAS NUCLEAR ONE
UNIT 2
RUSSELLVILLE, ARKANSAS

PIPING & INSTRUMENT DIAGRAM
LUBE OIL, LUBE OIL COOLING, ELECTRO/
HYDRAULIC CONTROLS & MAIN STEAM

DRAWING NO	SHEET	REVISION
LRA-M-2202	4	0

Entergy

RED "X" IF ORIGINAL

BASED ON M-2202 SH 4 REV 20

D-09