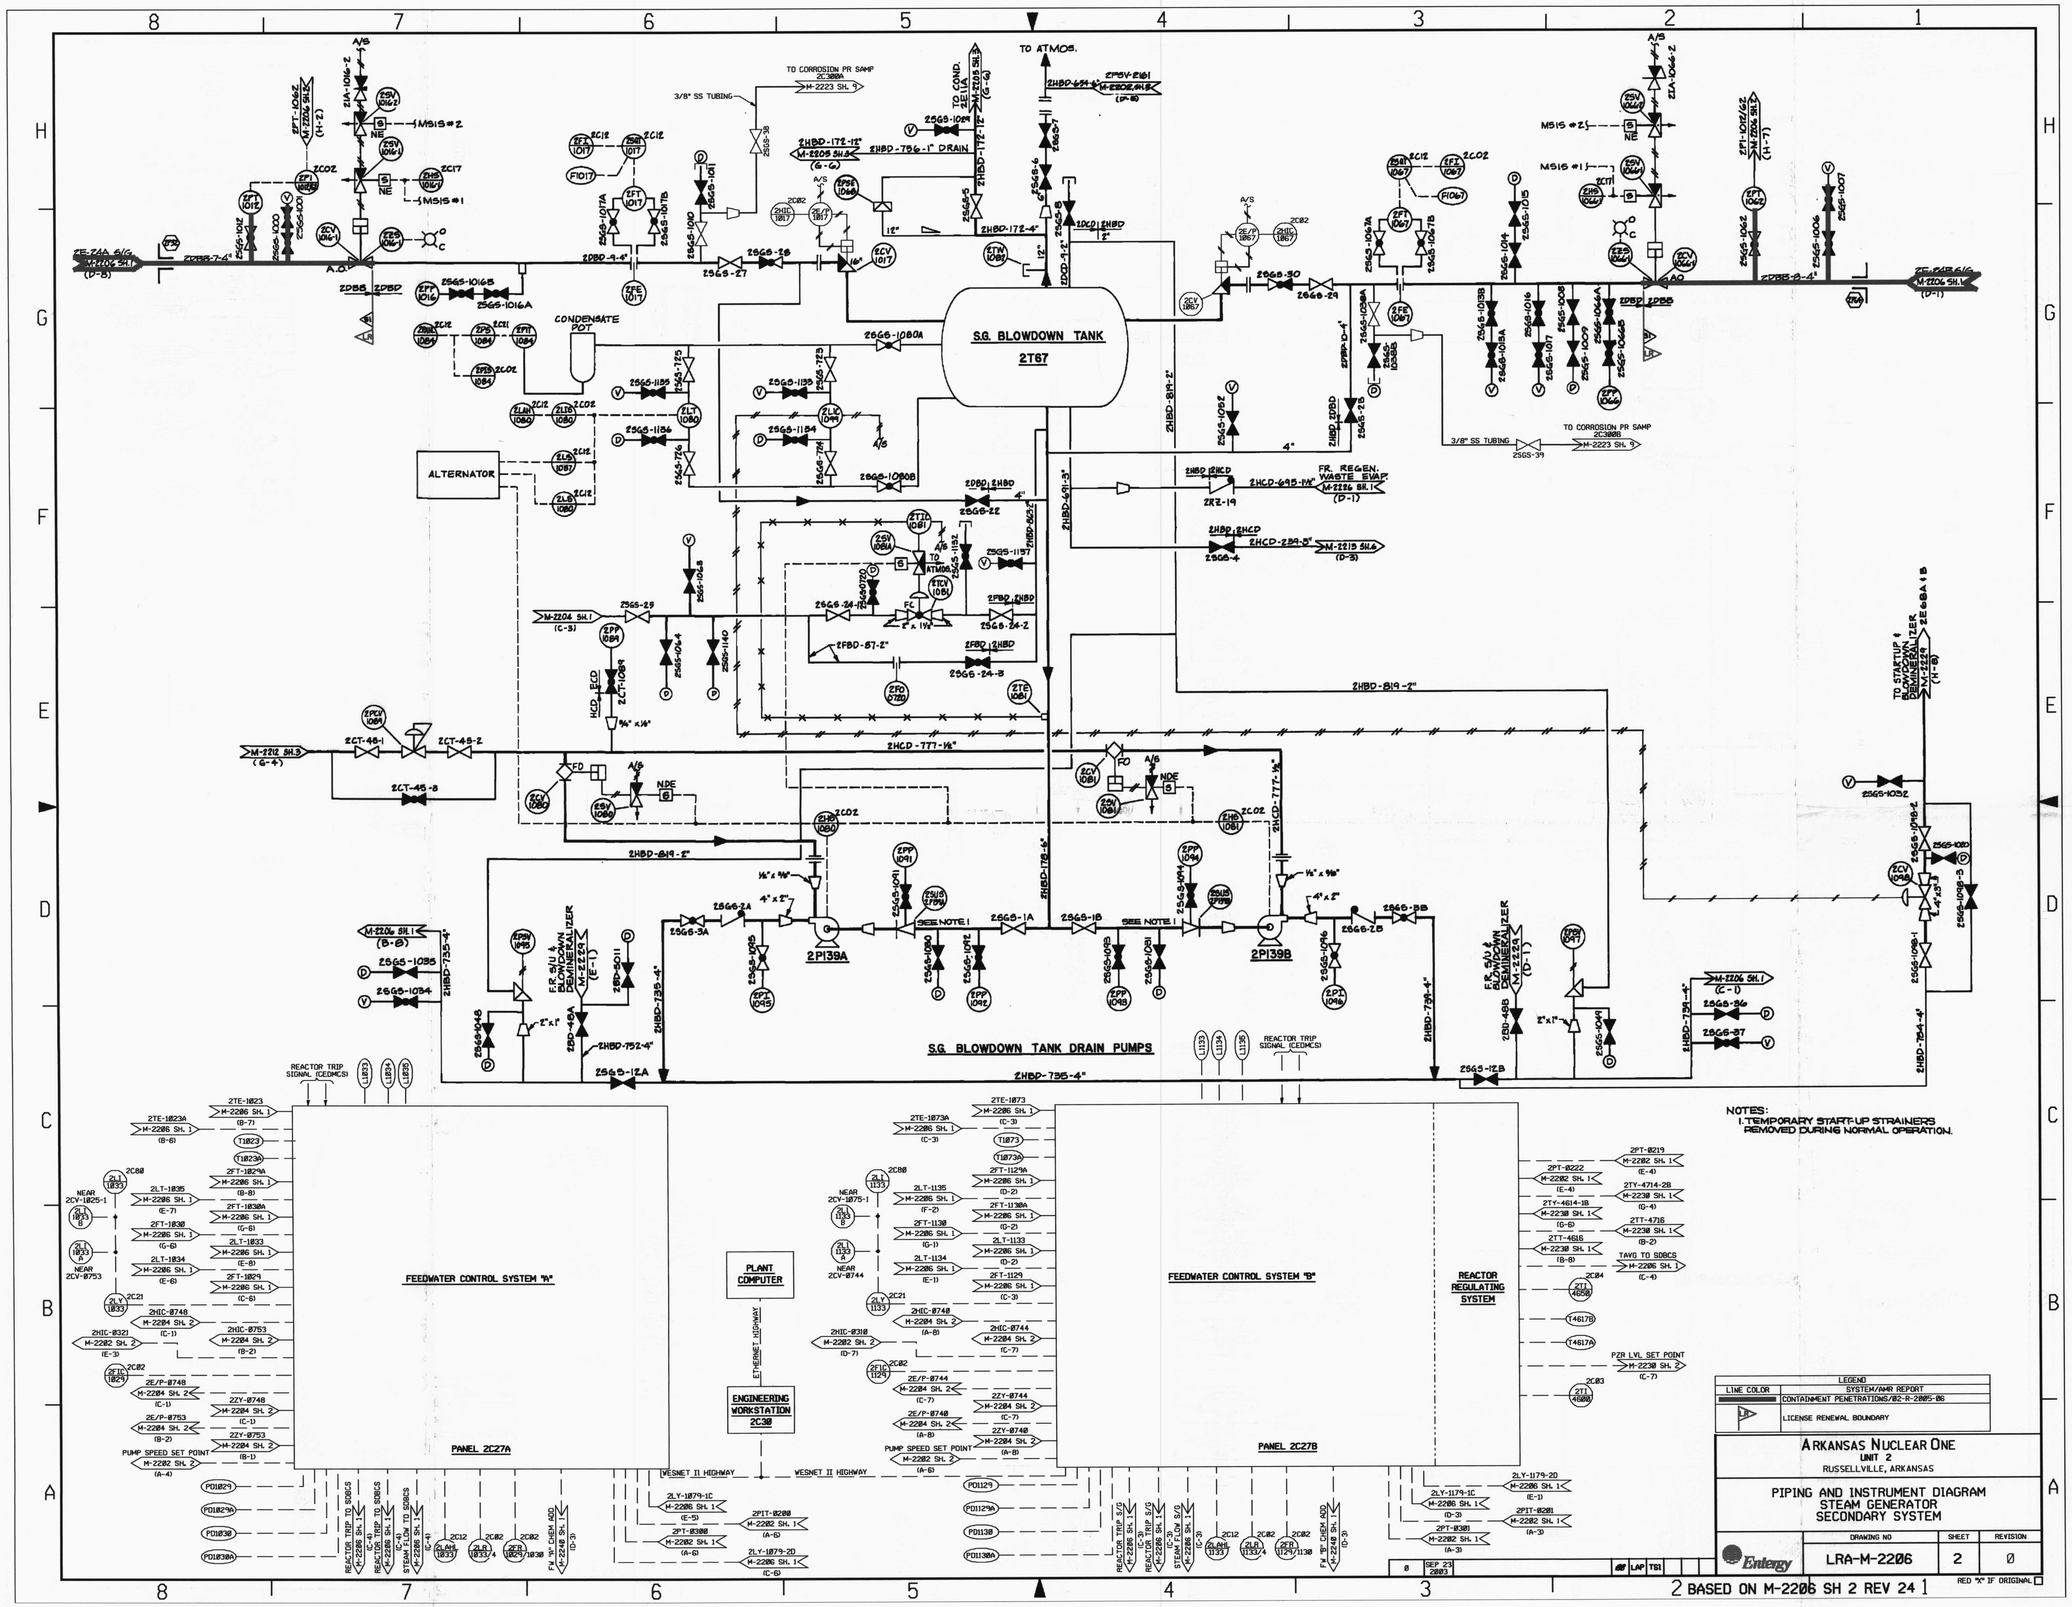
S.G. BLOWDOWN TANK
2T67
S.G. BLOWDOWN TANK DRAIN PUMPS
2P139A
2P139B
CONDENSATE POT
ALTERNATOR
TO ATMOS.
TO CORROSION PR SAMP
FR. REGEN. WASTE EVAP.
TO STARTUP & BLOWDOWN DEMINERALIZER
FEEDWATER CONTROL SYSTEM "A"
PANEL 2C27A
PLANT COMPUTER
ENGINEERING WORKSTATION 2C30
FEEDWATER CONTROL SYSTEM "B"
PANEL 2C27B
REACTOR REGULATING SYSTEM
REACTOR TRIP SIGNAL (CEDMCS)
WESNET II HIGHWAY
ETHERNET HIGHWAY
NOTES:
1. TEMPORARY START-UP STRAINERS REMOVED DURING NORMAL OPERATION.
LEGEND
LINE COLOR
SYSTEM/ANR REPORT
CONTAINMENT PENETRATIONS/82-R-2005-06
LICENSE RENEWAL BOUNDARY
ARKANSAS NUCLEAR ONE
UNIT 2
RUSSELLVILLE, ARKANSAS
PIPING AND INSTRUMENT DIAGRAM
STEAM GENERATOR
SECONDARY SYSTEM
Entergy
DRAWING NO
SHEET
REVISION
LRA-M-2206
2
0
RED "X" IF ORIGINAL
2 BASED ON M-2206 SH 2 REV 24 1

D-12