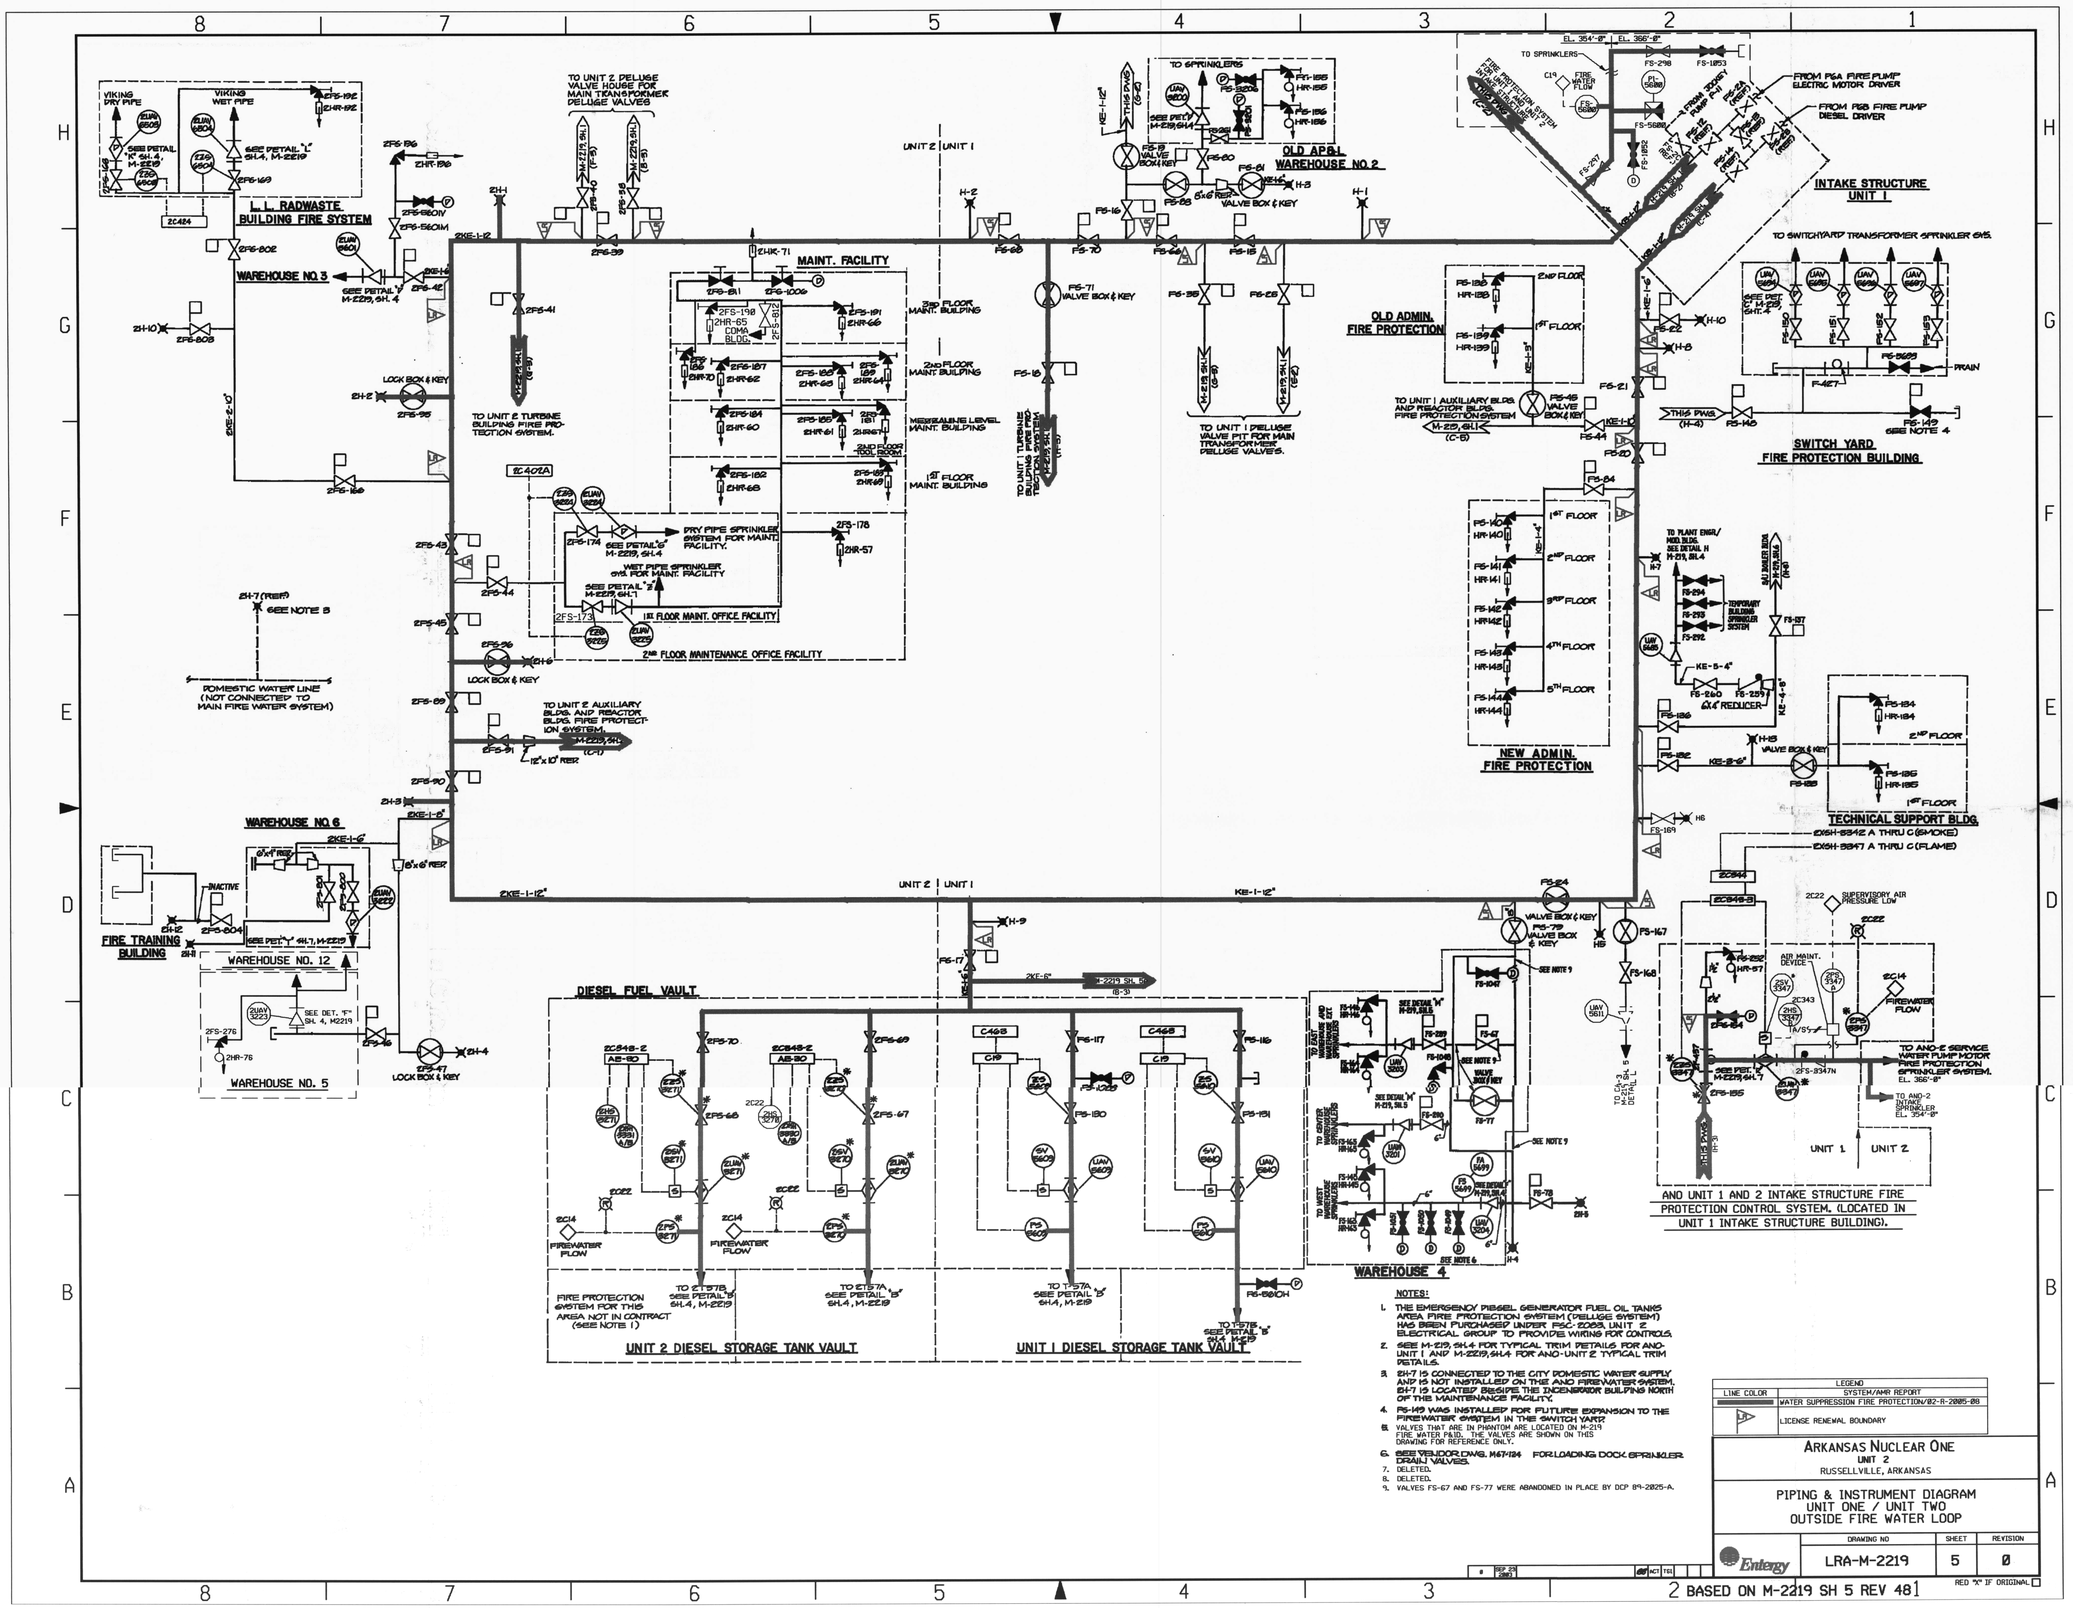

NOTES:

1. THE EMERGENCY DIESEL GENERATOR FUEL OIL TANKS AREA FIRE PROTECTION SYSTEM (DELUGE SYSTEM) HAS BEEN PURCHASED UNDER FSC-2083, UNIT 2 ELECTRICAL GROUP TO PROVIDE WIRING FOR CONTROLS.
2. SEE M-2219, SH.4 FOR TYPICAL TRIM DETAILS FOR ANO-UNIT 1 AND M-2219, SH.4 FOR ANO-UNIT 2 TYPICAL TRIM DETAILS.
3. 21-7 IS CONNECTED TO THE CITY DOMESTIC WATER SUPPLY AND IS NOT INSTALLED ON THE ANO FIREWATER SYSTEM. 21-7 IS LOCATED BESIDE THE INCENERATOR BUILDING NORTH OF THE MAINTENANCE FACILITY.
4. FS-149 WAS INSTALLED FOR FUTURE EXPANSION TO THE FIREWATER SYSTEM IN THE SWITCH YARD.
5. VALVES THAT ARE IN PHANTOM ARE LOCATED ON M-219 FIRE WATER PLAN. THE VALVES ARE SHOWN ON THIS DRAWING FOR REFERENCE ONLY.
6. SEE VENDOR DWG. M67-124 FOR LOADING DOCK SPRINKLER DRAIN VALVES.
7. DELETED.
8. DELETED.
9. VALVES FS-67 AND FS-77 WERE ABANDONED IN PLACE BY DCP 89-2025-A.

LEGEND	
LINE COLOR	SYSTEM/ARR REPORT
	WATER SUPPRESSION FIRE PROTECTION/82-R-2005-00
	LICENSE RENEWAL BOUNDARY

ARKANSAS NUCLEAR ONE
UNIT 2
RUSSELLVILLE, ARKANSAS

PIPING & INSTRUMENT DIAGRAM
UNIT ONE / UNIT TWO
OUTSIDE FIRE WATER LOOP

Entergy

DRAWING NO	SHEET	REVISION
LRA-M-2219	5	0

RED "X" IF ORIGINAL

BASED ON M-2219 SH 5 REV 48

D-30