NOTES:

1. FOR GENERAL NOTES, REFERENCES AND SYMBOLS SEE DRAWING M-2200 SHEETS 1, 2 AND 3.
2. EQUIPMENT NOT DESIGNATED WITH "*" DENOTES VENDOR SUPPLIED EQUIPMENT.
3. FOR DETAIL OF ALARM CHECK VALVE (2UAV-3206) SEE DRAWING M-2219 SHEET 7.
4. FIRE DEPARTMENT CONNECTION SUPPLIES THE SPRINKLERS ONLY.

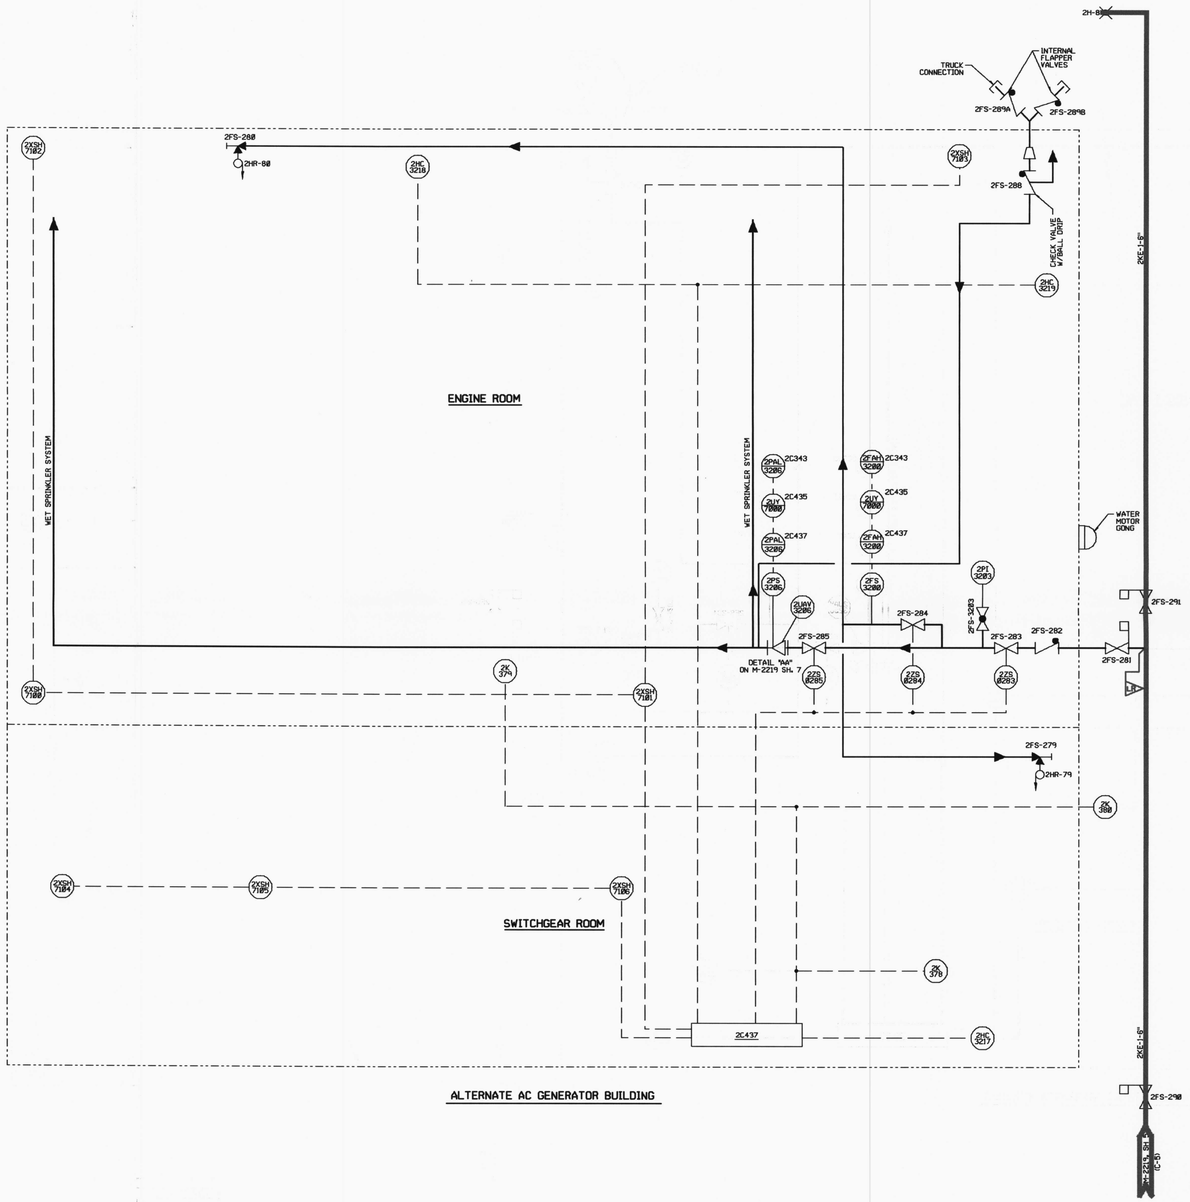

LEGEND	
LINE COLOR	SYSTEM/AMR REPORT
	WATER SUPPRESSION FIRE PROTECTION/02-R-2005-08
LR	LICENSE RENEWAL BOUNDARY

ARKANSAS NUCLEAR ONE
UNIT 2
RUSSELLVILLE, ARKANSAS

PIPING & INSTRUMENT DIAGRAM
AAC GENERATOR BUILDING
FIRE WATER SYSTEM

DRAWING NO	SHEET	REVISION
LRA-M-2219	5A	0

Entergy

UEC Nuclear
A Bechtel Company
7443.002

REV	DISCIPLINE	CHKD	DATE	DISCIPLINE	CHKD	DATE
	STRUCTURAL	N/A	-	INST & CONT	IB	2/4/05
	MECH POWER	CBK	2/4/05	MECH SVCE	N/A	-
	ELECTRICAL	IB	2/4/05	NUCLEAR	N/A	-
	R & QA	N/A	-			

SEP 29 2002

2 BASED ON M-2219 SH 5A REV 01

RED "X" IF ORIGINAL

D-31