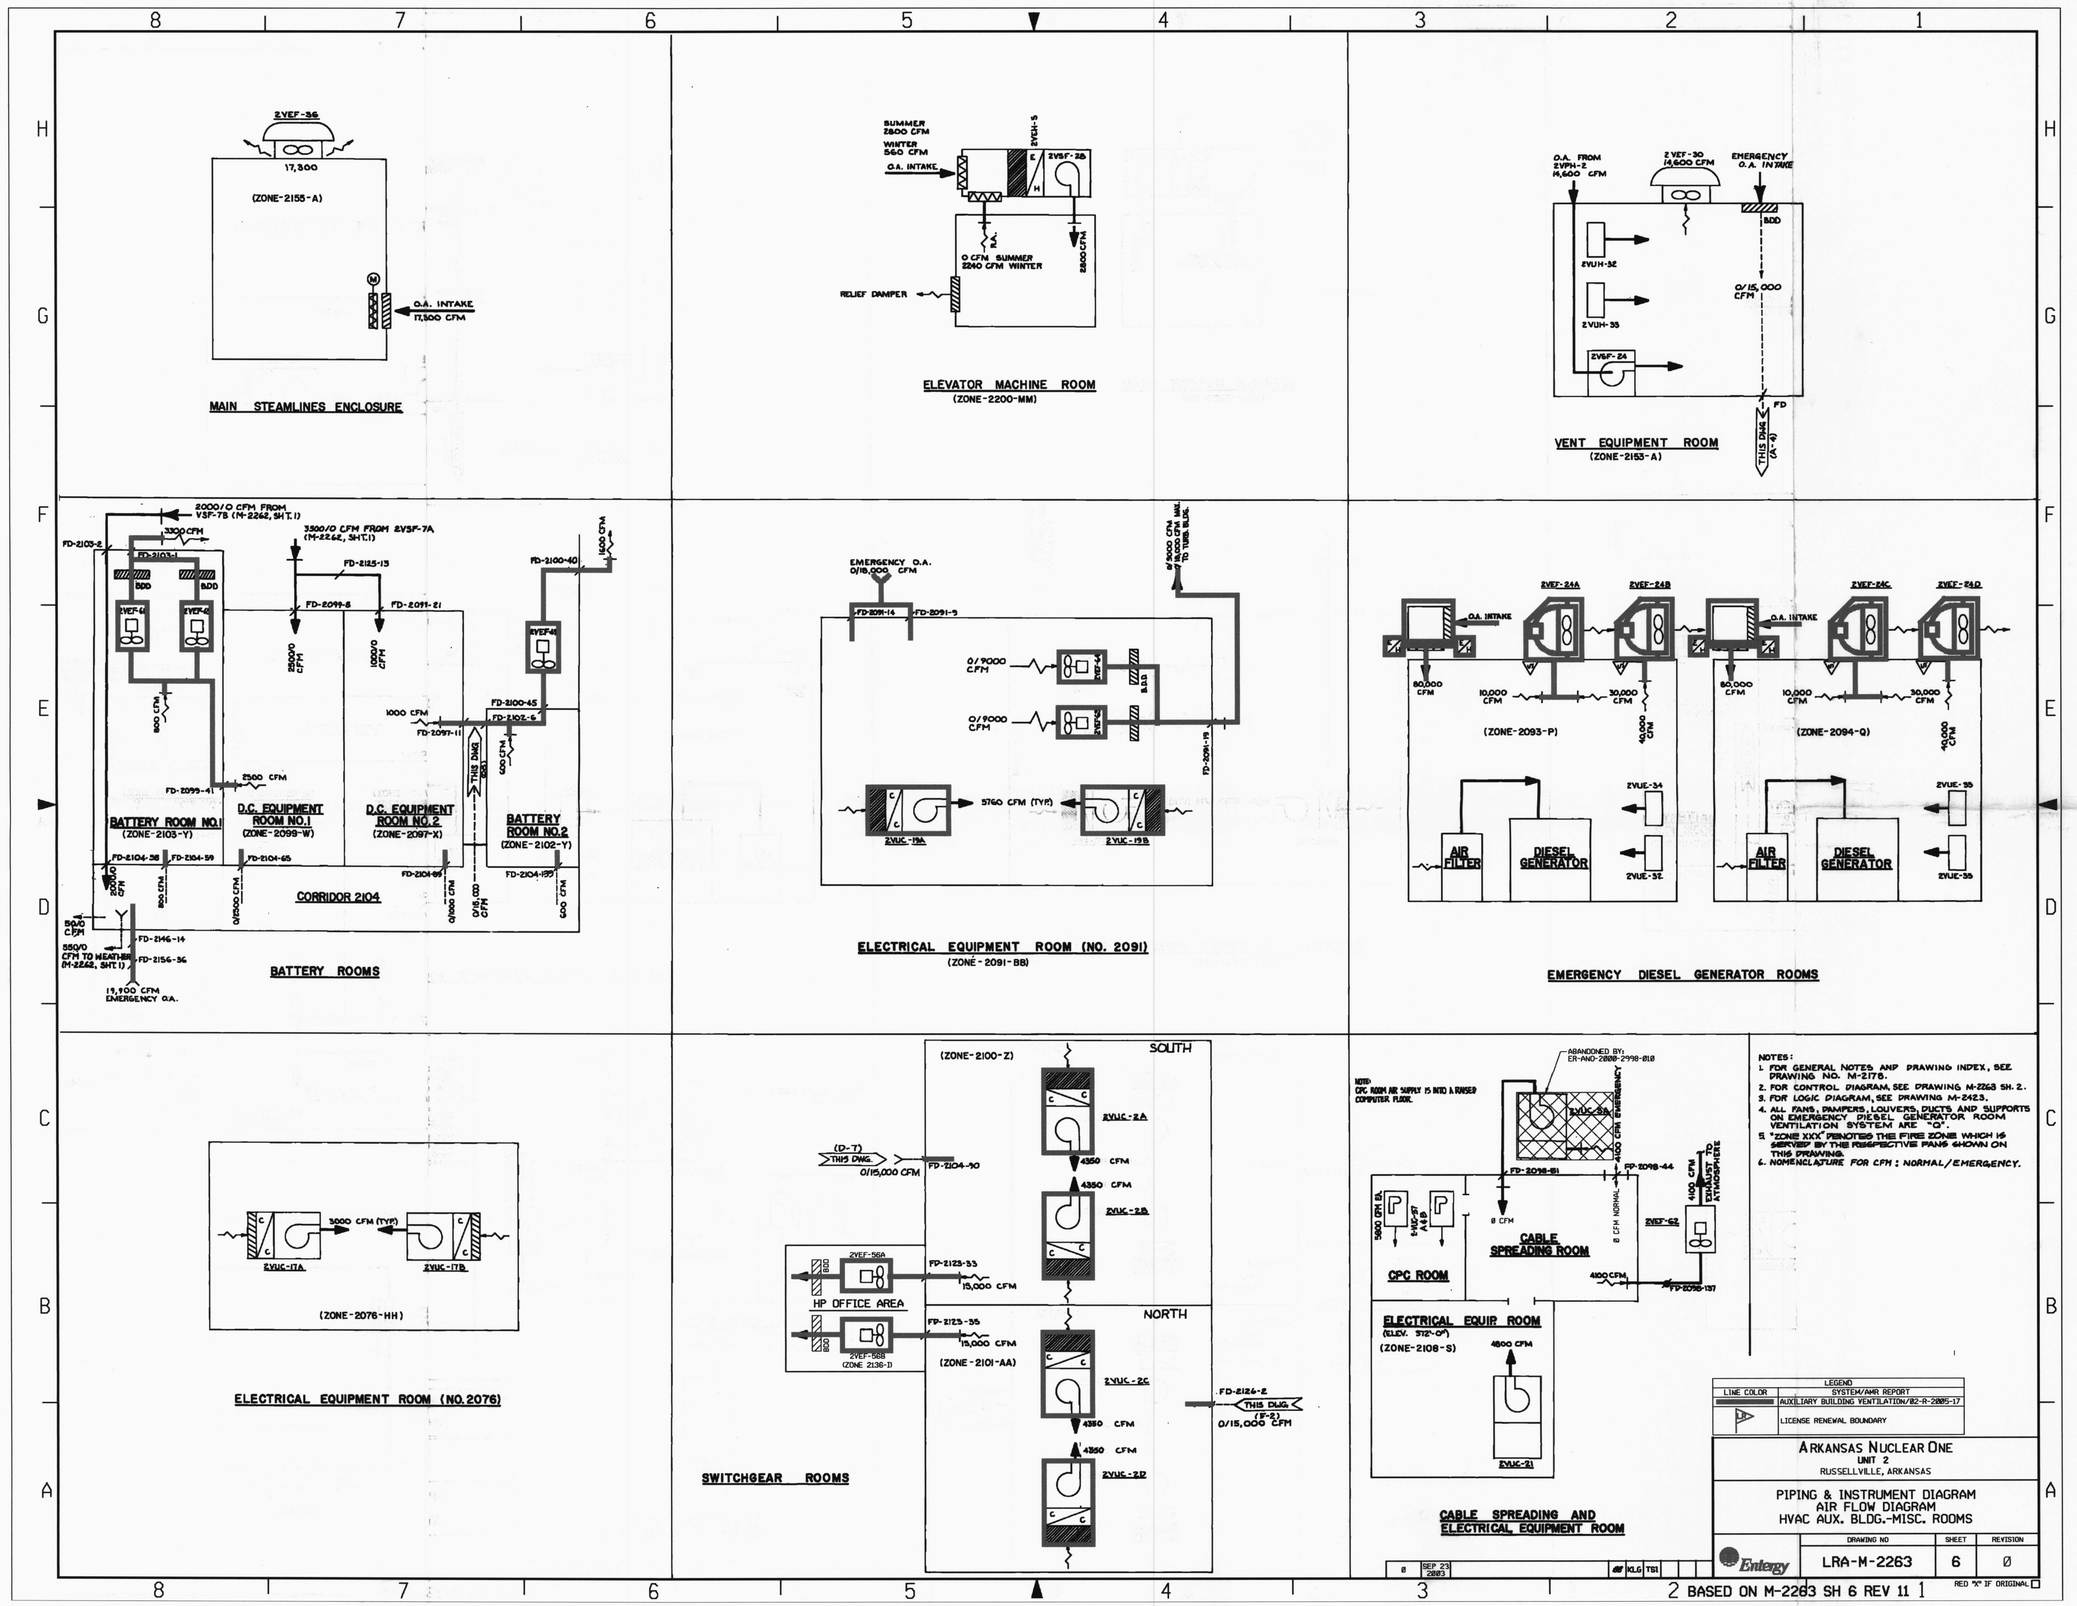
MAIN STEAMLINES ENCLOSURE
(ZONE-2155-A)
ELEVATOR MACHINE ROOM
(ZONE-2200-MM)
VENT EQUIPMENT ROOM
(ZONE-2153-A)
BATTERY ROOMS
BATTERY ROOM NO.1
(ZONE-2103-Y)
D.C. EQUIPMENT ROOM NO.1
(ZONE-2099-W)
D.C. EQUIPMENT ROOM NO.2
(ZONE-2097-X)
BATTERY ROOM NO.2
(ZONE-2102-Y)
CORRIDOR 2104
ELECTRICAL EQUIPMENT ROOM (NO. 2091)
(ZONE-2091-BB)
EMERGENCY DIESEL GENERATOR ROOMS
(ZONE-2093-P)
(ZONE-2094-Q)
AIR FILTER
DIESEL GENERATOR
ELECTRICAL EQUIPMENT ROOM (NO.2076)
(ZONE-2076-HH)
SWITCHGEAR ROOMS
SOUTH
NORTH
HP OFFICE AREA
(ZONE-2100-Z)
(ZONE-2101-AA)
CABLE SPREADING ROOM
CPC ROOM
ELECTRICAL EQUIP ROOM
(ZONE-2108-S)
CABLE SPREADING AND ELECTRICAL EQUIPMENT ROOM
NOTES:
1. FOR GENERAL NOTES AND DRAWING INDEX, SEE DRAWING NO. M-2178.
2. FOR CONTROL DIAGRAM, SEE DRAWING M-2263 SH. 2.
3. FOR LOGIC DIAGRAM, SEE DRAWING M-2423.
4. ALL FANS, DAMPERS, LOUVERS, DUCTS AND SUPPORTS ON EMERGENCY DIESEL GENERATOR ROOM VENTILATION SYSTEM ARE "Q".
5. "ZONE XXX" DENOTES THE FIRE ZONE WHICH IS SERVED BY THE RESPECTIVE FANS SHOWN ON THIS DRAWING.
6. NOMENCLATURE FOR CFM: NORMAL/EMERGENCY.
LEGEND
LINE COLOR
SYSTEM/AMR REPORT
AUXILIARY BUILDING VENTILATION/02-R-2005-17
LICENSE RENEWAL BOUNDARY
ARKANSAS NUCLEAR ONE
UNIT 2
RUSSELLVILLE, ARKANSAS
PIPING & INSTRUMENT DIAGRAM
AIR FLOW DIAGRAM
HVAC AUX. BLDG.-MISC. ROOMS
DRAWING NO
LRA-M-2263
SHEET
6
REVISION
Ø
Entergy
BASED ON M-2263 SH 6 REV 11
RED "X" IF ORIGINAL

D-64