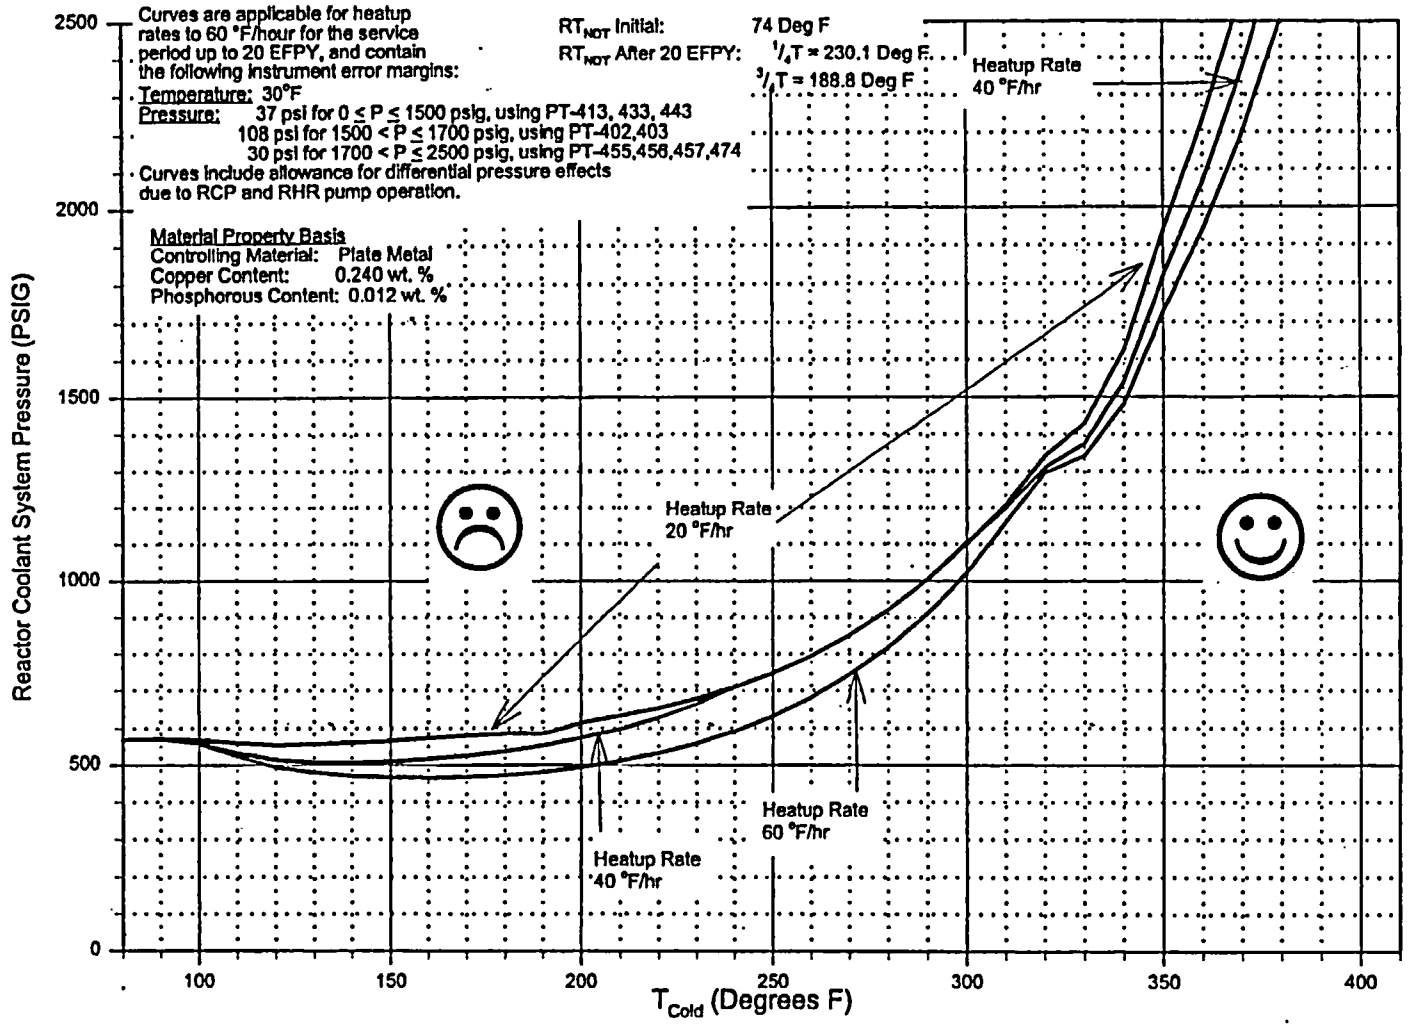

Figure 3.4.3-1:
Heatup Limitations for Reactor Coolant System

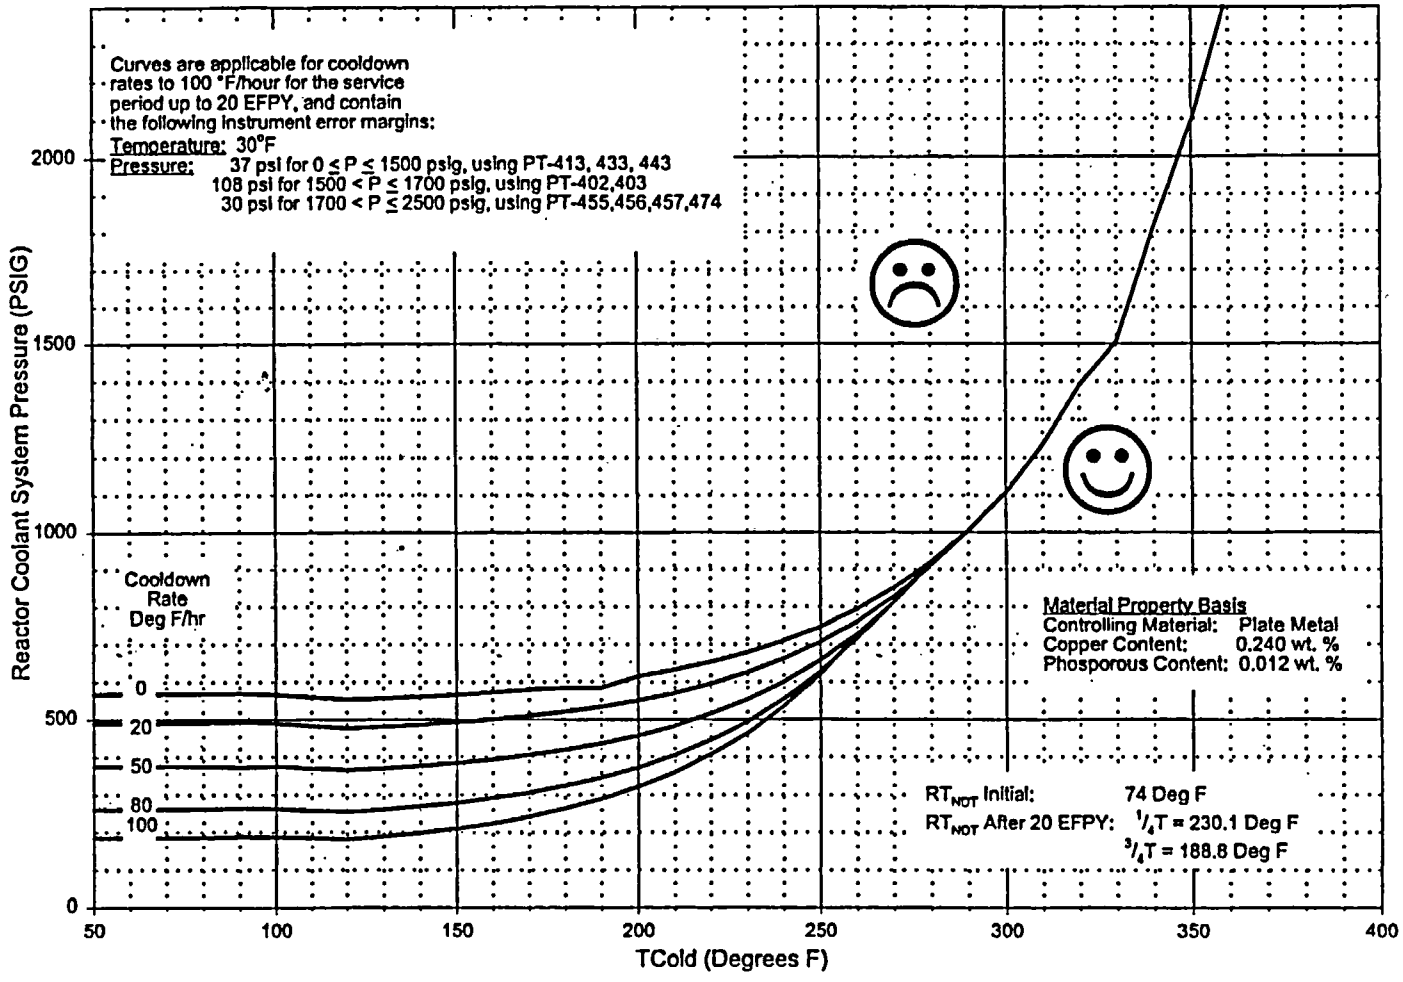

Figure 3.4.3-2:
Cooldown Limitations for Reactor Coolant System

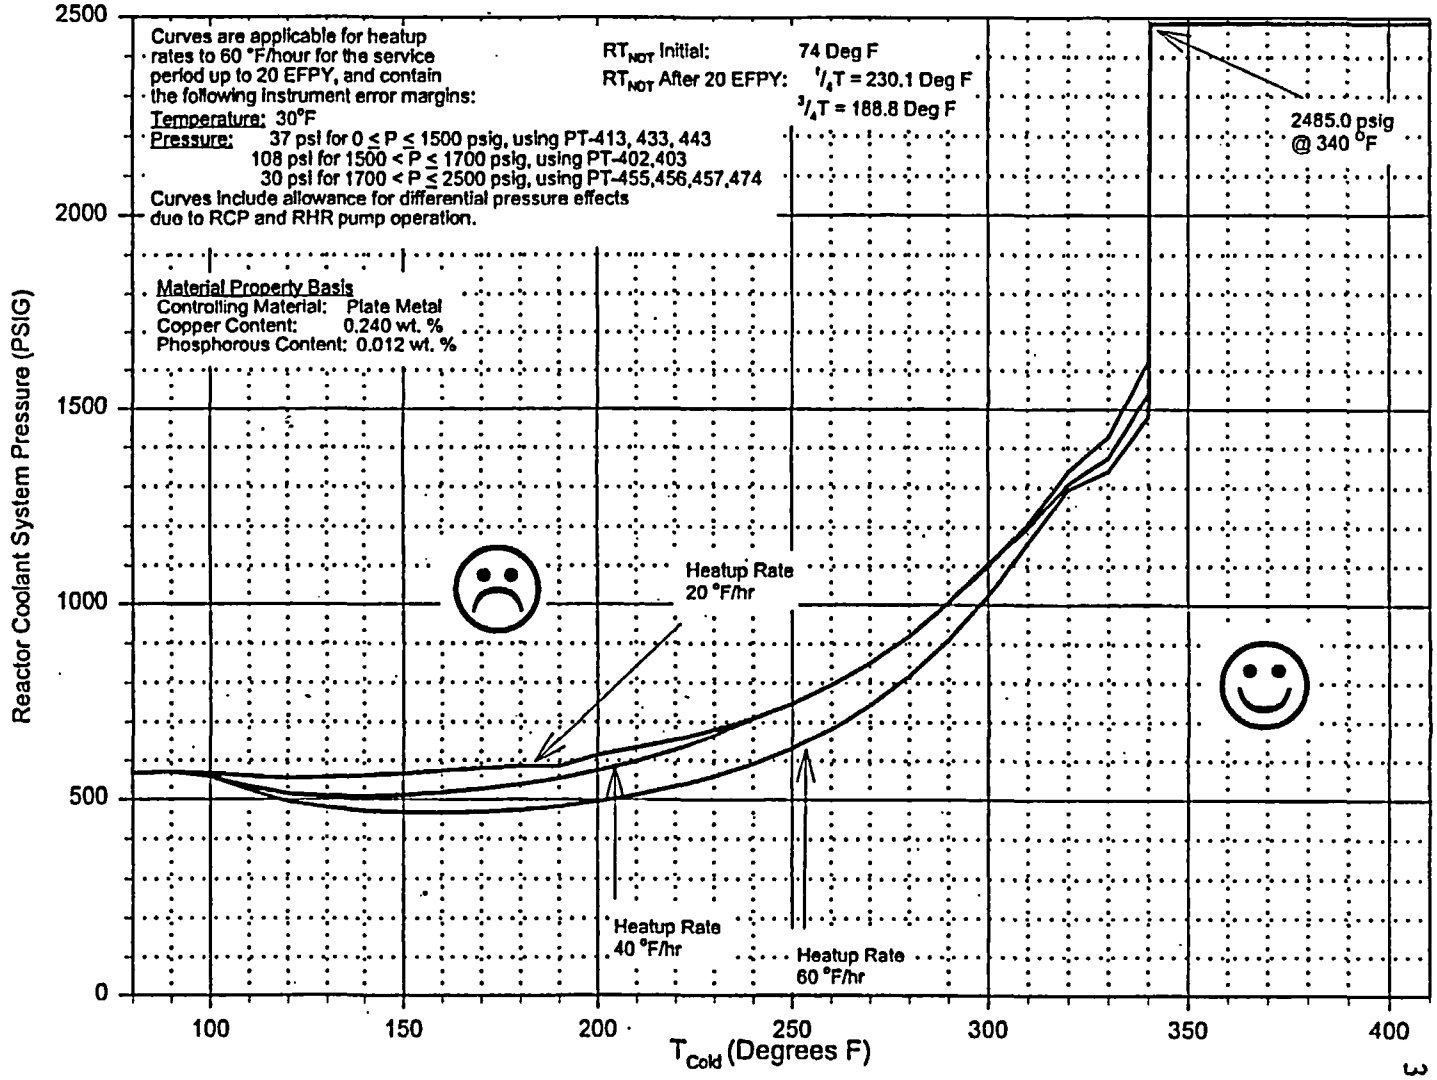

Figure 3.4.3-3:
Hydrostatic and Inservice Leak Testing Limitations for Reactor Coolant System

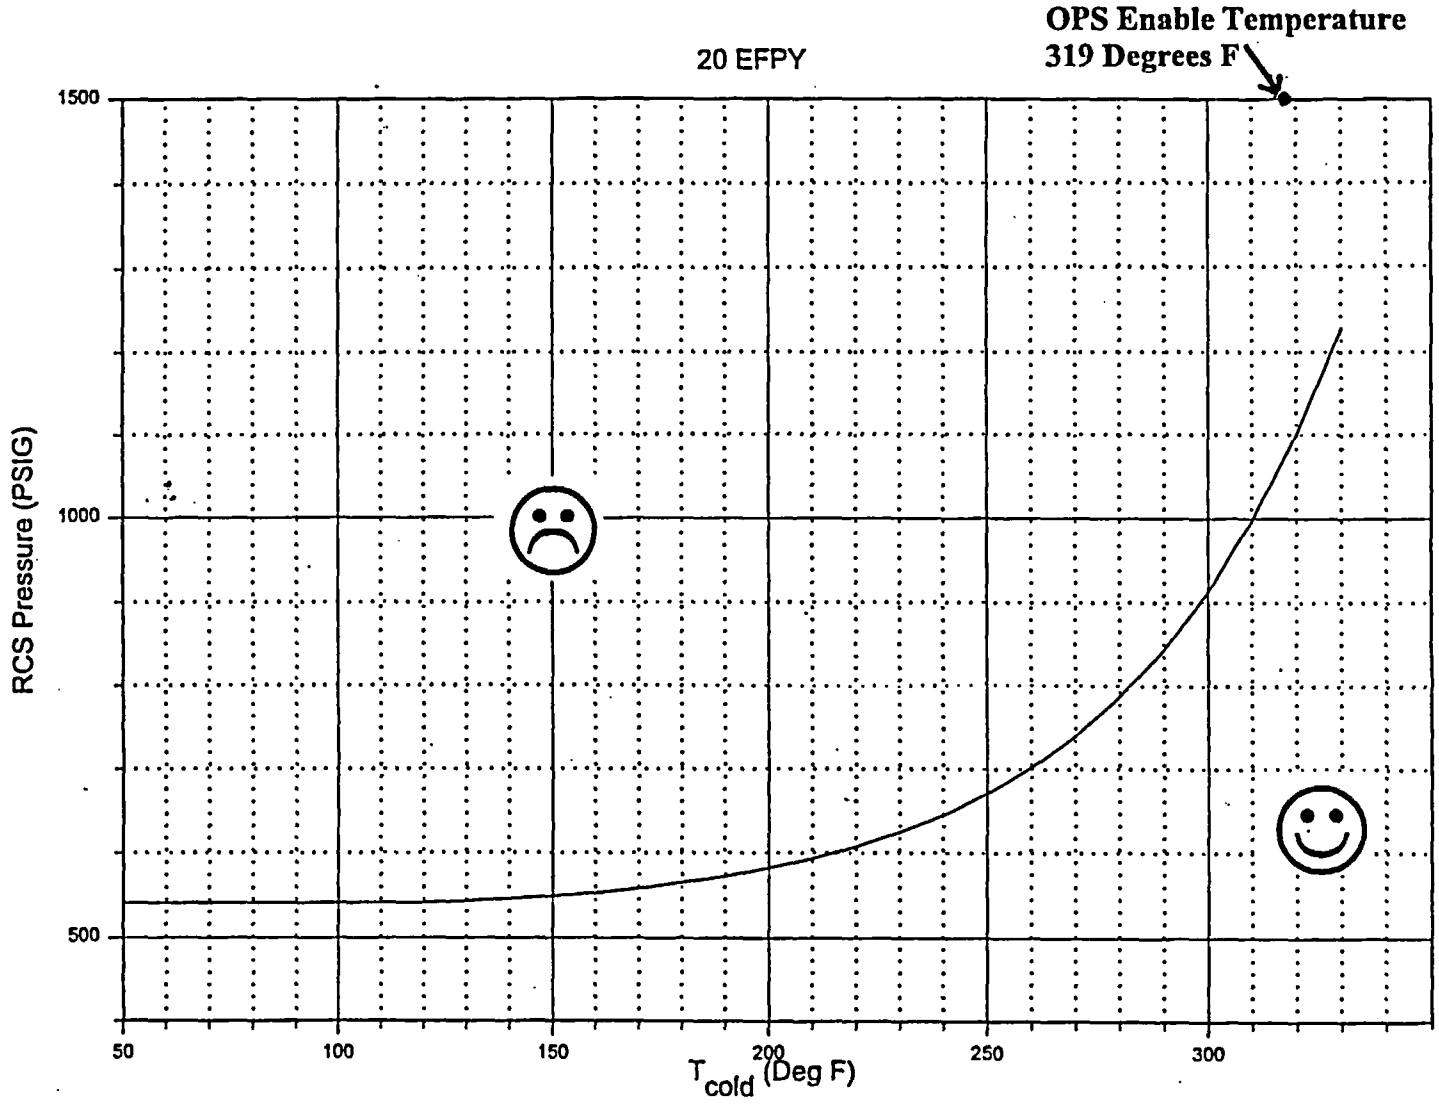

Figure 3.4.12-1: Maximum Allowable Nominal PORV Setpoint for LTOP (OPS), 20 EFPY

Note: OPS Enable Temperature includes an allowance of 14.4 degF for instrument uncertainty and margin.

Analytical Curve

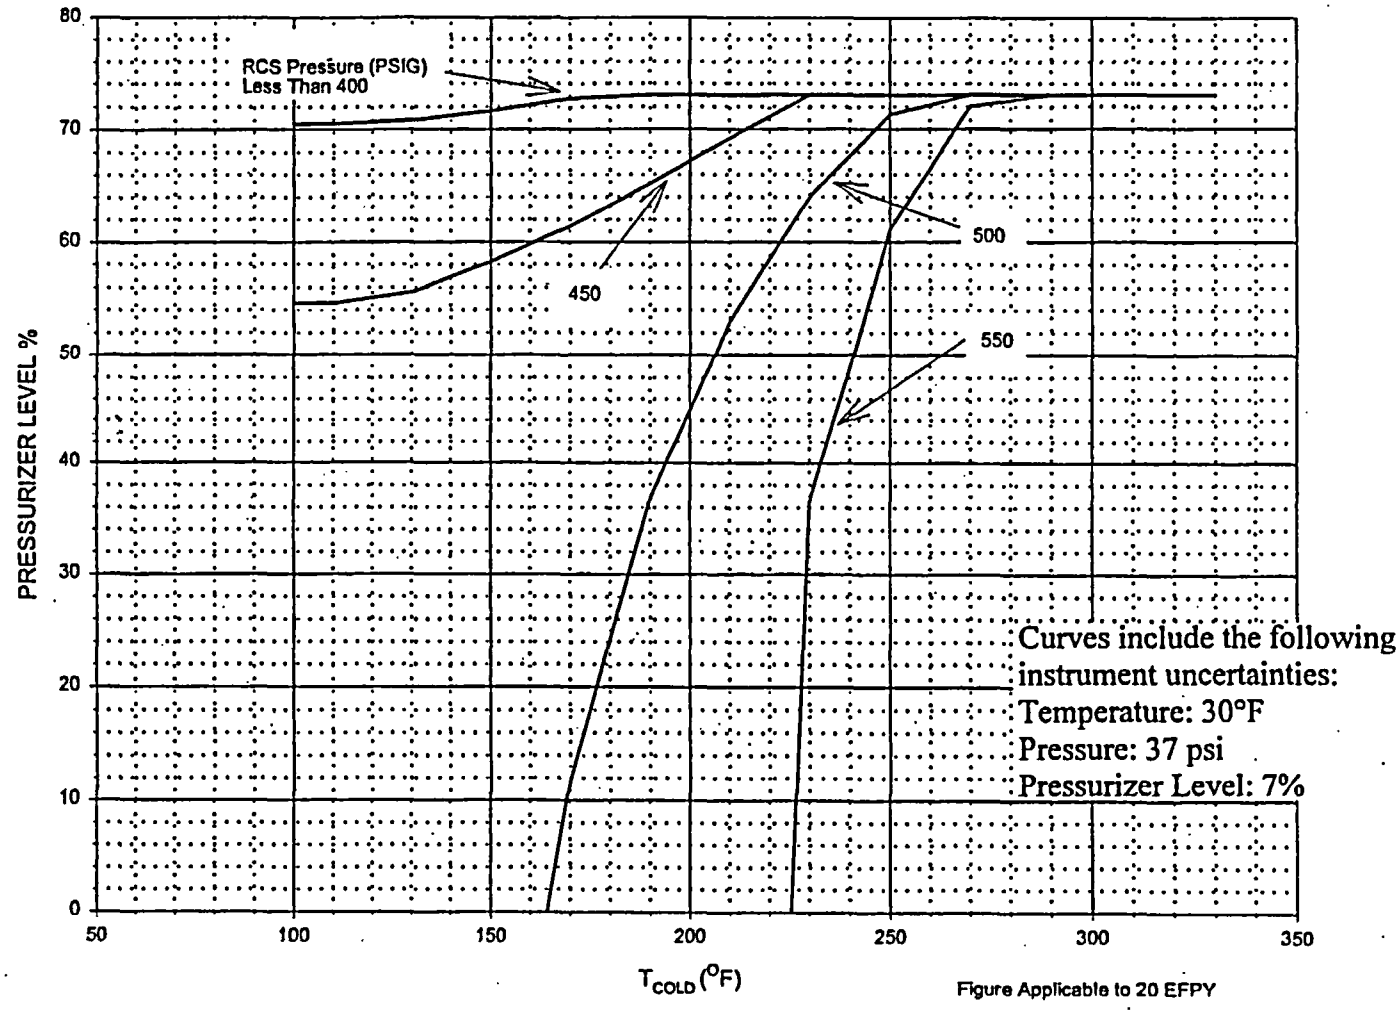

Curves represent maximum allowable pressurizer levels for the conditions defined

Figure 3.4.12-2: Pressurizer Limitations for OPS Inoperable, 20 EFPY (Up to one charging pump capable of feeding the RCS)

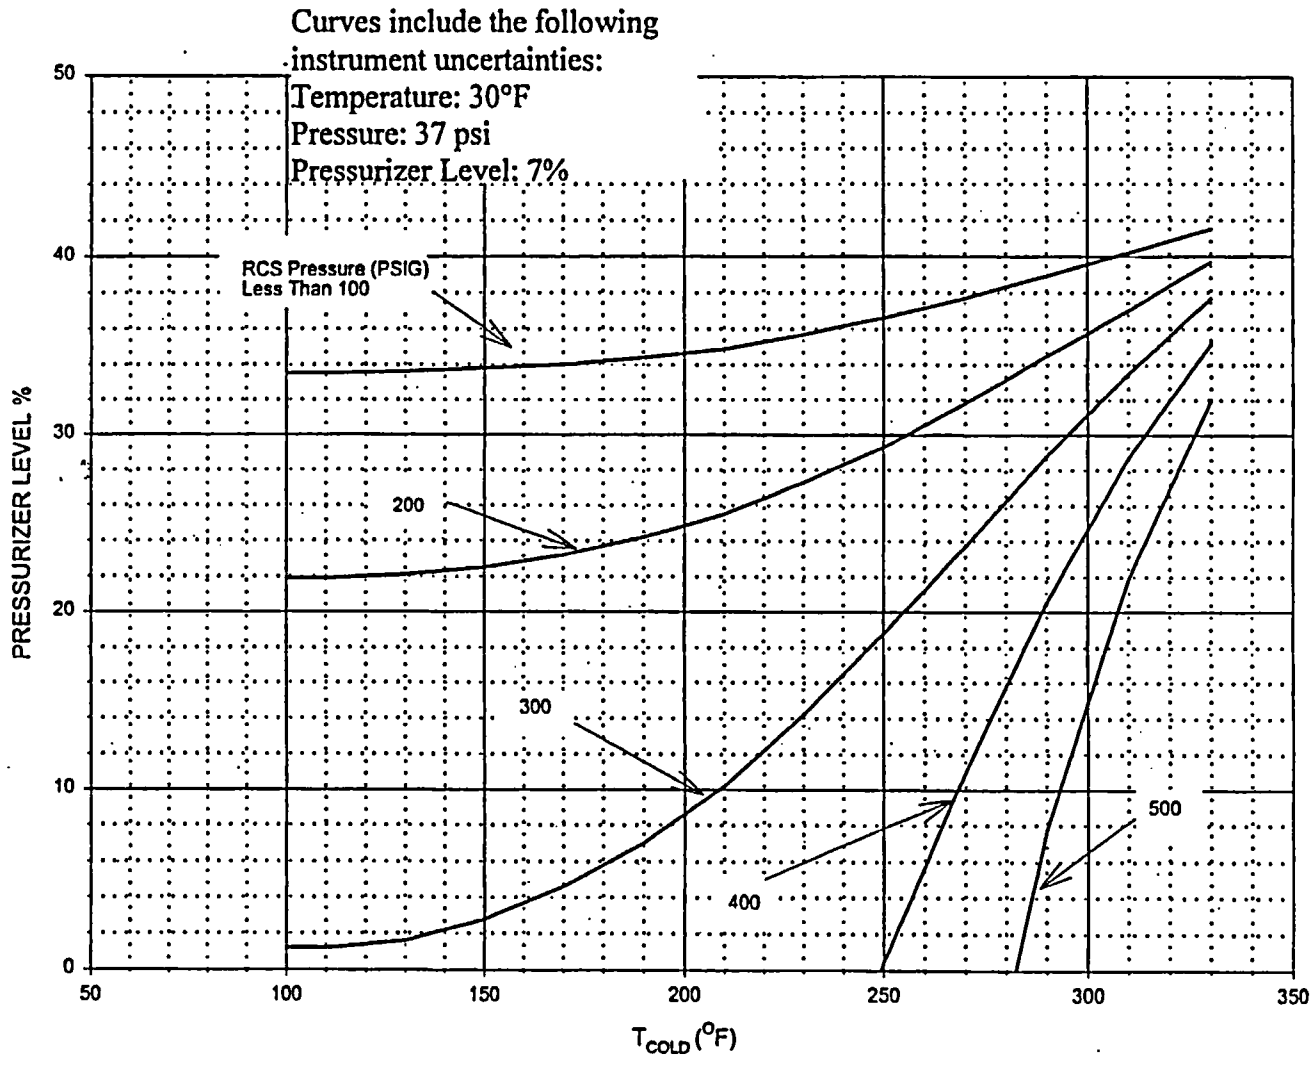

Figure Applicable to 20 EFPY

Curves represent maximum allowable pressurizer levels for the conditions defined

Figure 3.4.12-3: Pressurizer Limitations for OPS Inoperable, 20 EFPY (Up to three charging pumps and/or one safety injection pump capable of feeding the RCS)

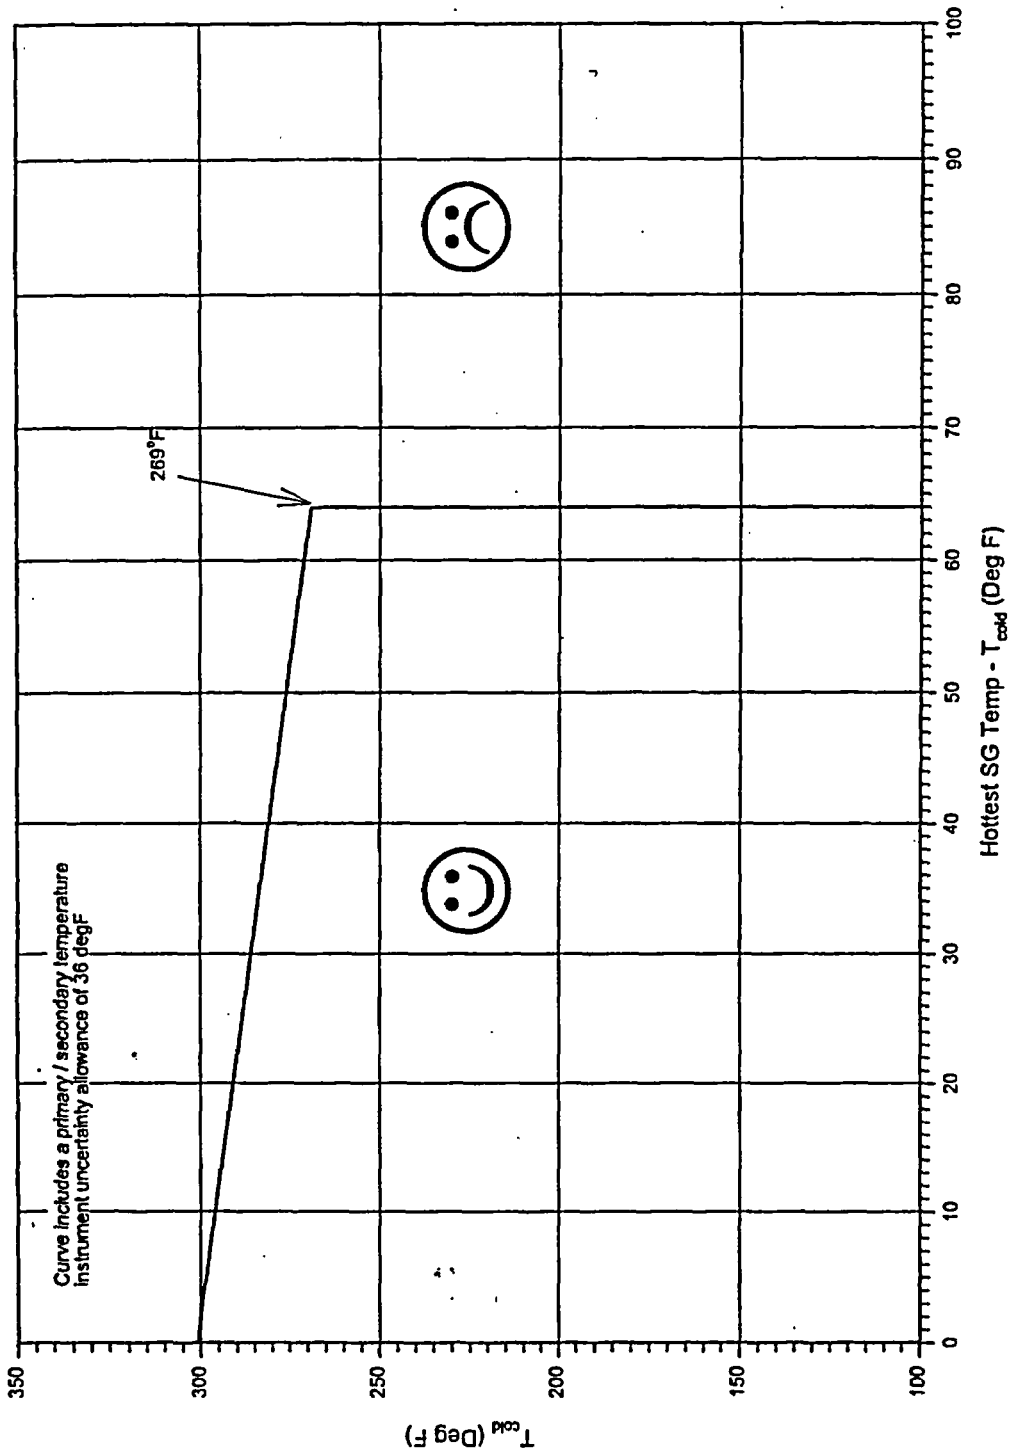

Figure 3.4.12-4: Secondary Side Limitations for RCP Start with Secondary Side Hotter than Primary Side, 20 EFPY