

Dominion Nuclear Connecticut, Inc.  
Millstone Power Station  
Rope Ferry Road  
Waterford, CT 06385



**Dominion™**

DEC 8 2003

Docket No. 50-336  
B19023

U.S. Nuclear Regulatory Commission  
Attention: Document Control Desk  
Washington, DC 20555

Millstone Power Station, Unit No. 2  
Core Operating Limits Report, Cycle 16

In accordance with the Millstone Unit No. 2 Technical Specifications, Section 6.9.1.8.d, Dominion Nuclear Connecticut, Inc., hereby submits, as Enclosure 1, the Cycle 16 Core Operating Limits Report (COLR).

The Millstone Unit No. 2 COLR has been revised to incorporate changes for Cycle 16 operation. The changes included revisions to Section 3.0, Analytical Methods, and Figure 2.5-1, Axial Shape Index vs. Percent of Allowable Power Level.

The COLR has been incorporated into the Millstone Unit No. 2 Technical Requirements Manual.

There are no regulatory commitments contained within this letter.

Should there be any questions regarding this submittal, please contact Mr. David W. Dodson at (860) 447-1791, extension 2346.

Very truly yours,

DOMINION NUCLEAR CONNECTICUT, INC.

  
\_\_\_\_\_  
J. Alan Price  
Site Vice President - Millstone

Enclosure (1)

cc: H. J. Miller, Region I Administrator  
R. M. Pulsifer, NRC Project Manager, Millstone Unit No. 2  
NRC Senior Resident Inspector

AC01

Docket No. 50-336  
B19023

Enclosure 1

Millstone Power Station, Unit No. 2

Core Operating Limits Report, Cycle 16

**TECHNICAL REQUIREMENTS MANUAL**  
**Appendix 8.1**  
**CORE OPERATING LIMITS REPORT, CYCLE 16**

## 1. CORE OPERATING LIMITS REPORT

This Core Operating Limits Report for Millstone 2 has been prepared in accordance with the requirements of Technical Specification 6.9.1.8. The Technical Specifications affected by this report are listed below:

<u>Section</u>	<u>Specification</u>	
2.1	3/4.1.1.1	SHUTDOWN MARGIN – $T_{avg} > 200^{\circ}\text{F}$
2.2	3/4.1.1.2	SHUTDOWN MARGIN – $T_{avg} \leq 200^{\circ}\text{F}$
2.3	3/4.1.1.4	Moderator Temperature Coefficient
2.4	3/4.1.3.6	Regulating CEA Insertion Limits
2.5	3/4.2.1	Linear Heat Rate
2.6	3/4.2.3	TOTAL UNRODDED INTEGRATED RADIAL PEAKING FACTOR – $F_r^T$
2.7	3/4.2.6	DNB Margin

Terms appearing in capitalized type are DEFINED TERMS as defined in Section 1.0 of the Technical Specifications.

## 2. OPERATING LIMITS

The cycle-specific parameter limits for the specifications listed in Section 1.0 are presented in the following subsections. These limits have been developed using the NRC-approved methodologies specified in Section 3.

2.1 SHUTDOWN MARGIN –  $T_{avg} > 200^{\circ}\text{F}$  (Specification 3/4.1.1.1)

The SHUTDOWN MARGIN shall be  $\geq 3.6\% \Delta\text{K/K}$

2.2 SHUTDOWN MARGIN –  $T_{avg} \leq 200^{\circ}\text{F}$  (Specification 3/4.1.1.2)

The SHUTDOWN MARGIN shall be  $\geq 3.6\% \Delta\text{K/K}$

2.3 Moderator Temperature Coefficient (Specification 3/4.1.1.4)

The moderator temperature coefficient shall be:

**TECHNICAL REQUIREMENTS MANUAL**  
**Appendix 8.1**  
**CORE OPERATING LIMITS REPORT, CYCLE 16**

- a. Less positive than  $0.7 \times 10^{-4} \Delta K/K/^{\circ}F$  whenever THERMAL POWER is  $\leq 70\%$  of RATED THERMAL POWER,
- b. Less positive than  $0.4 \times 10^{-4} \Delta K/K/^{\circ}F$  whenever THERMAL POWER is  $> 70\%$  of RATED THERMAL POWER,
- c. Less negative than  $-3.2 \times 10^{-4} \Delta K/K/^{\circ}F$  at RATED THERMAL POWER

**2.4 Regulating CEA Insertion Limits (Specification 3/4.1.3.6)**

The regulating CEA groups shall be limited to the withdrawal sequence and to the insertion limits shown in Figure 2.4-1. CEA insertion between the Long Term Steady State Insertion Limits and the Transient Insertion Limits is restricted to:

- a.  $\leq 4$  hours per 24 hour interval,
- b.  $\leq 5$  Effective Full Power Days per 30 Effective Full Power Day interval, and
- c.  $\leq 14$  Effective Full Power Days per calendar year.

**2.5 Linear Heat Rate (Specification 3/4.2.1)**

The Linear heat rate, including heat generated in the fuel, clad and moderator, shall not exceed:

- a) 15.1 kw/ft whenever the reactor coolant flow rate (determined per Specification 3/4.2.6.1) is  $\geq 360,000$  gpm.
- b) 15.0 kw/ft whenever the reactor coolant flow rate (determined per Specification 3/4.2.6.1) is  $< 360,000$  gpm and  $\geq 354,600$  gpm.
- c) 14.9 kw/ft whenever the reactor coolant flow rate (determined per Specification 3/4.2.6.1) is  $< 354,600$  gpm and  $\geq 349,200$  gpm.

During operation with the linear heat rate being monitored by the Excore Detector Monitoring System, the AXIAL SHAPE INDEX shall remain within the limits of Figure 2.5-1.

During operation with the linear heat rate being monitored by the Incore Detector Monitor System, the alarm setpoints shall be adjusted to less than or equal to the limit when the following factors are appropriately included in the setting of the alarms:

1. A measurement-calculational uncertainty factor of 1.07,
2. An engineering uncertainty factor of 1.03, and
3. A THERMAL POWER measurement uncertainty factor of 1.02.

**TECHNICAL REQUIREMENTS MANUAL**  
**Appendix 8.1**  
**CORE OPERATING LIMITS REPORT, CYCLE 16**

**2.6 TOTAL UNRODDED INTEGRATED RADIAL PEAKING FACTOR –  $F_r^T$  (Specification 3/4.2.3)**

The calculated value of  $F_r^T$  at RATED THERMAL POWER shall be:

≤ 1.690 whenever the reactor coolant flow rate is ≥ 360,000 gpm.

≤ 1.664 whenever the reactor coolant flow rate is < 360,000 gpm and ≥ 354,600 gpm.

≤ 1.639 whenever the reactor coolant flow rate is < 354,600 gpm and ≥ 349,200 gpm.

2.6.1. The Power Dependent  $F_r^T$  limits, whenever the reactor coolant flow rate is ≥ 360,000 gpm, are shown in Figure 2.6-1.

2.6.2. The Power Dependent  $F_r^T$  limits, whenever the reactor coolant flow rate is < 360,00 gpm and ≥ 354,600 gpm, are shown in Figure 2.6-2.

2.6.3. The Power Dependent  $F_r^T$  limits, whenever the reactor coolant flow rate is < 354,600 gpm and ≥ 349,200 gpm, are shown in Figure 2.6-3.

**2.7 DNB Margin (Specification 3/4.2.6)**

The DNB margin shall be preserved by maintaining the cold leg temperature, pressurizer pressure, reactor coolant flow rate, and AXIAL SHAPE INDEX within the following limits:

<u>Parameter</u>	<u>Limits</u>
<u>Four Reactor Coolant Pumps Operations</u>	
a. Cold Leg Temperature	≤ 549°F
b. Pressurizer Pressure	> 2225 psia*
c. Reactor Coolant Flow Rate	≥ 360,000 gpm with Linear Heat Rate and $F_r^T$ limits as specified in Sections 2.5 and 2.6. or ≥ 354,600 gpm with Linear Heat Rate and $F_r^T$ limit reductions as specified in Sections 2.5 and 2.6. or ≥ 349,200 gpm with Linear Heat Rate and $F_r^T$ limit reductions as specified in Sections 2.5 and 2.6.
d. AXIAL SHAPE INDEX	FIGURE 2.7-1

\*Limit not applicable during either the THERMAL POWER ramp increase in excess of 5% of RATED THERMAL POWER per minute or a THERMAL POWER step increase of greater than 10% of RATED THERMAL POWER.

**TECHNICAL REQUIREMENTS MANUAL**  
**Appendix 8.1**  
**CORE OPERATING LIMITS REPORT, CYCLE 16**

**3. ANALYTICAL METHODS**


The analytical methods used to determine the core operating limits shall be those previously reviewed and approved by the NRC, specifically those described in the following documents:

- 3.1 EMF-96-029(P)(A) Volumes 1 and 2, "Reactor Analysis System for PWRs Volume 1 - Methodology Description, Volume 2 - Benchmarking Results," Siemens Power Corporation, January 1997.
- 3.2 ANF-84-73 Revision 5 Appendix B(P)(A), "Advanced Nuclear Fuels Methodology for Pressurized Water Reactors: Analysis of Chapter 15 Events," Advanced Nuclear Fuels, July 1990.
- 3.3 XN-NF-92-21(P)(A) Revision 1, "Application of Exxon Nuclear Company PWR Thermal Margin Methodology to Mixed Core Configurations," Exxon Nuclear Company, September 1983.
- 3.4 XN-75-32(P)(A) Supplements 1 through 4, "Computational Procedure for Evaluating Fuel Rod Bowing," Exxon Nuclear Company, October 1983.
- 3.5 EMF-2328(P)(A), "PWR Small Break LOCA Evaluation Model S-RELAP5 Based," Framatome ANP, March 2001.
- 3.6 EMF-2087(P)(A), "SEM/PWR-98: ECCS Evaluation Model for PWR LBLOCA Applications," Siemens Power Corporation, June 1999.
- 3.7 XN-NF-78-44(NP)(A), "A Generic Analysis of the Control Rod Ejection Transient for Pressurized Water Reactors," Exxon Nuclear Company, October 1983.
- 3.8 XN-NF-621(P)(A) Revision 1, "Exxon Nuclear DNB Correlation for PWR Fuel Designs," Exxon Nuclear Company, September 1983.
- 3.9 XN-NF-82-06(P)(A) Revision 1 and Supplements 2, 4, and 5, "Qualification of Exxon Nuclear Fuel for Extended Burnup," Exxon Nuclear Company, October 1986.
- 3.10 ANF-88-133(P)(A) and Supplement 1, "Qualification of Advanced Nuclear Fuels PWR Design Methodology for Rod Burnups of 62 GWd/MTU," Advanced Nuclear Fuels Corporation, December 1991.

**TECHNICAL REQUIREMENTS MANUAL**  
**Appendix 8.1**  
**CORE OPERATING LIMITS REPORT, CYCLE 16**

- 3.11 XN-NF-85-92(P)(A) "Exxon Nuclear Uranium Dioxide/Gadolinia Irradiation Examination and Thermal Conductivity Results," Exxon Nuclear Company, November 1988.
- 3.12 ANF-89-151(P)(A), "ANF-RELAP Methodology for Pressurized Water Reactors: Analysis of Non-LOCA Chapter 15 Events," Advanced Nuclear Fuels Corporation, May 1992.
- 3.13 EMF-1961(P)(A) Revision 0, "Statistical Setpoint/Transient Methodology for Combustion Engineering Type Reactors," Siemens Power Corporation, July 2000.
- 3.14 EMF-2310(P)(A), "SRP Chapter 15 Non-LOCA Methodology for Pressurized Water Reactors," Framatome ANP, May 2001.
- 3.15 EMF-92-153(P)(A), and Supplement 1, "HTP: Departure from Nucleate Boiling Correlation for High Thermal Performance Fuel," Siemens Power Corporation, March 1994."

**TECHNICAL REQUIREMENTS MANUAL**  
**Appendix 8.1**  
**CORE OPERATING LIMITS REPORT, CYCLE 16**

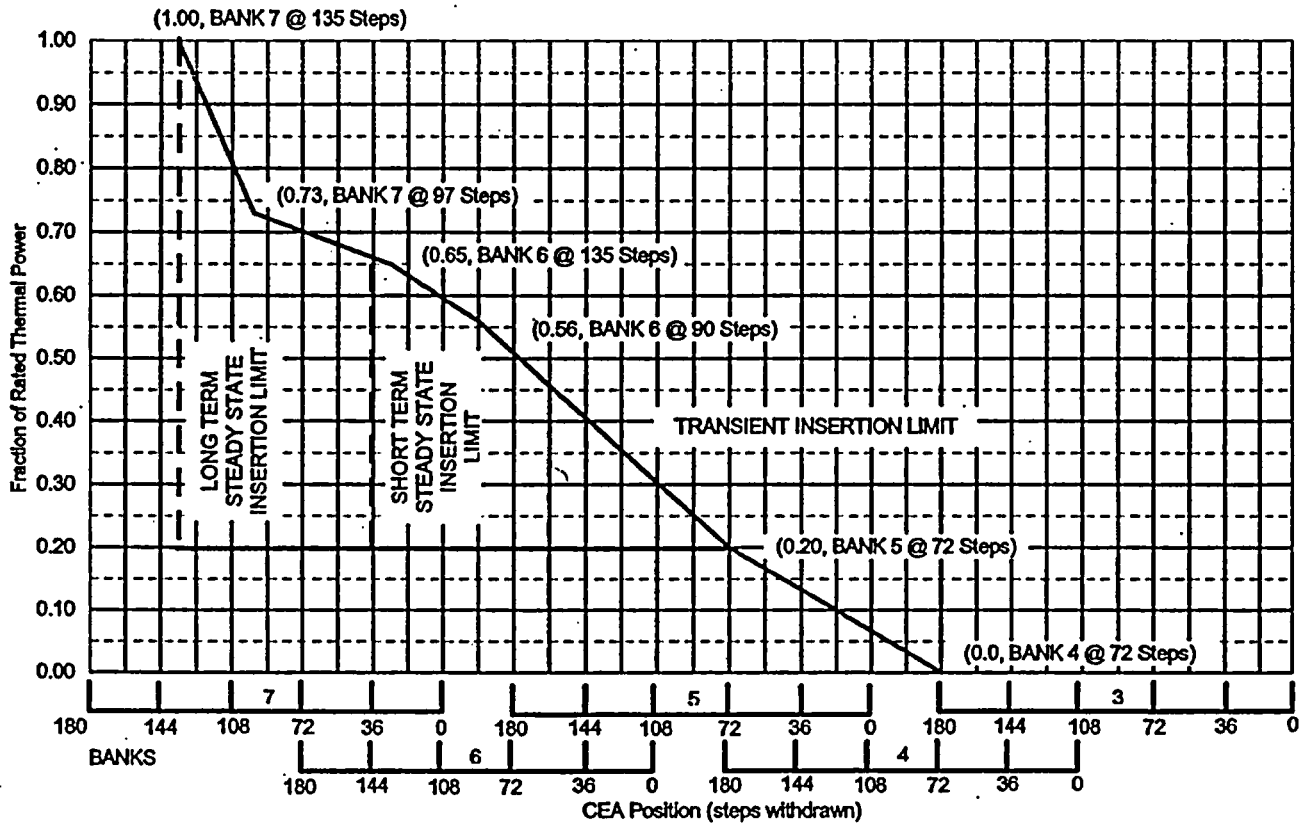

**FIGURE 2.4-1**  
**CEA Insertion Limit vs. THERMAL POWER With**  
**Four Reactor Coolant Pumps Operating**



**TECHNICAL REQUIREMENTS MANUAL**  
**Appendix 8.1**  
**CORE OPERATING LIMITS REPORT, CYCLE 16**


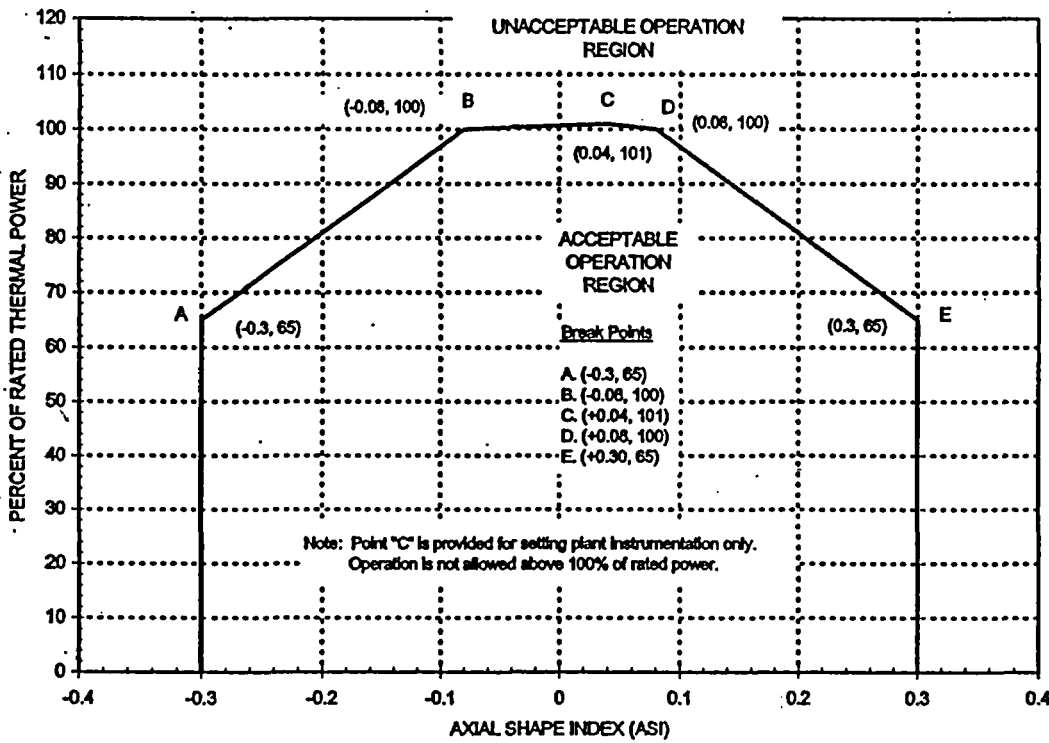


FIGURE 2.5-1  
 AXIAL SHAPE INDEX vs.  
 PERCENT OF ALLOWABLE POWER LEVEL


**TECHNICAL REQUIREMENTS MANUAL**  
**Appendix 8.1**  
**CORE OPERATING LIMITS REPORT, CYCLE 16**

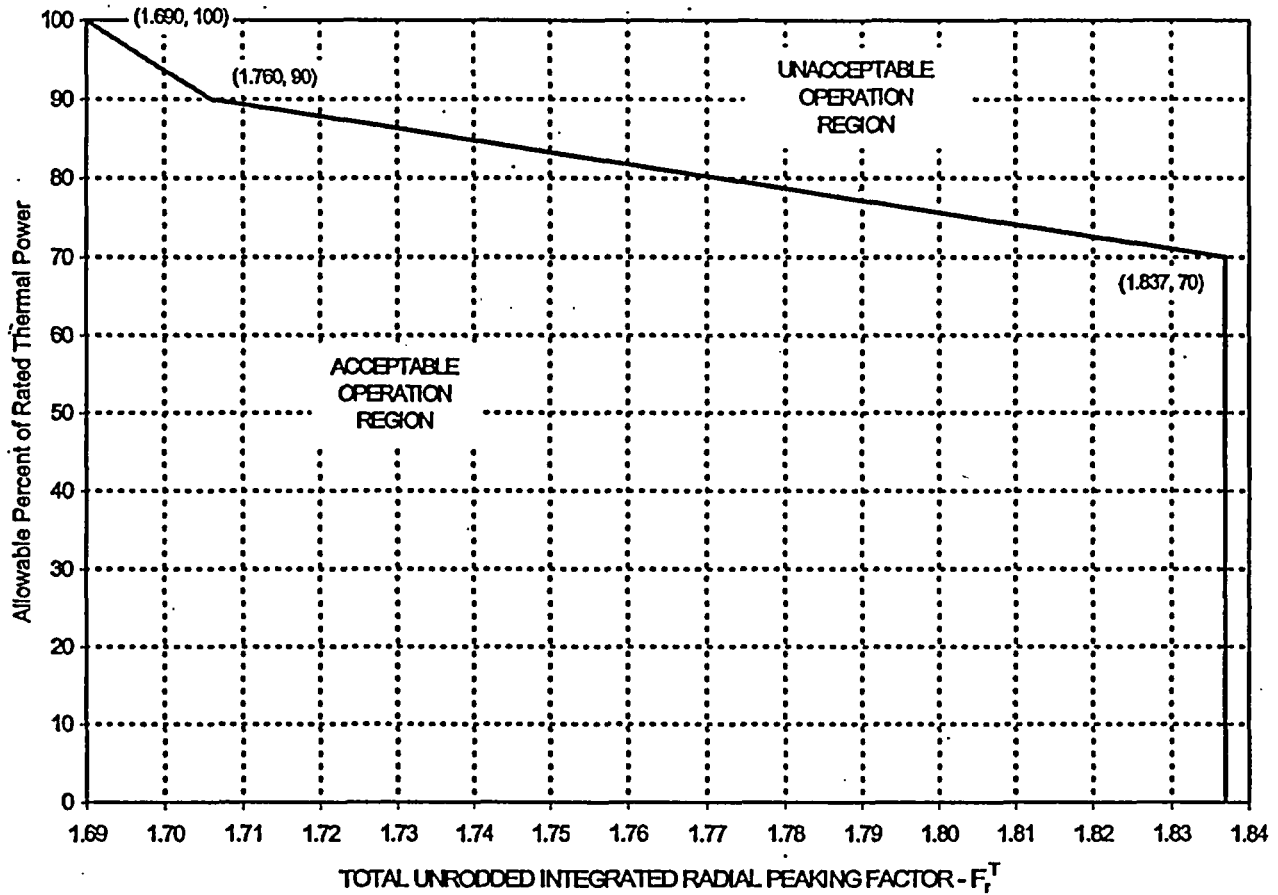

Note: The  $F_r^T$  limit should be reduced for reactor coolant flow rates  $\geq 349,200$  gpm and  $< 360,000$  gpm (see Section 2.6).


FIGURE 2.6-1  
TOTAL UNRODDED INTEGRATED RADIAL PEAKING FACTOR  
vs. Allowable Rated Thermal Power  
For Reactor Coolant Flow Rates  $\geq 360,000$  gpm

**TECHNICAL REQUIREMENTS MANUAL**  
**Appendix 8.1**  
**CORE OPERATING LIMITS REPORT, CYCLE 16**

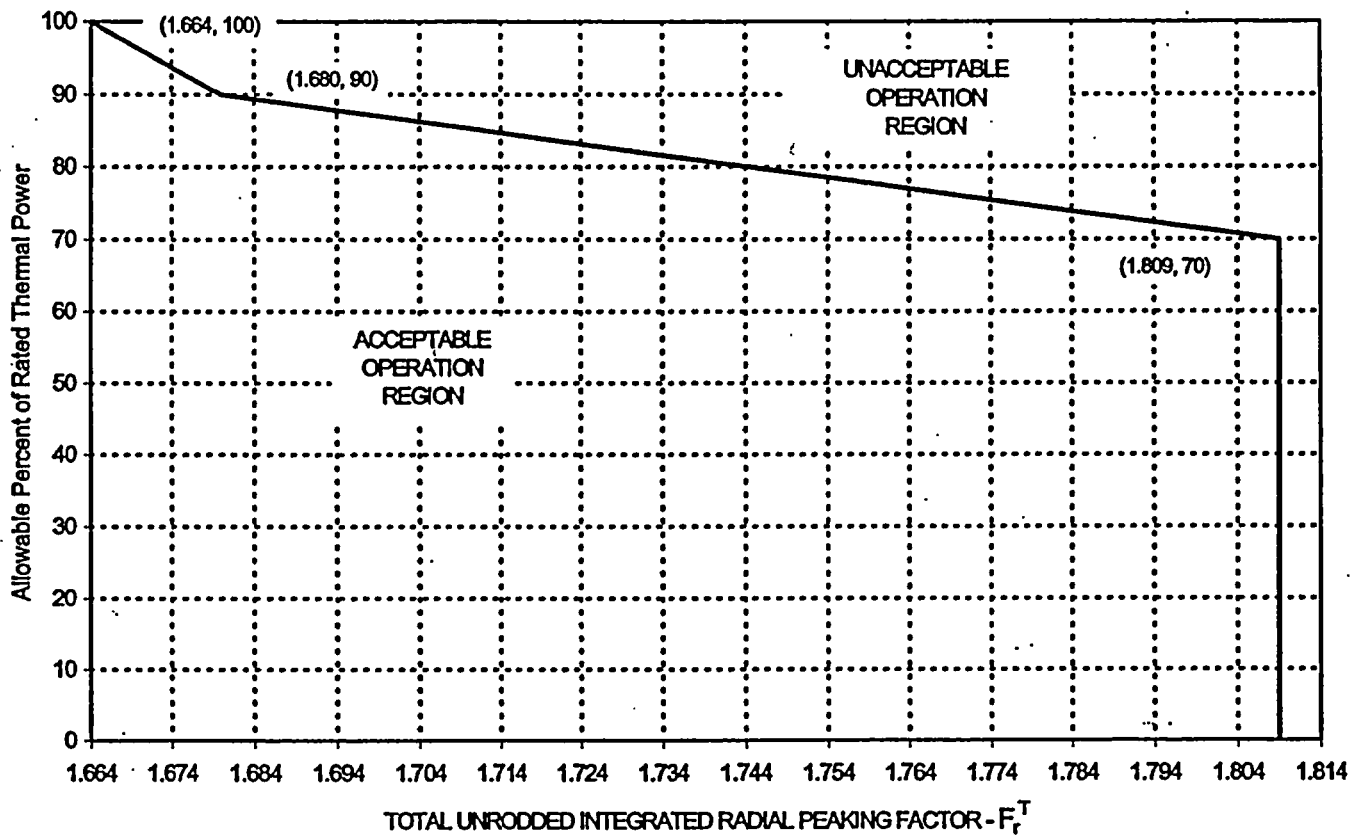


**FIGURE 2.6-2**  
**TOTAL UNRODDED INTEGRATED RADIAL PEAKING FACTOR**  
**vs. Allowable Rated Thermal Power**  
**For Reactor Coolant Flow Rates < 360,000 gpm and  $\geq$  354,600 gpm**

**TECHNICAL REQUIREMENTS MANUAL**  
**Appendix 8.1**  
**CORE OPERATING LIMITS REPORT, CYCLE 16**

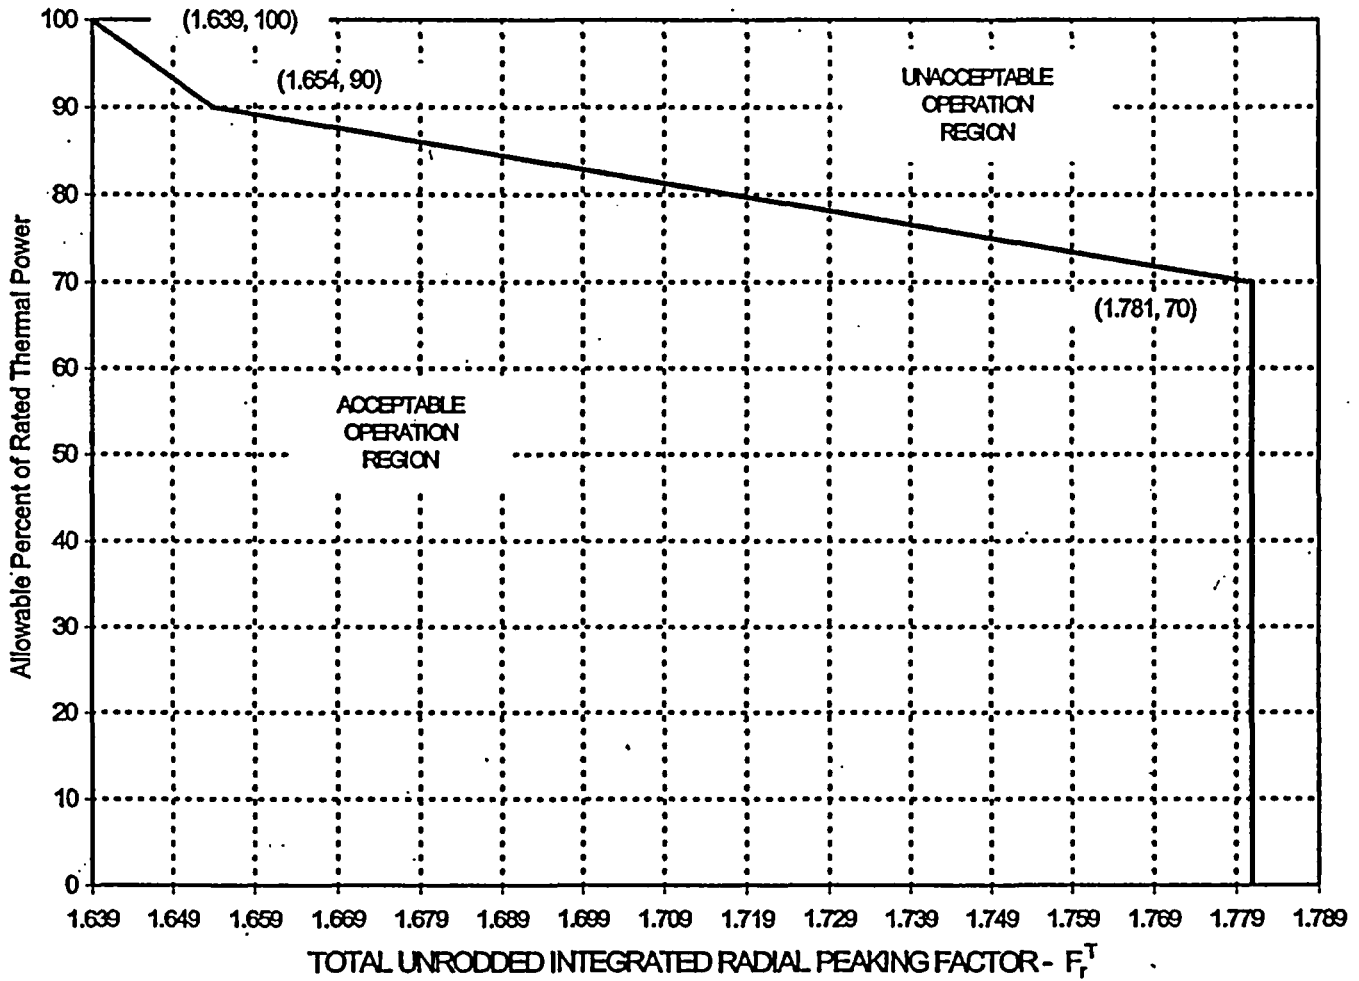

**FIGURE 2.6-3**  
**TOTAL UNRODDED INTEGRATED RADIAL PEAKING FACTOR**  
**vs. Allowable Rated Thermal Power**  
**For Reactor Coolant Flow Rates < 354,600 gpm and ≥ 349,200 gpm**

**TECHNICAL REQUIREMENTS MANUAL**  
**Appendix 8.1**  
**CORE OPERATING LIMITS REPORT, CYCLE 16**

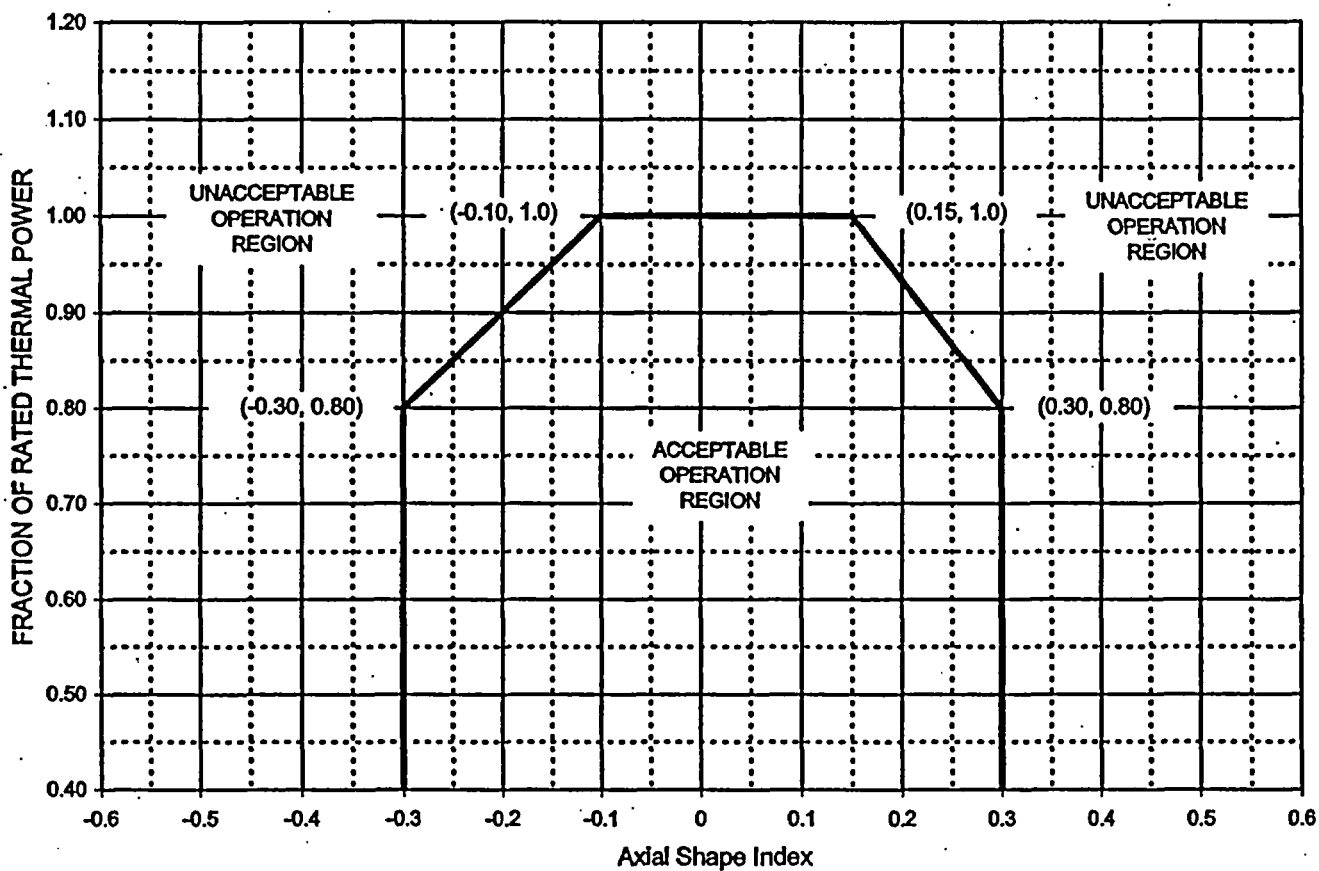

**FIGURE 2.7-1**  
**AXIAL SHAPE INDEX Operating Limits With**  
**Four Reactor Coolant Pumps Operating**