


# SIGNIFICANCE DETERMINATION

Diablo Canyon Fire Protection Triennial Inspection  
IR 50-275/03-02; 50-323/03-02

## Issue Dispositioning Screening (IMC 0612, Appendix B and Appendix E)

Performance Deficiency: The licensee failed to implement a procedure that would ensure operators could complete required actions in a timely manner in order to achieve and maintain hot shutdown conditions, in the event of a control room fire requiring control room evacuation and remote shutdown. Specifically, during a simulated fire in the control room, operators could not close PORVs within 5 minutes as analyzed, and could not establish AFW within 30 minutes, as analyzed.

eks

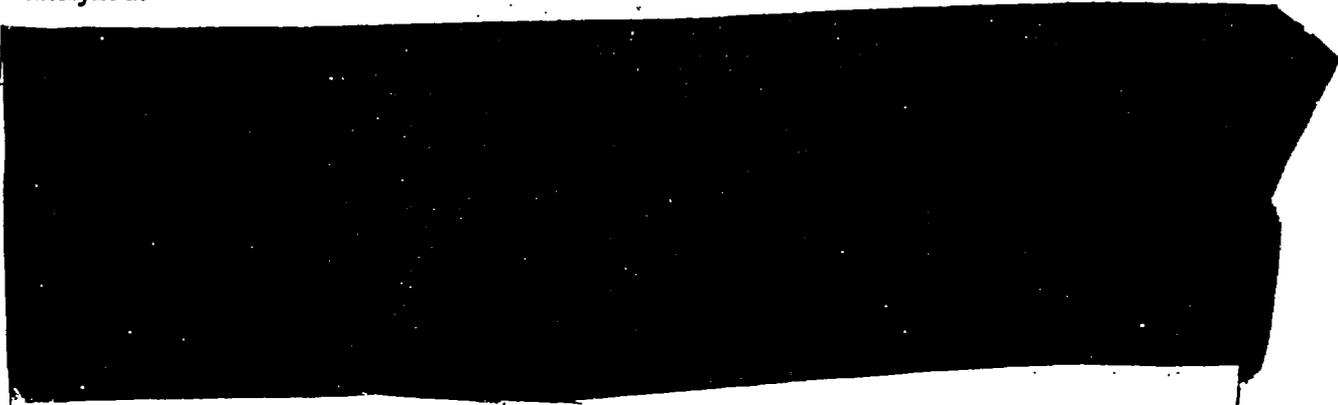

## PHASE 1 (IMC 0609, Appendix A)

eks

Step 1.1 - Performance Deficiency: The licensee failed to implement a procedure that would ensure operators could complete required actions in a timely manner in order to achieve and maintain hot shutdown conditions, in the event of a control room fire requiring control room evacuation and remote shutdown. Specifically, during a simulated fire in the control room, operators could not [redacted] as analyzed, and could not establish AFW within 30 minutes, as analyzed.

### Step 1.2 - Initial Screening of the Inspection Finding

Using the "SDP Phase 1 Screening Worksheet for IE, MS, and B Cornerstones"

Reference/Title: Inspection Report 50-275/03-02; 50-323/03-02

eks

Performance Deficiency: The licensee failed to implement a procedure that would ensure operators could complete required actions in a timely manner in order to achieve and maintain hot shutdown conditions, in the event of a control room fire requiring control room evacuation and remote shutdown. Specifically, during a simulated fire in the control room, operators could not [redacted] as analyzed, and could not establish AFW within 30 minutes, as analyzed.

BB-16

**Factual Description of Identified Condition:** During a walkdown of the licensee's Procedure OP AP-8A, "Control Room Inaccessibility Hot Standby used for shutting down the reactor in the event of a fire in the control room requiring evacuation and remote shutdown, the team found that operators could not establish auxiliary feedwater within 30 minutes assumed in Calculation M-944.

On April 4, 2003, in response to the team's finding the licensee re-timed the operator actions in AP-8A, using their ASD simulator. During this simulated event, operators took 18 minutes to close the PORV and 42 minutes to initiate AFW. Calculation M-944 requires that the PORVs be closed in 5 minutes and AFW be established in 30 minutes. The licensee initiated AR A0580357 to place this item into the corrective action system.

**System(s) and Train(s) Degraded by Identified Condition:** [REDACTED] and both trains of AFW.

**Licensing Basis Function of System(s) or Train(s):** The licensee credits Procedure OP-8A for meeting the requirements of 10 CFR Part 50, Appendix R, Section III.G.3 and III.L.

**Other Safety Function of System(s) or Train(s):** Not applicable

**Maintenance Rule Category:** Risk-significant

**Time that Identified condition existed or is assumed to have existed:** greater than 30 days

**Functions and Cornerstones degraded as a result of this identified condition:** [REDACTED]

If the finding is assumed to degrade fire protection defense in depth (DID), detection, suppression, barriers, fire brigade. STOP. Go to IMC 0609, Appendix F

## **PHASE 1 (IMC 0609, Appendix F)**


### **Step F.4 - Fire Protection Risk Significance Screening Methodology - Phase 1**

#### **Step 1: Screening of Fire Protection Findings:**

##### **Figure 4-1: Screening Process Phase 1 (Step 1)**

**Clearly Stated Fire Protection Findings:** The licensee failed to implement a procedure that would ensure operators could complete required actions in a timely manner in order to achieve and maintain hot shutdown conditions, in the event of a control room fire requiring control room evacuation and remote shutdown.

On April 4, 2003, in response to the team's finding the licensee re-timed the operator actions in AP-8A, using their ASD simulator. During this simulated event, operators took [REDACTED] and 42 minutes to initiate AFW. Calculation M-944 requires that the PORVs be closed in 5 minutes and AFW be established in 30 minutes.

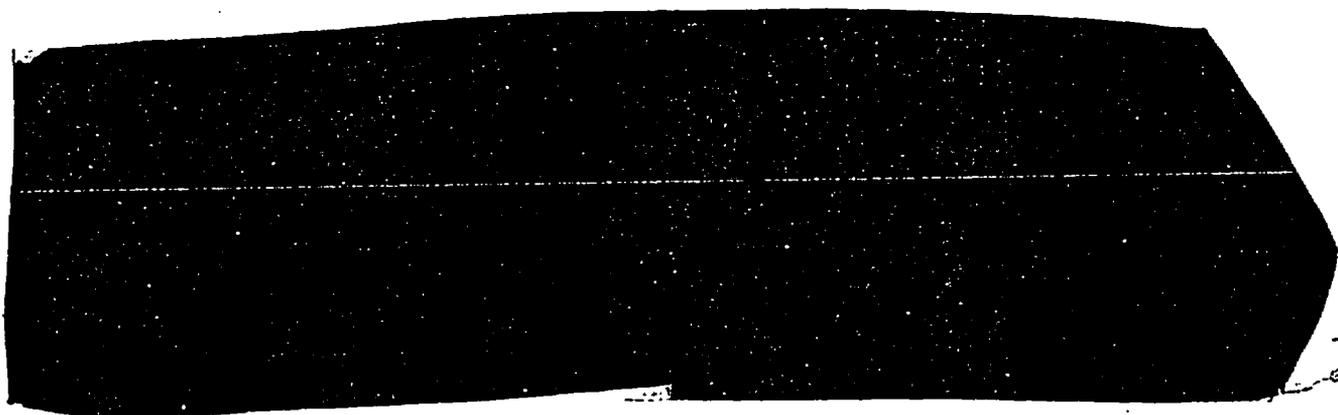

Step 2: Safety Importance Determination


Using Figure 4-3 as the protection scheme and screening criteria for Figure 4-3 to determine if the fire protection DID findings are potentially significant:

Is fixed fire suppression system affected by the finding? [redacted]

Does fire barrier forming the fire area boundaries interface with recovery areas. Are any of these fire barriers affected by the finding? [redacted]

Is detection or fire brigade effectiveness affected by the finding? [redacted]

PHASE 1 CONCLUSION

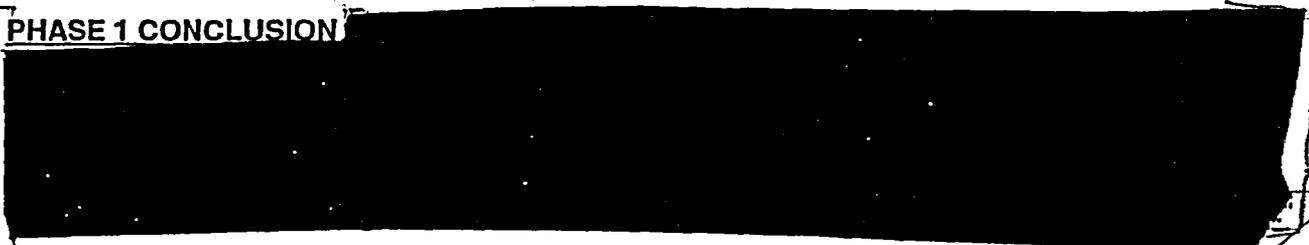

PHASE 2 (IMC 0609, Appendix F)

Step 1: Grouping of Fire Protection and Post-fire Safe Shutdown Findings

The alternative shutdown procedure is inadequate, in that During a simulated control room fire requiring evacuation and remote shutdown, operators took [redacted] and 42 minutes to initiate AFW. Calculation M-944 requires that the PORVs be closed in 5 minutes and AFW be established in 30 minutes.

Step 2: Define the Fire Scenario



[REDACTED]

Step 3: Quantitative Evaluation of Findings

5

[REDACTED]

Steps 4 through 7

Using Table 5.1 determine the risk associated with DID elements. and the FMF formula:  
 $FMF = \log(IF) + FB + MS + AS + CC$  (when appropriate)

5

[REDACTED]

Step 8: Modifications Necessary To Add Impact of Spurious Actuations

As stated, multiple spurious actuations occur with a probability of 0.1; therefore a factor of -1 is added to the cutset that is impacted by spurious actuations.

5

[REDACTED]

PHASE 2 CONCLUSION: In following the SDP process as outlined in IMC 0609, Appendices A and F, this issue is [REDACTED]. However, given the uncertainty concerning the ignition frequency and the RSO, and questions [REDACTED]

5

5