



# **Computer Codes and Validation Adequacy**

**David Richards**

**Manager, AECL Code Centre and Software Performance**

**ACRS Subcommittee on Future Plant Designs**

**Washington D.C.**

**January 13, 2004**





# Outline

- **AECL Computer Code Software Quality Assurance (SQA) Program**
- **Validation Methodology**
- **Industry Standard Toolset and Key ACR Computer Codes**
- **Experimental Data for Thermal Hydraulics Validation**
- **Examples of CATHENA Validation**



# **Computer Program Software Quality Assurance (SQA)**

- **Code Development and Qualification are conducted according to pre-defined QA procedures:**
  - **The Canadian Standards Association (CSA) published “Quality Assurance of Analytical, Scientific, and Design Computer Programs for Nuclear Power Plants”, N286.7-99 in March 1999**
  - **AECL published 00-01913-QAM-003, “Quality Assurance Manual for Analytical Scientific and Design Computer Programs in September 1999, and revised the document in March 2001**
- **Compliance is verified through internal, 3rd-party and regulatory audits**



# Industry Standard Toolset (IST)

- **Formal qualification of safety and licensing codes was recognized as requiring significant investment, and resulting in redundancies and inconsistencies if undertaken separately**
- **Canadian utilities and AECL worked together to qualify a standard set of computer programs (IST)**
  - **Agreed to common processes to meet CSA-N286.7-99**
  - **Shared effort on code development, qualification and support**

# Key ACR Computer Codes




Physics

Thermal-Hydraulics

Fuel & Channel

Containment & Fission Trans.


Severe Core Damage

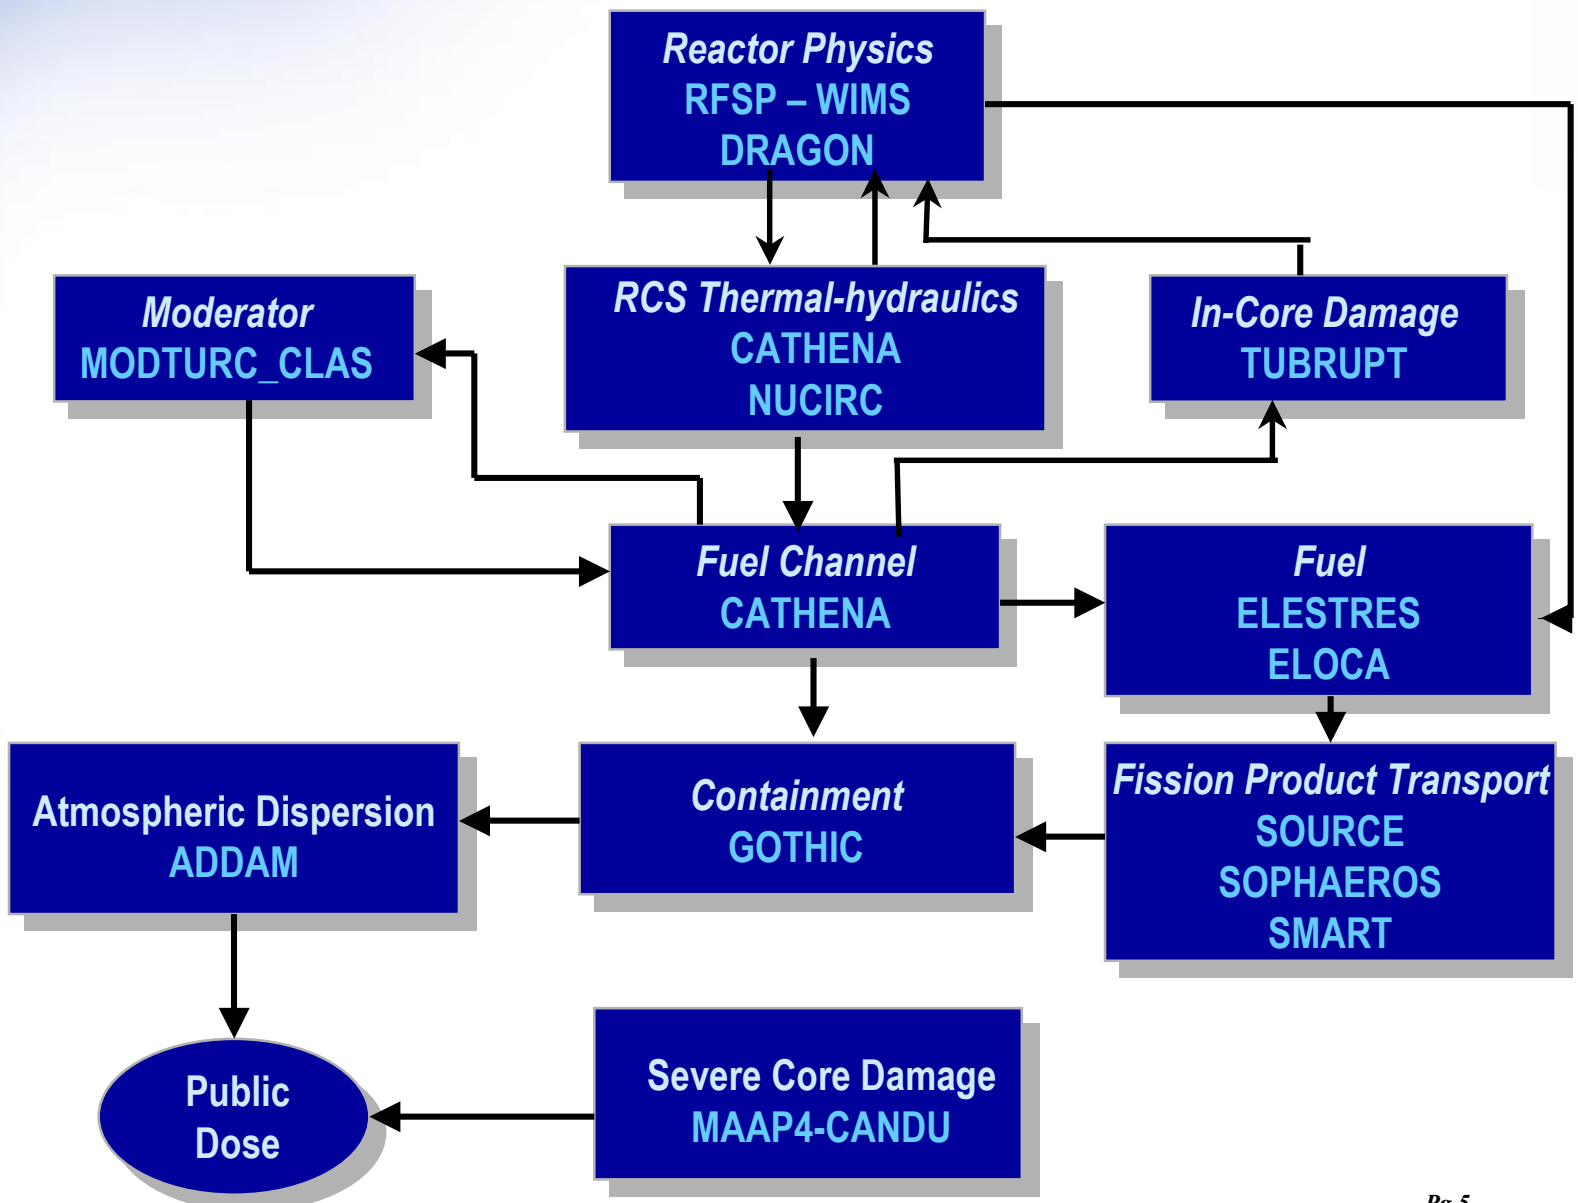



# CATHENA THERMALHYDRAULIC MODEL


Axial Segment (node)

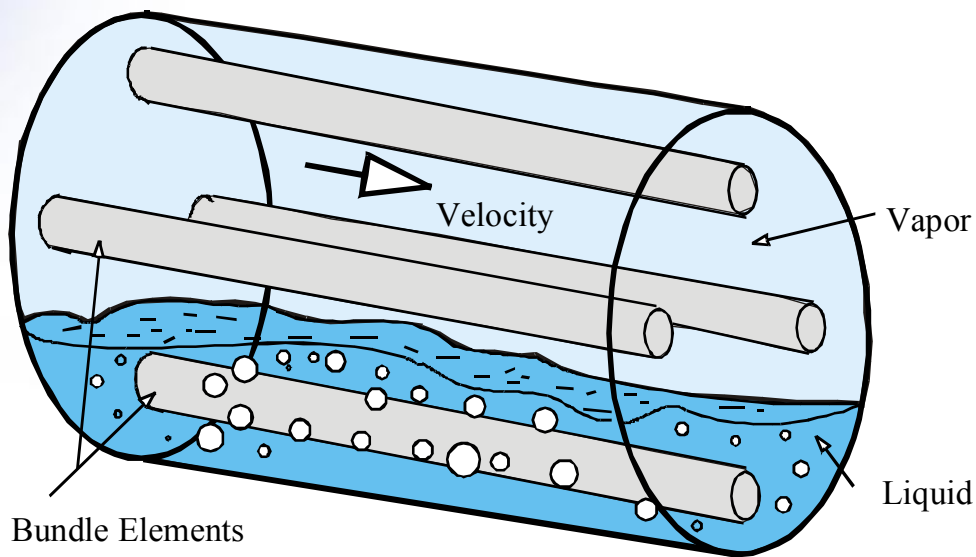

- **Non-equilibrium model**
  - 2-velocities,
  - 2-temperatures
  - 2-pressures
  - plus noncondensables
- **Flow regime dependent constitutive relations couple two-phase model**
- **CATHENA “interfaces” to other codes:**
  - i.e, Fuel Behavior, Plant Control, Physics




# CATHENA's Solid Heat Transfer Model

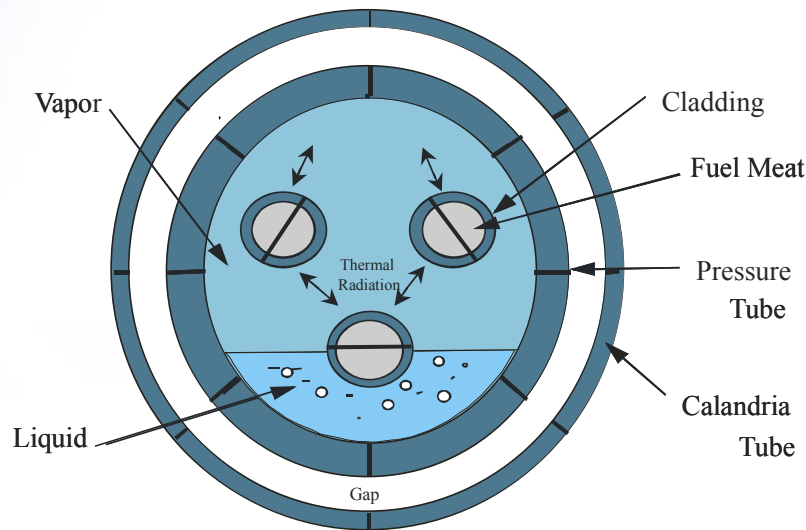

- Multiple surfaces per thermal hydraulic node
- Radial and circumferential conduction modeled
- Models heat transfer within bundles subjected to stratified flow
- Radiation heat transfer calculated
- Built-in temperature dependent material property tables
- Models deformed geometry and pressure / calandria tube contact



# Code Validation Methodology

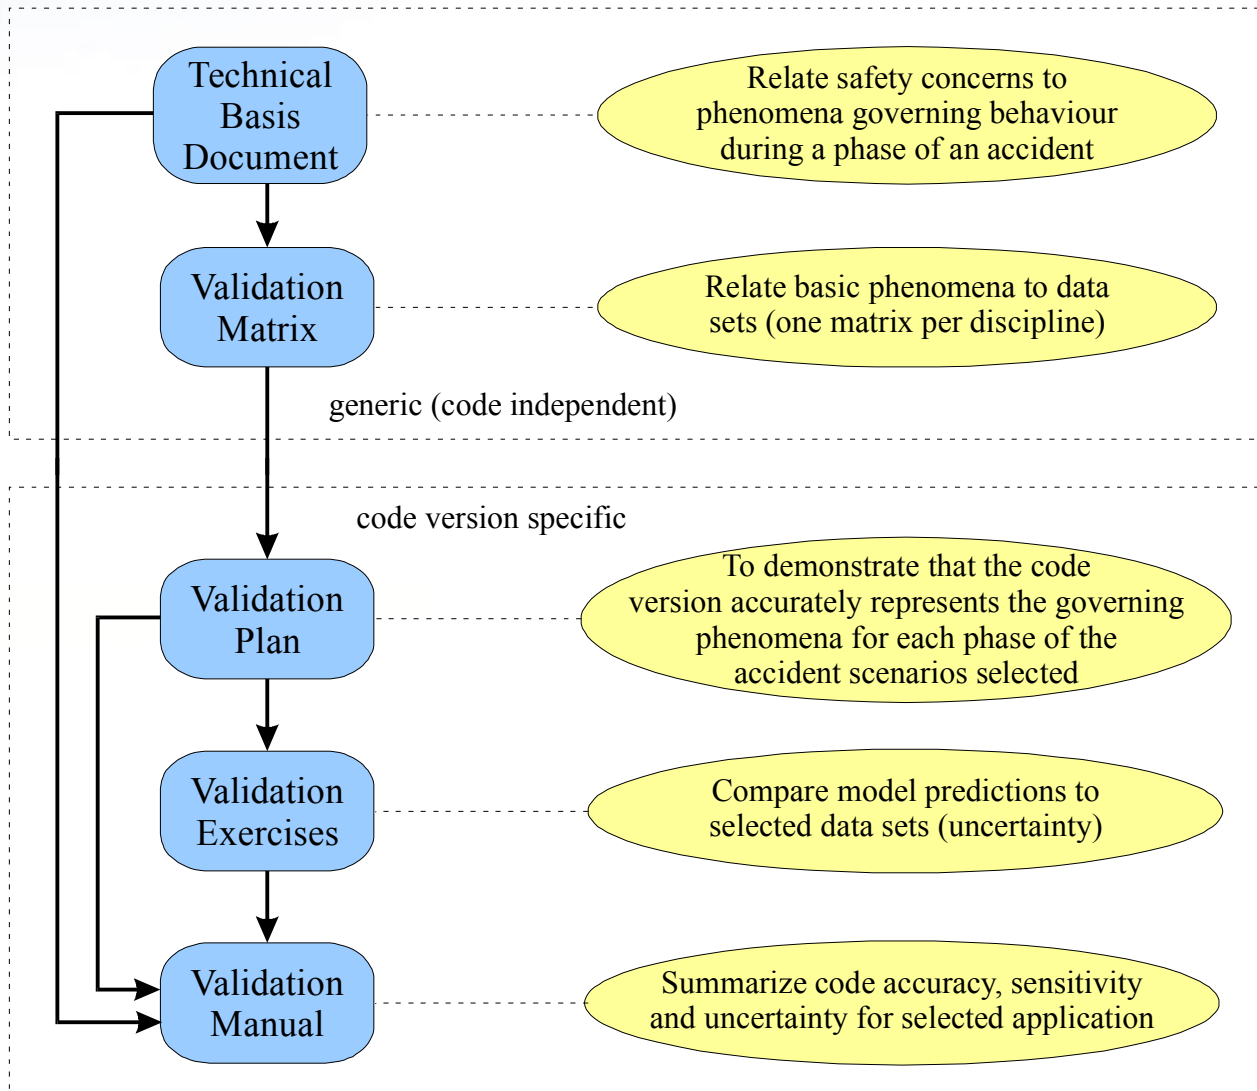





# Technical Basis Document (TBD)

- **For a given accident category, the TBD identifies:**
  - The key safety concerns
  - The expected phenomena governing the behavior that evolves with time during identifiable phases of an accident
- **The TBD establishes a relationship between technical disciplines, the safety concerns associated with a phase of an accident, the governing physical phenomena, and the relevant validation matrices**
- **Example:**
  - Early in a LOCA, “Break discharge characteristics and critical flow” is a primary (high ranking of importance) phenomenon
  - During ECC injection, “Quench/rewet characteristics” becomes a primary phenomenon



# Validation Matrices

- **Identify and describe phenomena relevant to a discipline**
- **Rank the phenomena according to their importance in accident phases (consistent with PIRT-like process)**
- **Identify data sets and cross-reference to phenomena**
  - **Separate effects experiments, integral and/or scaled experiments, analytical solutions, inter-code comparisons**
  - **Includes CANDU-specific and otherwise**



# Thermal Hydraulics Phenomena, (first 10 of 23)

ID No.	Phenomenon	Large LOCA	LOCA/ LOECC	Small LOCA	LOF	LOR	Loss of Feed-water	Steam Line Break
TH1	Break Discharge Characteristics and Critical Flow	✓	✓	✓			✓	✓
TH2	Coolant Voiding	✓	✓	✓	x	x		
TH3	Phase Separation	✓	✓	✓	✓		✓	✓
TH4	Level Swell and Void Holdup	x	x	✓				✓
TH5	Pump Characteristics (Single & 2-Phase)	✓	✓	✓	✓			✓
TH6	Thermal Conduction	✓	✓	✓	x	x		
TH7	Convective Heat Transfer	✓	✓	✓	✓	✓	✓	✓
TH8	Nucleate Boiling			✓	✓			
TH9	CHF & Post Dryout Heat Transfer	x	x	✓	✓	✓		
TH10	Condensation Heat Transfer	✓		✓	✓		✓	✓

✓ primary phenomena

x secondary phenomena




# Test Data for Thermal Hydraulics Phenomena (sample)

ID#	Data Set Name	TH2 Coolant Voiding	TH3 Phase Separat.	TH6 Thermal Conduct.	TH7 Convect. Heat Tran.	TH16 Flow Oscillation
SE1	Edwards Pipe Blowdown	■				
SE5	Marviken Bottom Blowdown	○				
SE13	PT/CT Contact Heat Transfer Tests			■		
SE21	CWIT Flow Stratification Tests		■		■	
CO1	End Fitting Characterization Tests	○	○	■		
INT9	RD-14 Natural Circulation Tests		○		■	■
INT14	Station Transients		■			■
NUM6	Radial Conduction Test			■		



Suitable for direct validation



Suitable for indirect validation



# Experimental Data Base

- **CANDU System Makes Use of International Data Sets:**
  - **Edwards Pipe Blowdown (Break Discharge)**
  - **Marviken Blowdown Tests (Break Discharge)**
  - **Dartmouth Air/Water Flooding in Straight Pipe (Counter Current Flow)**
  - **GE Large Vessel Blowdown Tests (Level Swell)**
  - **Christensen Power Void Tests (Coolant Voiding)**
  - ***..... and others***



# Experimental Data Base – CANDU Specific

- Can be subdivided into:
  - Small Scale Experiments
  - Component Experiments
  - Integral Experiments
  - CANDU Plant Transients
- The majority of existing data (supporting current CANDUs) can be used for validation of the ACR
- Where “gaps” exist (i.e., higher pressure and temperatures of the ACR), new experiments have been completed and others have been planned
- Small Scale Experiments, Examples:
  - Flooding – downstream of an elbow (relevant to feeder)
  - Pressure Tube / Calandria Tube Heat Transfer Experiments
  - Horizontal Tube Rewetting / Refilling Experiments
  - Pressure Tube Circumferential Temperature Distribution




# **Experimental Data Base – CANDU Specific**

- **Full-Scale Component Experiments:**
  - **Feeder Refilling, Cold Water Injection Test Facility**
  - **Channel Stratification Studies, Cold Water Injection Test Facility**
  - **Header Studies, Large Scale Header Facility**
  - **Header Studies, Header Visualization Facility**
  - **Pump Characterization, CANDU Pump Facility**
  - **End Fitting Studies, End Fitting Characterization Facility**



# Cold Water Injection Facility (CWIT)

- Full-scale heated fuel channel with simulated fuel string
- CANDU representative feeders and End Fittings
- Designed to investigate feeder/channel refill performance, as well as flow stratification within CANDU bundle

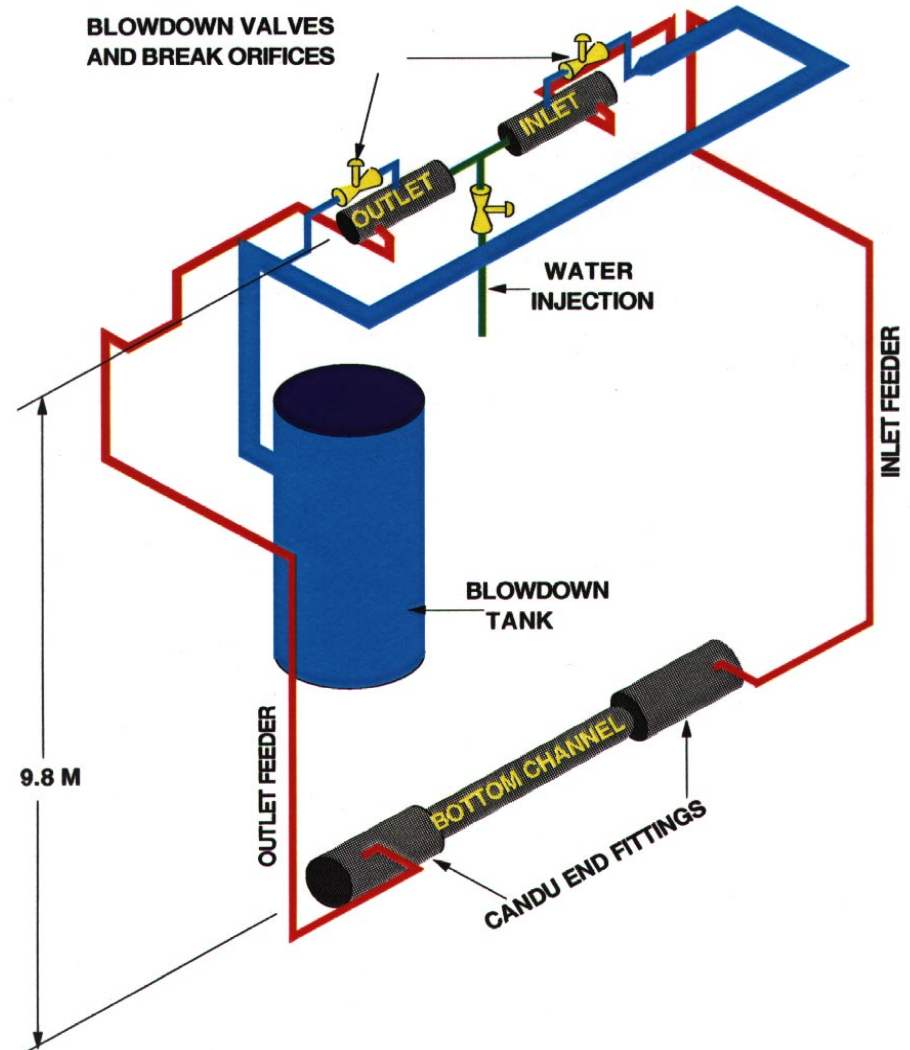


**CWIT Test Facility**





# RD-14M Integral Test Facility

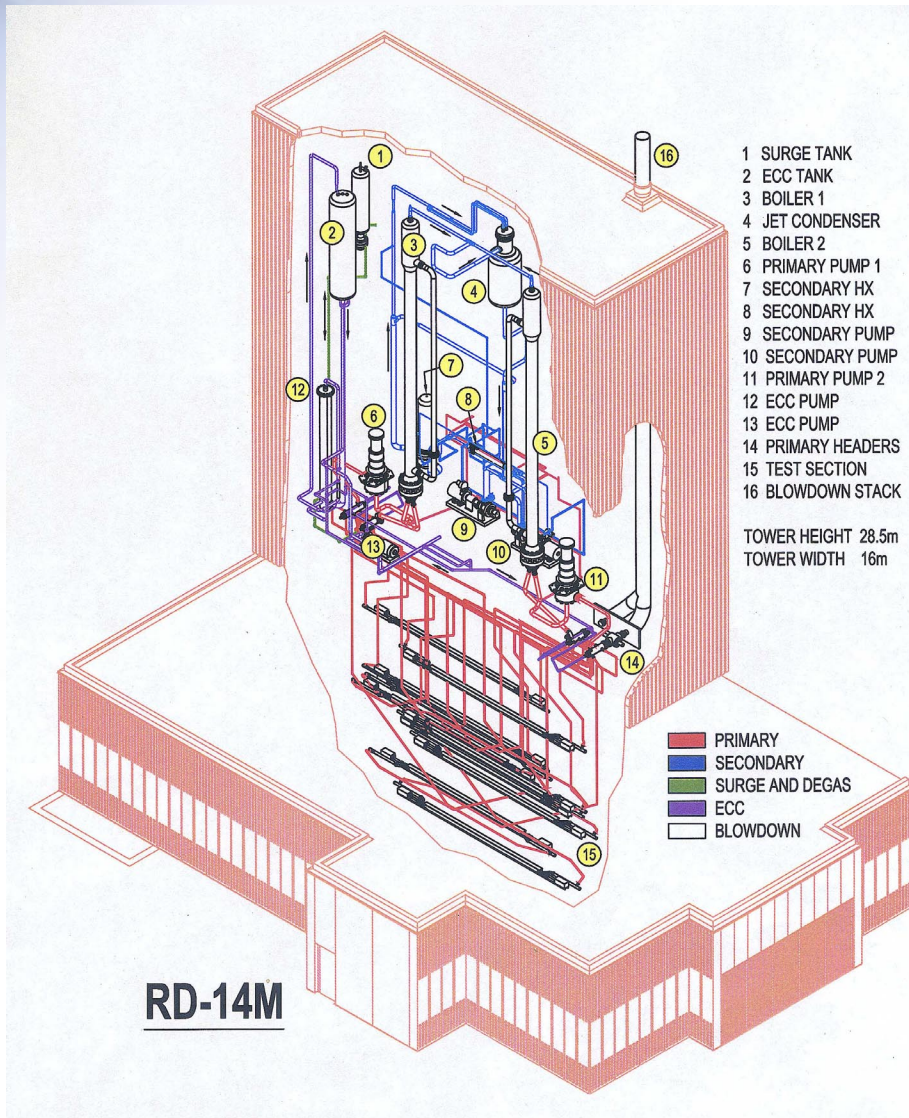

- Full elevation changes between major components and full linear dimensions
- Reactor typical heat- and mass-transfer rates
- Ten full length electrically heated channels (maximum of 11 MW)
- Simulation of all primary-side components - channels, end-fittings, feeders, headers, and steam generators
- Full pressure and temperature conditions (current CANDUs and ACR)




# Examples of Validation for CATHENA

- **Component**
  - Marviken tests, discharge characteristics
- **RD-14M**
  - Channel voiding
- **CANDU Plant transient**
  - Single-pump trip




# TH1: Break Discharge Characteristics – 3

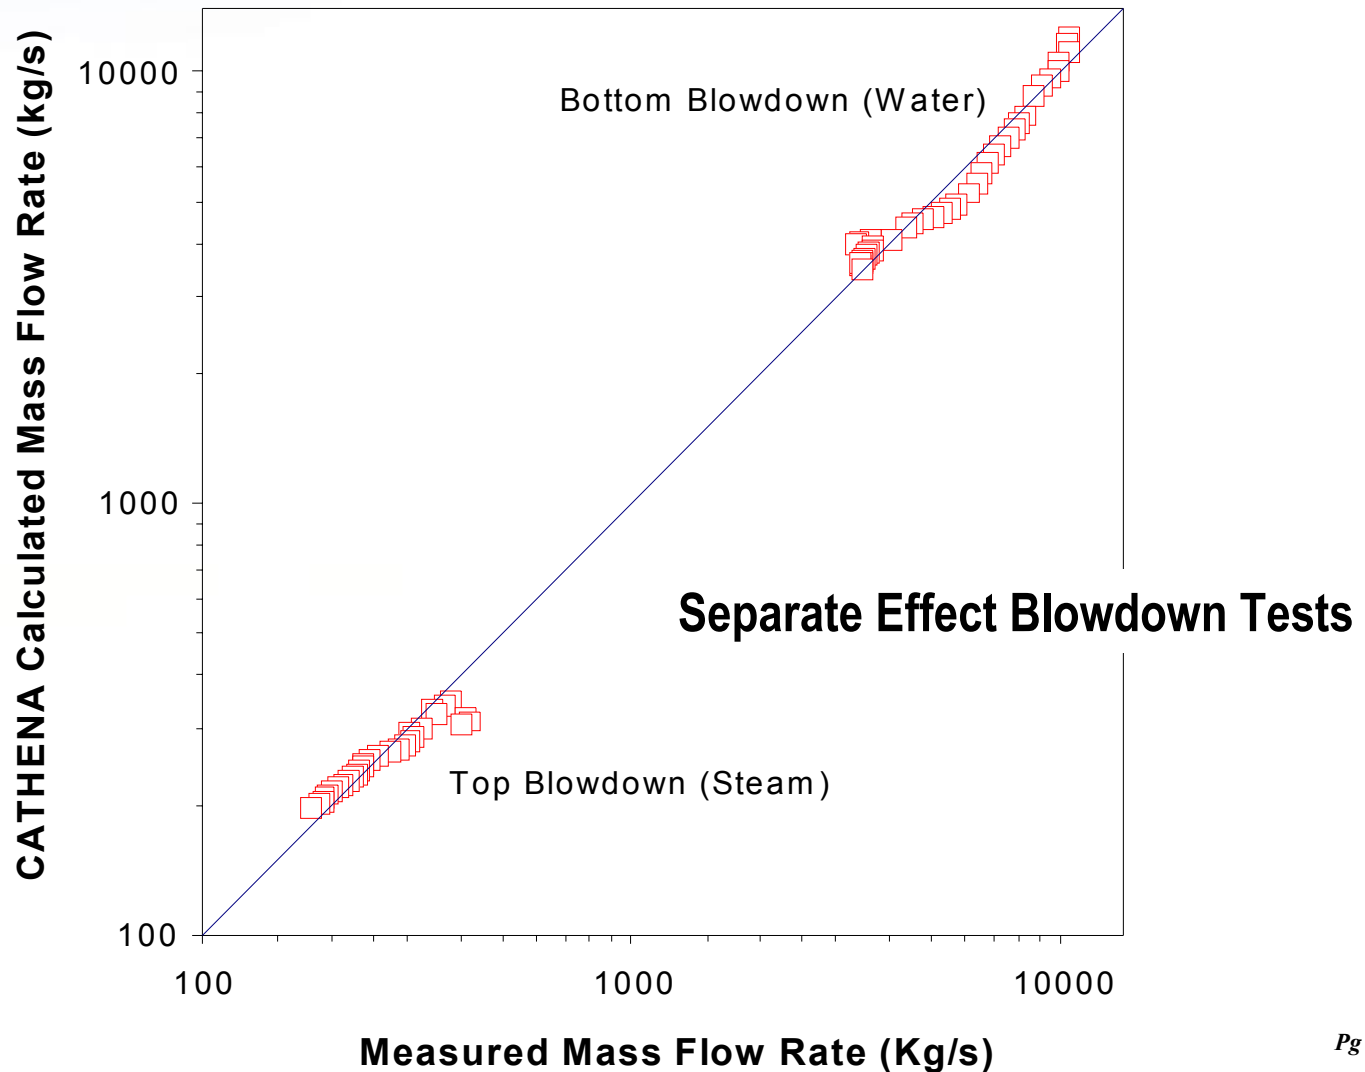




# CATHENA Validation, Example of Prediction of Channel Void During LOCA

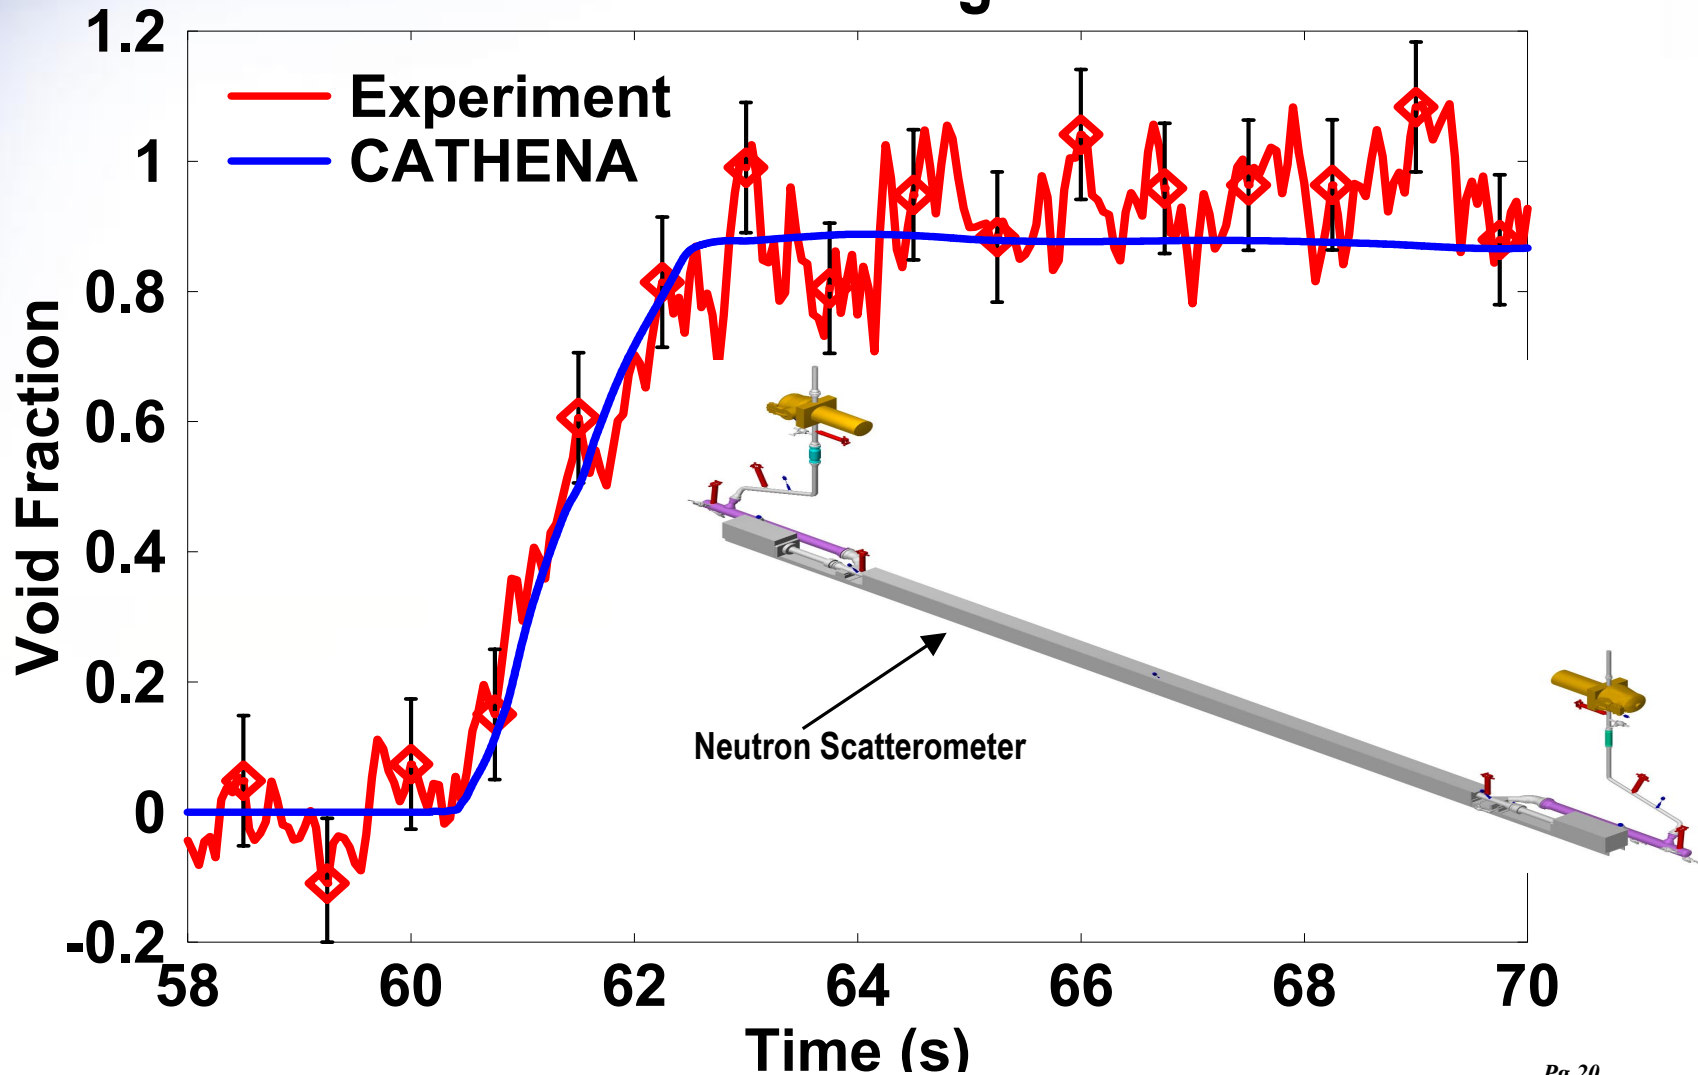



# Single Pump Trip in a CANDU 6 Pump Run-down Speed

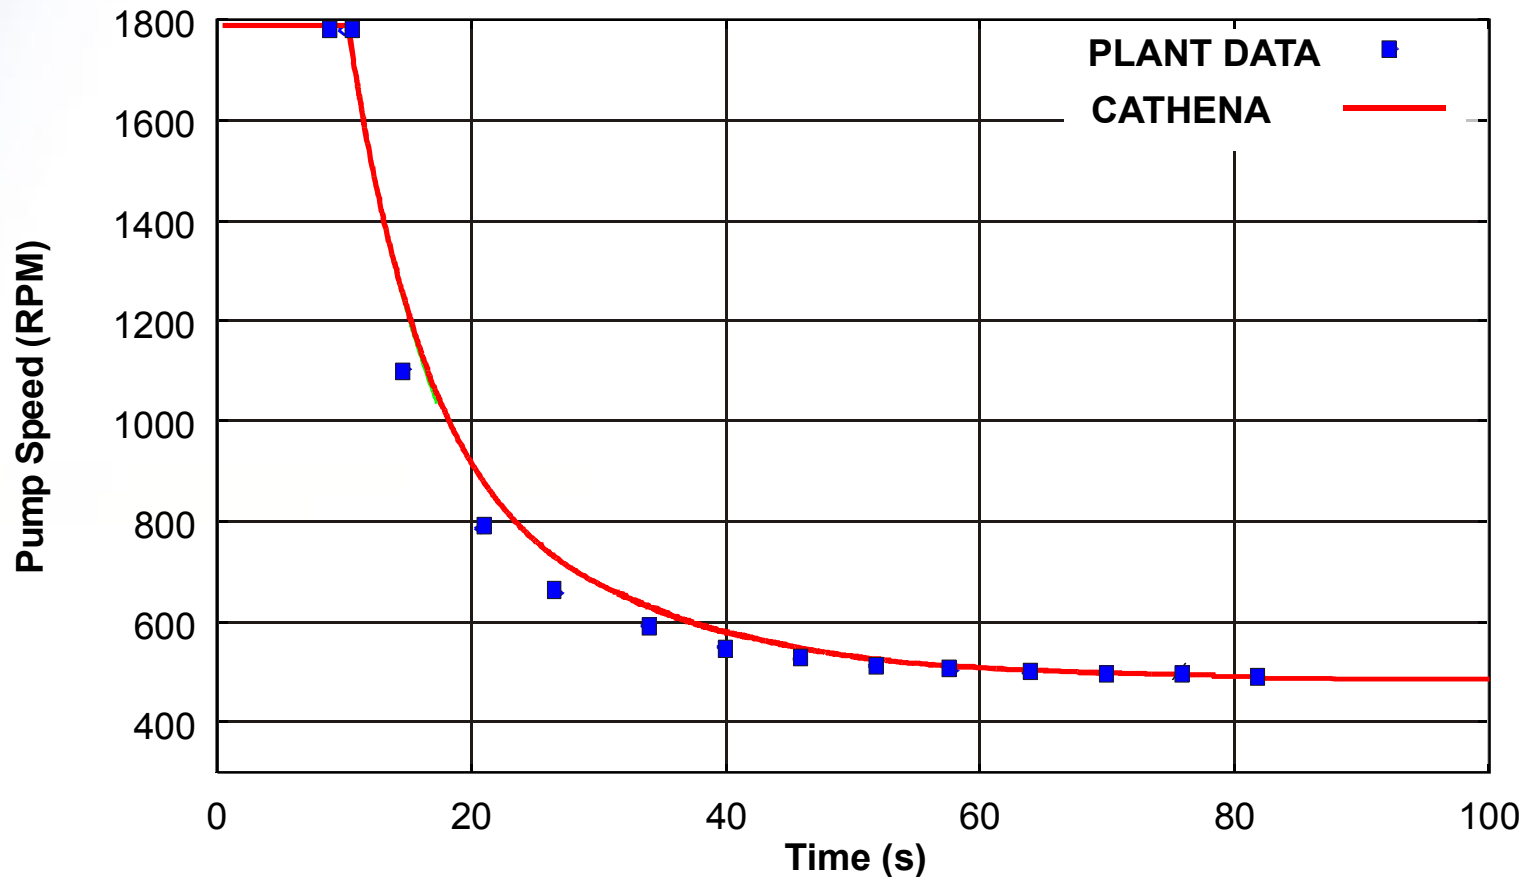



# Conclusion

- **ACR analysis codes are developed and qualified under a formal SQA program**
- **Validation methodology has been demonstrated, using thermal hydraulics as an example, and the CATHENA code**
- **A wide range of experimental databases is used in the validation process**
- **Examples of CATHENA validation are provided**



 **AECL**  
TECHNOLOGIES INC.