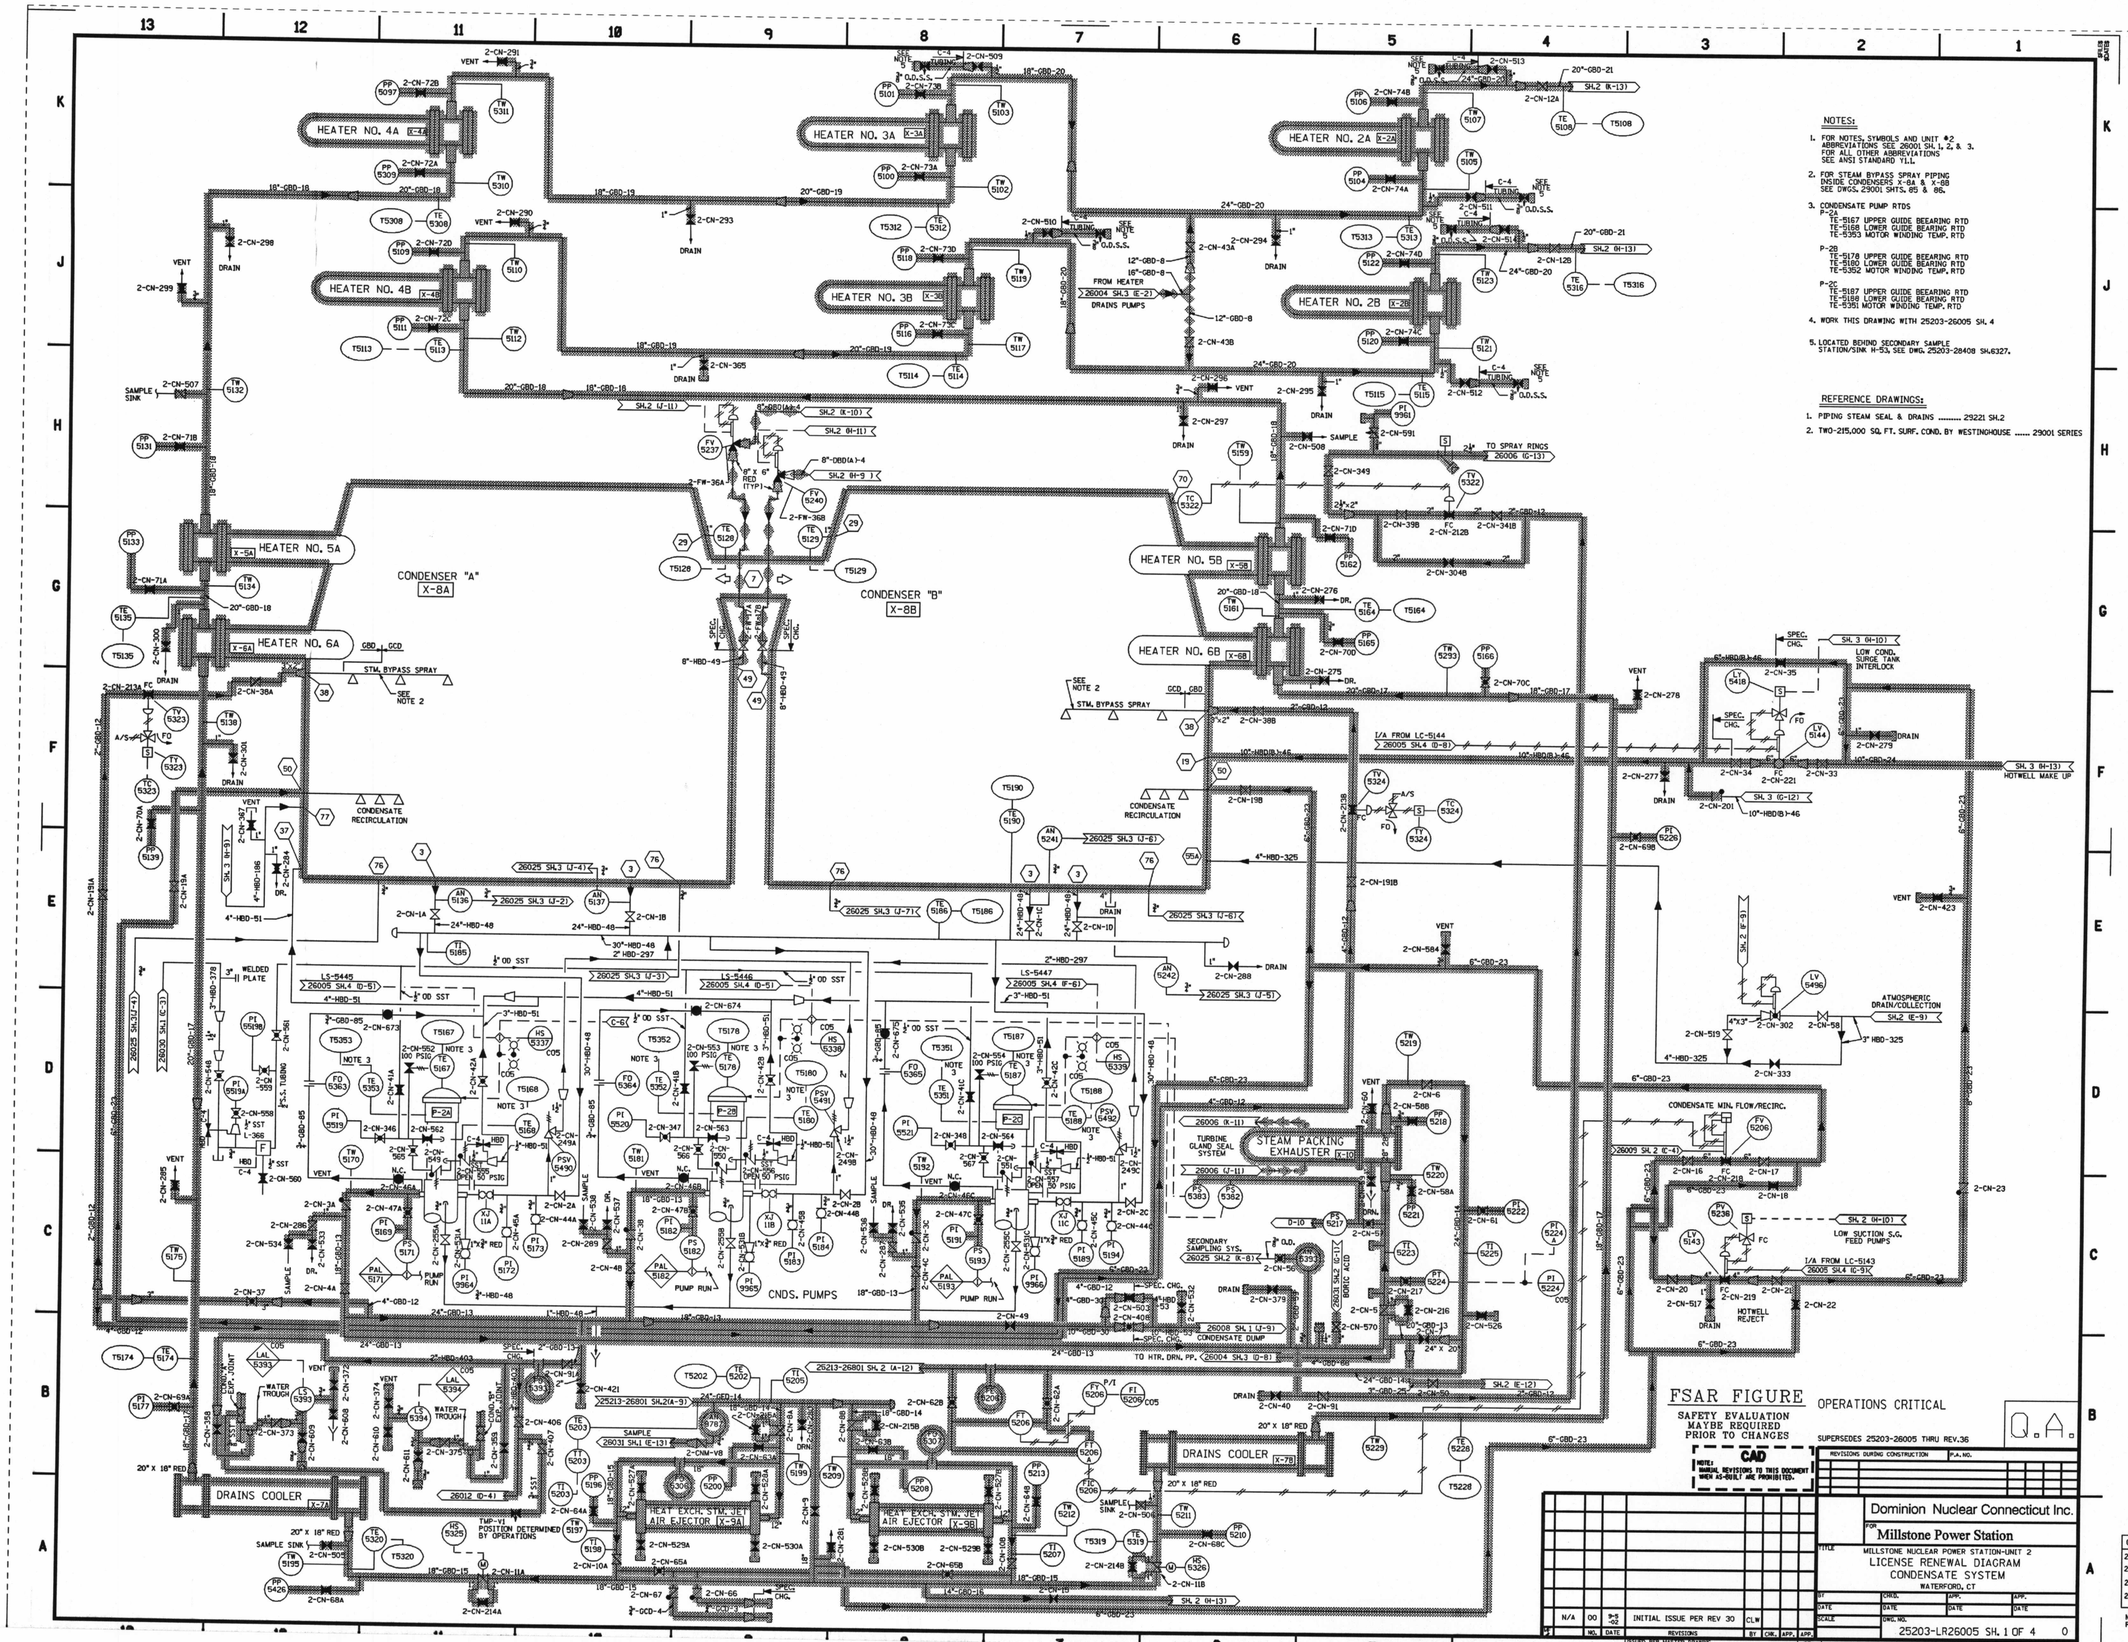

NOTES:

1. FOR NOTES, SYMBOLS AND UNIT #2 ABBREVIATIONS SEE 26001 SH. 1, 2, & 3. FOR ALL OTHER ABBREVIATIONS SEE ANSI STANDARD Y1.1.
2. FOR STEAM BYPASS SPRAY PIPING INSIDE CONDENSERS X-8A & X-8B SEE DWGS. 29001 SHTS. 85 & 86.
3. CONDENSATE PUMP RTDS
   P-2A
   TE-5167 UPPER GUIDE BEARING RTD
   TE-5168 LOWER GUIDE BEARING RTD
   TE-5353 MOTOR WINDING TEMP. RTD
   P-2B
   TE-5178 UPPER GUIDE BEARING RTD
   TE-5180 LOWER GUIDE BEARING RTD
   TE-5352 MOTOR WINDING TEMP. RTD
   P-2C
   TE-5187 UPPER GUIDE BEARING RTD
   TE-5188 LOWER GUIDE BEARING RTD
   TE-5351 MOTOR WINDING TEMP. RTD
4. WORK THIS DRAWING WITH 25203-26005 SH. 4
5. LOCATED BEHIND SECONDARY SAMPLE STATION/SINK H-53, SEE DWG. 25203-28408 SH.6327.

REFERENCE DRAWINGS:

1. PIPING STEAM SEAL & DRAINS 29221 SH.2
2. TWO-215,000 SQ. FT. SURF. COND. BY WESTINGHOUSE ..... 29001 SERIES

D013

Submitted by SEKULIC on Monday December 22 2003 at 07:42:13 AM EST