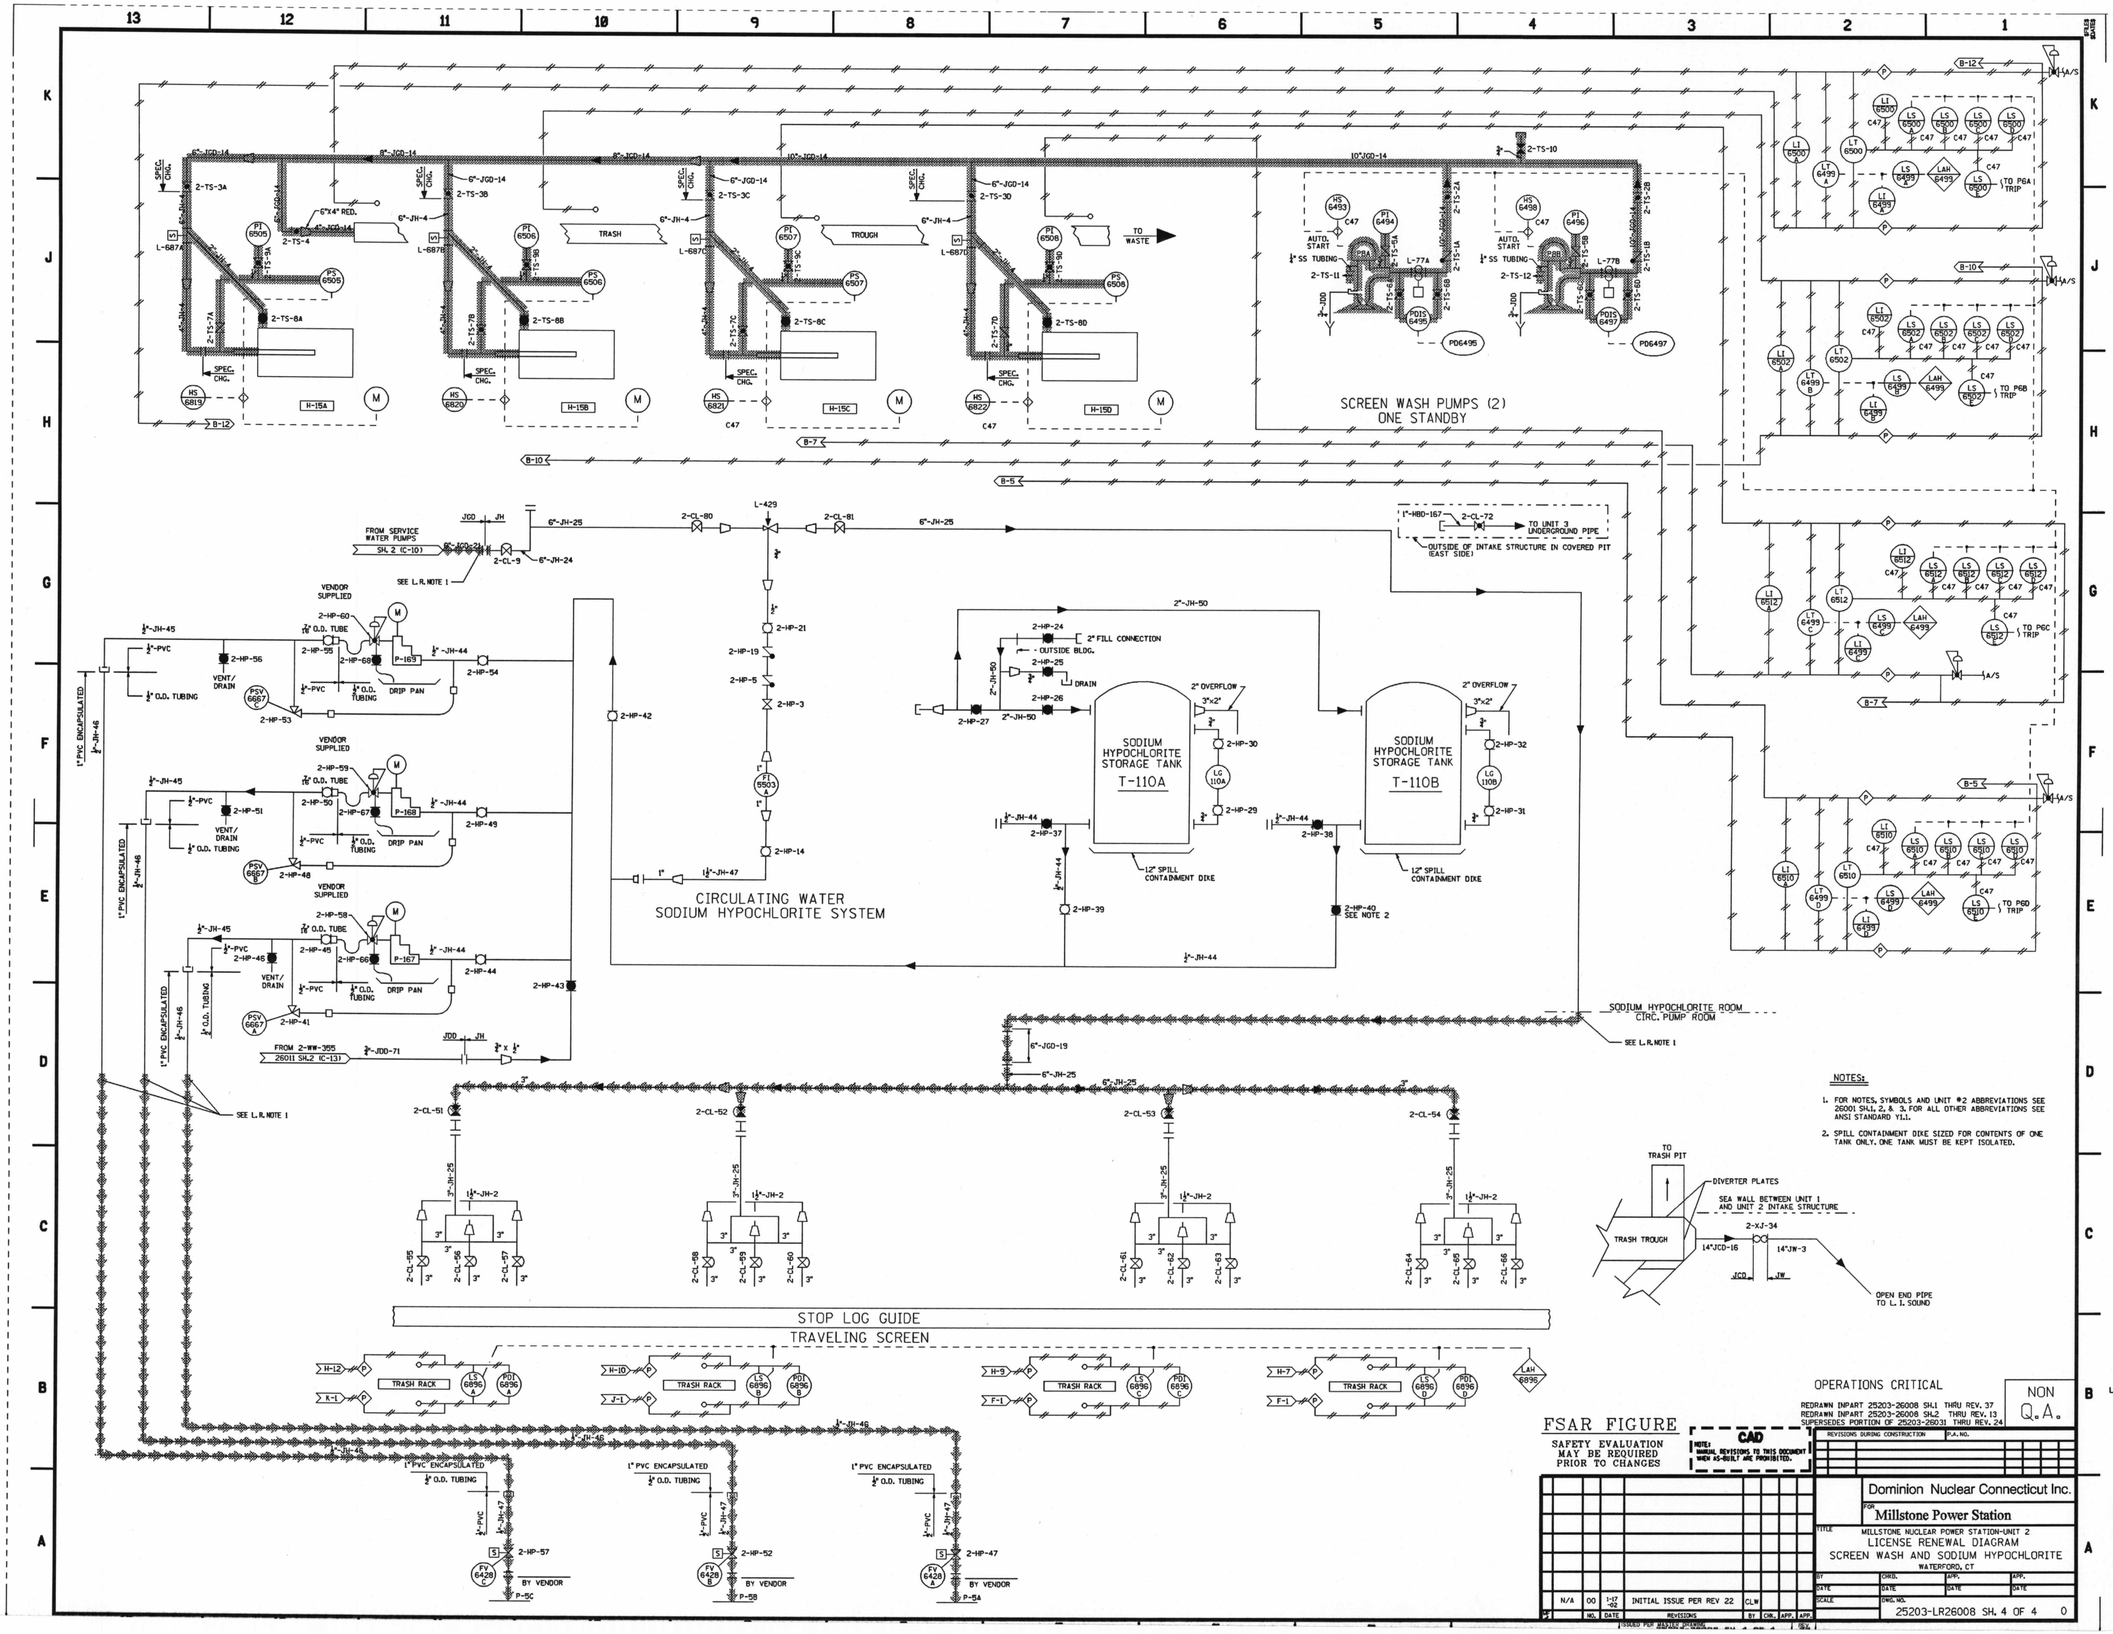

NOTES:

1. FOR NOTES, SYMBOLS AND UNIT #2 ABBREVIATIONS SEE 26001 SH.1, 2, & 3. FOR ALL OTHER ABBREVIATIONS SEE ANSI STANDARD Y1.1.
2. SPILL CONTAINMENT DIKE SIZED FOR CONTENTS OF ONE TANK ONLY. ONE TANK MUST BE KEPT ISOLATED.

L.R. NOTES:

1. A WALL DEFINES THE BOUNDARY BETWEEN THE CIRC. PUMP ROOM AND THE SODIUM HYPOCHLORITE ROOM.

OPERATIONS CRITICAL

NON Q.A.

REDRAWN INPART 25203-26008 SH.1 THRU REV. 37
REDRAWN INPART 25203-26008 SH.2 THRU REV. 13
SUPERSEDES PORTION OF 25203-26031 THRU REV. 24

FSAR FIGURE

SAFETY EVALUATION MAY BE REQUIRED PRIOR TO CHANGES

CAD

NOTE: MANUAL REVISIONS TO THIS DOCUMENT WHEN AS-BUILT ARE PROHIBITED.

REVISIONS DURING CONSTRUCTION	P.A. NO.

NO.	DATE	REVISIONS	BY	CHK.	APP.	APP.
N/A	00	1-17-02 INITIAL ISSUE PER REV 22	CLW			

Dominion Nuclear Connecticut Inc.
FOR Millstone Power Station
TITLE MILLSTONE NUCLEAR POWER STATION-UNIT 2
LICENSE RENEWAL DIAGRAM
SCREEN WASH AND SODIUM HYPOCHLORITE
WATERFORD, CT

BY | CHKD. | APP. | APP.
DATE | DATE | DATE | DATE
SCALE | DWG. NO. 25203-LR26008 SH. 4 OF 4 | 0

COMPONENTS SUBJECT TO AGING MANAGEMENT REVIEW
2327 SCREEN WASH
2326A SERVICE WATER
2326A SODIUM HYPOCHLORITE

NOTE: SOME SHADED LINES MAY CONTAIN COMPONENTS FROM MORE THAN ONE SYSTEM.

D020

Submitted by SEKULIC on Monday December 22 2003 at 07:41:31 AM EST