


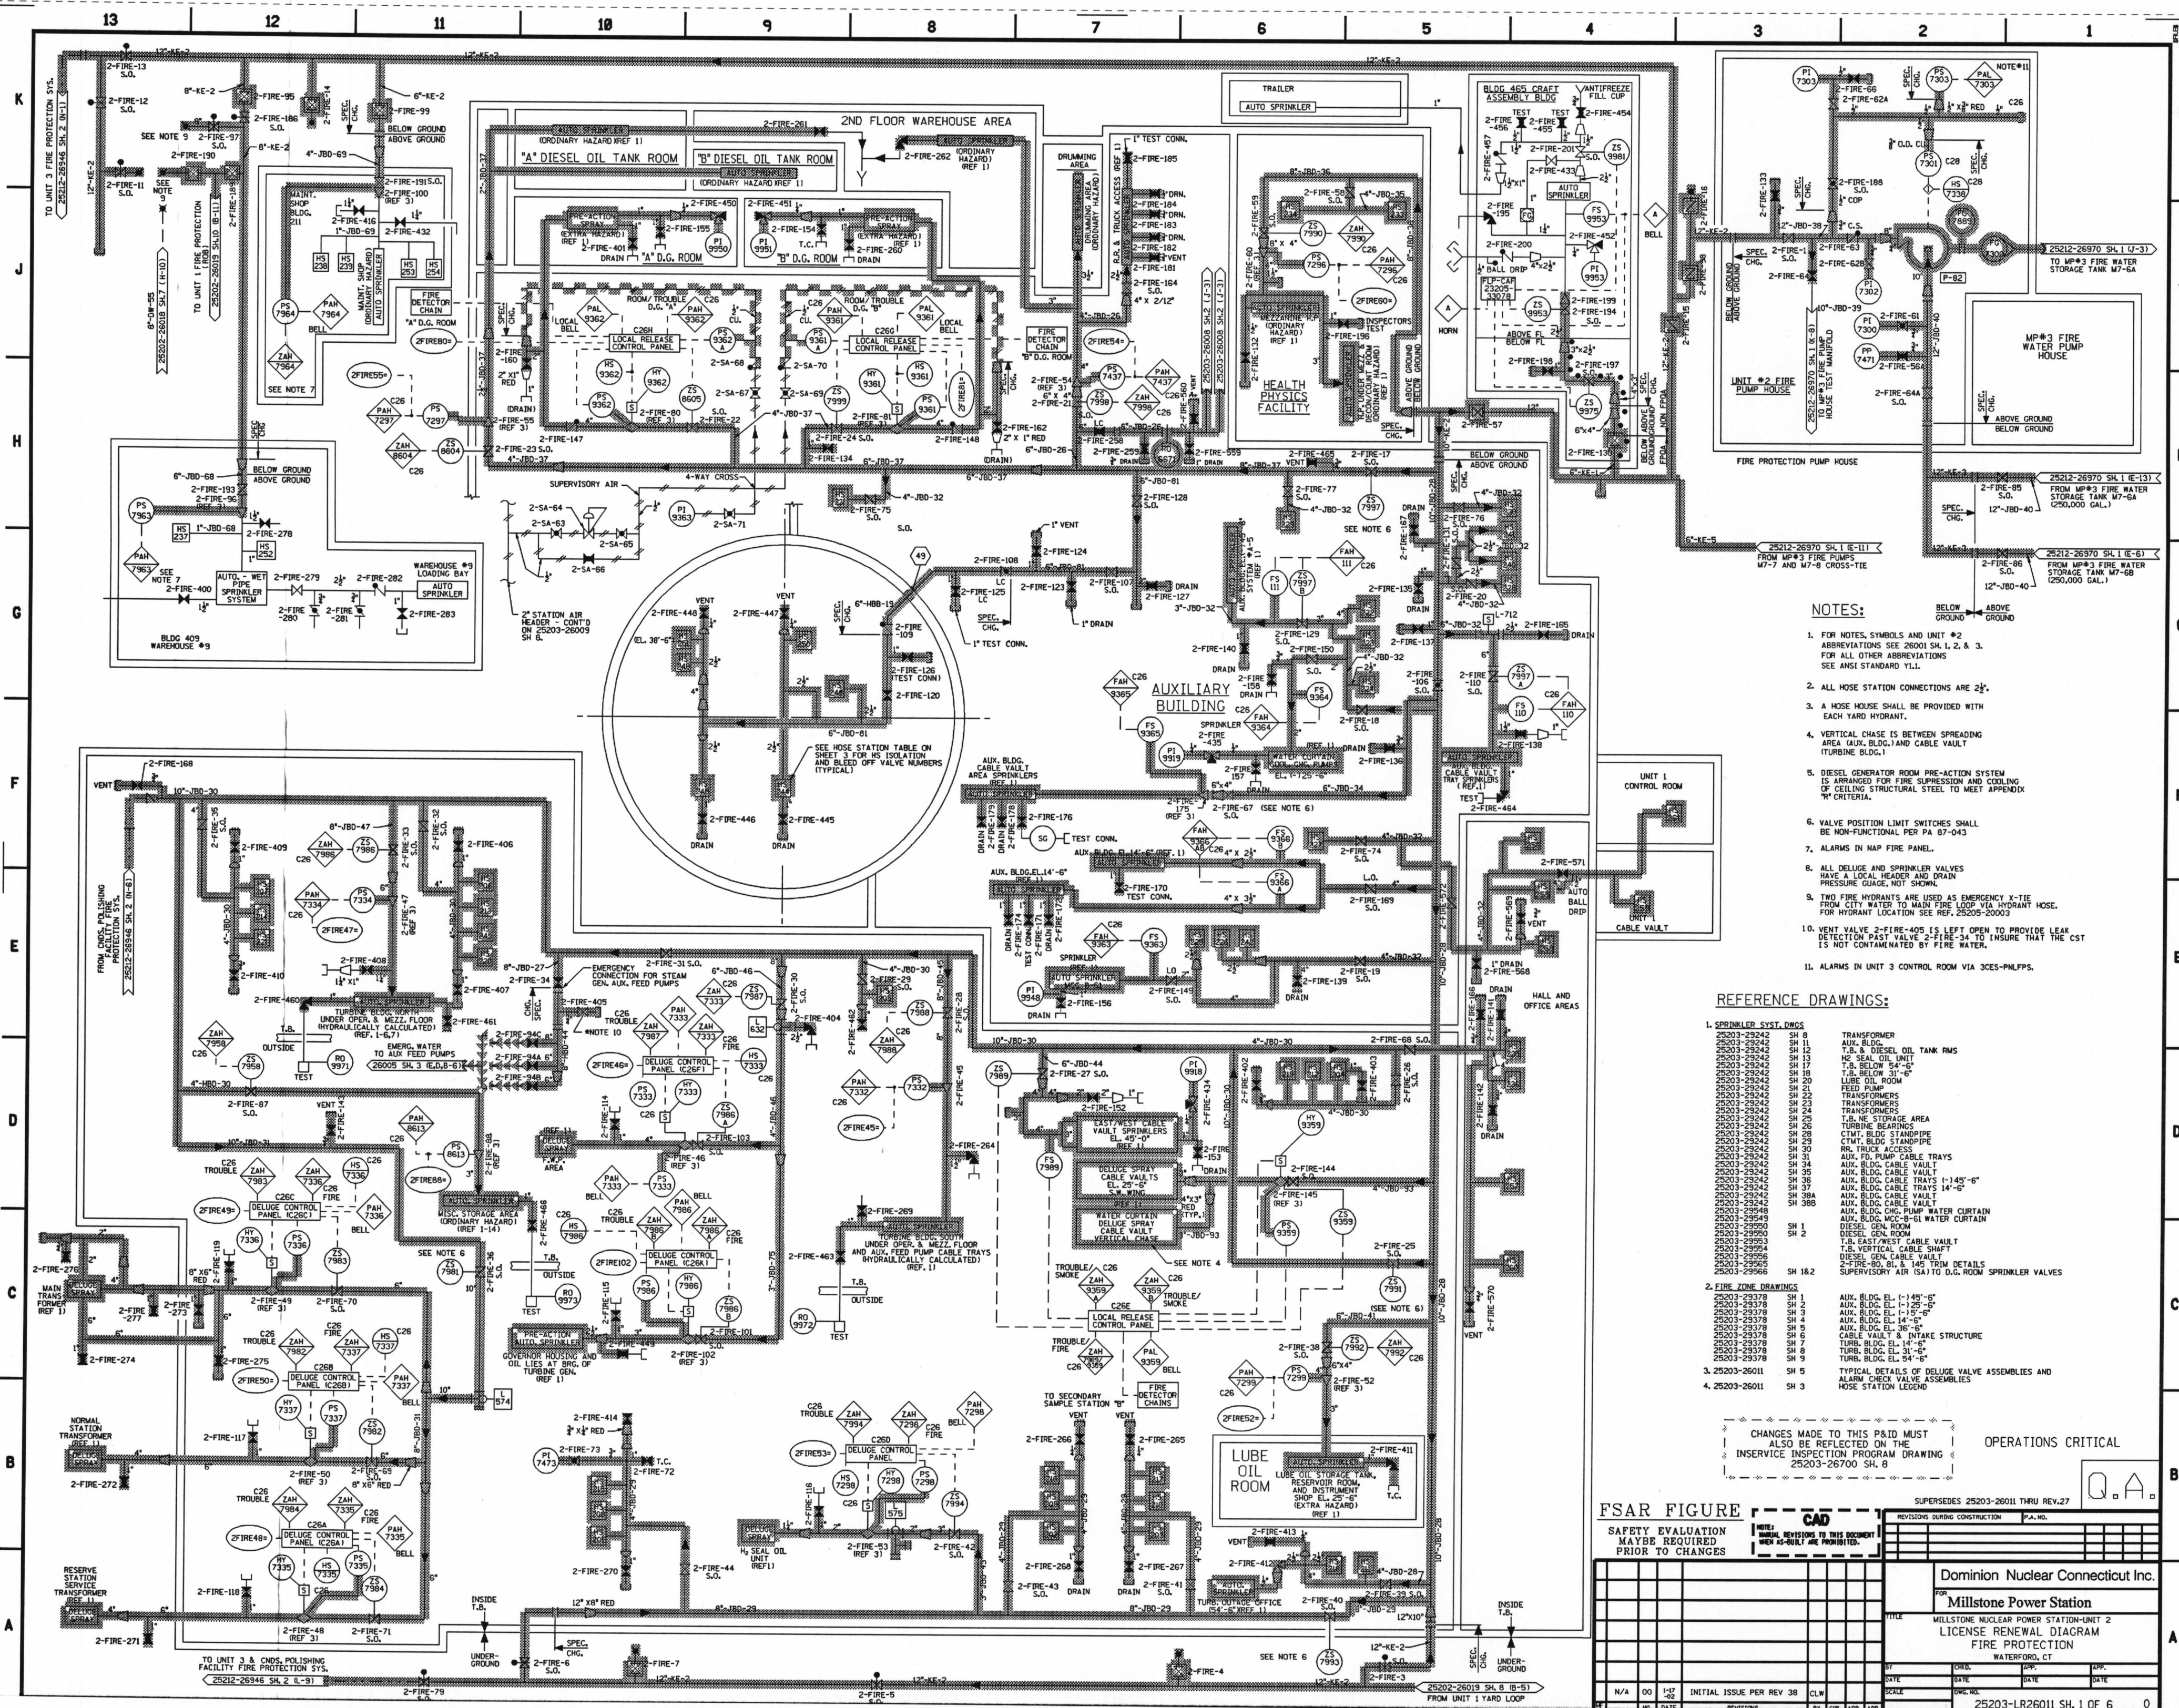

- NOTES:**
- FOR NOTES, SYMBOLS AND UNIT #2 ABBREVIATIONS SEE 25001 SH 1, 2, & 3. FOR ALL OTHER ABBREVIATIONS SEE ANSI STANDARD Y1.1.
 - ALL HOSE STATION CONNECTIONS ARE 2 1/2".
 - A HOSE HOUSE SHALL BE PROVIDED WITH EACH YARD HYDRANT.
 - VERTICAL CHASE IS BETWEEN SPREADING AREA (AUX. BLDG.) AND CABLE VAULT (TURBINE BLDG.).
 - DIESEL GENERATOR ROOM PRE-ACTION SYSTEM IS ARRANGED FOR FIRE SUPPRESSION AND COOLING OF CEILING STRUCTURAL STEEL TO MEET APPENDIX "H" CRITERIA.
 - VALVE POSITION LIMIT SWITCHES SHALL BE NON-FUNCTIONAL PER PA 87-043.
 - ALARMS IN NAF FIRE PANEL.
 - ALL DELUGE AND SPRINKLER VALVES HAVE A LOCAL HEADER AND DRAIN PRESSURE GAUGE, NOT SHOWN.
 - TWO FIRE HYDRANTS ARE USED AS EMERGENCY X-TIE FROM CITY WATER TO MAIN FIRE LOOP VIA HYDRANT HOSE. FOR HYDRANT LOCATION SEE REF. 25205-20003.
 - VENT VALVE 2-FIRE-405 IS LEFT OPEN TO PROVIDE LEAK DETECTION PAST VALVE 2-FIRE-34 TO INSURE THAT THE CST IS NOT CONTAMINATED BY FIRE WATER.
 - ALARMS IN UNIT 3 CONTROL ROOM VIA 3CES-PHFFS.

- REFERENCE DRAWINGS:**
- 1. SPRINKLER SYST. DRWS
25001-25003 SH 1, 2, & 3
25004-25006 SH 1, 2, & 3
25007-25009 SH 1, 2, & 3
25010-25012 SH 1, 2, & 3
25013-25015 SH 1, 2, & 3
25016-25018 SH 1, 2, & 3
25019-25021 SH 1, 2, & 3
25022-25024 SH 1, 2, & 3
25025-25027 SH 1, 2, & 3
25028-25030 SH 1, 2, & 3
25031-25033 SH 1, 2, & 3
25034-25036 SH 1, 2, & 3
25037-25039 SH 1, 2, & 3
25040-25042 SH 1, 2, & 3
25043-25045 SH 1, 2, & 3
25046-25048 SH 1, 2, & 3
25049-25051 SH 1, 2, & 3
25052-25054 SH 1, 2, & 3
25055-25057 SH 1, 2, & 3
25058-25060 SH 1, 2, & 3
25061-25063 SH 1, 2, & 3
25064-25066 SH 1, 2, & 3
25067-25069 SH 1, 2, & 3
25070-25072 SH 1, 2, & 3
25073-25075 SH 1, 2, & 3
25076-25078 SH 1, 2, & 3
25079-25081 SH 1, 2, & 3
25082-25084 SH 1, 2, & 3
25085-25087 SH 1, 2, & 3
25088-25090 SH 1, 2, & 3
25091-25093 SH 1, 2, & 3
25094-25096 SH 1, 2, & 3
25097-25099 SH 1, 2, & 3
25100-25102 SH 1, 2, & 3
25103-25105 SH 1, 2, & 3
25106-25108 SH 1, 2, & 3
25109-25111 SH 1, 2, & 3
25112-25114 SH 1, 2, & 3
25115-25117 SH 1, 2, & 3
25118-25120 SH 1, 2, & 3
25121-25123 SH 1, 2, & 3
25124-25126 SH 1, 2, & 3
25127-25129 SH 1, 2, & 3
25130-25132 SH 1, 2, & 3
25133-25135 SH 1, 2, & 3
25136-25138 SH 1, 2, & 3
25139-25141 SH 1, 2, & 3
25142-25144 SH 1, 2, & 3
25145-25147 SH 1, 2, & 3
25148-25150 SH 1, 2, & 3
25151-25153 SH 1, 2, & 3
25154-25156 SH 1, 2, & 3
25157-25159 SH 1, 2, & 3
25160-25162 SH 1, 2, & 3
25163-25165 SH 1, 2, & 3
25166-25168 SH 1, 2, & 3
25169-25171 SH 1, 2, & 3
25172-25174 SH 1, 2, & 3
25175-25177 SH 1, 2, & 3
25178-25180 SH 1, 2, & 3
25181-25183 SH 1, 2, & 3
25184-25186 SH 1, 2, & 3
25187-25189 SH 1, 2, & 3
25190-25192 SH 1, 2, & 3
25193-25195 SH 1, 2, & 3
25196-25198 SH 1, 2, & 3
25199-25201 SH 1, 2, & 3
25202-25204 SH 1, 2, & 3
25205-25207 SH 1, 2, & 3
25208-25210 SH 1, 2, & 3
25211-25213 SH 1, 2, & 3
25214-25216 SH 1, 2, & 3
25217-25219 SH 1, 2, & 3
25220-25222 SH 1, 2, & 3
25223-25225 SH 1, 2, & 3
25226-25228 SH 1, 2, & 3
25229-25231 SH 1, 2, & 3
25232-25234 SH 1, 2, & 3
25235-25237 SH 1, 2, & 3
25238-25240 SH 1, 2, & 3
25241-25243 SH 1, 2, & 3
25244-25246 SH 1, 2, & 3
25247-25249 SH 1, 2, & 3
25250-25252 SH 1, 2, & 3
25253-25255 SH 1, 2, & 3
25256-25258 SH 1, 2, & 3
25259-25261 SH 1, 2, & 3
25262-25264 SH 1, 2, & 3
25265-25267 SH 1, 2, & 3
25268-25270 SH 1, 2, & 3
25271-25273 SH 1, 2, & 3
25274-25276 SH 1, 2, & 3
25277-25279 SH 1, 2, & 3
25280-25282 SH 1, 2, & 3
25283-25285 SH 1, 2, & 3
25286-25288 SH 1, 2, & 3
25289-25291 SH 1, 2, & 3
25292-25294 SH 1, 2, & 3
25295-25297 SH 1, 2, & 3
25298-25299 SH 1, 2, & 3
 - 2. FIRE ZONE DRAWINGS
25201-25203 SH 1, 2, & 3
25204-25206 SH 1, 2, & 3
25207-25209 SH 1, 2, & 3
25210-25212 SH 1, 2, & 3
25213-25215 SH 1, 2, & 3
25216-25218 SH 1, 2, & 3
25219-25221 SH 1, 2, & 3
25222-25224 SH 1, 2, & 3
25225-25227 SH 1, 2, & 3
25228-25230 SH 1, 2, & 3
25231-25233 SH 1, 2, & 3
25234-25236 SH 1, 2, & 3
25237-25239 SH 1, 2, & 3
25240-25242 SH 1, 2, & 3
25243-25245 SH 1, 2, & 3
25246-25248 SH 1, 2, & 3
25249-25251 SH 1, 2, & 3
25252-25254 SH 1, 2, & 3
25255-25257 SH 1, 2, & 3
25258-25260 SH 1, 2, & 3
25261-25263 SH 1, 2, & 3
25264-25266 SH 1, 2, & 3
25267-25269 SH 1, 2, & 3
25270-25272 SH 1, 2, & 3
25273-25275 SH 1, 2, & 3
25276-25278 SH 1, 2, & 3
25279-25281 SH 1, 2, & 3
25282-25284 SH 1, 2, & 3
25285-25287 SH 1, 2, & 3
25288-25290 SH 1, 2, & 3
25291-25293 SH 1, 2, & 3
25294-25296 SH 1, 2, & 3
25297-25299 SH 1, 2, & 3
25300-25302 SH 1, 2, & 3
25303-25305 SH 1, 2, & 3
25306-25308 SH 1, 2, & 3
25309-25311 SH 1, 2, & 3
25312-25314 SH 1, 2, & 3
25315-25317 SH 1, 2, & 3
25318-25320 SH 1, 2, & 3
25321-25323 SH 1, 2, & 3
25324-25326 SH 1, 2, & 3
25327-25329 SH 1, 2, & 3
25330-25332 SH 1, 2, & 3
25333-25335 SH 1, 2, & 3
25336-25338 SH 1, 2, & 3
25339-25341 SH 1, 2, & 3
25342-25344 SH 1, 2, & 3
25345-25347 SH 1, 2, & 3
25348-25350 SH 1, 2, & 3
25351-25353 SH 1, 2, & 3
25354-25356 SH 1, 2, & 3
25357-25359 SH 1, 2, & 3
25360-25362 SH 1, 2, & 3
25363-25365 SH 1, 2, & 3
25366-25368 SH 1, 2, & 3
25369-25371 SH 1, 2, & 3
25372-25374 SH 1, 2, & 3
25375-25377 SH 1, 2, & 3
25378-25380 SH 1, 2, & 3
25381-25383 SH 1, 2, & 3
25384-25386 SH 1, 2, & 3
25387-25389 SH 1, 2, & 3
25390-25392 SH 1, 2, & 3
25393-25395 SH 1, 2, & 3
25396-25398 SH 1, 2, & 3
25399-25401 SH 1, 2, & 3
25402-25404 SH 1, 2, & 3
25405-25407 SH 1, 2, & 3
25408-25410 SH 1, 2, & 3
25411-25413 SH 1, 2, & 3
25414-25416 SH 1, 2, & 3
25417-25419 SH 1, 2, & 3
25420-25422 SH 1, 2, & 3
25423-25425 SH 1, 2, & 3
25426-25428 SH 1, 2, & 3
25429-25431 SH 1, 2, & 3
25432-25434 SH 1, 2, & 3
25435-25437 SH 1, 2, & 3
25438-25440 SH 1, 2, & 3
25441-25443 SH 1, 2, & 3
25444-25446 SH 1, 2, & 3
25447-25449 SH 1, 2, & 3
25450-25452 SH 1, 2, & 3
25453-25455 SH 1, 2, & 3
25456-25458 SH 1, 2, & 3
25459-25461 SH 1, 2, & 3
25462-25464 SH 1, 2, & 3
25465-25467 SH 1, 2, & 3
25468-25470 SH 1, 2, & 3
25471-25473 SH 1, 2, & 3
25474-25476 SH 1, 2, & 3
25477-25479 SH 1, 2, & 3
25480-25482 SH 1, 2, & 3
25483-25485 SH 1, 2, & 3
25486-25488 SH 1, 2, & 3
25489-25491 SH 1, 2, & 3
25492-25494 SH 1, 2, & 3
25495-25497 SH 1, 2, & 3
25498-25499 SH 1, 2, & 3
 - 3. 25203-26011 SH 5
4. 25203-26011 SH 3

CHANGES MADE TO THIS P&ID MUST ALSO BE REFLECTED ON THE INSERVICE INSPECTION PROGRAM DRAWING 25203-26700 SH 8

FSAR FIGURE

SAFETY EVALUATION MAYBE REQUIRED PRIOR TO CHANGES

CAD

REVISIONS DURING CONSTRUCTION

Domain Nuclear Connecticut Inc.

Millstone Power Station

LICENSE: RENEWAL DIAGRAM

FIRE PROTECTION

WATERFORD, CT

COMPONENTS SUBJECT TO AGING MANAGEMENT REVIEW

2341 FIRE PROTECTION

2350A STATION AIR

2350B CONDENSATE STORAGE & TRANSFER

NOTE: SHED LINES MAY CONTAIN COMPONENTS FROM MORE THAN ONE SYSTEM.

25203-LR26011 SH 1 OF 6