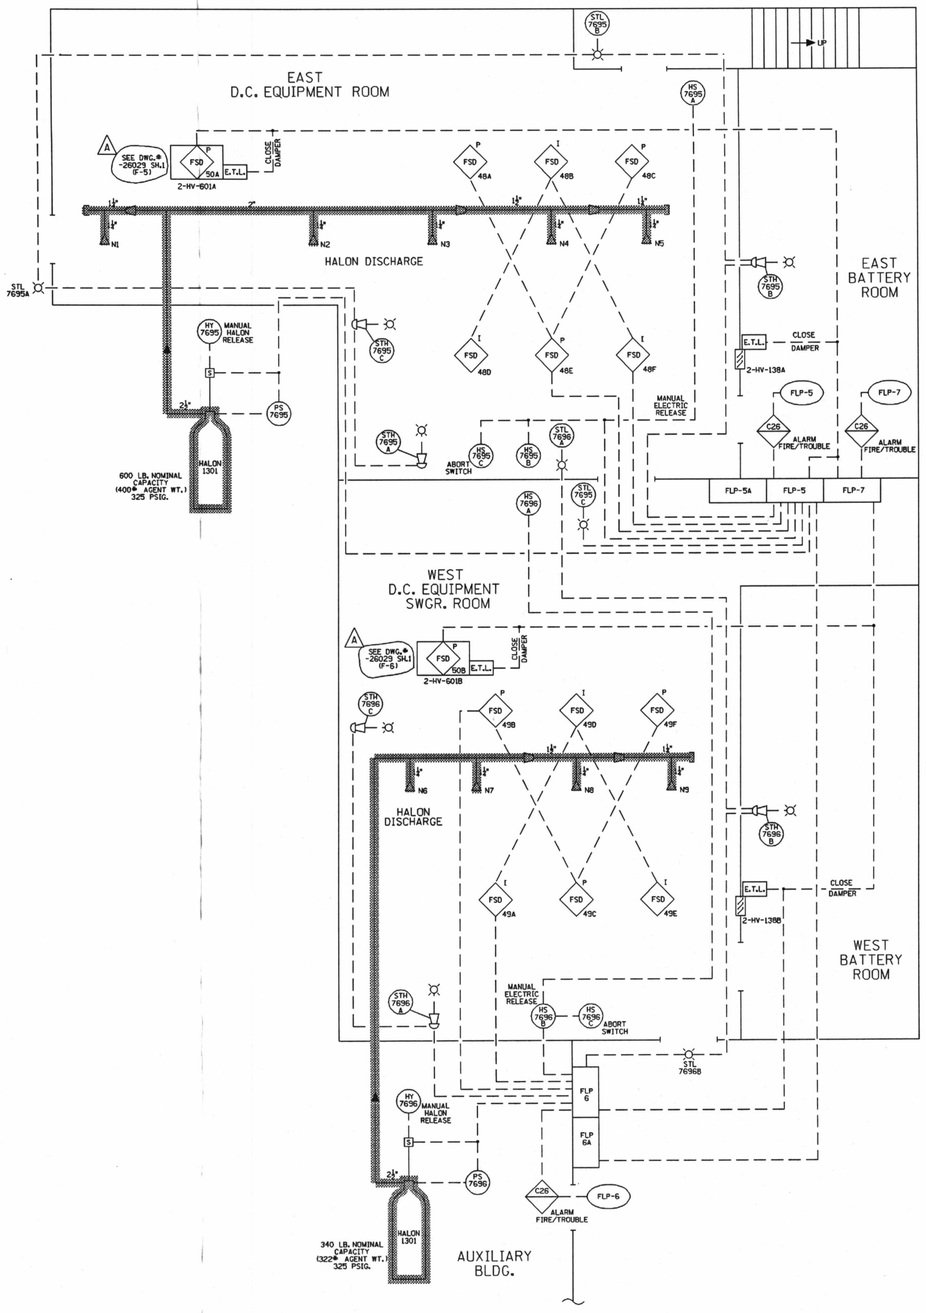

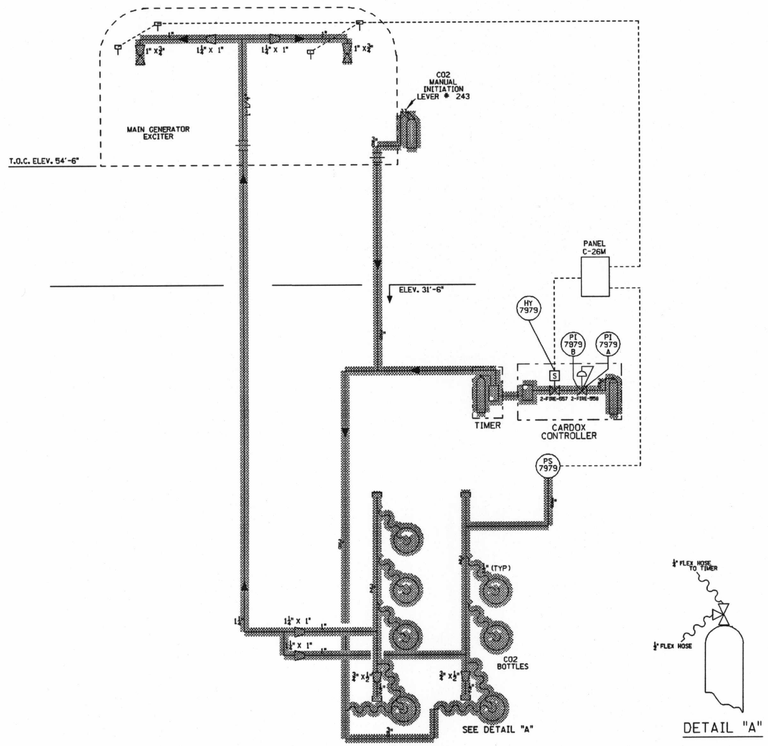

TURBINE GENERATOR EXCITER
CO2 FIRE SUPPRESSION
SYSTEM

E.T.L.=ELECTRO THERMAL LINK

OPERATIONS CRITICAL

Q.A.

CAD
NOTE: MANUAL REVISIONS TO THIS DOCUMENT WHEN AS-BUILT ARE PROHIBITED.

NO.	DATE	REVISIONS	BY	CHK.	APP.	REV
N/A	00 1-28-02	INITIAL ISSUE PER REV 5	CLM			

REVISIONS DURING CONSTRUCTION | P.A. NO.

Dominion Nuclear Connecticut Inc.
FOR Millstone Power Station

TITLE: MILLSTONE NUCLEAR POWER STATION-UNIT 2
LICENSE RENEWAL DIAGRAM
HALON AND EXCITER CO_2 FIRE PROTECTION

BY	DRWL.	CHK.	APP.
DATE	DATE	DATE	DATE

SCALE | DWG. NO. 25203-LR26011 SH. 4 OF 6 | 0

COMPONENTS SUBJECT TO AGING MANAGEMENT REVIEW
2341 FIRE PROTECTION

NOTE: SOME SHADED LINES MAY CONTAIN COMPONENTS FROM MORE THAN ONE SYSTEM.

Submitted by SEKULIC on Monday December 22 2003 at 07:40:49 AM EST

Pg 8