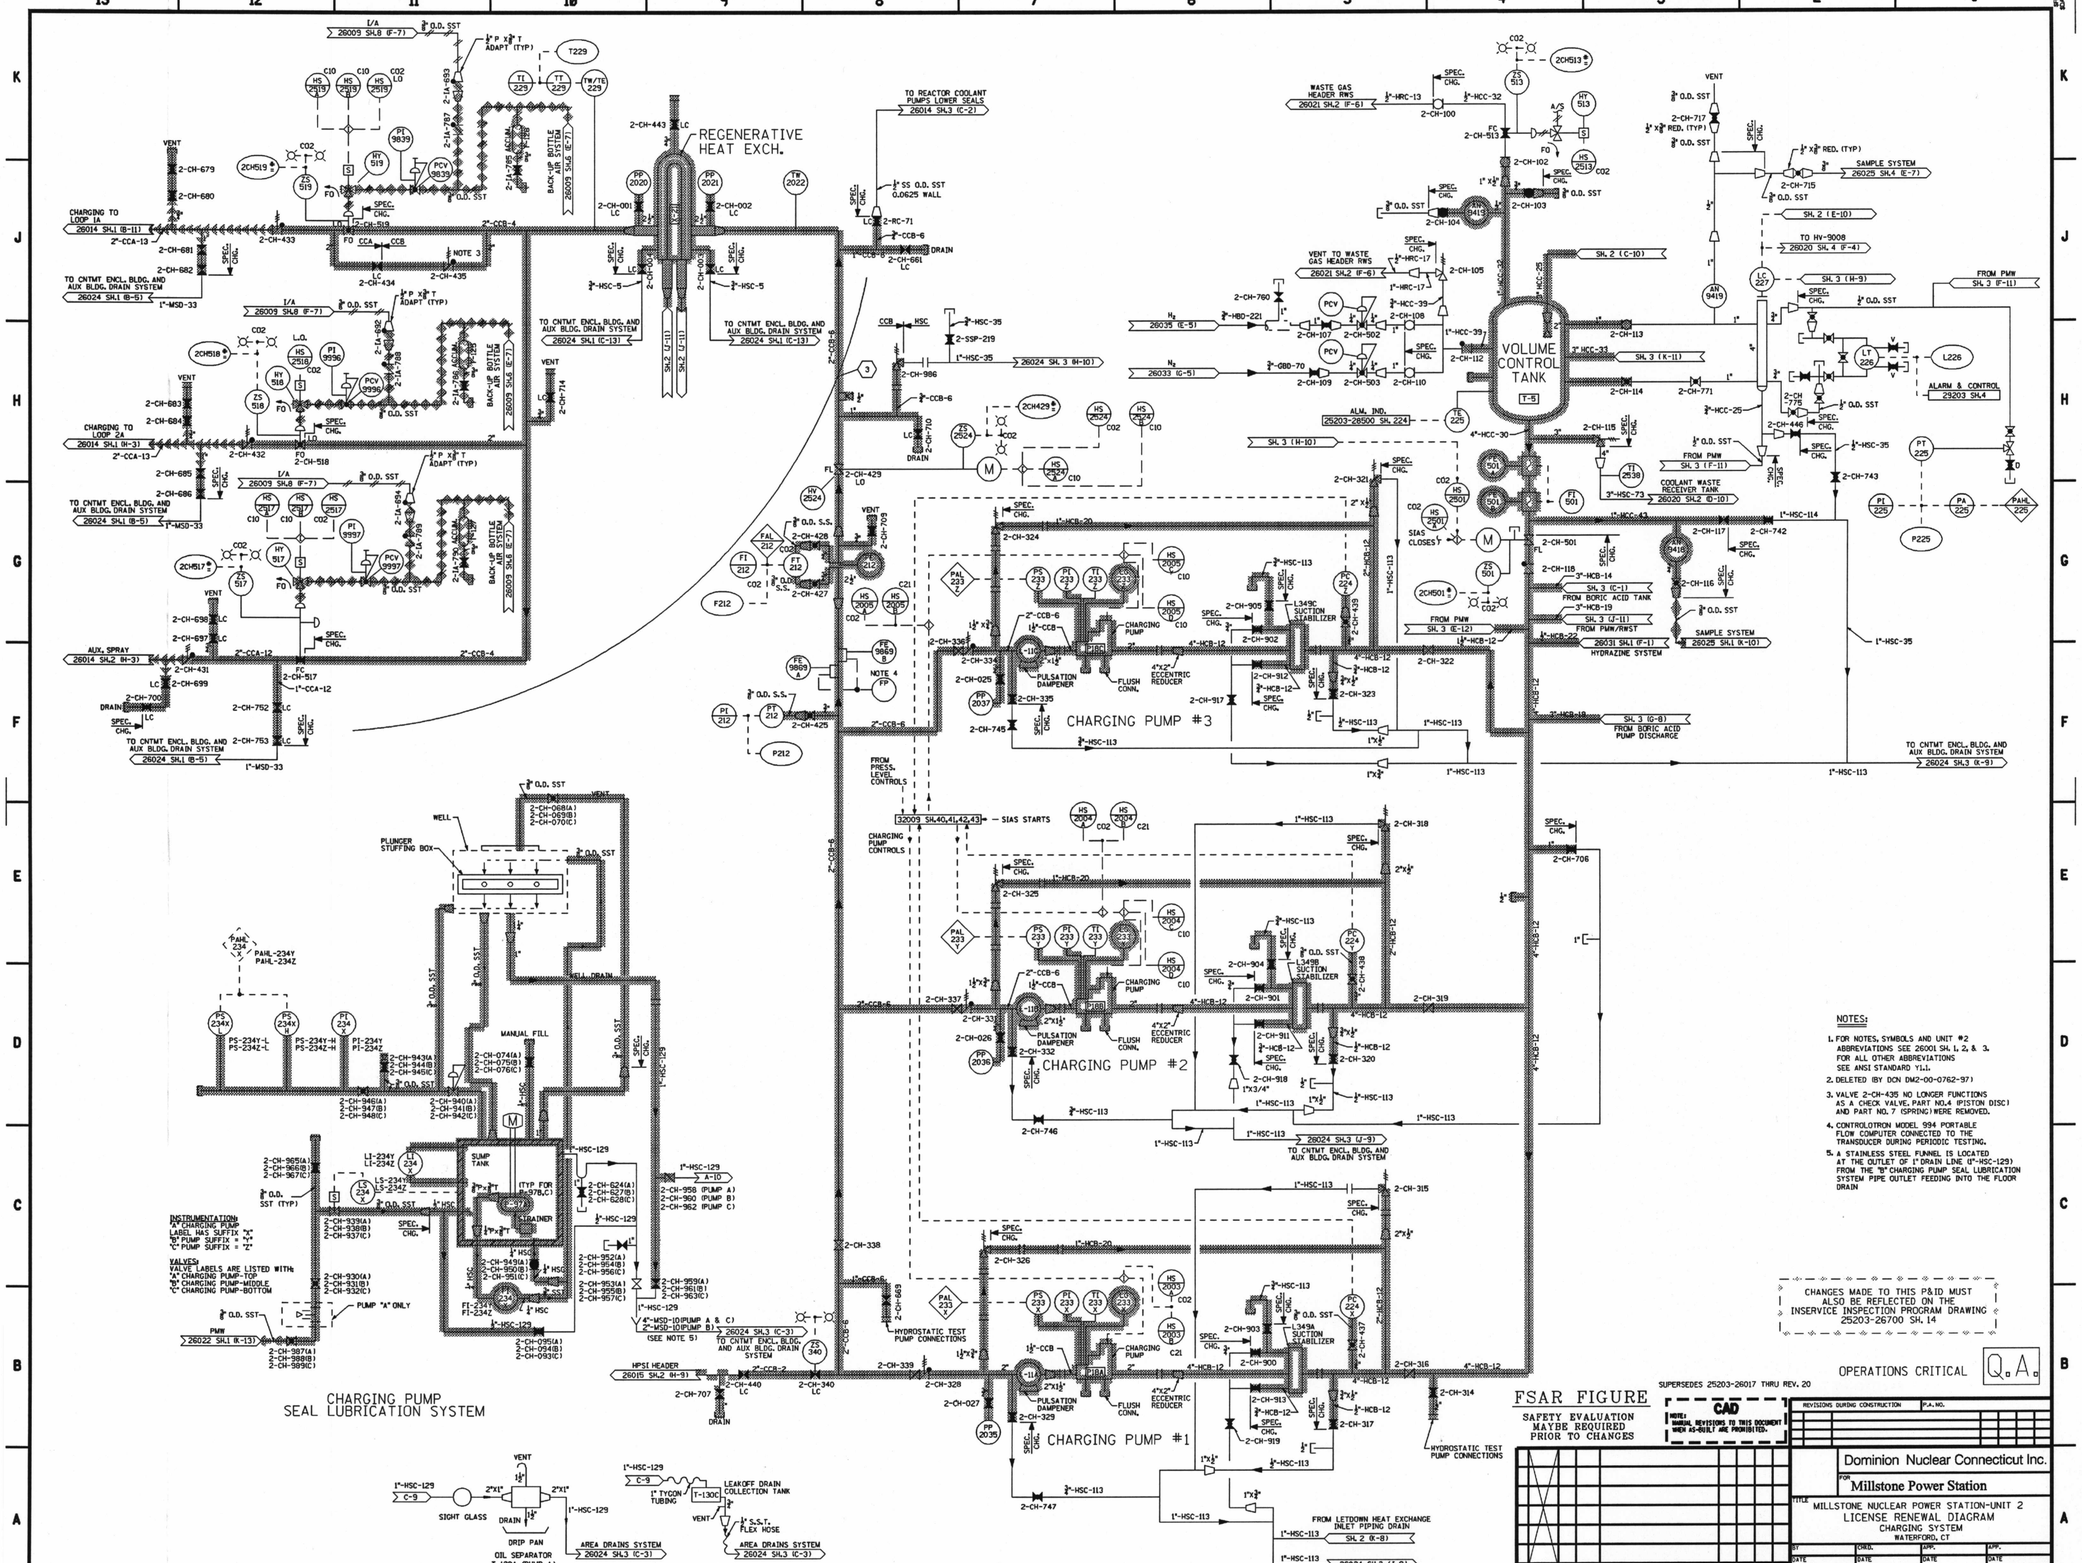

NOTES:

1. FOR NOTES, SYMBOLS AND UNIT #2 ABBREVIATIONS SEE 26001 SH. 1, 2, & 3. FOR ALL OTHER ABBREVIATIONS SEE ANSI STANDARD Y1.1.
2. DELETED (BY DCN DM2-00-0762-97)
3. VALVE 2-CH-435 NO LONGER FUNCTIONS AS A CHECK VALVE. PART NO.4 (PISTON DISC) AND PART NO. 7 (SPRING) WERE REMOVED.
4. CONTROLOTRON MODEL 994 PORTABLE FLOW COMPUTER CONNECTED TO THE TRANSDUCER DURING PERIODIC TESTING.
5. A STAINLESS STEEL FUNNEL IS LOCATED AT THE OUTLET OF (1" DRAIN LINE (1"-HSC-129) FROM THE "B" CHARGING PUMP SEAL LUBRICATION SYSTEM PIPE OUTLET FEEDING INTO THE FLOOR DRAIN

CHANGES MADE TO THIS P&ID MUST ALSO BE REFLECTED ON THE INSERVICE INSPECTION PROGRAM DRAWING 25203-26700 SH. 14

OPERATIONS CRITICAL

Q.A.

FSAR FIGURE

SAFETY EVALUATION MAYBE REQUIRED PRIOR TO CHANGES

SUPERSEDES 25203-26017 THRU REV. 20

CAD

NOTE: MANUAL REVISIONS TO THIS DOCUMENT WHEN AS-BUILT ARE PROHIBITED.

REVISIONS DURING CONSTRUCTION	P.A. NO.

N/A	00	1-08-02	INITIAL ISSUE PER REV 42	CLW	

Dominion Nuclear Connecticut Inc.

FOR Millstone Power Station

TITLE MILLSTONE NUCLEAR POWER STATION-UNIT 2
LICENSE RENEWAL DIAGRAM
CHARGING SYSTEM
WATERFORD, CT

BY | CHKD. | APP. | APP.
DATE | DATE | DATE | DATE
SCALE | DWG. NO. 25203-LR26017 SH. 1 OF 3 | 0

COMPONENTS SUBJECT TO AGING MANAGEMENT REVIEW	
2304	CHEMICAL & VOLUME CONTROL
2332B	INSTRUMENT AIR
2305G	SAFETY INJECTION
2311	SAMPLING
2301	REACTOR COOLANT
2330A	REACTOR BUILDING CLOSED COOLING WATER

NOTE: SOME SHADED LINES MAY CONTAIN COMPONENTS FROM MORE THAN ONE SYSTEM.

bmitted by SEKULIC on Monday December 22 2003 at 07:39:50 AM EST

D037