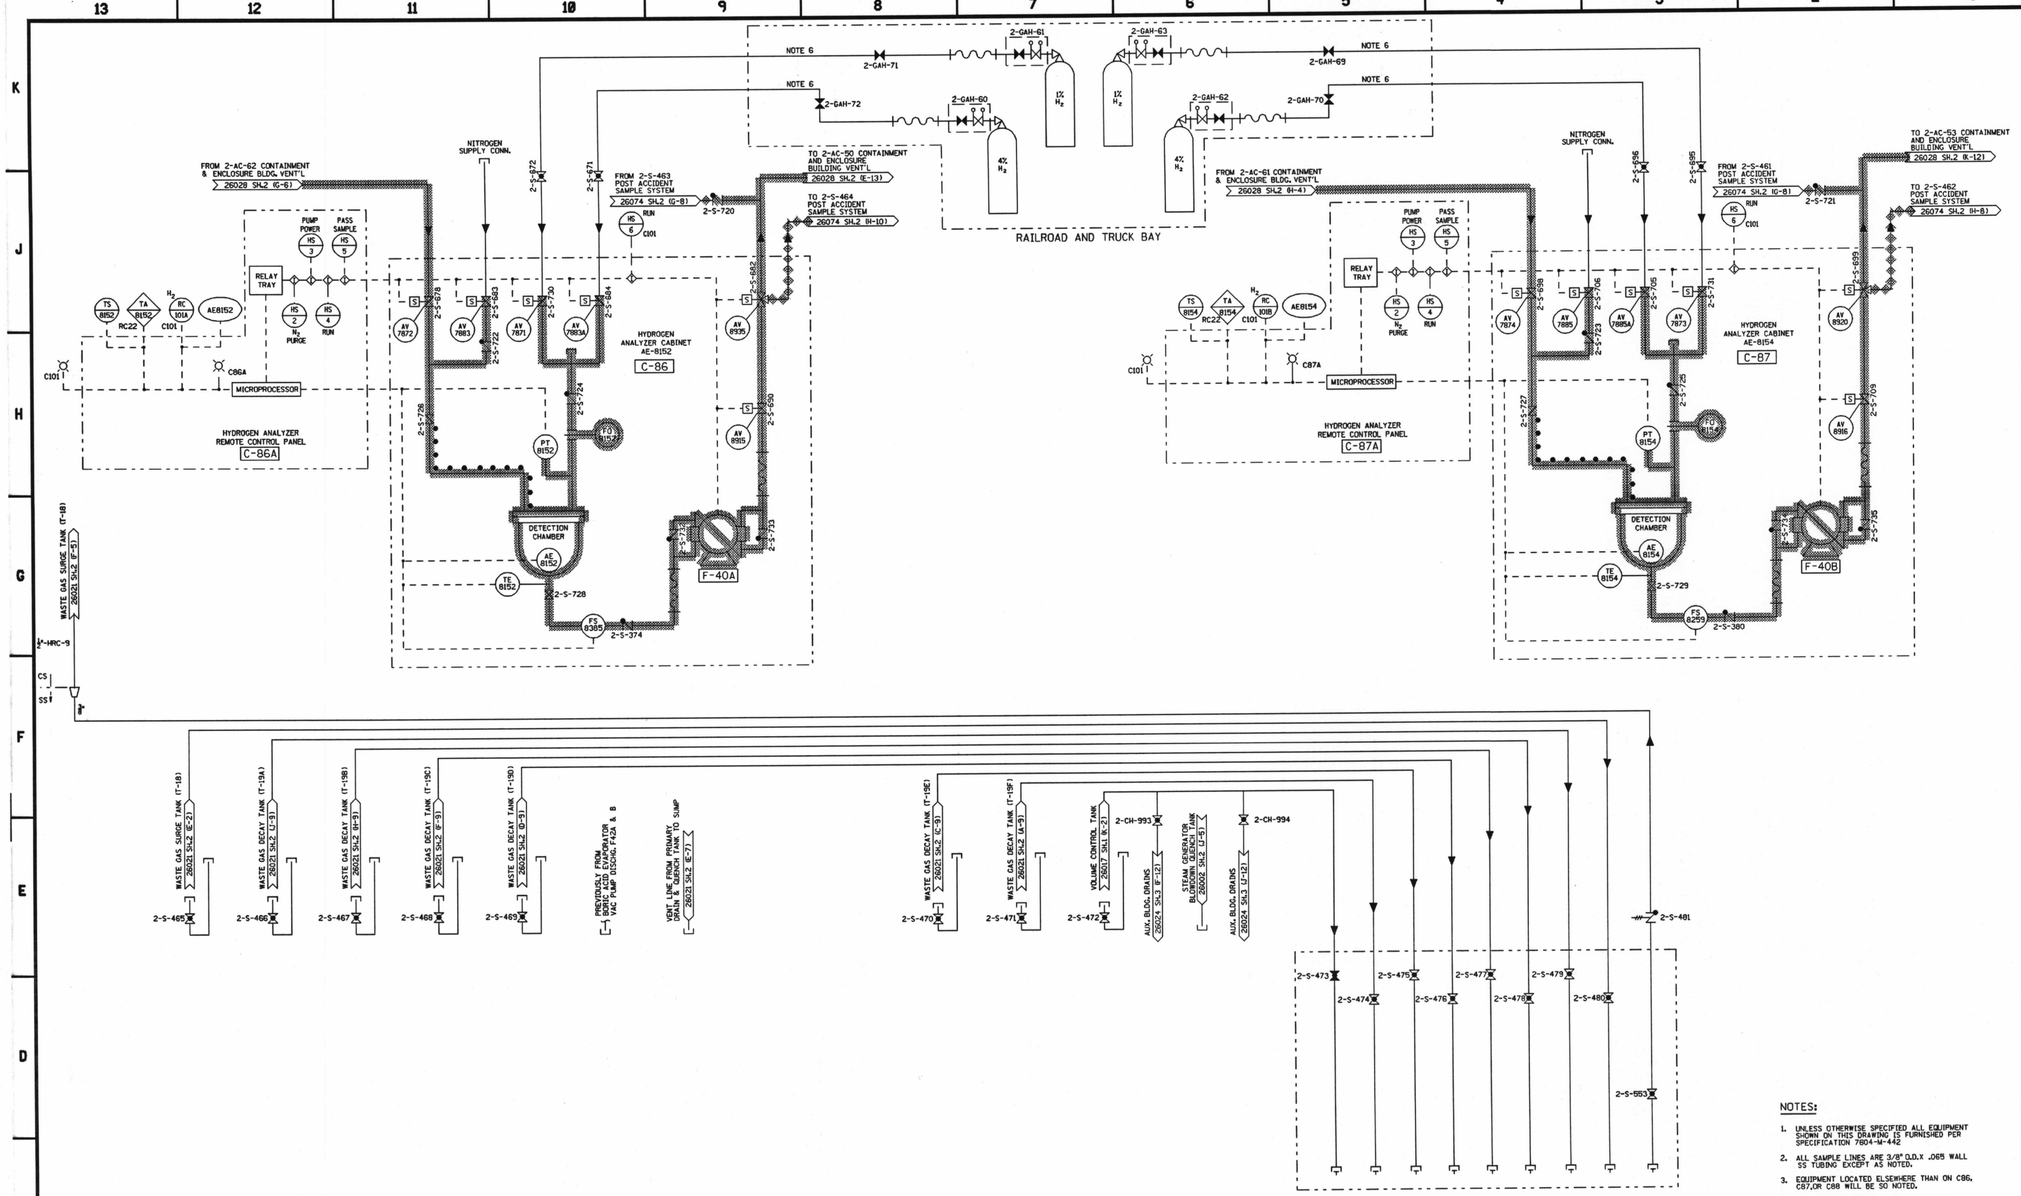

NOTES:

1. UNLESS OTHERWISE SPECIFIED ALL EQUIPMENT SHOWN ON THIS DRAWING IS FURNISHED PER SPECIFICATION 7804-M-442
2. ALL SAMPLE LINES ARE 3/8" O.D.X .065 WALL SS TUBING EXCEPT AS NOTED.
3. EQUIPMENT LOCATED ELSEWHERE THAN ON C86, C87,OR C88 WILL BE SO NOTED.
4. WASTE GAS SAMPLING LINES ARE 3/8" O.D. X .065 WALL S.S. TUBING WITH SWAGELOK FITTINGS.
5. CHEMISTRY TO SUPPLY NECESSARY SAMPLING EQUIPMENT DEPENDING ON SAMPLE DESIRED.
6. SPAN GAS LINES IN THIS AREA ARE 1/4" O.D. X .049 IN. WALL TUBING WITH SWAGELOK FITTINGS.
7. THE OXYGEN ANALYZER IC-8811S REMOVED AND THE TUBING HAS BEEN ISOLATED.
8. FOR NOTES, SYMBOLS AND UNIT #2 ABBREVIATIONS, SEE 26001 SH. 1, 2 & 3. FOR ALL OTHER ABBREVIATIONS SEE ANSI STANDARD Y1.1.

OPERATIONS CRITICAL

Q.A.

REDRAWN FROM 25203-26025 SH.3 THRU REV 11.

CAD
NOTE: MARGINAL REVISIONS TO THIS DOCUMENT WHEN AS-BUILT ARE PROHIBITED.

REVISIONS DURING CONSTRUCTION	P.A. NO.

NO.	DATE	REVISIONS	BY	CHK.	APP.	APP.
N/A	00	7-28-82	INITIAL ISSUE PER REV 16	CLW		

ISSUED PER MASTER DRAWING

Dominion Nuclear Connecticut Inc.
FOR Millstone Power Station

TITLE: MILLSTONE NUCLEAR POWER STATION - UNIT #2
LICENSE RENEWAL DIAGRAM
SAMPLING SYSTEM
WATERFORD, CT

BY	CHKD.	APP.	APP.
DATE	DATE	DATE	DATE

SCALE | DWG. NO. 25203-LR26025 SH. 4 OF 4 | 0

COMPONENTS SUBJECT TO AGING MANAGEMENT REVIEW	
241N	POST ACCIDENT SAMPLING
231X	CONTAINMENT POST ACCIDENT H2 CONTROL

NOTE: SOME SHADED LINES MAY CONTAIN COMPONENTS FROM MORE THAN ONE SYSTEM.

submitted by SEKULIC on Monday December 22 2003 at 07:37:15 AM EST

D062