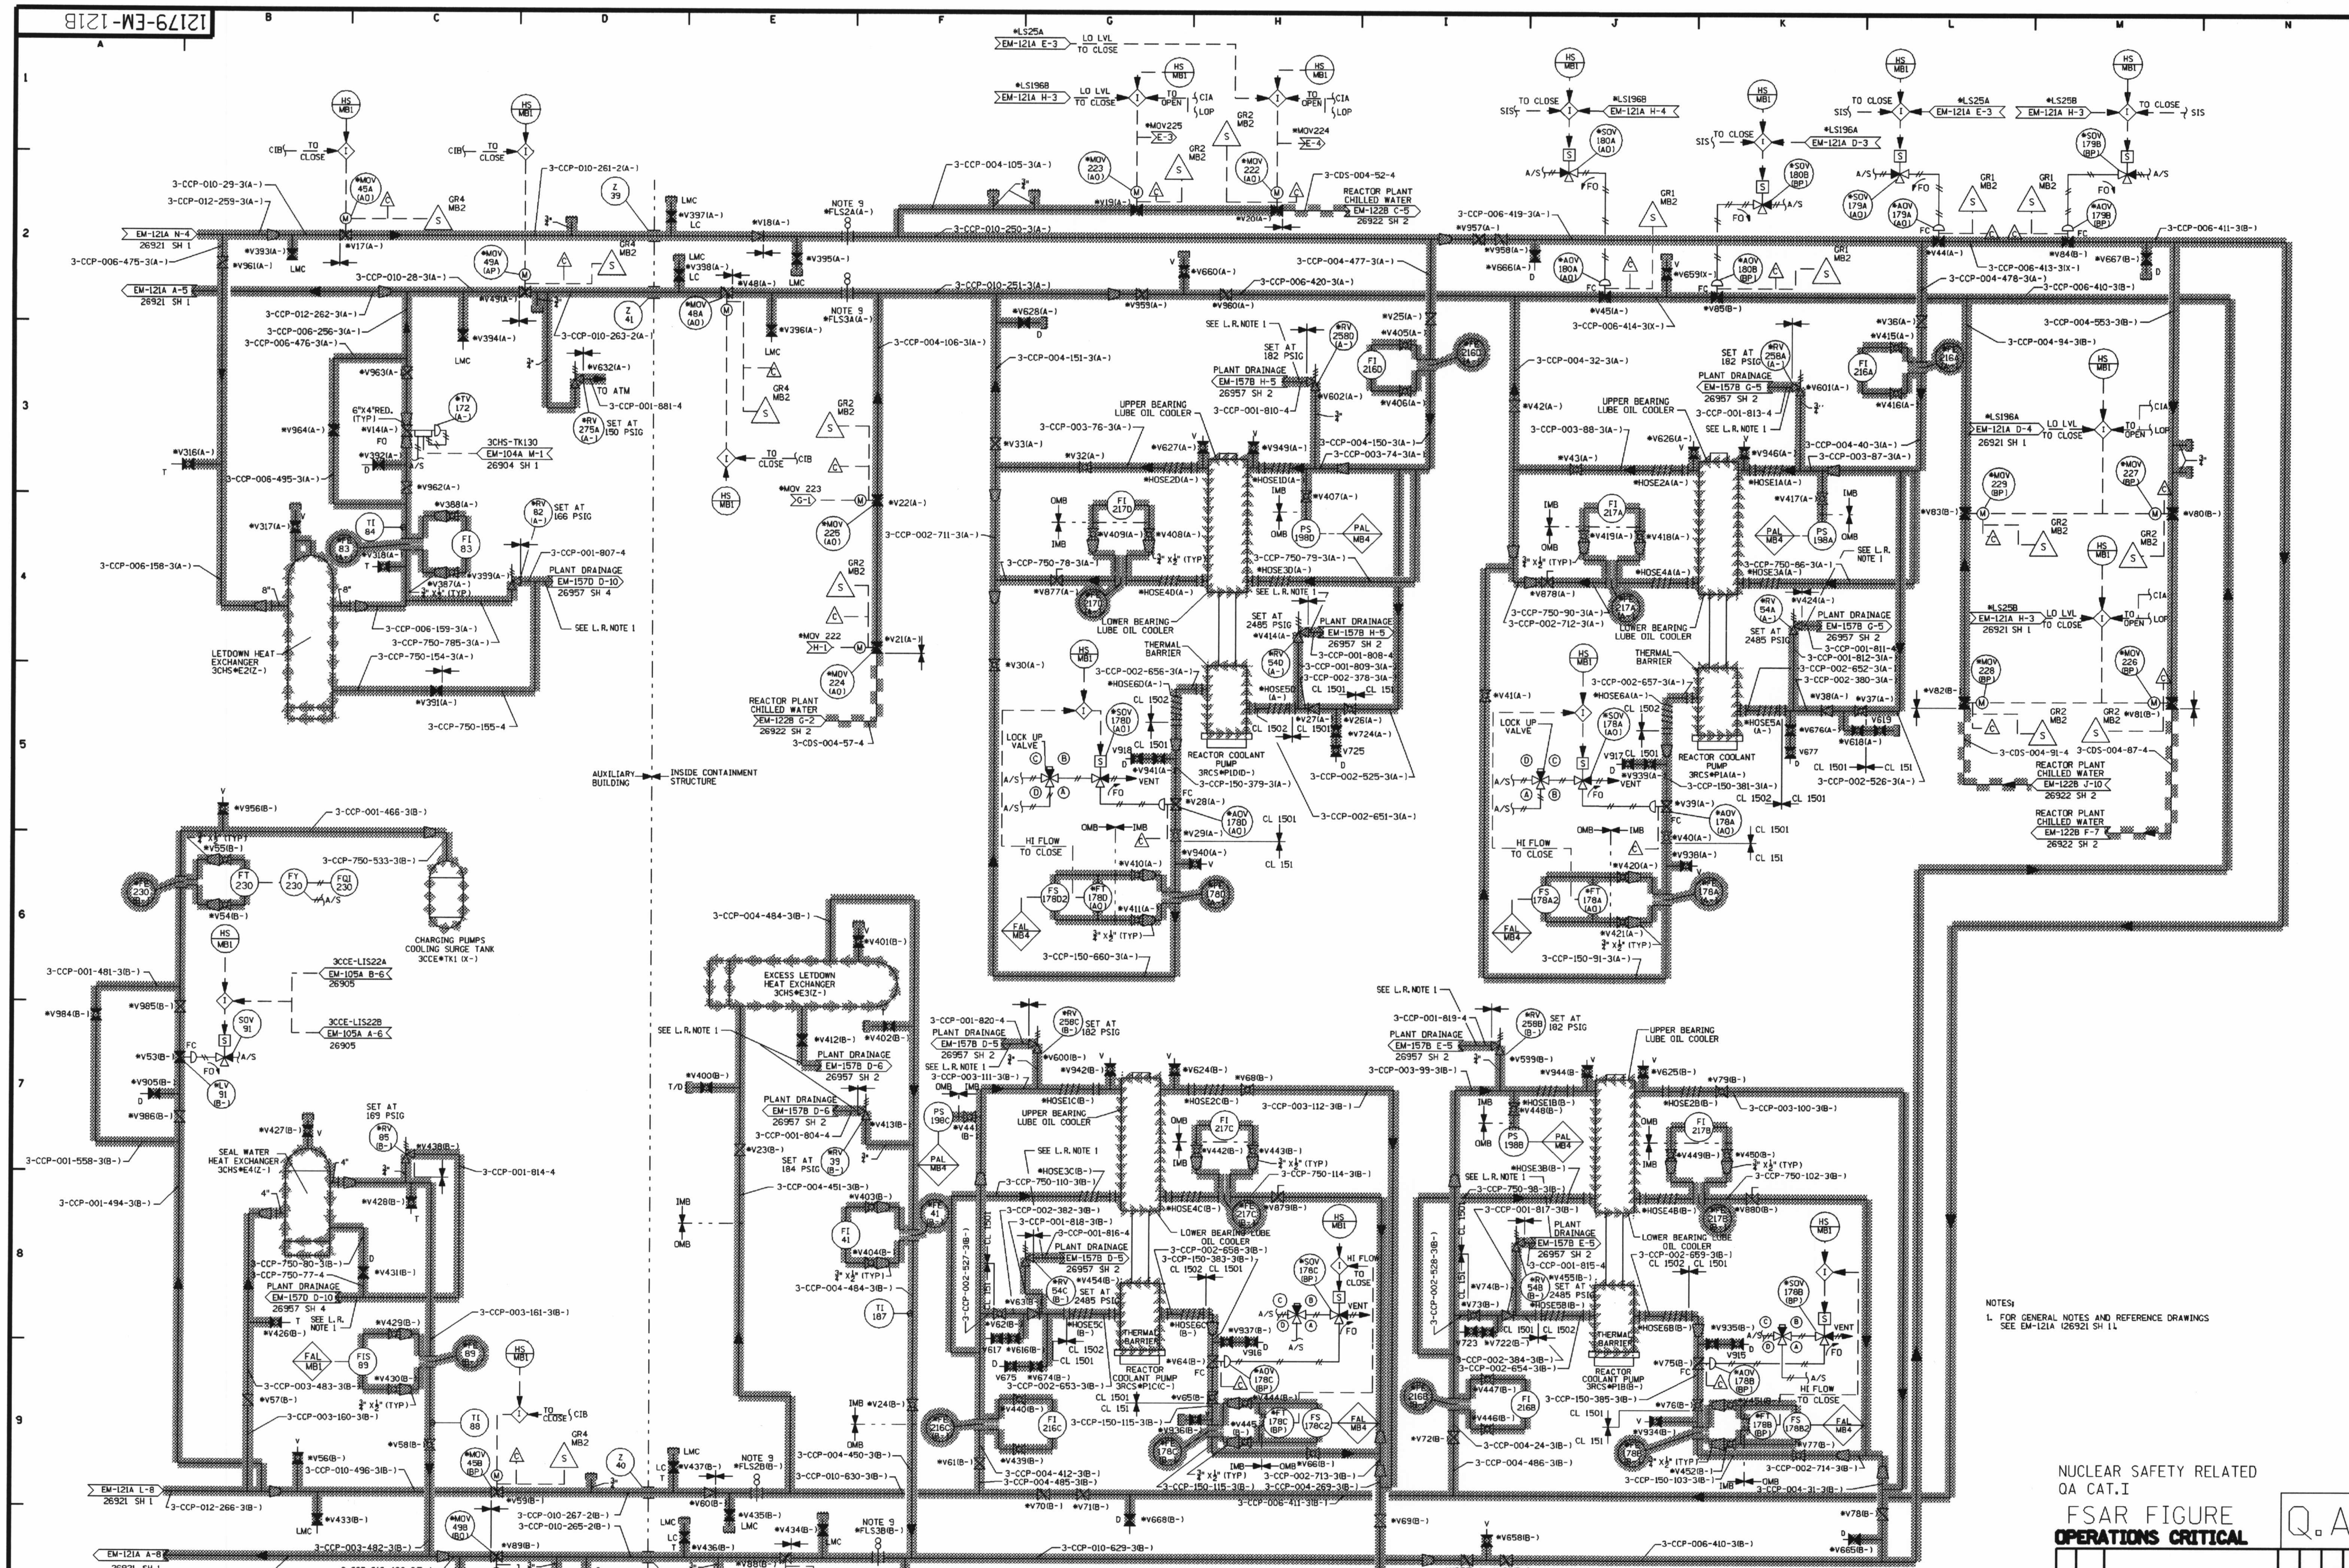

NOTES:

1. FOR GENERAL NOTES AND REFERENCE DRAWINGS SEE EM-121A (26921 SH 1).

NUCLEAR SAFETY RELATED
QA CAT.I

FSAR FIGURE

OPERATIONS CRITICAL

Q.A.

L.R. NOTES:

1. CRITERION 2 PIPING BOUNDARY ENDS AT THE FLOOR DRAIN.

CAD
NOTE: MANUAL REVISIONS TO THIS DOCUMENT WHEN AS-BUILT ARE PROHIBITED.

REV.	DATE	DESCRIPTION	BY	CHK	CORR	APP
REVISIONS DURING CONSTRUCTION			P.A. No.			

Dominion Nuclear Connecticut Inc.

Millstone Power Station

TITLE: MILLSTONE POWER STATION-UNIT NO. 3
LICENSE RENEWAL DIAGRAM
REACTOR PLANT
COMPONENT COOLING SYSTEM

BY	CHKD.	APP.	APP.
DATE	DATE	DATE	DATE
SCALE NONE	MICROFILM DATE	DWG. NO. 25212-LR26921 SH. 2 OF 3 00	

STONE & WEBSTER ENGINEERING CORPORATION BOSTON, MASS.

RESP. ENGR: W.SHERMAN/F.FORTINI
DESN. ENGR: W.F.KOLAITIS

P.A.#	NO.	DATE	REVISIONS	BY	CHK.	CORR	APP.
N/A	00	2-25-02	INITIAL ISSUE PER REV 20	CLW			

ISSUED PER MASTER DRAWING 25212-26921 SH. 2 OF 3 | REV 20

S&W DWG. NO.12179-EM- 121B

DRAWN BY: CHECKED BY:

COMPONENTS SUBJECT TO AGING MANAGEMENT REVIEW	
3330A	REACTOR PLANT COMPONENT COOLING
3330C	CHILLED WATER
3330D	CHARGING PUMP COOLING
3301	REACTOR COOLANT
3304	CHEMICAL & VOLUME CONTROL

NOTE: SOME SHADED LINES MAY CONTAIN COMPONENTS FROM MORE THAN ONE SYSTEM.

D144

Submitted by AHLUWALIAC on Wednesday January 07 2004 at 11:06:04 AM EST