12179-EM-133B

NOTES:

1. FOR GENERAL NOTES AND REFERENCE DRAWINGS SEE EM-133A (26933 SH 1).
2. PRESSURE INDICATORS PI139A, 140A, 141A, 142A, 139B, 140B, 141B, AND 142B WITH ASSOCIATED NEEDLE VALVES AND TUBING ARE VENDOR FURNISHED WITH THE HVQ UNITS.
3. DELETED
4. INLET SCREENS HAVE BEEN INSTALLED IN HEAT EXCHANGERS 3CCP*E1A, 3CCP*E1B & 3CCP*E1C.
5. STAINLESS STEEL SCREEN INSTALLED ON INLET TUBESHEET OF HEAT EXCHANGER.
6. ELECTRICAL POWER TO OPEN/CLOSE ISOLATION VALVES 3SWP*MOV130A/B IS ELIMINATED. VALVES ARE CAPABLE OF LOCAL MANUAL OPERATION.

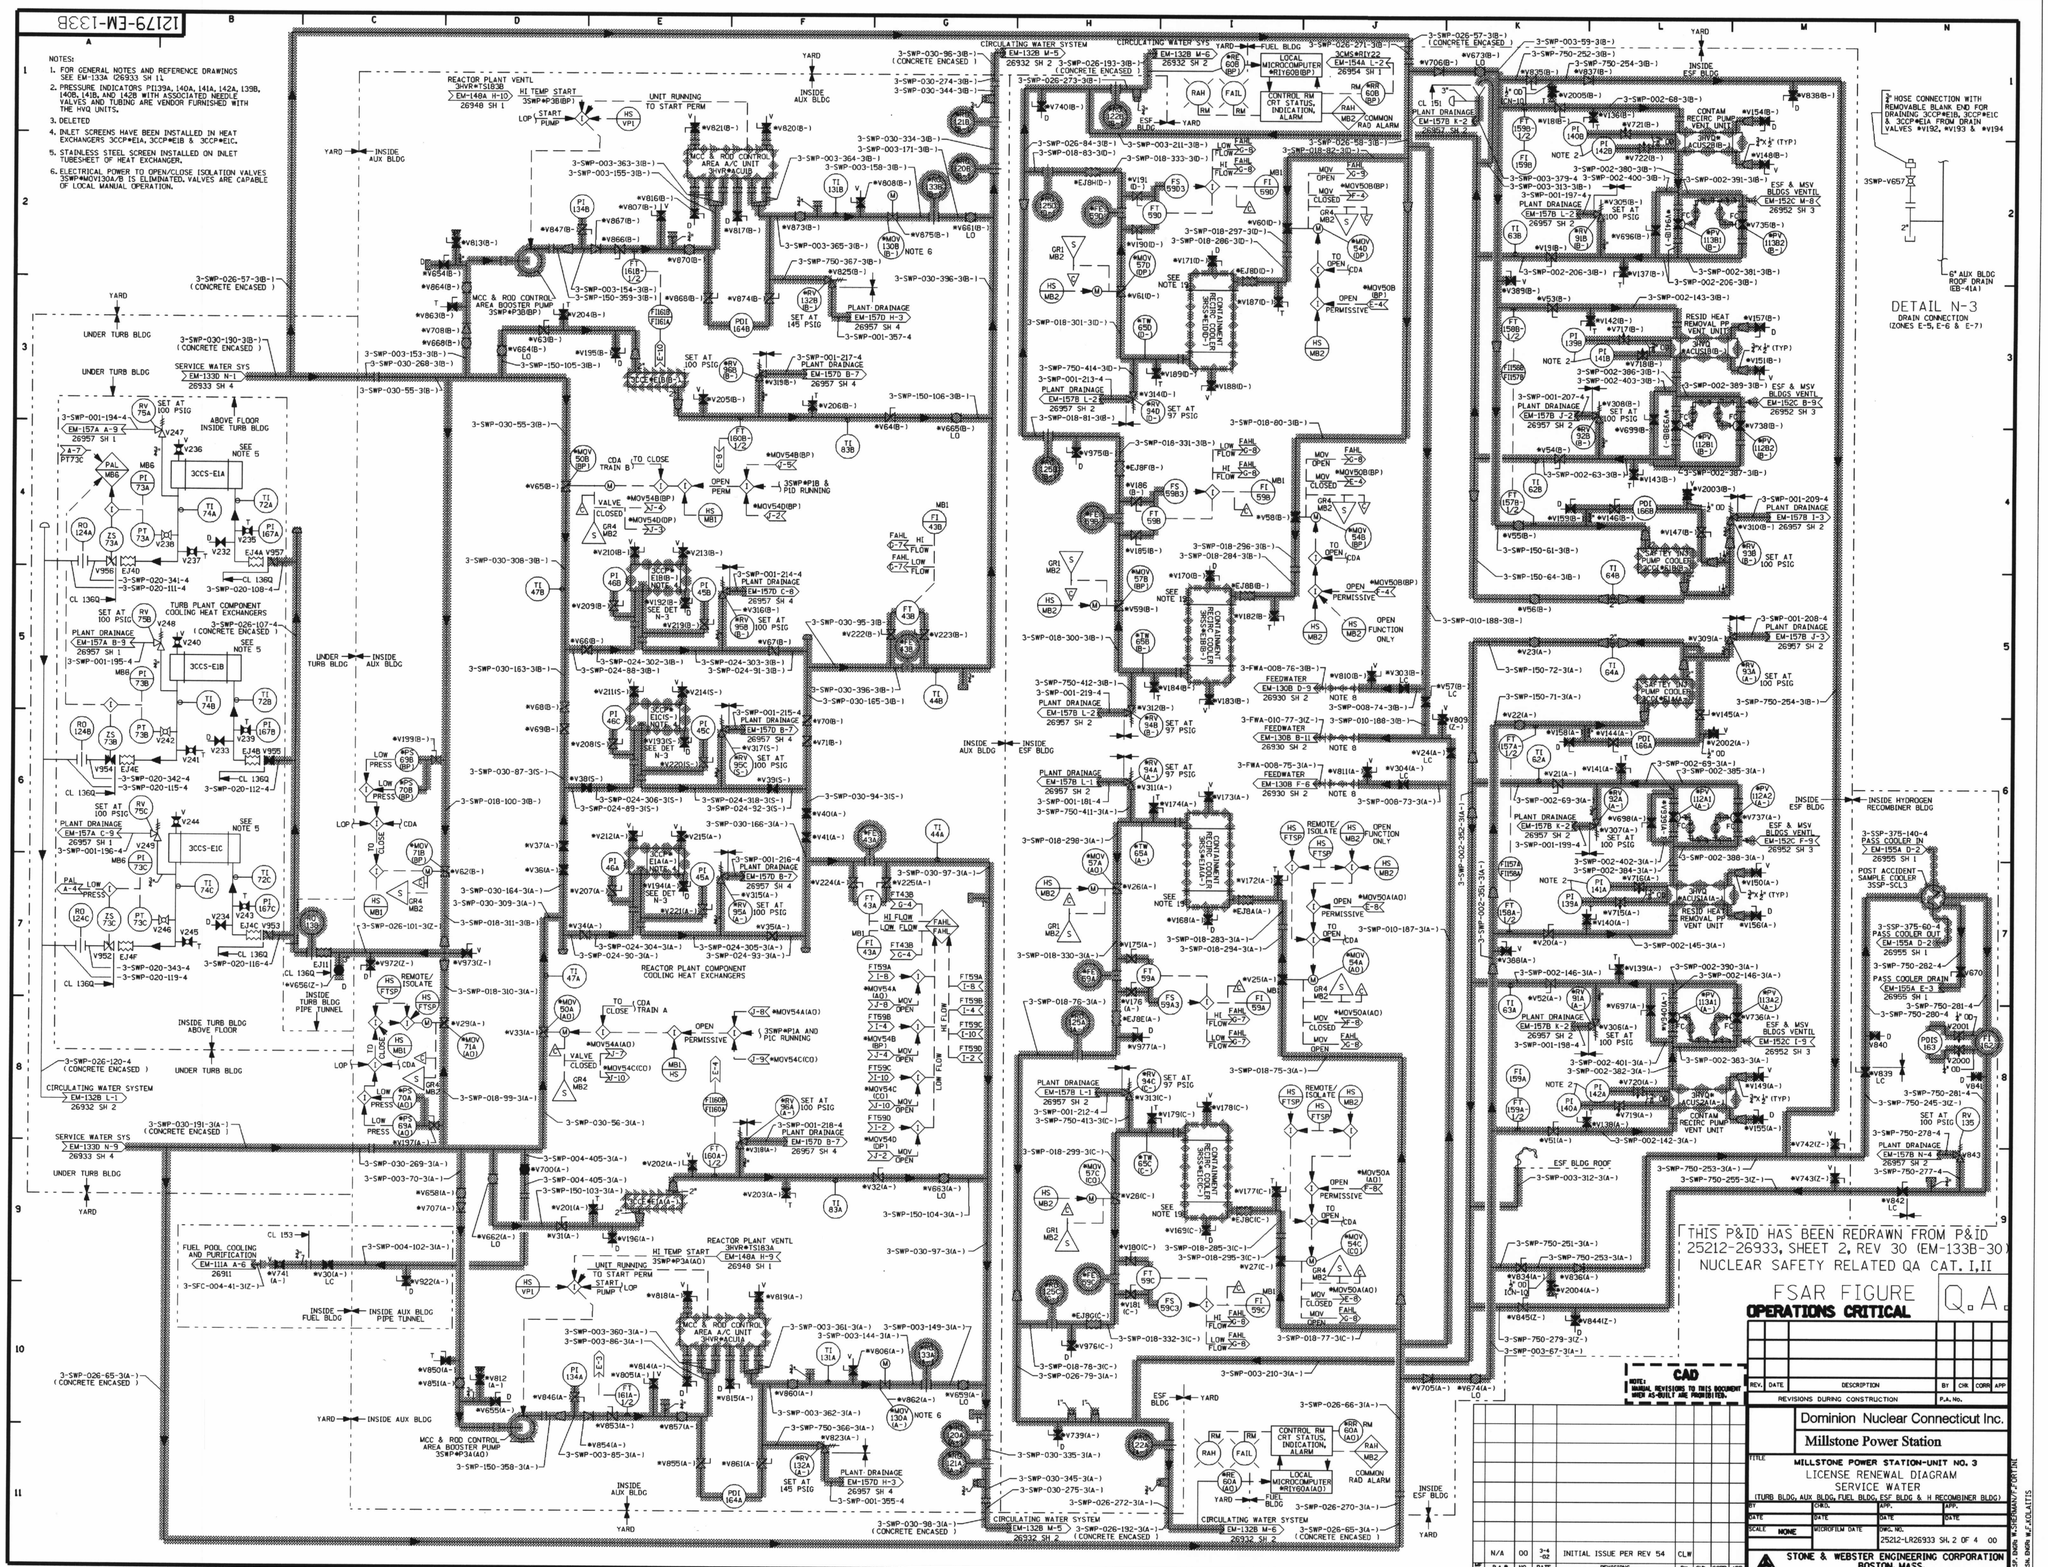

Submitted by AHLUWALIAC on Wednesday January 07 2004 at 11:04:29 AM EST

D162