12179-EM-138C

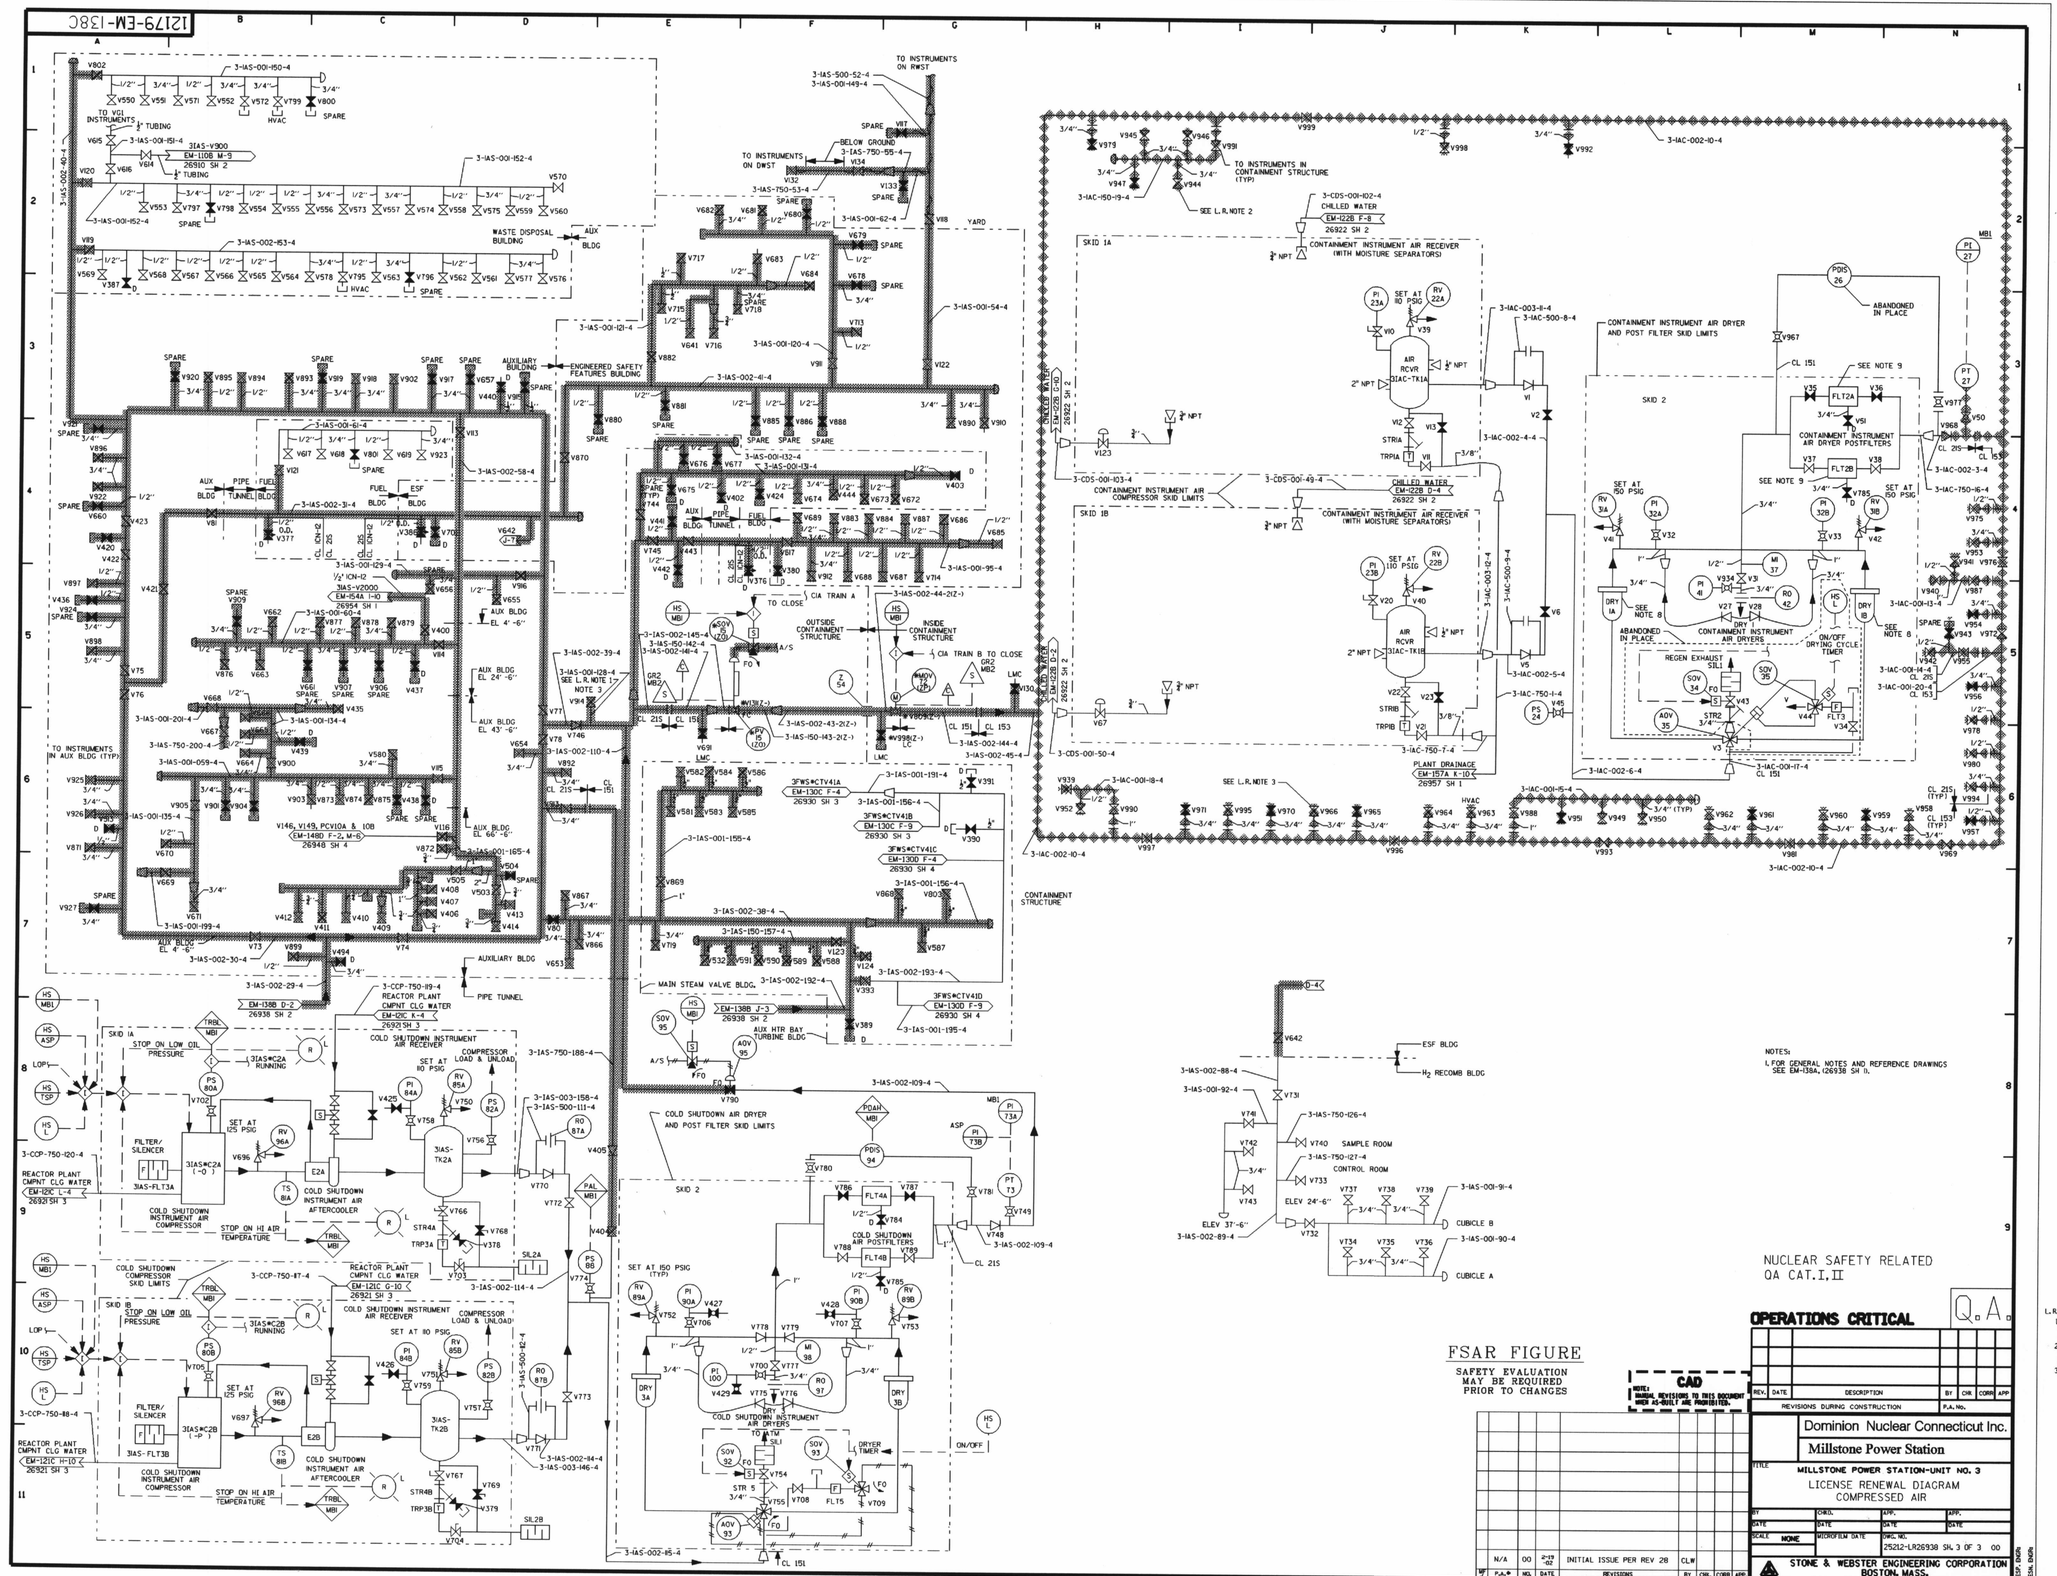

NOTES:

1. FOR GENERAL NOTES AND REFERENCE DRAWINGS SEE EM-138A, (26938 SH 1).

FSAR FIGURE

SAFETY EVALUATION MAY BE REQUIRED PRIOR TO CHANGES

CAD

NOTE: MANUAL REVISIONS TO THIS DOCUMENT MUST BE AS-BUILT AND PROHIBITED.

OPERATIONS CRITICAL

Q.A.

REV.	DATE	DESCRIPTION	BY	CHK.	CORR	APP.
		REVISIONS DURING CONSTRUCTION		P.A. No.		

REV.	P.A.#	MOD.	DATE	REVISIONS	BY	CHK.	CORR	APP.
N/A	00	2-19-02		INITIAL ISSUE PER REV 28	CLW			

ISSUED FOR MASTER DRAWING: 25212-26938 SH. 3 OF 3 | REV 28

DRAWN BY: CHECKED BY:

Dominion Nuclear Connecticut Inc.

Millstone Power Station

TITLE: MILLSTONE POWER STATION-UNIT NO. 3
LICENSE RENEWAL DIAGRAM
COMPRESSED AIR

BY	CHKD.	APP.	APP.
DATE	DATE	DATE	DATE
SCALE NONE	MICROFILM DATE	DWG. NO. 25212-LR26938 SH. 3 OF 3 00	

STONE & WEBSTER ENGINEERING CORPORATION
BOSTON, MASS.

S&W DWG. NO.12179-EM-138C

L.R. NOTES:

1. BOUNDARY EXTENDS TO INCLUDE INSTRUMENT AIR SUPPLY FOR THE OPERATION OF VALVE 3-IAS-HPV-15 DURING A FIRE EVENT IN THE CONTAINMENT.
2. BOUNDARY EXTENDS TO INCLUDE AIR SUPPLY FOR THE OPERATION OF VALVES 3-HCS-LCV-159/160 AND 3-CHS-AV-816B DURING A FIRE EVENT IN THE CONTAINMENT.
3. BOUNDARY EXTENDS TO INCLUDE AIR SUPPLY FOR THE OPERATION OF VALVES 3-CHS-HV-8149A/B/C AND AV-8145 DURING A FIRE EVENT IN THE CONTAINMENT.

COMPONENTS SUBJECT TO AGING MANAGEMENT REVIEW	
3332A	INSTRUMENT AIR
3332B	CONTAINMENT INSTRUMENT AIR

NOTE: SOME SHADED LINES MAY CONTAIN COMPONENTS FROM MORE THAN ONE SYSTEM.

D-172

Submitted by AHLUWALIAC on Wednesday January 07 2004 at 11:03:29 AM EST