12179-EM-146D

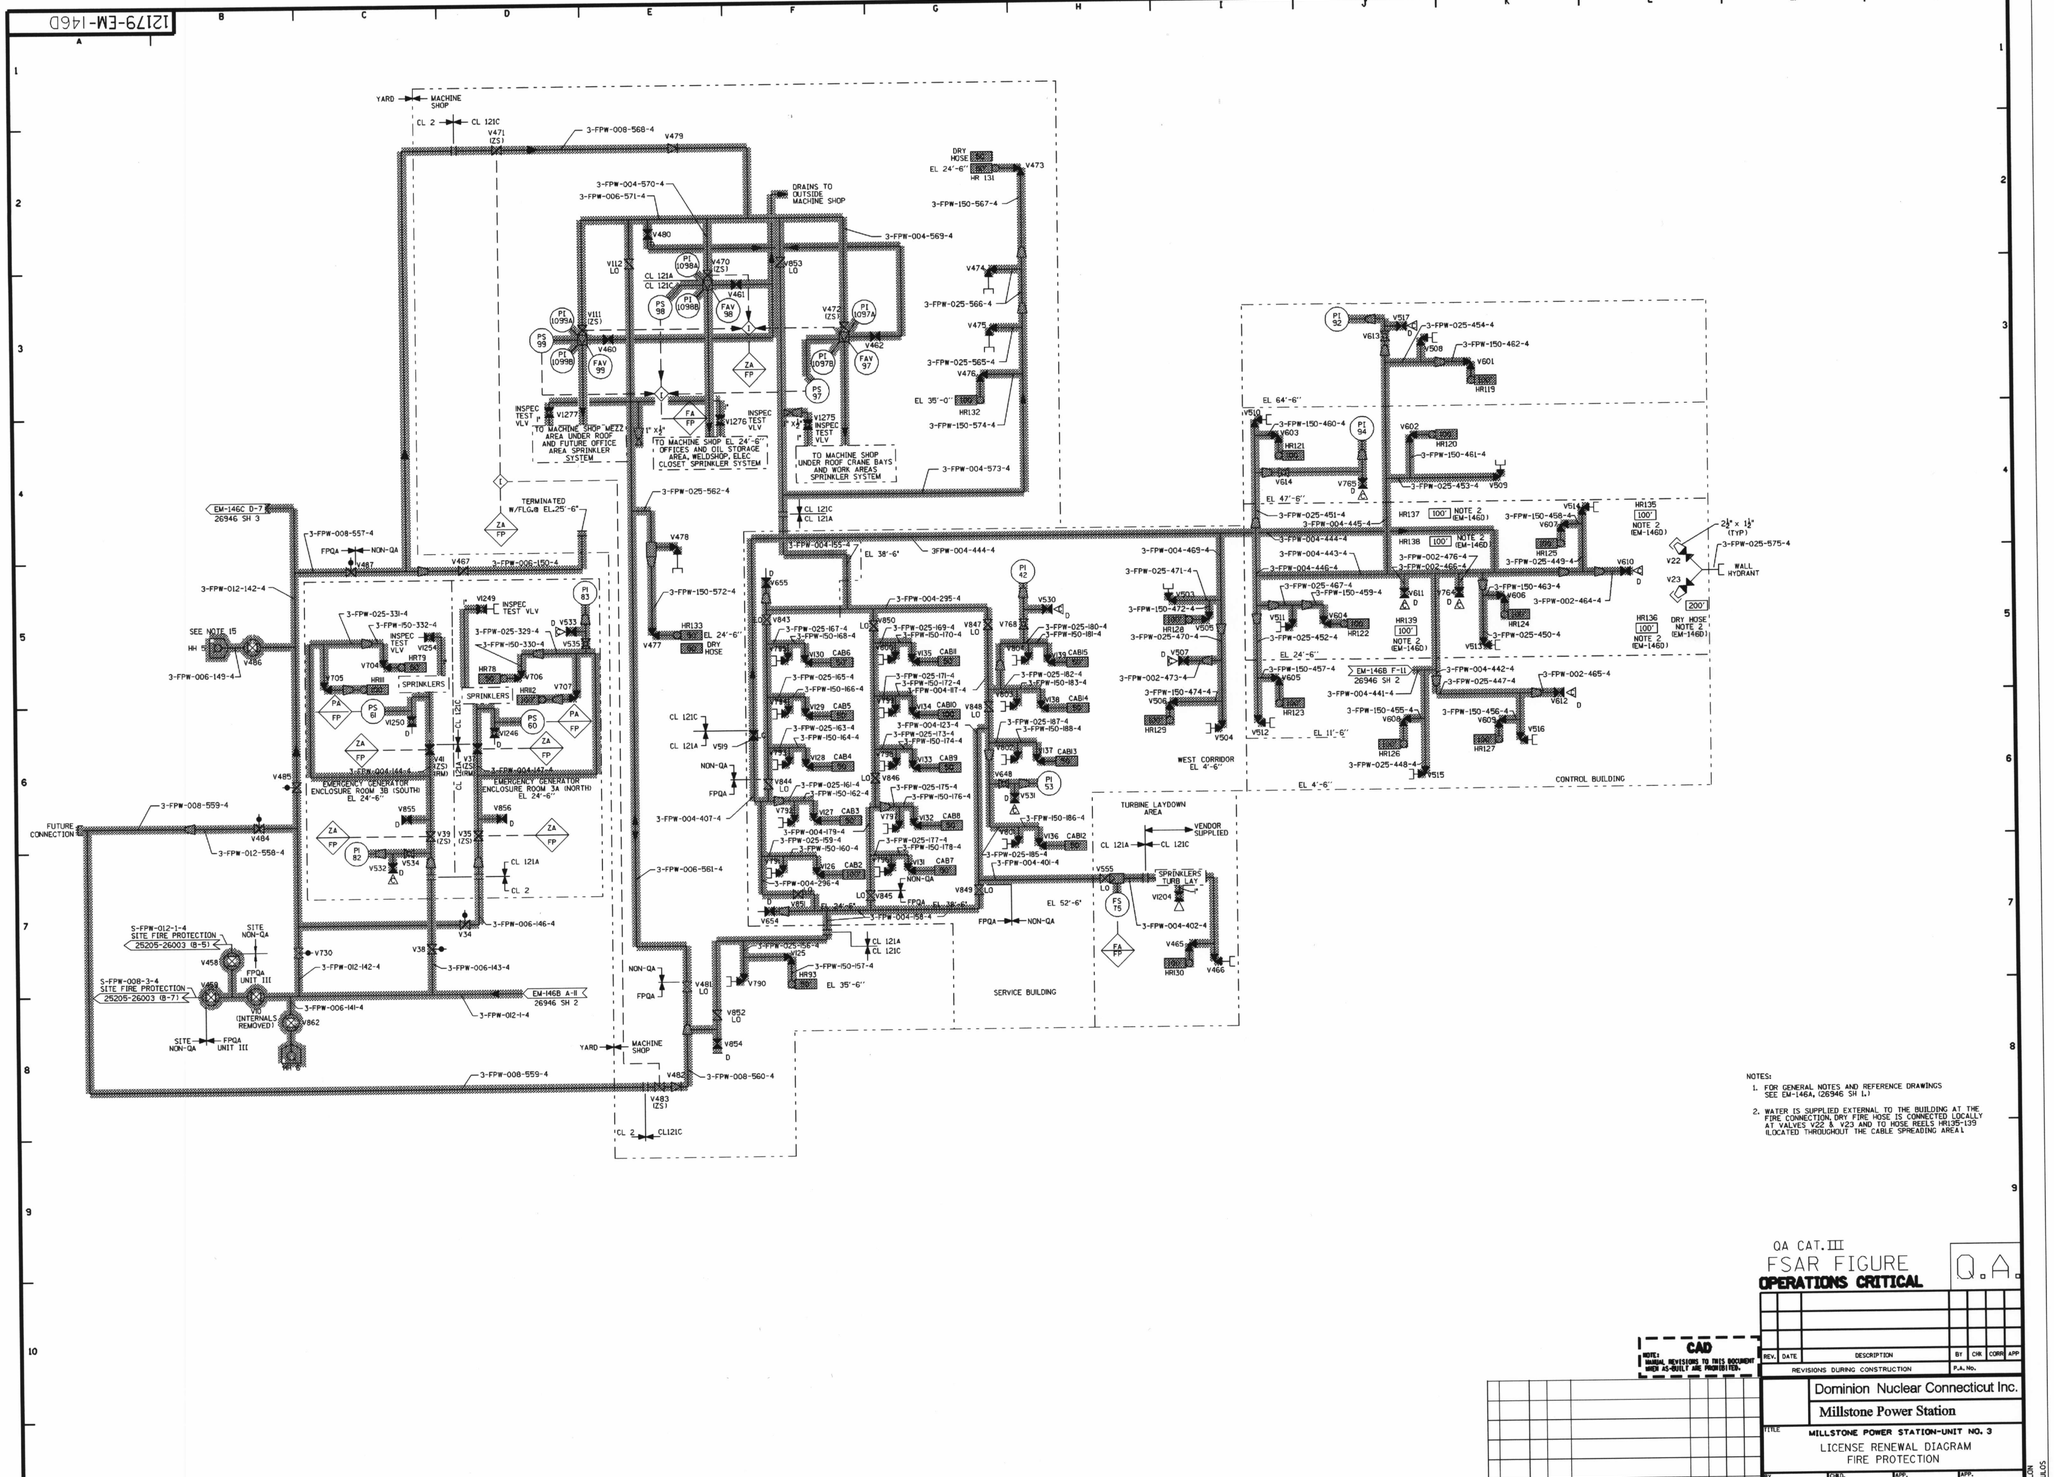

NOTES:

1. FOR GENERAL NOTES AND REFERENCE DRAWINGS SEE EM-146A, (26946 SH 1.)
2. WATER IS SUPPLIED EXTERNAL TO THE BUILDING AT THE FIRE CONNECTION. DRY FIRE HOSE IS CONNECTED LOCALLY AT VALVES V22 & V23 AND TO HOSE REELS HR135-139 (LOCATED THROUGHOUT THE CABLE SPREADING AREA).

QA CAT. III

FSAR FIGURE

OPERATIONS CRITICAL

Q.A.

CAD
NOTE: MANUAL REVISIONS TO THIS DOCUMENT MADE AS-BUILT ARE PROHIBITED.

REV.	DATE	DESCRIPTION	BY	CHK.	CORR.	APP.
		REVISIONS DURING CONSTRUCTION		P.A. No.		

Dominion Nuclear Connecticut Inc.

Millstone Power Station

TITLE: MILLSTONE POWER STATION-UNIT NO. 3
LICENSE RENEWAL DIAGRAM
FIRE PROTECTION

BY	CHKD.	APP.	APP.
DATE	DATE	DATE	DATE
SCALE NONE	MICROFILM DATE	DWG. NO. 25212-LR26946 SH. 4 OF 4	00

STONE & WEBSTER ENGINEERING CORPORATION BOSTON, MASS.

MF	P.A.#	NO.	DATE	REVISIONS	BY	CHK.	CORR.	APP.
	N/A	00	2-28-02	INITIAL ISSUE PER REV 20	CLM			

ISSUED FOR MASTER DRAWING 25212-26946 SH. 4 OF 4 REV 20

S&W DWG. NO. 12179-EM-146D

DRAWN BY: CHECKED BY: DESIGN ENGINEER: N. BOULOS REF. ENGINEER: C.CARLSON

COMPONENTS SUBJECT TO AGING MANAGEMENT REVIEW
3341 FIRE PROTECTION

NOTE: SOME SHADED LINES MAY CONTAIN COMPONENTS FROM MORE THAN ONE SYSTEM.

D-184

Submitted by: AHLIWALIA on Wednesday, January 07 2004 at 11:02:29 AM EST