12179-EM-147A

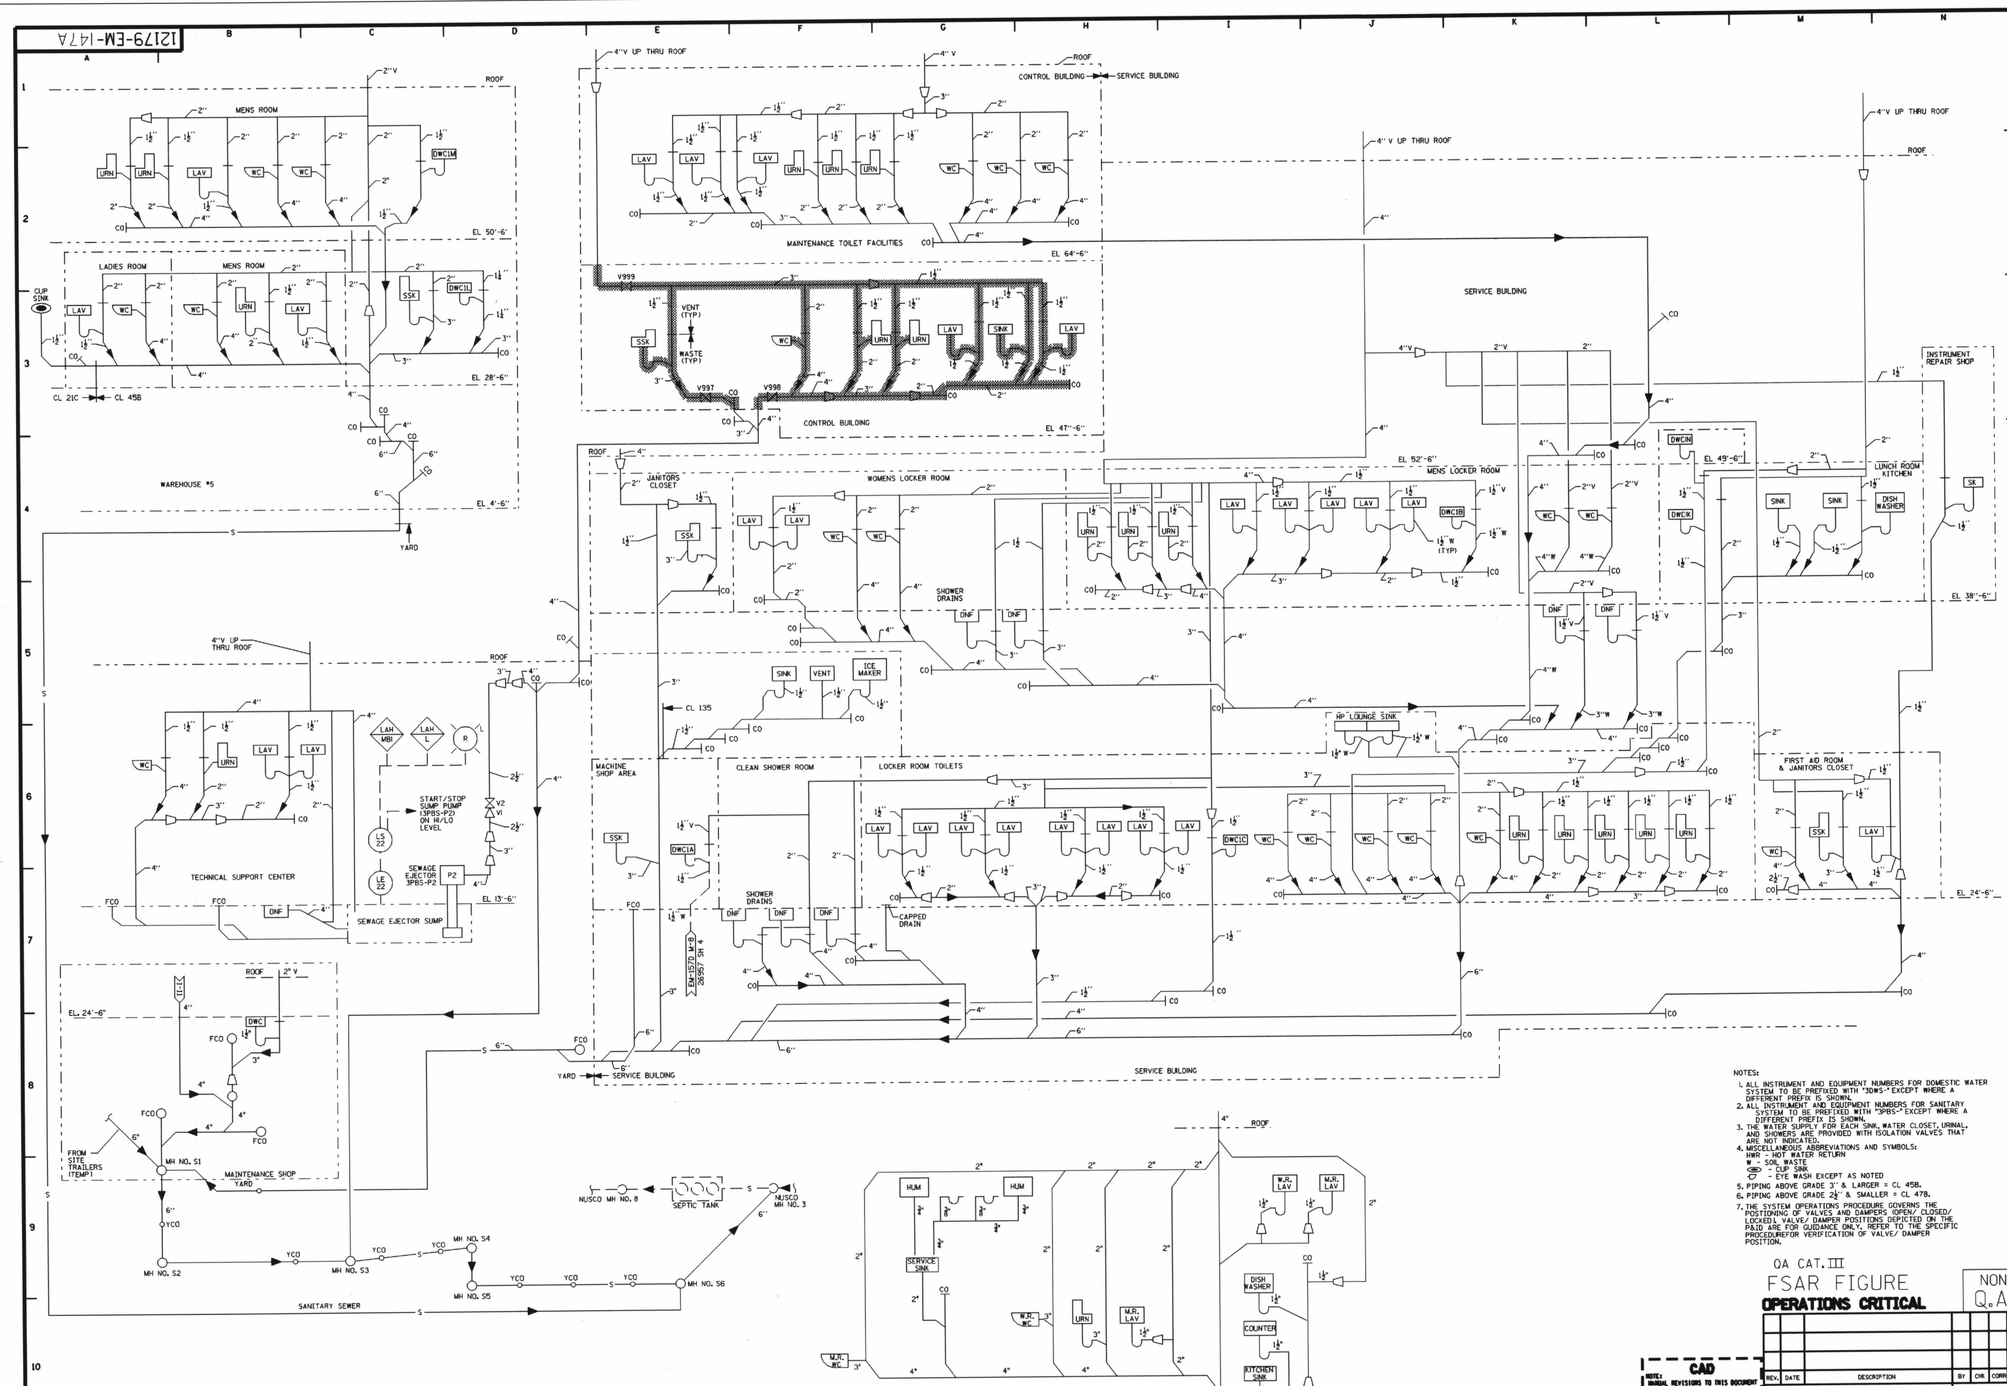

NOTES:

1. ALL INSTRUMENT AND EQUIPMENT NUMBERS FOR DOMESTIC WATER SYSTEM TO BE PREFIXED WITH "3DWS-" EXCEPT WHERE A DIFFERENT PREFIX IS SHOWN.
2. ALL INSTRUMENT AND EQUIPMENT NUMBERS FOR SANITARY SYSTEM TO BE PREFIXED WITH "3PBS-" EXCEPT WHERE A DIFFERENT PREFIX IS SHOWN.
3. THE WATER SUPPLY FOR EACH SINK, WATER CLOSET, URINAL, AND SHOWERS ARE PROVIDED WITH ISOLATION VALVES THAT ARE NOT INDICATED.
4. MISCELLANEOUS ABBREVIATIONS AND SYMBOLS:
   HWR - HOT WATER RETURN
   W - SOIL WASTE
   CS - CUP SINK
   EW - EYE WASH EXCEPT AS NOTED
5. PIPING ABOVE GRADE 3" & LARGER = CL 45B.
6. PIPING ABOVE GRADE 2½" & SMALLER = CL 47B.
7. THE SYSTEM OPERATIONS PROCEDURE GOVERNS THE POSITIONING OF VALVES AND DAMPERS (OPEN/ CLOSED/ LOCKED). VALVE/ DAMPER POSITIONS DEPICTED ON THE P&ID ARE FOR GUIDANCE ONLY. REFER TO THE SPECIFIC PROCEDURE FOR VERIFICATION OF VALVE/ DAMPER POSITION.

QA CAT. III

FSAR FIGURE

OPERATIONS CRITICAL

NON Q.A.

REV.	DATE	DESCRIPTION	BY	CHR.	CORR.	APP.

REVISIONS DURING CONSTRUCTION — P.A. No.

CAD
NOTE: ORIGINAL REVISIONS TO THIS DOCUMENT MADE AS-BUILT ARE PROHIBITED.

NF	P.A.*	NO.	DATE	REVISIONS	BY	CHR.	CORR.	APP.
	N/A	00	4-17-02	INITIAL ISSUE PER REV 8	CLW			

*ISSUED PER MASTER DRAWING 25212-26947 SH. 1 OF 3 — REV 8

S&W DWG. NO. 12179-EM-147A

DRAWN BY: — CHECKED BY: — REF: DWG#A,B,C,D,E,L,05

Dominion Nuclear Connecticut Inc.

Millstone Power Station

TITLE: MILLSTONE POWER STATION-UNIT NO. 3
LICENSE RENEWAL DIAGRAM
RISER DIAGRAM
SANITARY DRAINS & VENTS

BY	CHRD.	APP.	APP.
DATE	DATE	DATE	DATE
SCALE NONE	MICROFILM DATE	DWG. NO. 25212-LR26947 SH. 1 OF 3	00

STONE & WEBSTER ENGINEERING CORPORATION BOSTON, MASS.

COMPONENTS SUBJECT TO AGING MANAGEMENT REVIEW
3336A — SANITARY WATER

NOTE: SOME SHADED LINES MAY CONTAIN COMPONENTS FROM MORE THAN ONE SYSTEM.

D-152

Submitted by AHLUWALIAC on Wednesday January 07 2004 at 11:02:23 AM EST