

January 23, 2004

**Joseph A. Widay**  
Vice President  
and Plant Manager

Mr. Robert L. Clark  
Office of Nuclear Regulatory Regulation  
U.S. Nuclear Regulatory Commission  
ATTN: Document Control Desk  
Washington, D.C. 20555-0001

Subject: Transmittal of Core Operating Limits Report (COLR)  
Rochester Gas & Electric Corporation  
R.E. Ginna Nuclear Power Plant  
Docket No. 50-244

Ref.(a): Technical Specification 5.6.5

Dear Mr. Clark:

Ginna Station Technical Specification 5.6.5 requires that RG&E provide the NRC with any revisions of the COLR. As such, attached please find a copy of Revision 1 of this document for Cycle 31. Future revisions to this document will be forwarded to the NRC in accordance with the applicable technical specification.

Very truly yours,

*Joseph A. Widay*  
Joseph A. Widay

Attachment

xc: Mr. Robert Clark (Mail Stop O-8-C2)  
Project Directorate I  
Division of Licensing Project Management  
Office of Nuclear Reactor Regulation  
U.S. Nuclear Regulatory Commission  
11555 Rockville Pike  
Rockville, MD 20852

Regional Administrator, Region 1  
U.S. Nuclear Regulatory Commission  
475 Allendale Road  
King of Prussia, PA 19406

U.S. NRC Ginna Senior Resident Inspector

An equal opportunity employer

89 East Avenue | Rochester, NY 14649  
tel (585) 546-2700

www.rge.com

1000932

A001



R.E. Ginna Nuclear Power Plant

# Core Operating Limits Report COLR

Cycle 31

Revision 1

Responsible Manager:

Mark D. Flaherty  
Mark Flaherty

Effective Date:

1/23/04  
01-23-2004

Controlled Copy No. \_\_\_\_\_

Record Cat.# 4.43.2

*id*

## 1.0 CORE OPERATING LIMITS REPORT

This Core Operating Limits Report (COLR) for the R.E. Ginna Nuclear Power Plant has been prepared in accordance with the requirements of Technical Specification 5.6.5.

The Technical Specifications affected by this report are listed below:

- 3.1.1 SHUTDOWN MARGIN (SDM)
- 3.1.3 MODERATOR TEMPERATURE COEFFICIENT (MTC)
- 3.1.5 Shutdown Bank Insertion Limit
- 3.1.6 Control Bank Insertion Limits
- 3.2.1 Heat Flux Hot Channel Factor ( $F_Q(Z)$ )
- 3.2.2 Nuclear Enthalpy Rise Hot Channel Factor ( $F_{\Delta H}^N$ )
- 3.2.3 AXIAL FLUX DIFFERENCE (AFD)
- 3.4.1 RCS Pressure, Temperature, and Flow Departure from Nucleate Boiling (DNB) Limits
- 3.9.1 Boron Concentration

## 2.0 OPERATING LIMITS

The cycle-specific parameter limits for the specifications listed in Section 1.0 are presented in the following subsections. These limits have been developed using the NRC approved methodologies specified in Technical Specification 5.6.5. All items that appear in capitalized type are defined in Technical Specification 1.1, Definitions.

### 2.1 SHUTDOWN MARGIN<sup>1</sup>

(LCO 3.1.1)

- 2.1.1 The SHUTDOWN MARGIN in MODE 2 with  $K_{\text{eff}} < 1.0$  and MODES 3 and 4 shall be greater than or equal to the limits specified in Figure COLR - 1 for the number of reactor coolant pumps in operation (non main feedwater operation).
- 2.1.2 The SHUTDOWN MARGIN in MODE 4 when both reactor coolant pumps are not OPERABLE and in operation and in MODE 5 shall be greater than or equal to the one loop operation curve of Figure COLR - 1.
- 2.1.3 The SHUTDOWN MARGIN required in LCO 3.1.4, LCO 3.1.5, LCO 3.1.6, LCO 3.1.8, and LCO 3.4.5 shall be greater than the limits specified in Figure COLR - 1 for the number of reactor coolant pumps in operation and the status of the main feedwater system.

### 2.2 MODERATOR TEMPERATURE COEFFICIENT<sup>1</sup>

(LCO 3.1.3)

- 2.2.1 The Moderator Temperature Coefficient (MTC) limits are:

The BOL ARO/HZP - MTC shall be less positive than +5.0 pcm/°F for power levels below 70% RTP and less than or equal to 0 pcm/°F for power levels at or above 70% RTP.

The EOL ARO/RTP - MTC shall be less negative than -42.9 pcm/°F.

where:

ARO stands for All Rods Out

BOL stands for Beginning of Cycle Life

EOL stands for End of Cycle Life

HZP stands for Hot Zero Power

RTP stands for RATED THERMAL POWER

**2.3 Shutdown Bank Insertion Limit<sup>1</sup>**

(LCO 3.1.5)

2.3.1 The shutdown bank shall be fully withdrawn which is defined as  $\geq 221$  steps.

**2.4 Control Bank Insertion Limits<sup>1</sup>**

(LCO 3.1.6)

2.4.1 The control banks shall be limited in physical insertion as shown in Figure COLR - 2.

2.4.2 The control banks shall be moved sequentially with a 100 ( $\pm 5$ ) step overlap between successive banks.

**2.5 Heat Flux Hot Channel Factor ( $F_Q(Z)$ )<sup>2</sup>**

(LCO 3.2.1)

2.5.1  $F_Q(Z) \leq ((F_Q) * K(Z) / P)$  when  $P > 0.5$

$F_Q(Z) \leq ((F_Q) * K(Z) / 0.5)$  when  $P \leq 0.5$

where:

Z is the height in the core,

$F_Q = 2.45$ ,

K(Z) is provided in Figure COLR - 3, and

P = THERMAL POWER / RATED THERMAL POWER

**2.6 Nuclear Enthalpy Rise Hot Channel Factor ( $F_{\Delta H}^N$ )<sup>1</sup>**

(LCO 3.2.2)

2.6.1  $F_{\Delta H}^N \leq F_{\Delta H}^{RTP} * (1 + PF_{\Delta H} * (1-P))$

where:

$F_{\Delta H}^{RTP} = 1.75$ ,

$PF_{\Delta H} = 0.3$ , and

P = THERMAL POWER / RATED THERMAL POWER

**2.7 AXIAL FLUX DIFFERENCE<sup>3</sup>**

(LCO 3.2.3)

2.7.1 The AXIAL FLUX DIFFERENCE (AFD) target band is  $\pm 5\%$ . The actual target bands are provided by Procedure RE-11.1.

2.7.2 The AFD acceptable operation limits are provided in Figure COLR - 4.

**2.8 RCS Pressure, Temperature, and Flow Departure from Nucleate Boiling (DNB) Limits<sup>4</sup>**

(LCO 3.4.1)

2.8.1 The pressurizer pressure shall be  $\geq 2205$  psig.

2.8.2 The RCS average temperature shall be  $\leq 577.5$  °F.

2.8.3 The RCS total flow rate shall be  $\geq 177,300$  gpm (includes 4% minimum flow uncertainty per Revised Thermal Design Methodology).


**2.9 Boron Concentration<sup>1</sup>**

(LCO 3.9.1)

2.9.1 The boron concentrations of the hydraulically coupled Reactor Coolant System, the refueling canal, and the refueling cavity shall be  $\geq 2300$  ppm.

### 3.0 REFERENCES

1. WCAP-9272-P-A, Westinghouse Reload Safety Evaluation Methodology, July 1985.
2. WCAP-10054-P-A and WCAP-10081-A, "Westinghouse Small Break ECCS Evaluation Model Using the NOTRUMP Code," August 1985.
3. WCAP-10924-P-A, Volume 1, Revision 1, "Westinghouse Large-Break LOCA Best-Estimate Methodology, Volume 1: Model Description and Validation Responses to NRC Questions," and Addenda 1,2,3, December 1988.
4. WCAP-10924-P-A, Volume 2, Revision 2, "Westinghouse Large-Break LOCA Best-Estimate Methodology, Volume 2: Application to Two-Loop PWRs Equipped with Upper Plenum Injection," and Addendum 1, December 1988.
5. WCAP-10924-P-A, Volume 1, Revision 1, Addendum 4, "Westinghouse Large-Break LOCA Best-Estimate Methodology, Volume 1: Model Description and Validation, Addendum 4: Model Revisions," March 1991.
6. WCAP-13677-P-A, "10 CFR 50.46 Evaluation Model Report: WCOBRA/TRAC Two-Loop Upper Plenum Injection Model Updates to Support ZIRLO™ Cladding Option," February 1994.
7. WCAP-12610-P-A, "VANTAGE + Fuel Assembly Reference Core Report," April 1995.
8. WCAP-8385, "Power Distribution Control and Load Following Procedures - Topical Report," September 1974.
9. WCAP-11397-P-A, "Revised Thermal Design Procedure", April 1989.

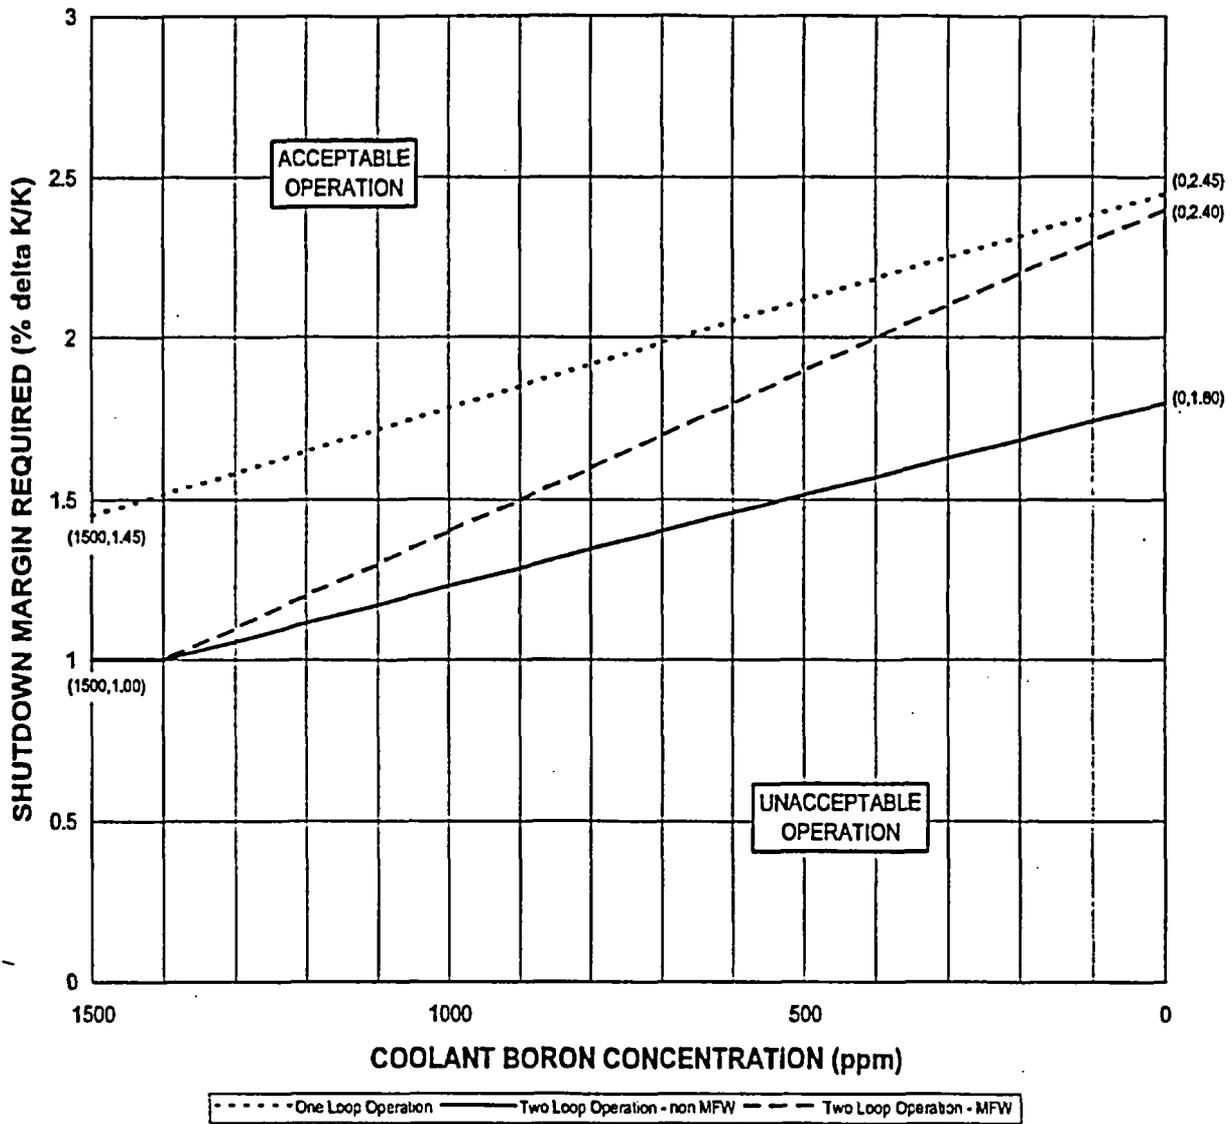


NOTE:

Two Loop Operation - non MFW means that the main feedwater system is not supplying the steam generators.

Two Loop Operation - MFW means that the main feedwater system is supplying the steam generators.

Figure COLR - 1  
REQUIRED SHUTDOWN MARGIN

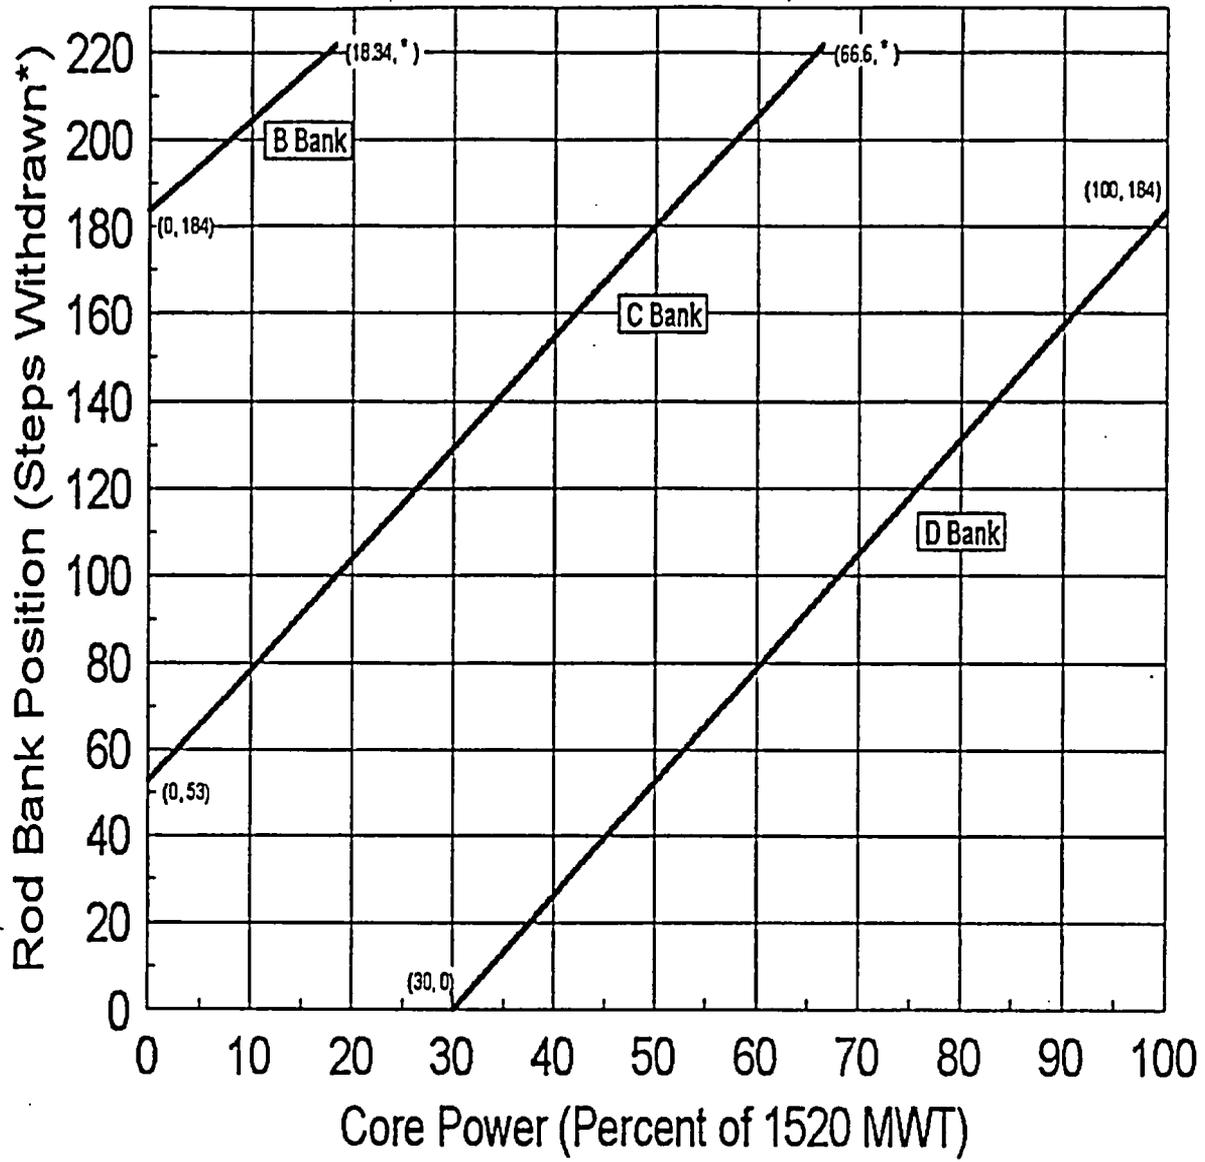

\*The fully withdrawn position is defined as  $\geq 221$  steps.

Figure COLR - 2  
CONTROL BANK INSERTION LIMITS

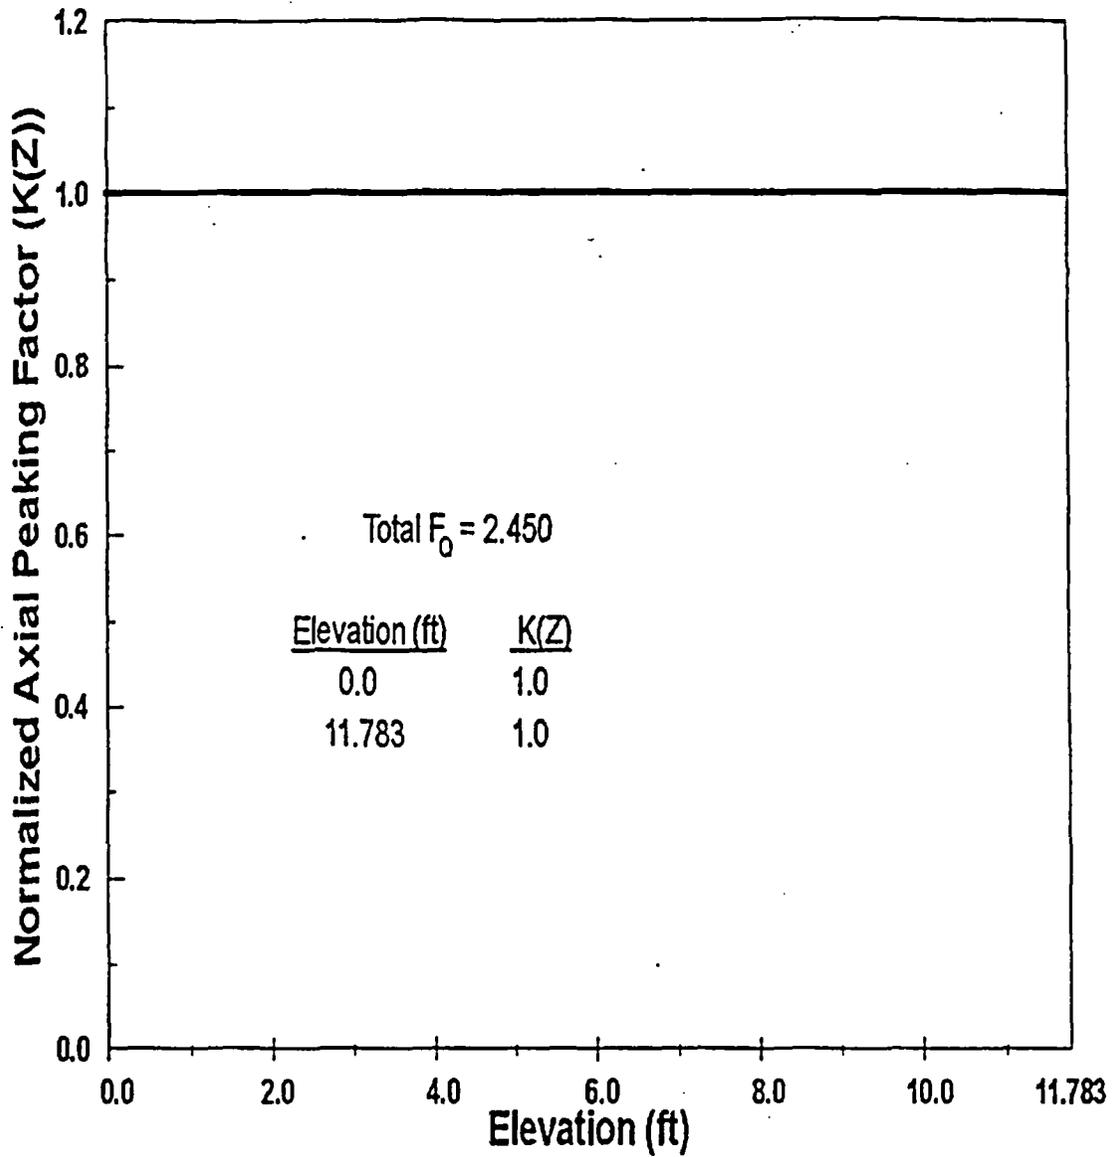


FIGURE 3

Figure COLR - 3  
K(Z) - NORMALIZED  $F_Q(Z)$  AS A FUNCTION OF CORE HEIGHT

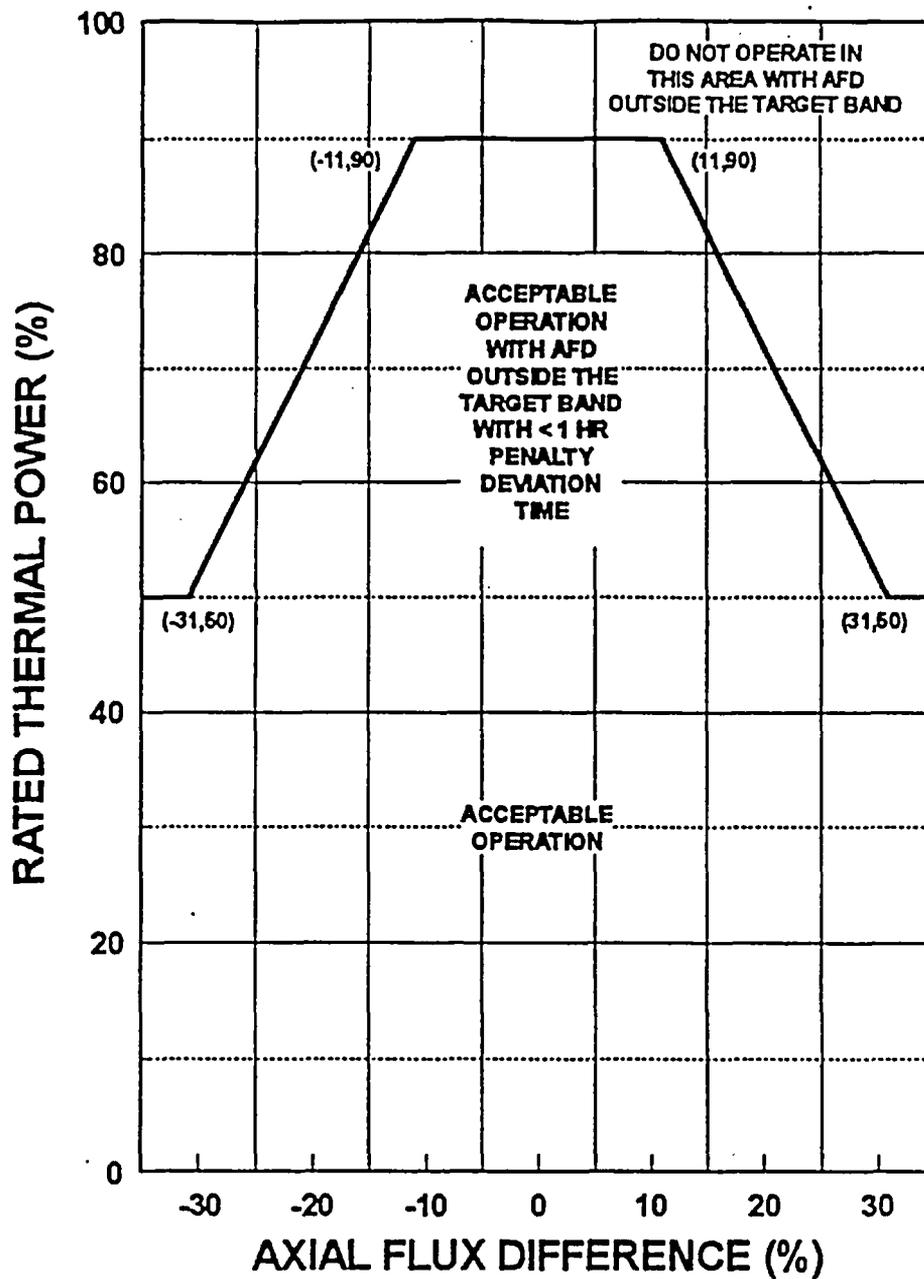


FIGURE 4

Figure COLR - 4  
AXIAL FLUX DIFFERENCE ACCEPTABLE OPERATION LIMITS AS A FUNCTION OF RATED THERMAL POWER

END NOTES

---

---

1. (Limits generated using Reference 1)
2. (Limits generated using References 1 through 7)
3. (Limits generated using References 1 and 8)
4. (Limits generated using Reference 9)