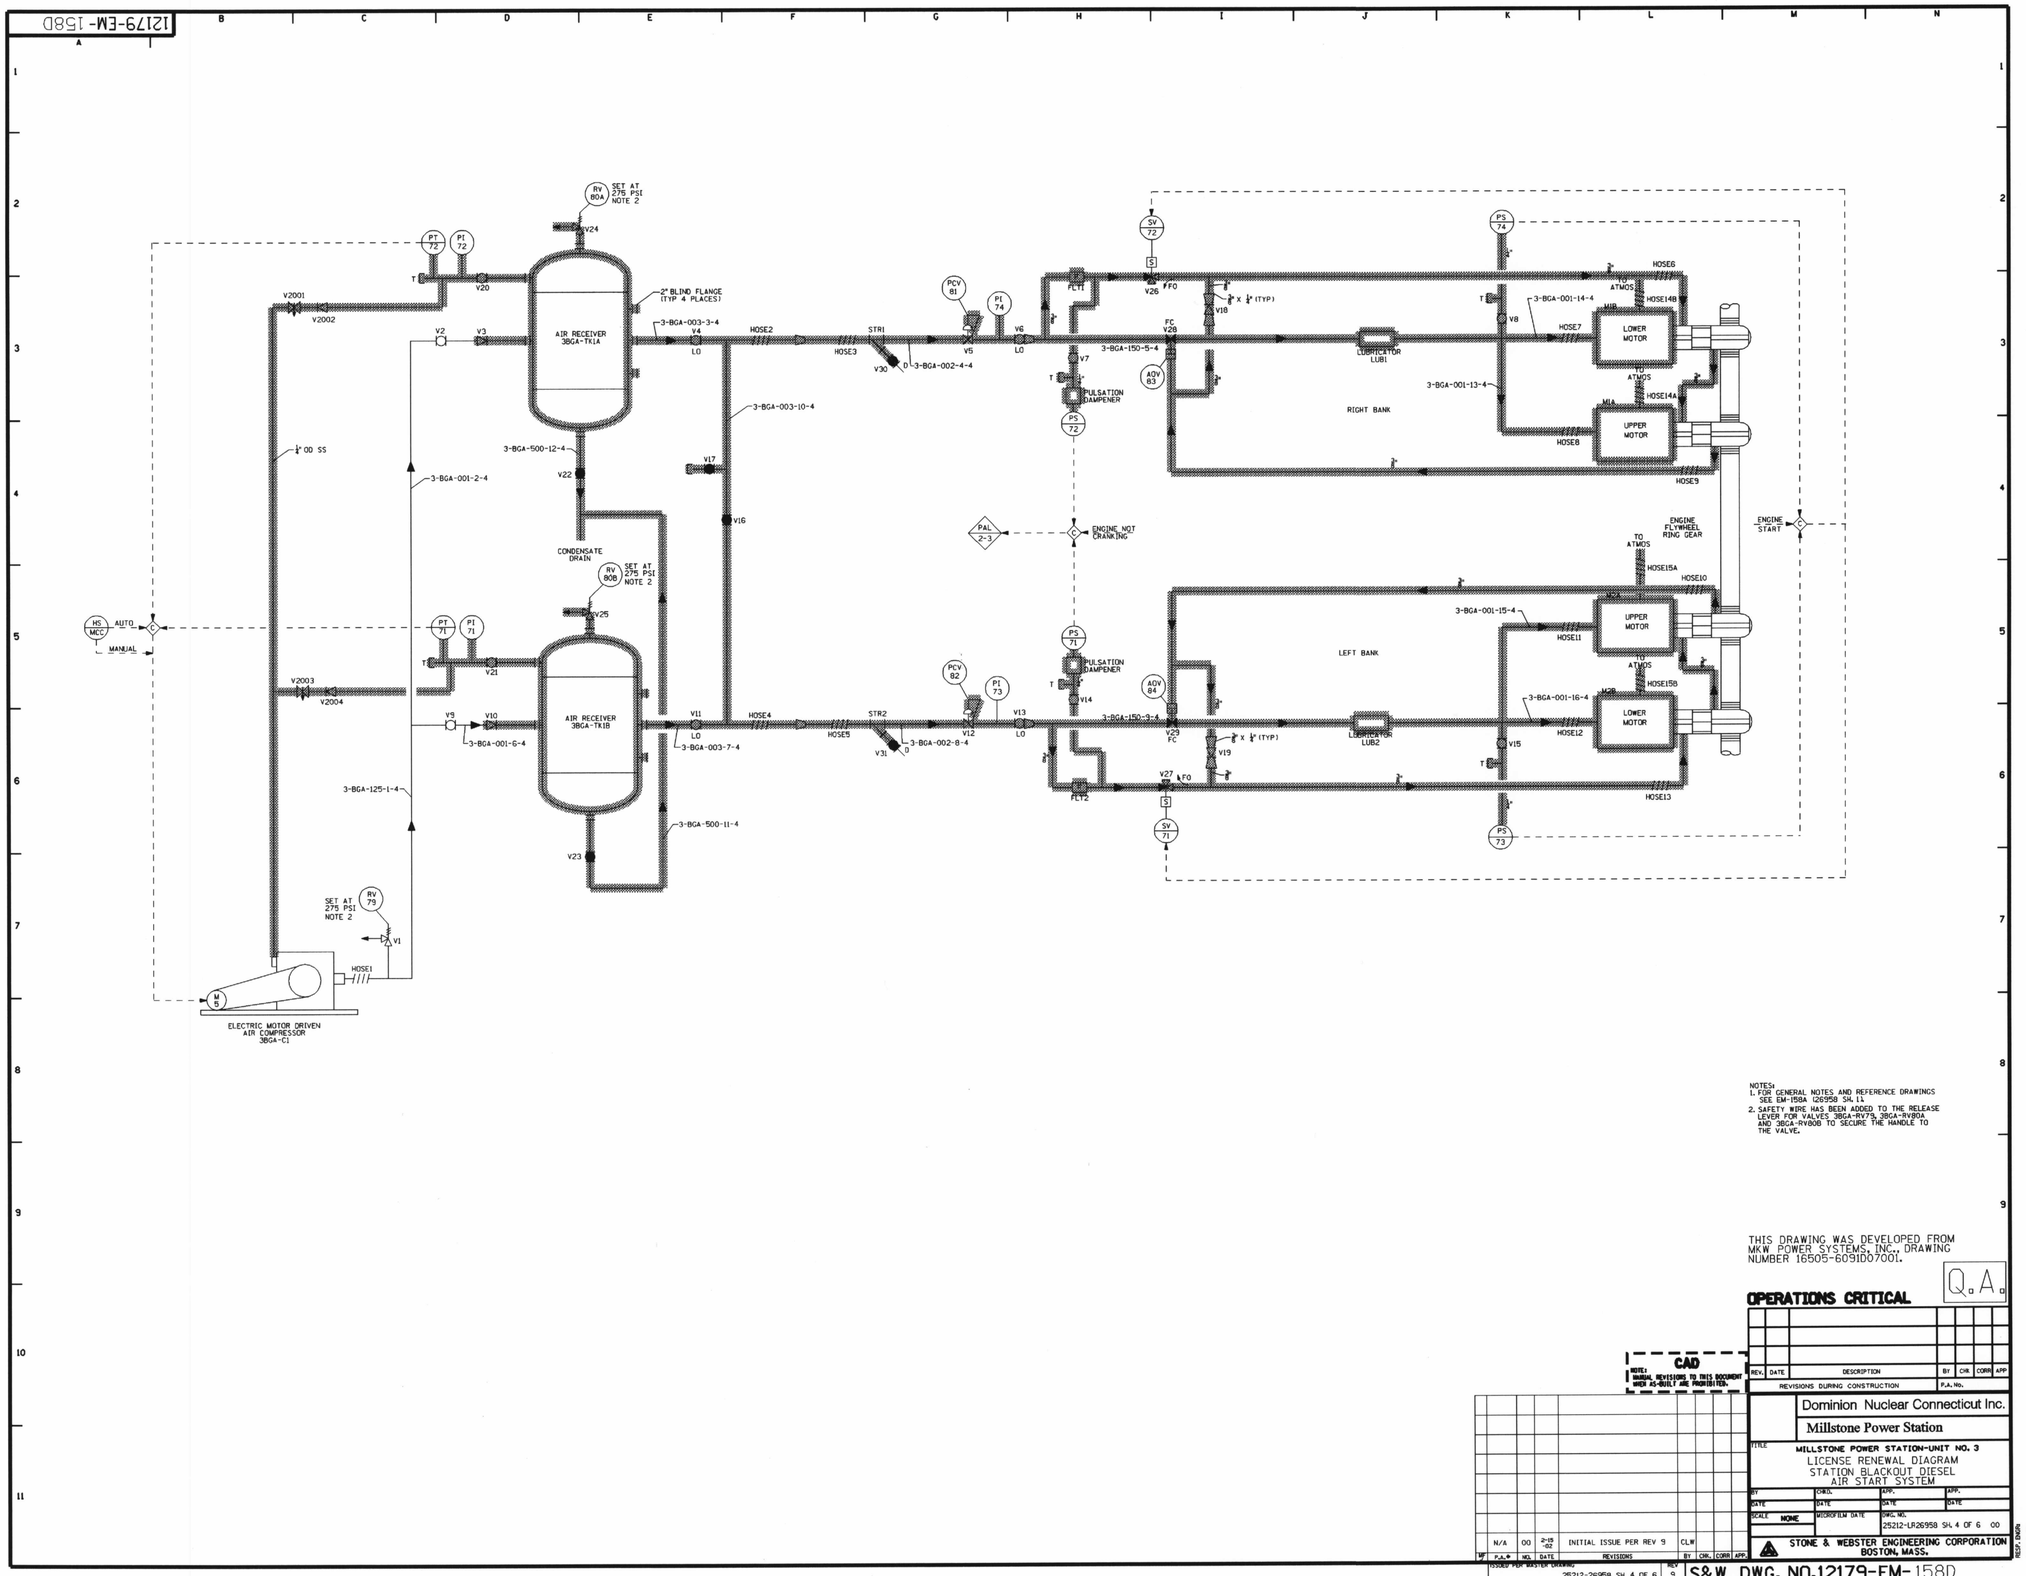

NOTES:
1. FOR GENERAL NOTES AND REFERENCE DRAWINGS SEE EM-158A (26958 SH. 1).
2. SAFETY WIRE HAS BEEN ADDED TO THE RELEASE LEVER FOR VALVES 3BGA-RV79, 3BGA-RV80A AND 3BGA-RV80B TO SECURE THE HANDLE TO THE VALVE.

THIS DRAWING WAS DEVELOPED FROM MKW POWER SYSTEMS, INC., DRAWING NUMBER 16505-6091D07001.

Q.A.

OPERATIONS CRITICAL

CAD
NOTE: MANUAL REVISIONS TO THIS DOCUMENT WHEN AS-BUILT ARE PROHIBITED.

REV.	DATE	DESCRIPTION	BY	CHK	CORR	APP
		REVISIONS DURING CONSTRUCTION	P.A. No.			

Dominion Nuclear Connecticut Inc.
Millstone Power Station

TITLE: MILLSTONE POWER STATION-UNIT NO. 3
LICENSE RENEWAL DIAGRAM
STATION BLACKOUT DIESEL
AIR START SYSTEM

BY	CHKD.	APP.	APP.
DATE	DATE	DATE	DATE
SCALE NONE	MICROFILM DATE	DWG. NO. 25212-LR26958 SH. 4 OF 6 00	

STONE & WEBSTER ENGINEERING CORPORATION
BOSTON, MASS.

MF	P.A.#	NO.	DATE	REVISIONS	BY	CHK.	CORR	APP.
	N/A	00	2-15-02	INITIAL ISSUE PER REV 9	CLW			

ISSUED PER MASTER DRAWING 25212-26958 SH. 4 OF 6 REV 9

S&W DWG. NO.12179-EM-158D

DRAWN BY: CHECKED BY:

RESP. ENGR: DESN. ENGR:

COMPONENTS SUBJECT TO AGING MANAGEMENT REVIEW
3346C STATION BLACKOUT DIESEL GENERATOR

NOTE: SOME SHADED LINES MAY CONTAIN COMPONENTS FROM MORE THAN ONE SYSTEM.

D-215

Submitted by AHLUWALIAC on Wednesday January 07 2004 at 10:58:49 AM EST