

2.0 SAFETY LIMITS (SLs)

2.1 SLs

2.1.1 Reactor Core SLs

In MODES 1 and 2, the combination of THERMAL POWER, Reactor Coolant System (RCS) highest cold leg temperature, and pressurizer pressure shall not exceed the SLs specified in Figure 2.1.1-1.

2.1.2 RCS Pressure SL

In MODES 1, 2, 3, 4, and 5, the RCS pressure shall be maintained \leq 2735 psig.


2.2 SL Violations

2.2.1 If SL 2.1.1 is violated, restore compliance and be in MODE 3 within 1 hour.

2.2.2 If SL 2.1.2 is violated:

2.2.2.1 In MODE 1 or 2, restore compliance and be in MODE 3 within 1 hour.

2.2.2.2 In MODE 3, 4, or 5, restore compliance within 5 minutes.

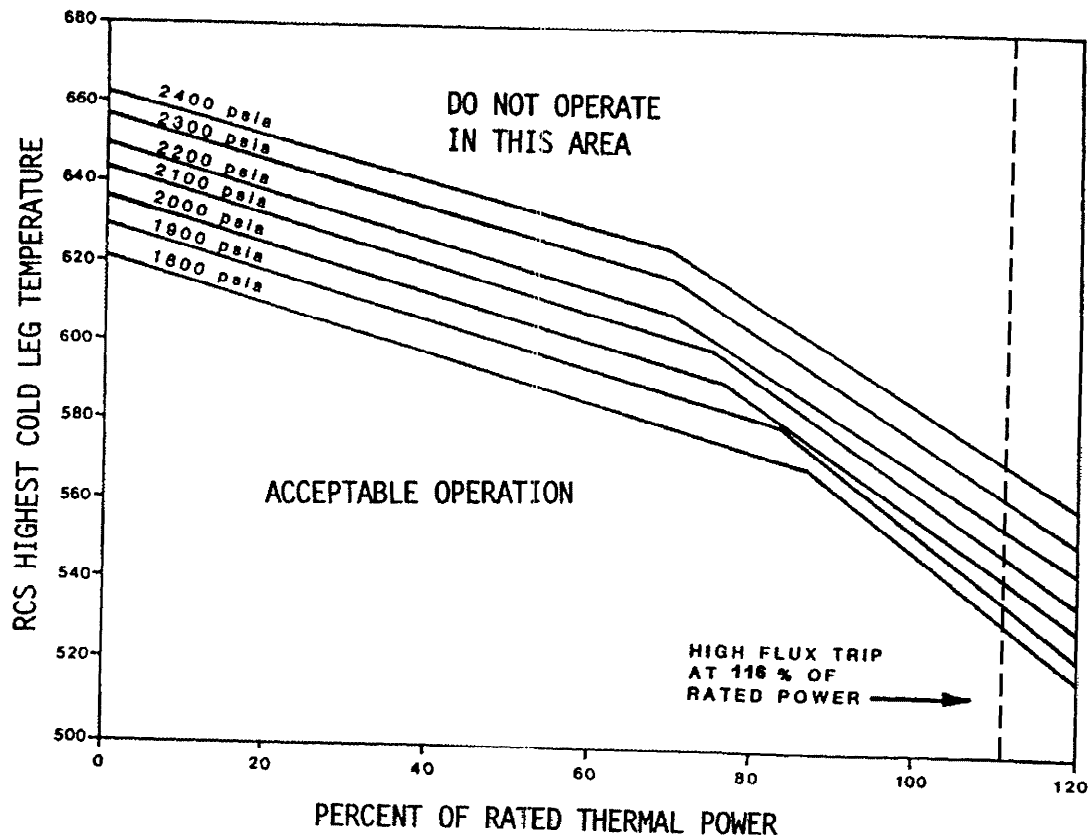

NOTE: BASED ON A MINIMUM RCS FLOW OF 97.3×10^6 lbm/hr

Figure 2.1.1-1 (page 1 of 1)
Reactor Core Safety Limits