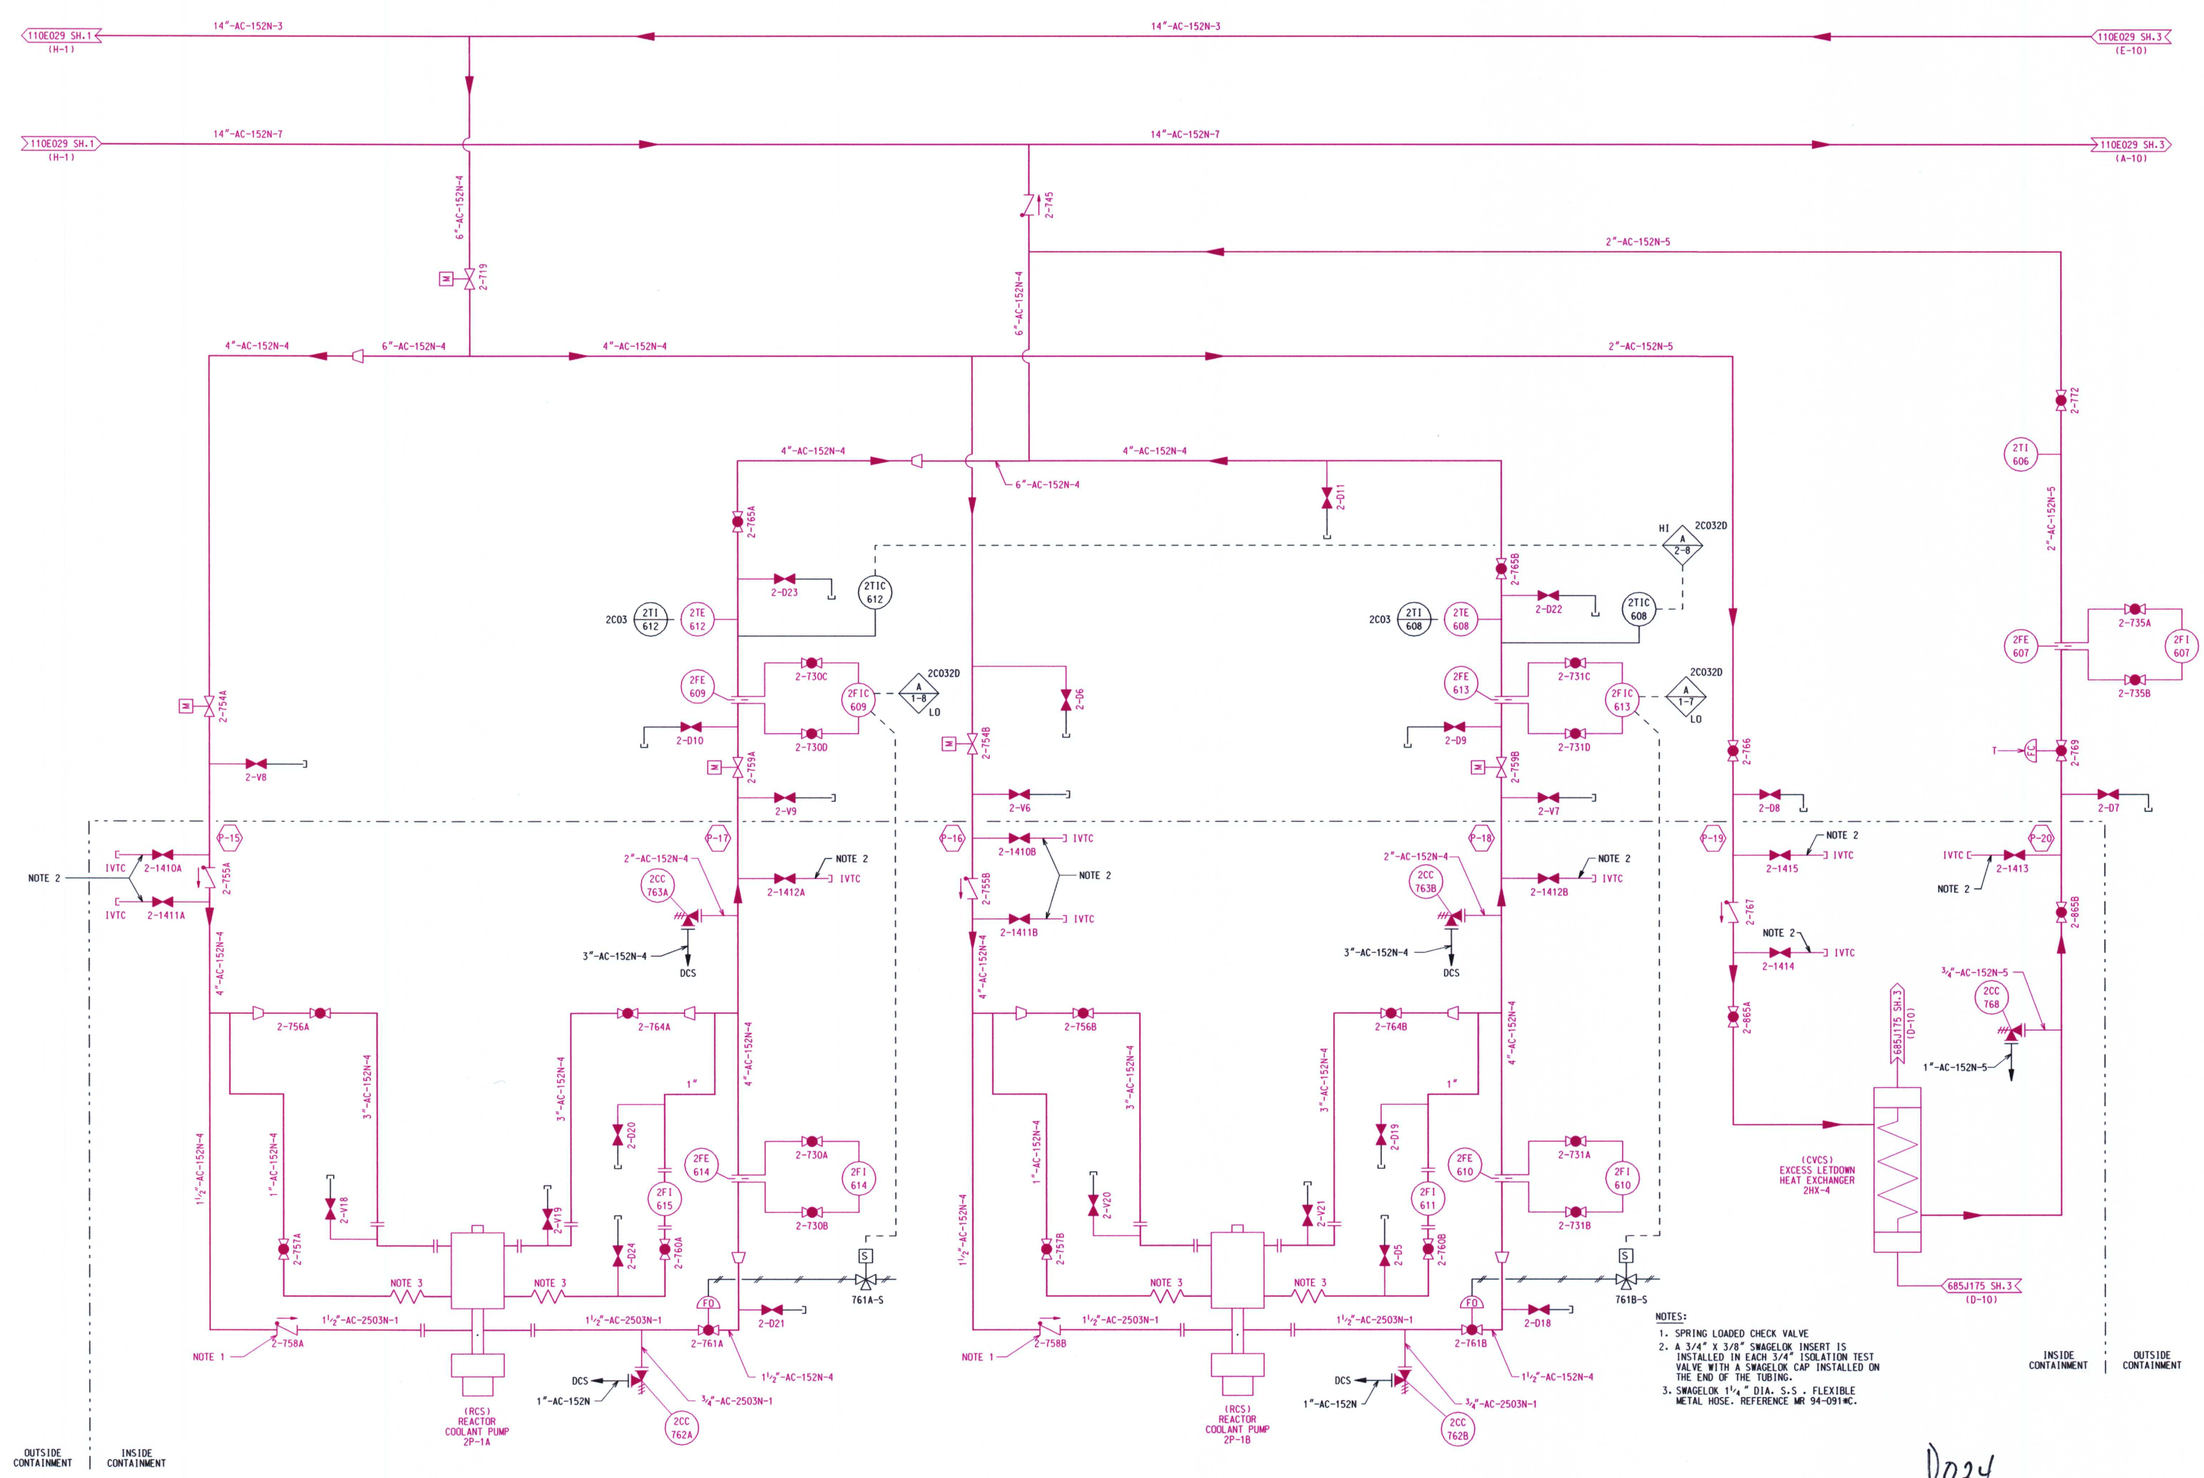

NOTES:

1. SPRING LOADED CHECK VALVE
2. A 3/4" X 3/8" SWAGELOK INSERT IS INSTALLED IN EACH 3/4" ISOLATION TEST VALVE WITH A SWAGELOK CAP INSTALLED ON THE END OF THE TUBING.
3. SWAGELOK 1¼" DIA. S.S. FLEXIBLE METAL HOSE. REFERENCE MR 94-091#C.

D024

LEGEND

MAGENTA - IN SCOPE LR

BLACK - NOT IN SCOPE LR

LR-110E029 SH-2
UNIT 2
AUXILIARY COOLANT SYSTEM

REV. 1 DATE:10-17-03