NOTES:

1. ALL TUBING IS 3/8" O.D. EXCEPT AS DETAILED
2. ALL VALVES INSTALLED WITH FLOW UNDER SEAT EXCEPT VALVE NUMBERS 962A, 962B, 962C, 968, 969A, 970, 978 AND 980.
3. 3/4" NOMINAL PIPE O.D. X 3/8" TUBING INSERT.
4. INLET TO ALL SAMPLE VESSELS IS AT THE BOTTOM CONNECTION.
5. 2-F1903 MAXIMUM PRESSURE RATING 3000 P.S.I.G.
6. TWO SHIELDED SAMPLE BOMBS OF DIFFERENT VOLUMES ARE SHARED BETWEEN UNITS 1 & 2. SINCE BOTH ARE PORTABLE, THEY MAY NOT BE INSTALLED - THEREFORE ASSOCIATED ISOLATION VALVES (*) ARE SHOWN BUT NOT NUMBERED. BOMBS REQUIRE SWAGELOK INLET/OUTLET CONNECTIONS.
7. FI ASSEMBLY CAN BE USED ON EITHER UNIT.
8. UNLESS OTHERWISE NOTED, ALL VALVE NUMBERS ARE PRECEEDED BY 'SC'.

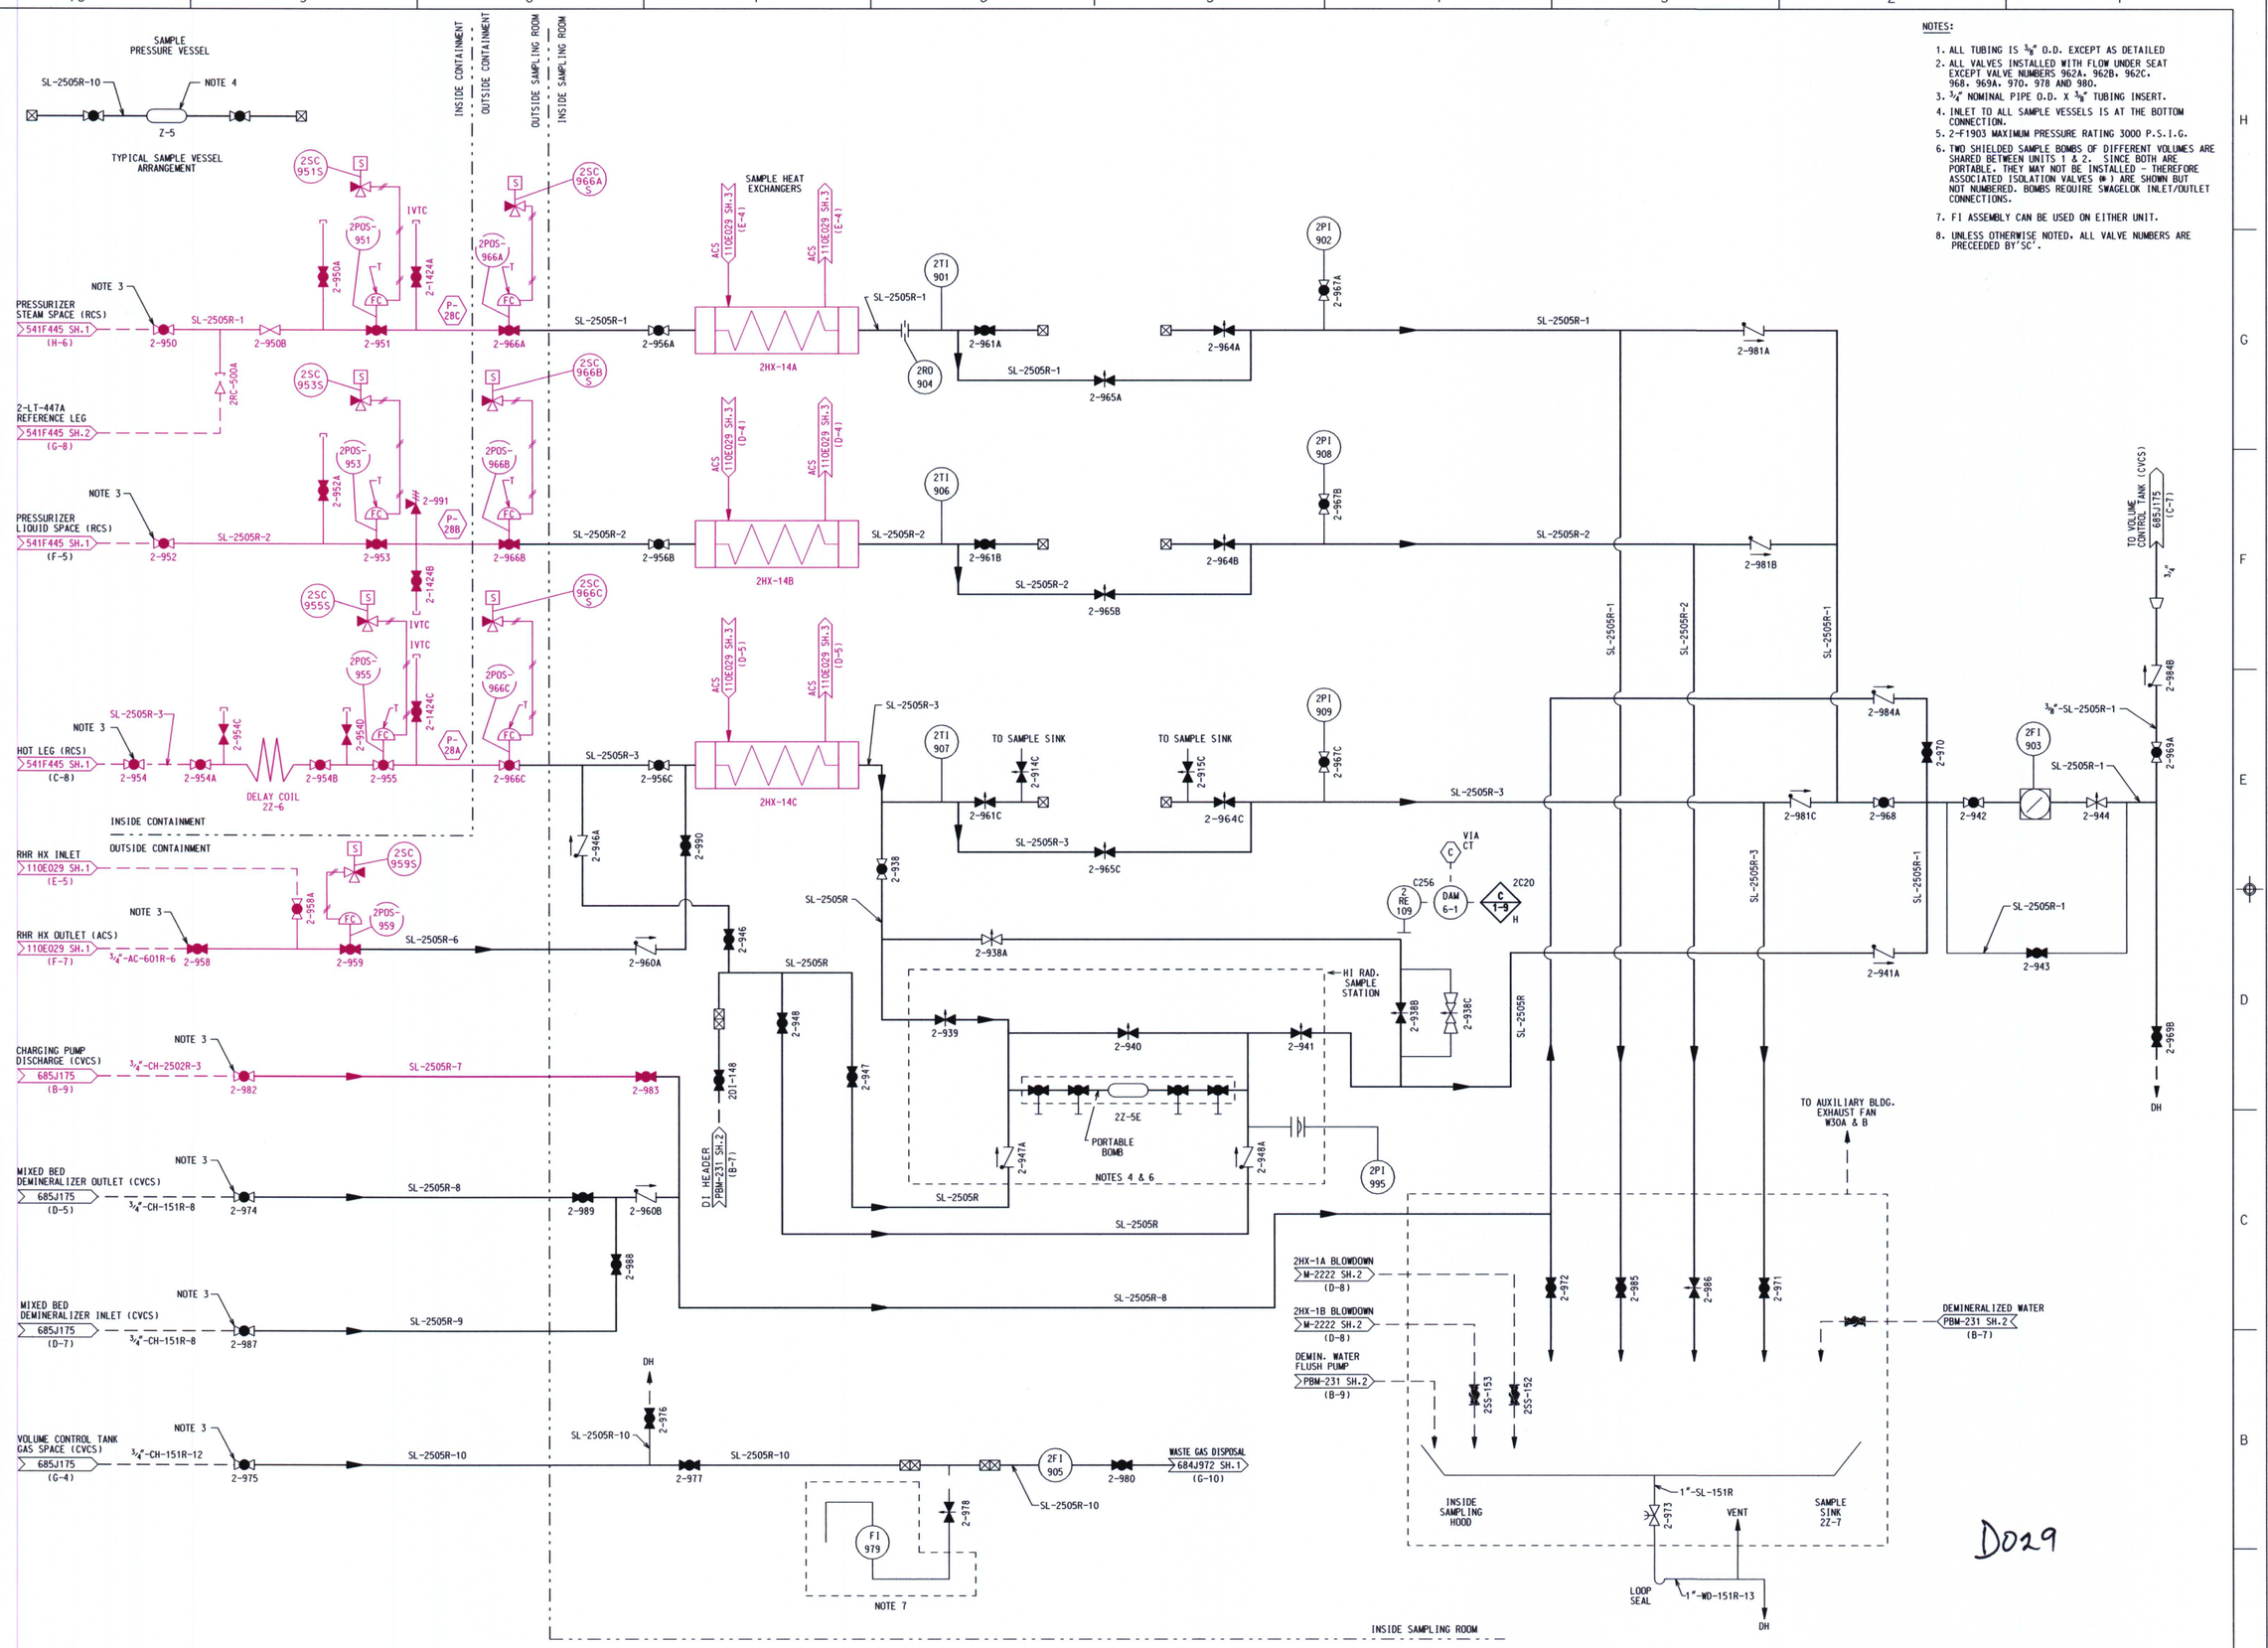

D029

LEGEND

MAGENTA - IN SCOPE LR

BLACK - NOT IN SCOPE LR

LR-541F448
UNIT 2
PRIMARY SAMPLE SYSTEM
REV. 1 DATE:10-17-03