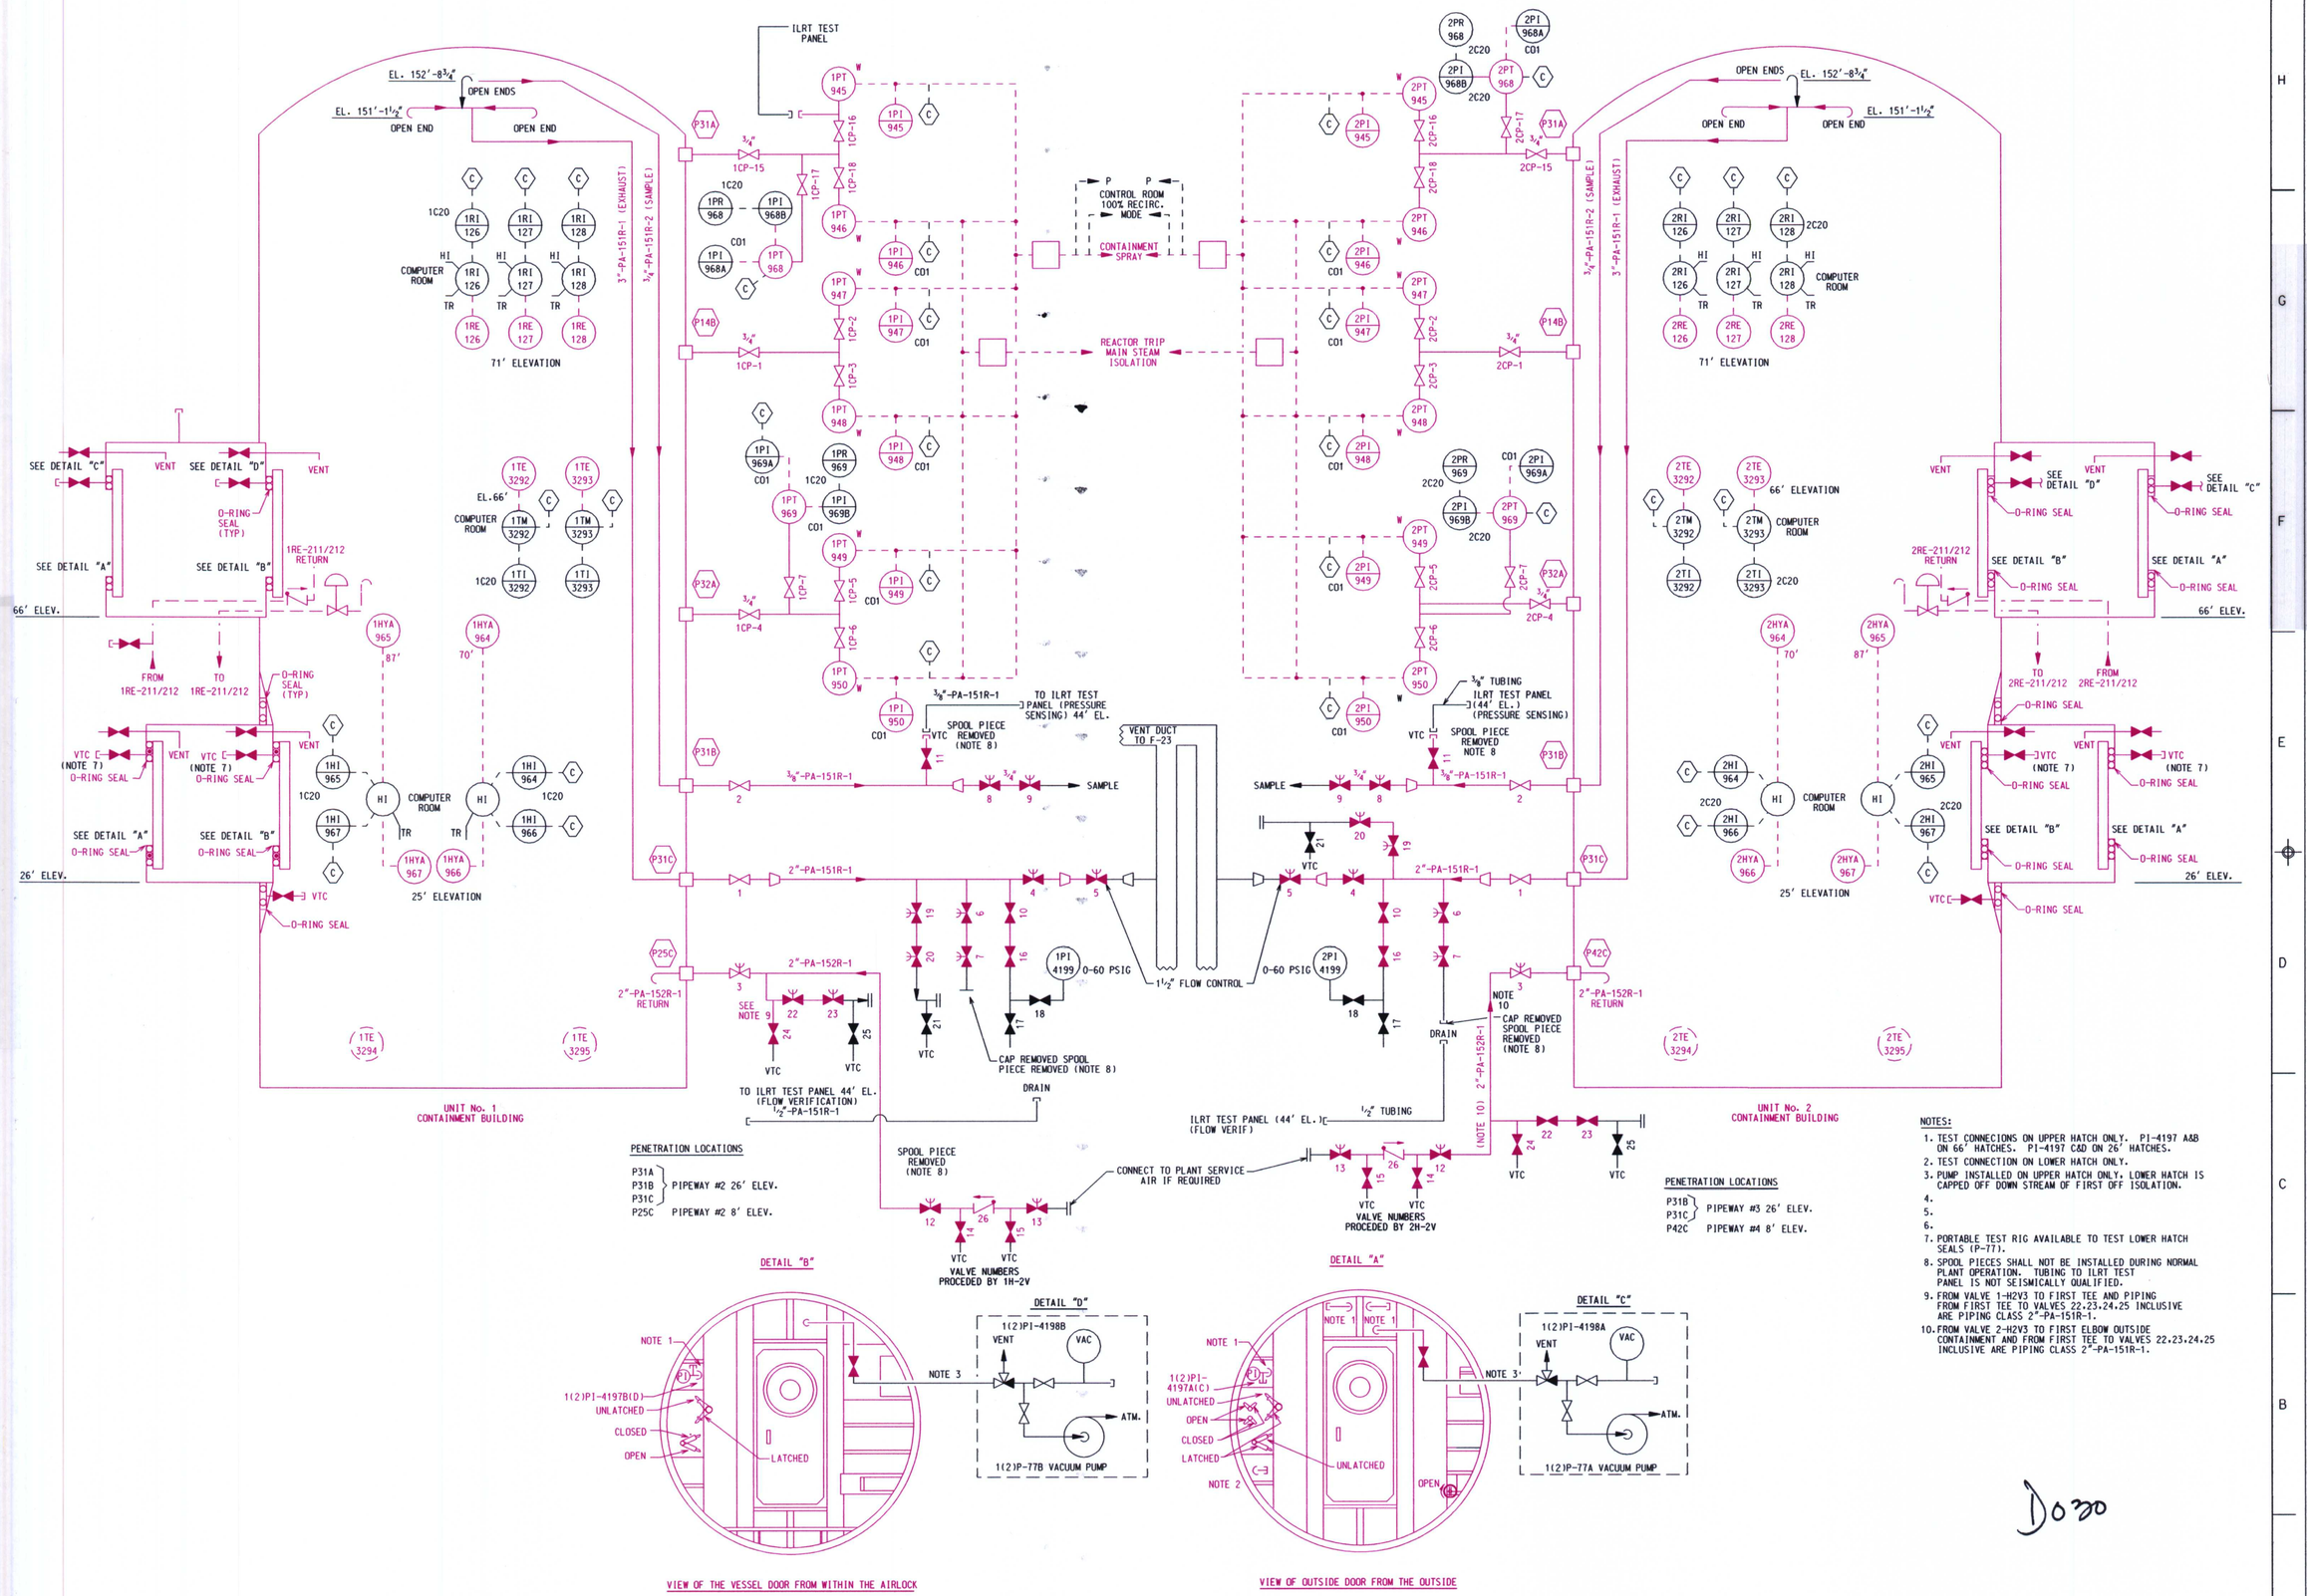

NOTES:

1. TEST CONNECIONS ON UPPER HATCH ONLY. P1-4197 A&B ON 66' HATCHES. P1-4197 C&D ON 26' HATCHES.
2. TEST CONNECTION ON LOWER HATCH ONLY.
3. PUMP INSTALLED ON UPPER HATCH ONLY. LOWER HATCH IS CAPPED OFF DOWN STREAM OF FIRST OFF ISOLATION.
4.
5.
6.
7. PORTABLE TEST RIG AVAILABLE TO TEST LOWER HATCH SEALS (P-77).
8. SPOOL PIECES SHALL NOT BE INSTALLED DURING NORMAL PLANT OPERATION. TUBING TO ILRT TEST PANEL IS NOT SEISMICALLY QUALIFIED.
9. FROM VALVE 1-H2V3 TO FIRST TEE AND PIPING FROM FIRST TEE TO VALVES 22.23.24.25 INCLUSIVE ARE PIPING CLASS 2"-PA-151R-1.
10. FROM VALVE 2-H2V3 TO FIRST ELBOW OUTSIDE CONTAINMENT AND FROM FIRST TEE TO VALVES 22.23.24.25 INCLUSIVE ARE PIPING CLASS 2"-PA-151R-1.

D030

LEGEND

MAGENTA - IN SCOPE LR

BLACK - NOT IN SCOPE LR

LR-M-224

UNIT 1

POST-ACCIDENT CONTAINMENT VENT SYSTEM

REV. 1 DATE: 10-17-03