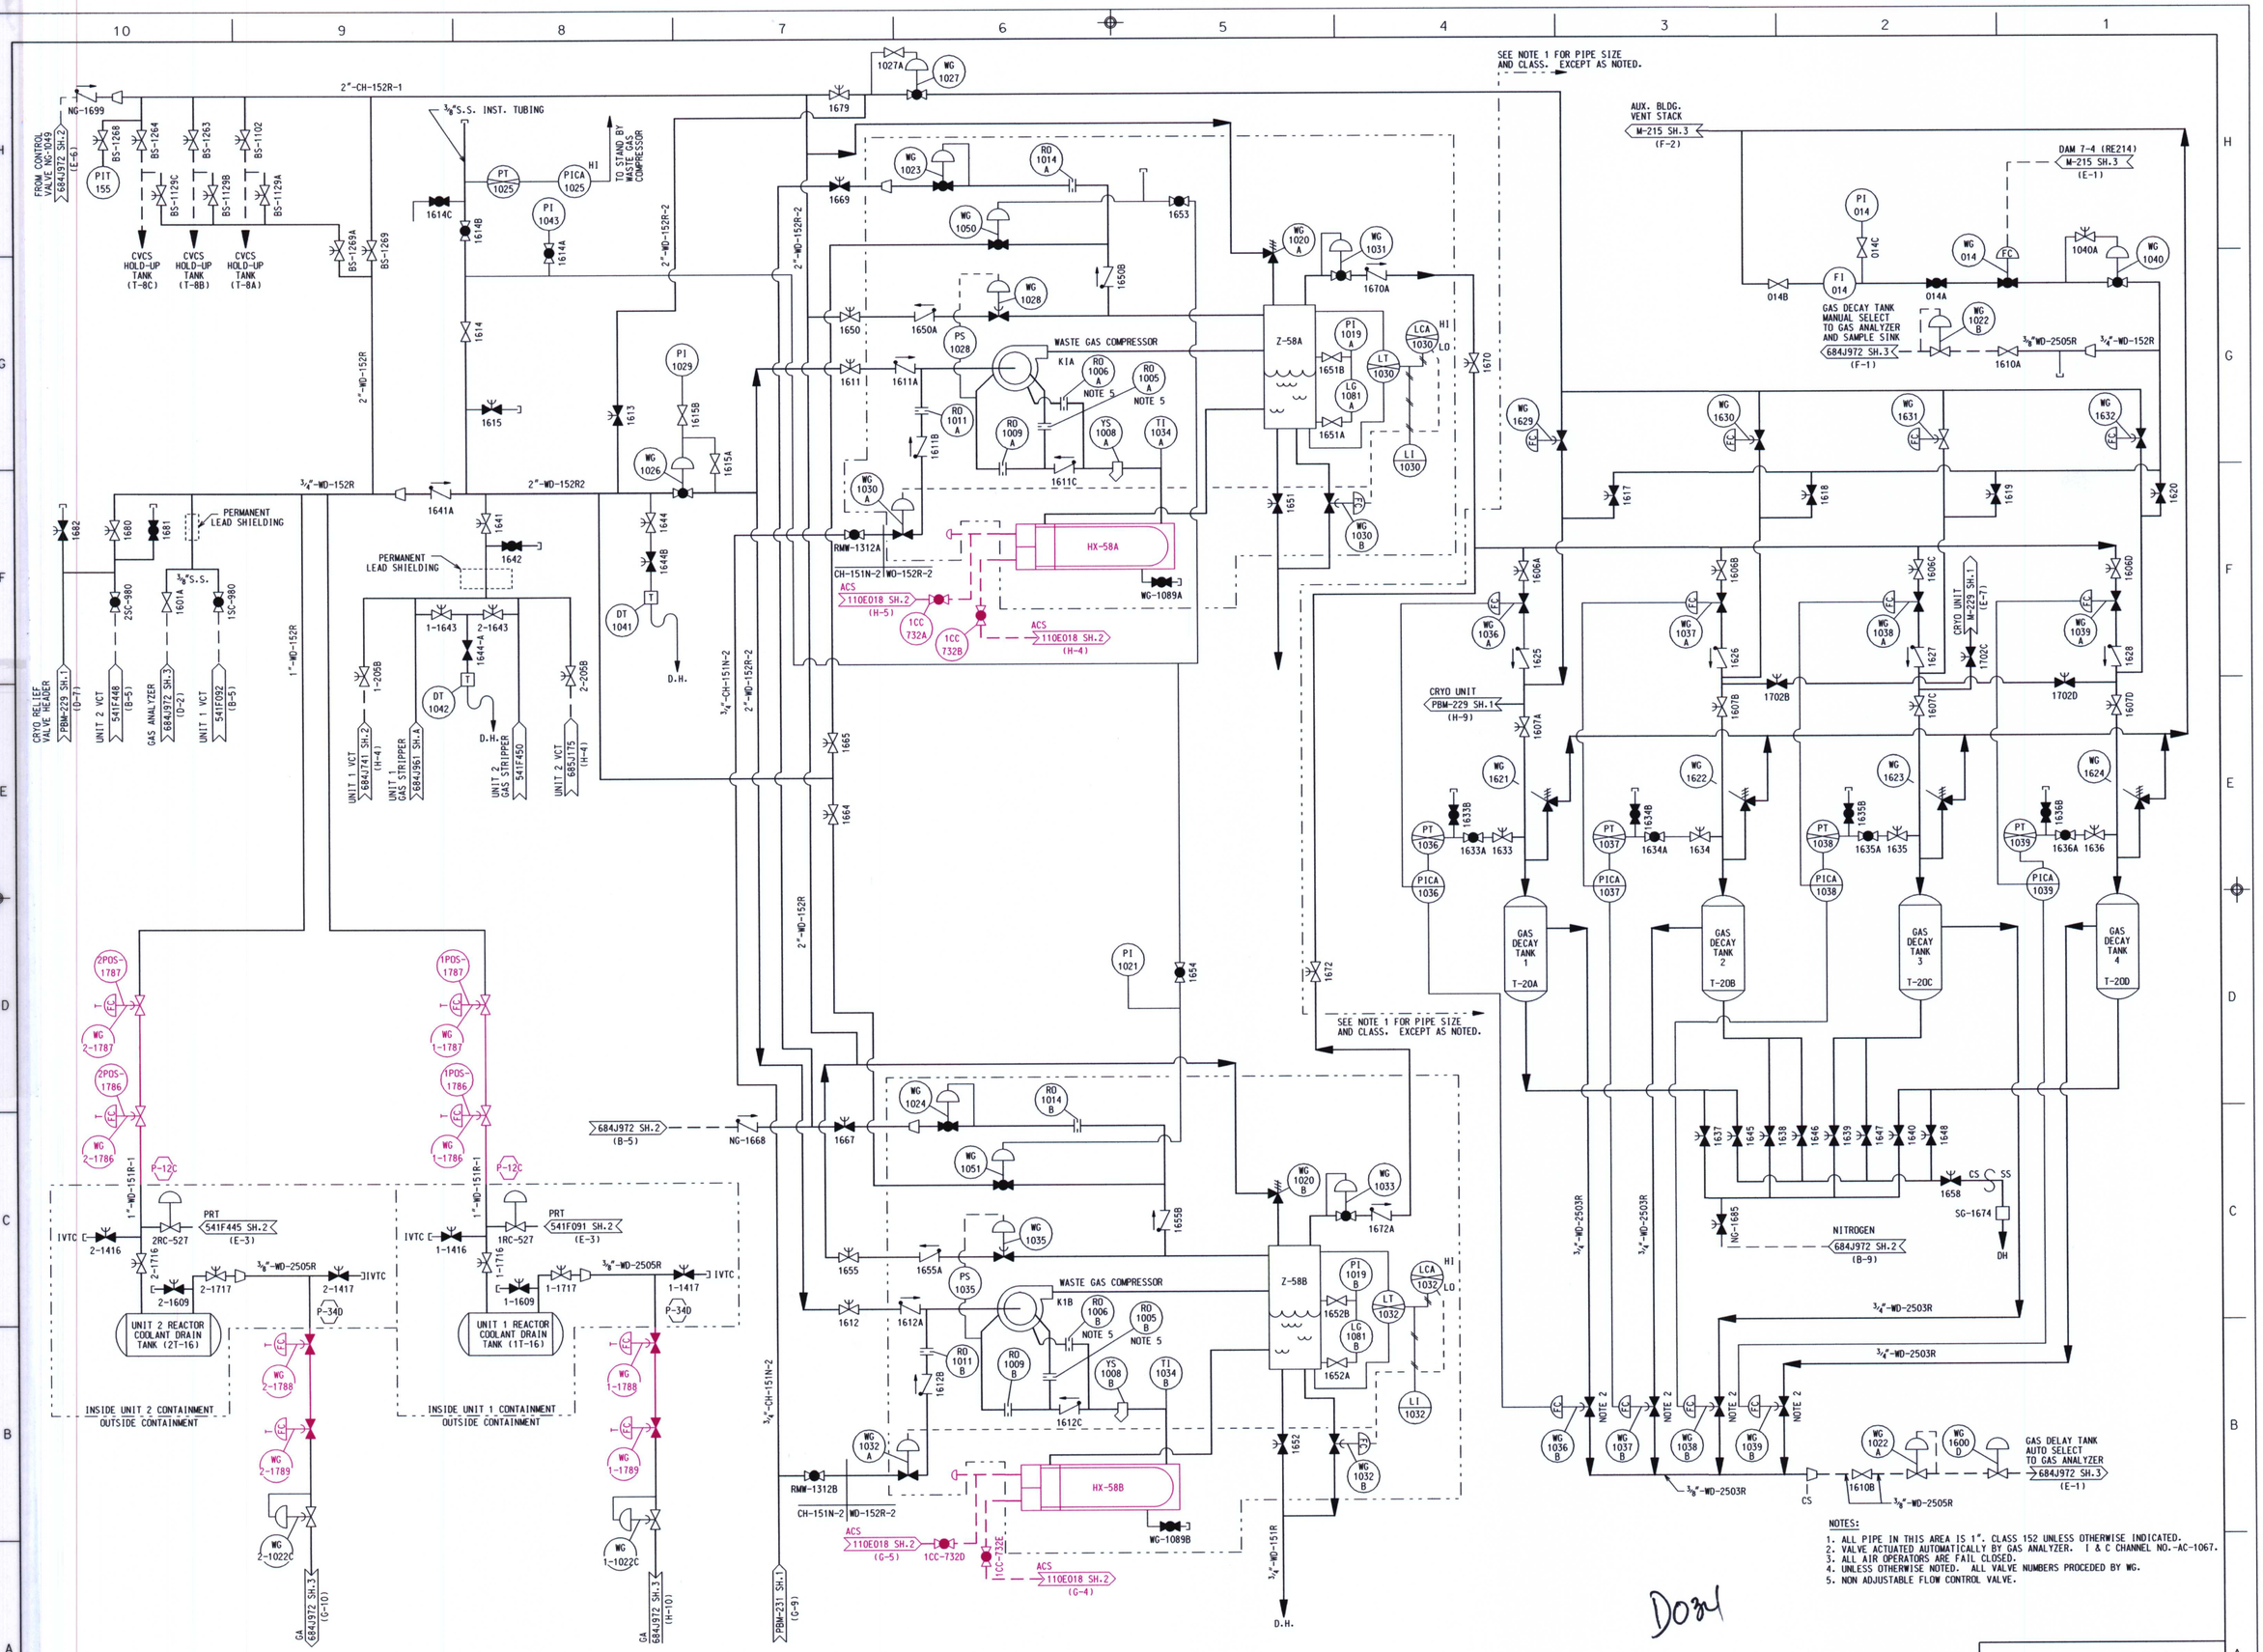

NOTES:

1. ALL PIPE IN THIS AREA IS 1". CLASS 152 UNLESS OTHERWISE INDICATED.
2. VALVE ACTUATED AUTOMATICALLY BY GAS ANALYZER. I & C CHANNEL NO.-AC-1067.
3. ALL AIR OPERATORS ARE FAIL CLOSED.
4. UNLESS OTHERWISE NOTED. ALL VALVE NUMBERS PROCEDED BY WG.
5. NON ADJUSTABLE FLOW CONTROL VALVE.

LEGEND

MAGENTA - IN SCOPE LR

BLACK - NOT IN SCOPE LR

LR-684J972 SH-1

UNIT 1 & 2

WASTE GAS DISPOSAL SYSTEM

REV. 1 DATE:10-17-03