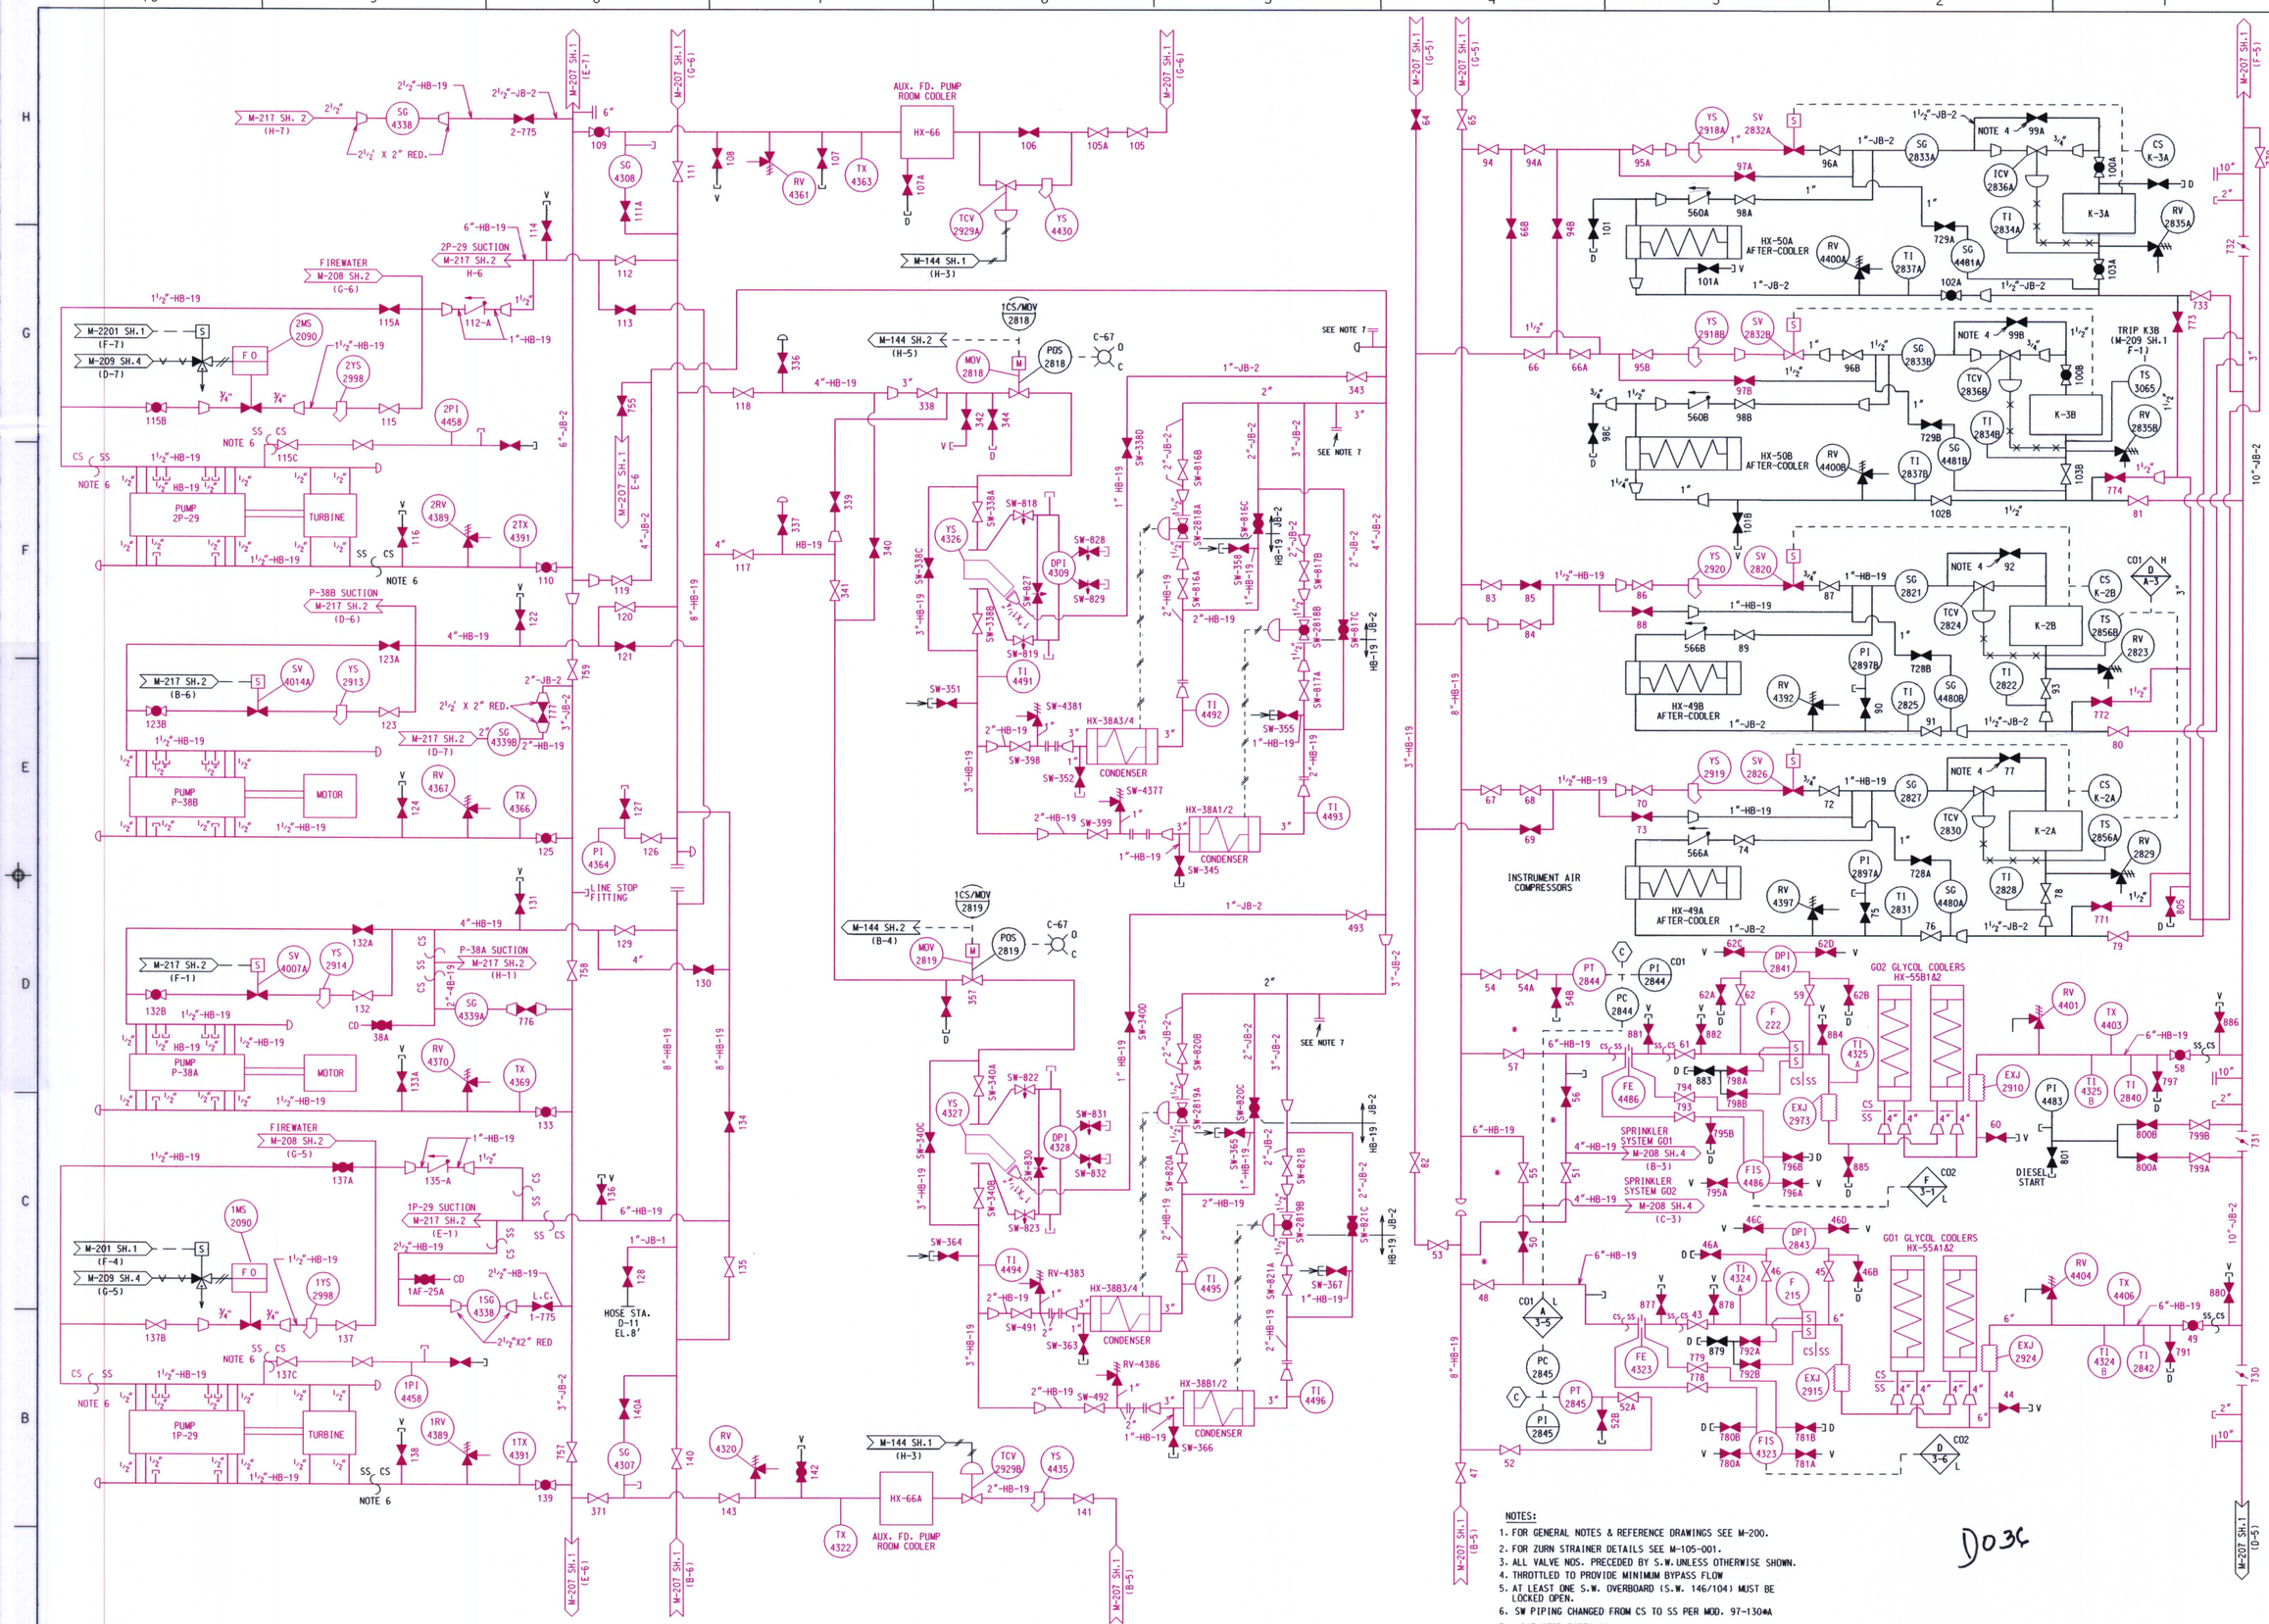

NOTES:

1. FOR GENERAL NOTES & REFERENCE DRAWINGS SEE M-200.
2. FOR ZURN STRAINER DETAILS SEE M-105-001.
3. ALL VALVE NOS. PRECEDED BY S.W. UNLESS OTHERWISE SHOWN.
4. THROTTLED TO PROVIDE MINIMUM BYPASS FLOW
5. AT LEAST ONE S.W. OVERBOARD (S.W. 146/104) MUST BE LOCKED OPEN.
6. SW PIPING CHANGED FROM CS TO SS PER MOD. 97-130#A
7. LINE STOP FITTINGS.

LEGEND

MAGENTA - IN SCOPE LR

BLACK - NOT IN SCOPE LR

LR-M-207 SH-1A
UNIT 1
SERVICE WATER

REV. 1 DATE:10-17-03