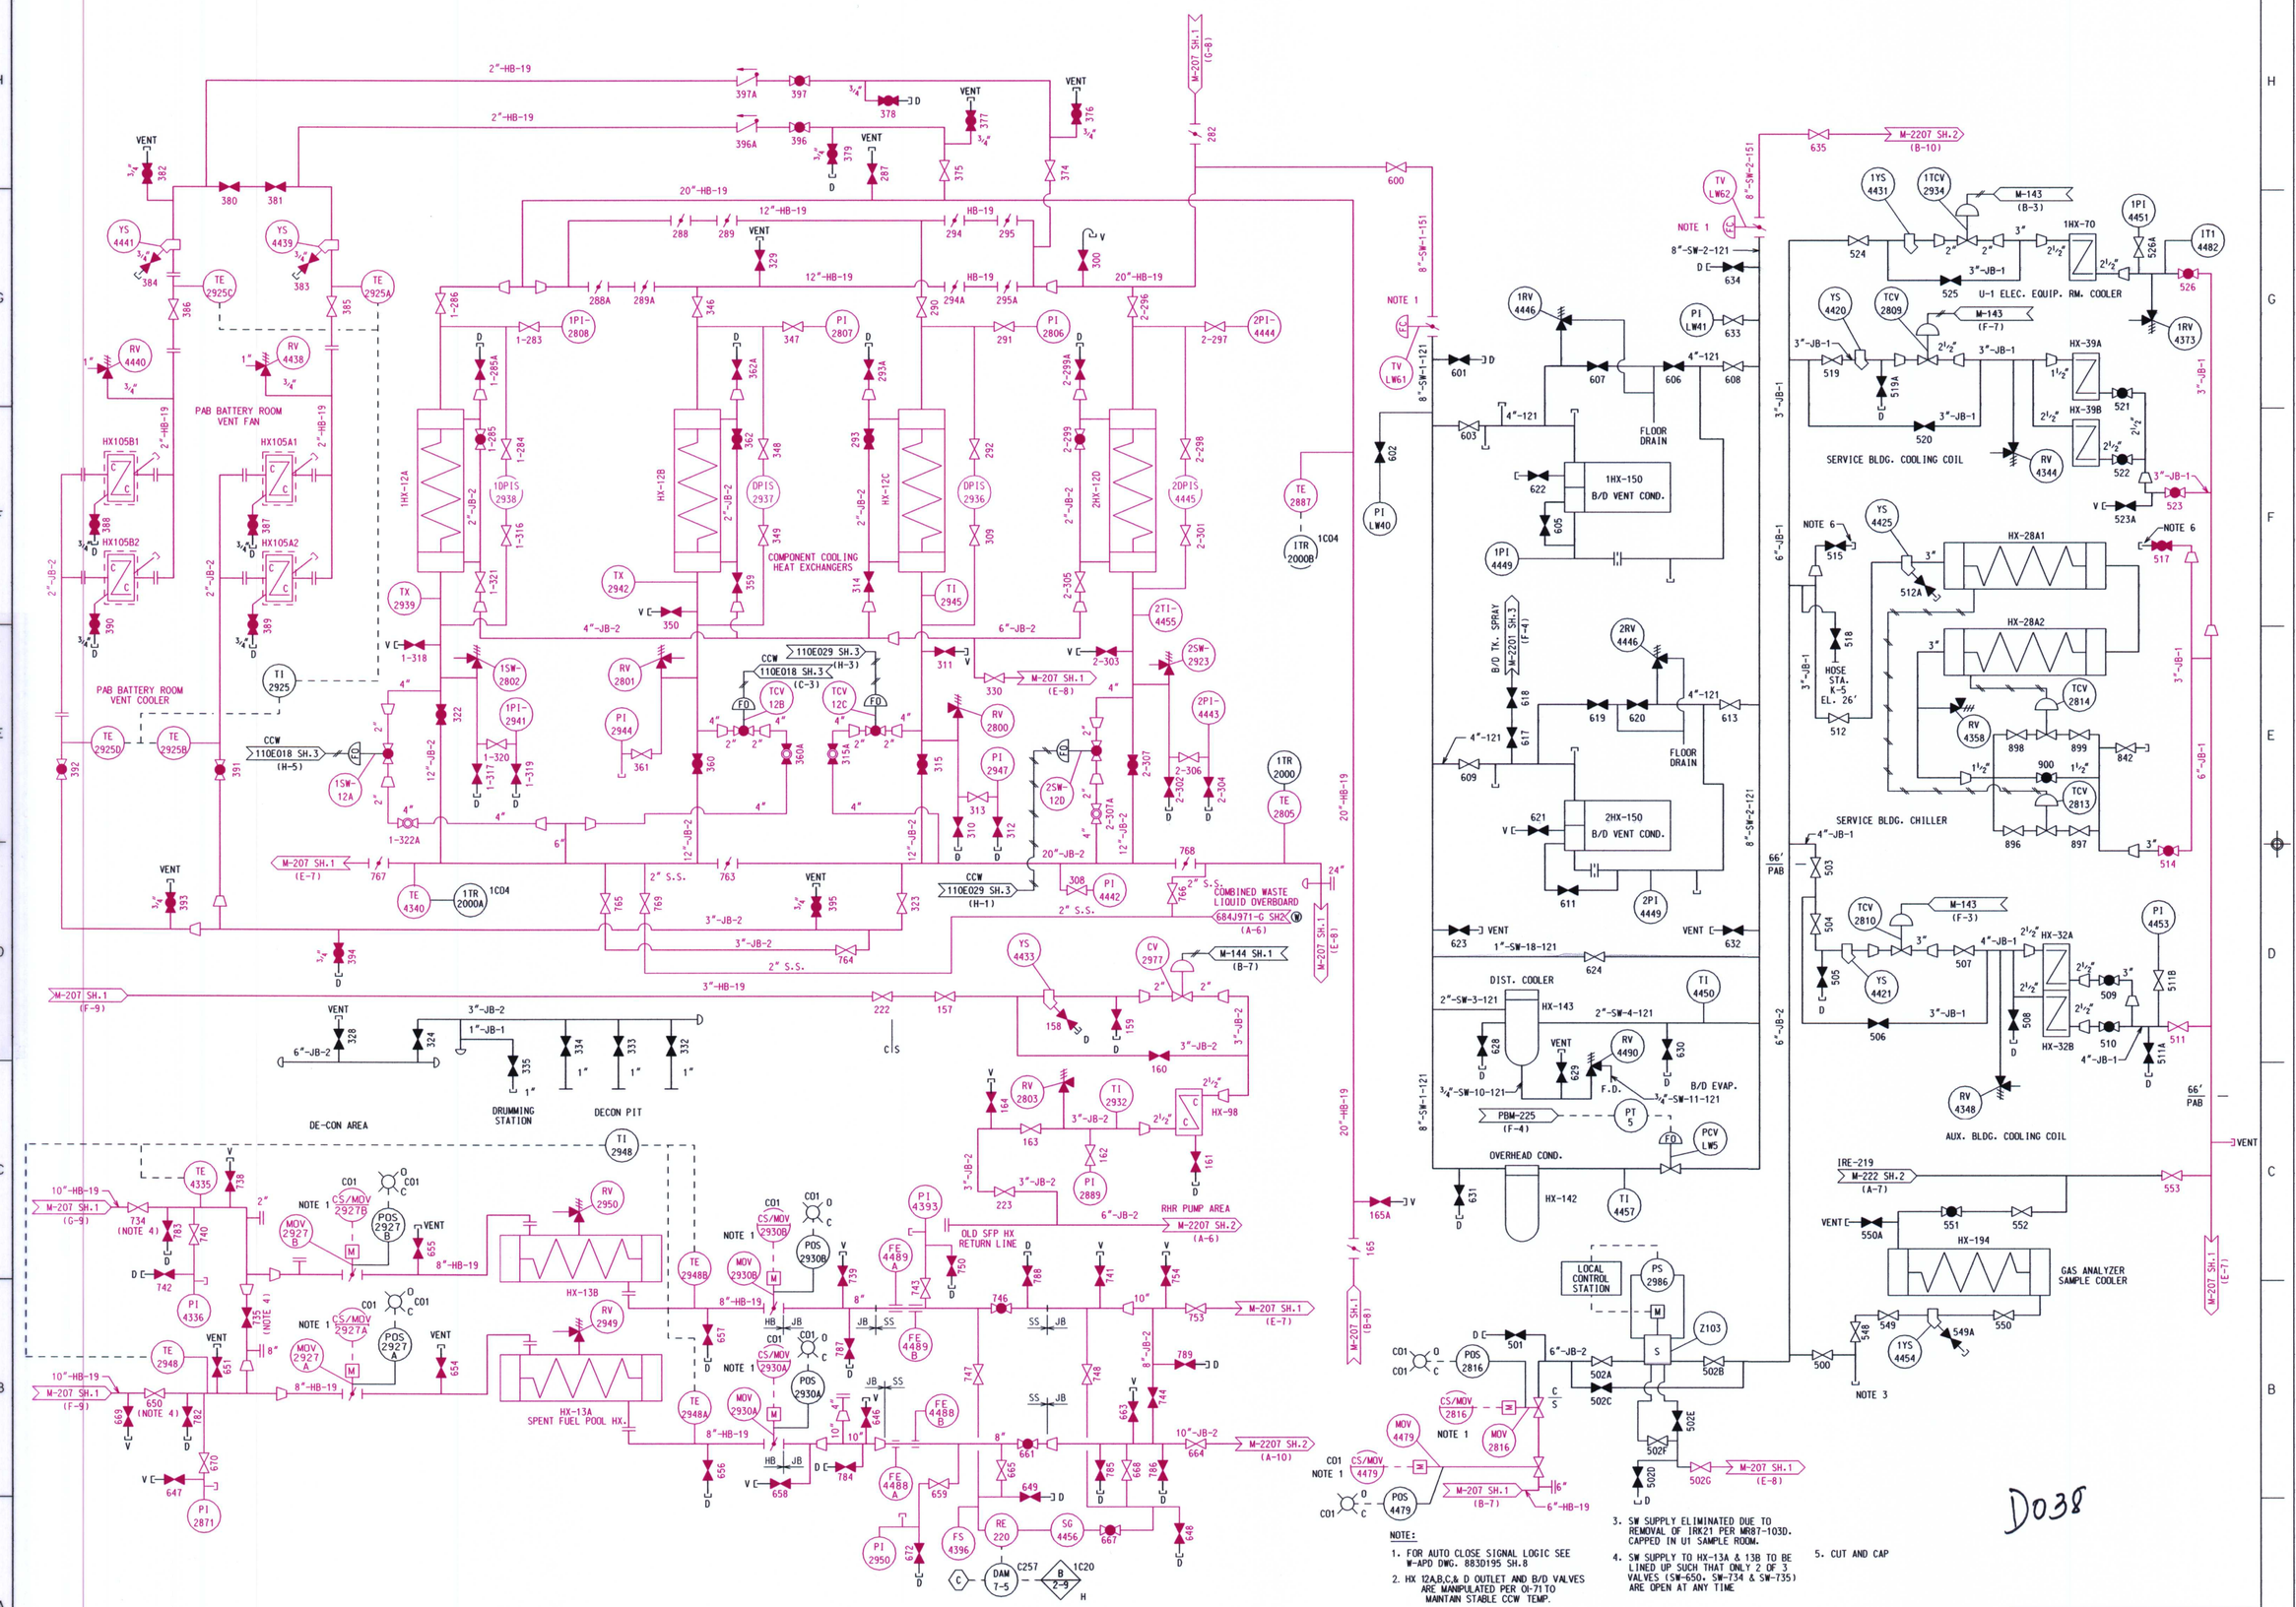

NOTE:

1. FOR AUTO CLOSE SIGNAL LOGIC SEE W-APD DWG. 883D195 SH.8
2. HX 12A,B,C,& D OUTLET AND B/D VALVES ARE MANIPULATED PER OI-71 TO MAINTAIN STABLE CCW TEMP.
3. SW SUPPLY ELIMINATED DUE TO REMOVAL OF IRK21 PER MR87-103D. CAPPED IN U1 SAMPLE ROOM.
4. SW SUPPLY TO HX-13A & 13B TO BE LINED UP SUCH THAT ONLY 2 OF 3 VALVES (SW-650, SW-734 & SW-735) ARE OPEN AT ANY TIME
5. CUT AND CAP

LEGEND

MAGENTA - IN SCOPE LR
BLACK - NOT IN SCOPE LR

D038

LR-M-207 SH-3
UNIT 1
SERVICE WATER

REV. 1 DATE:10-17-03