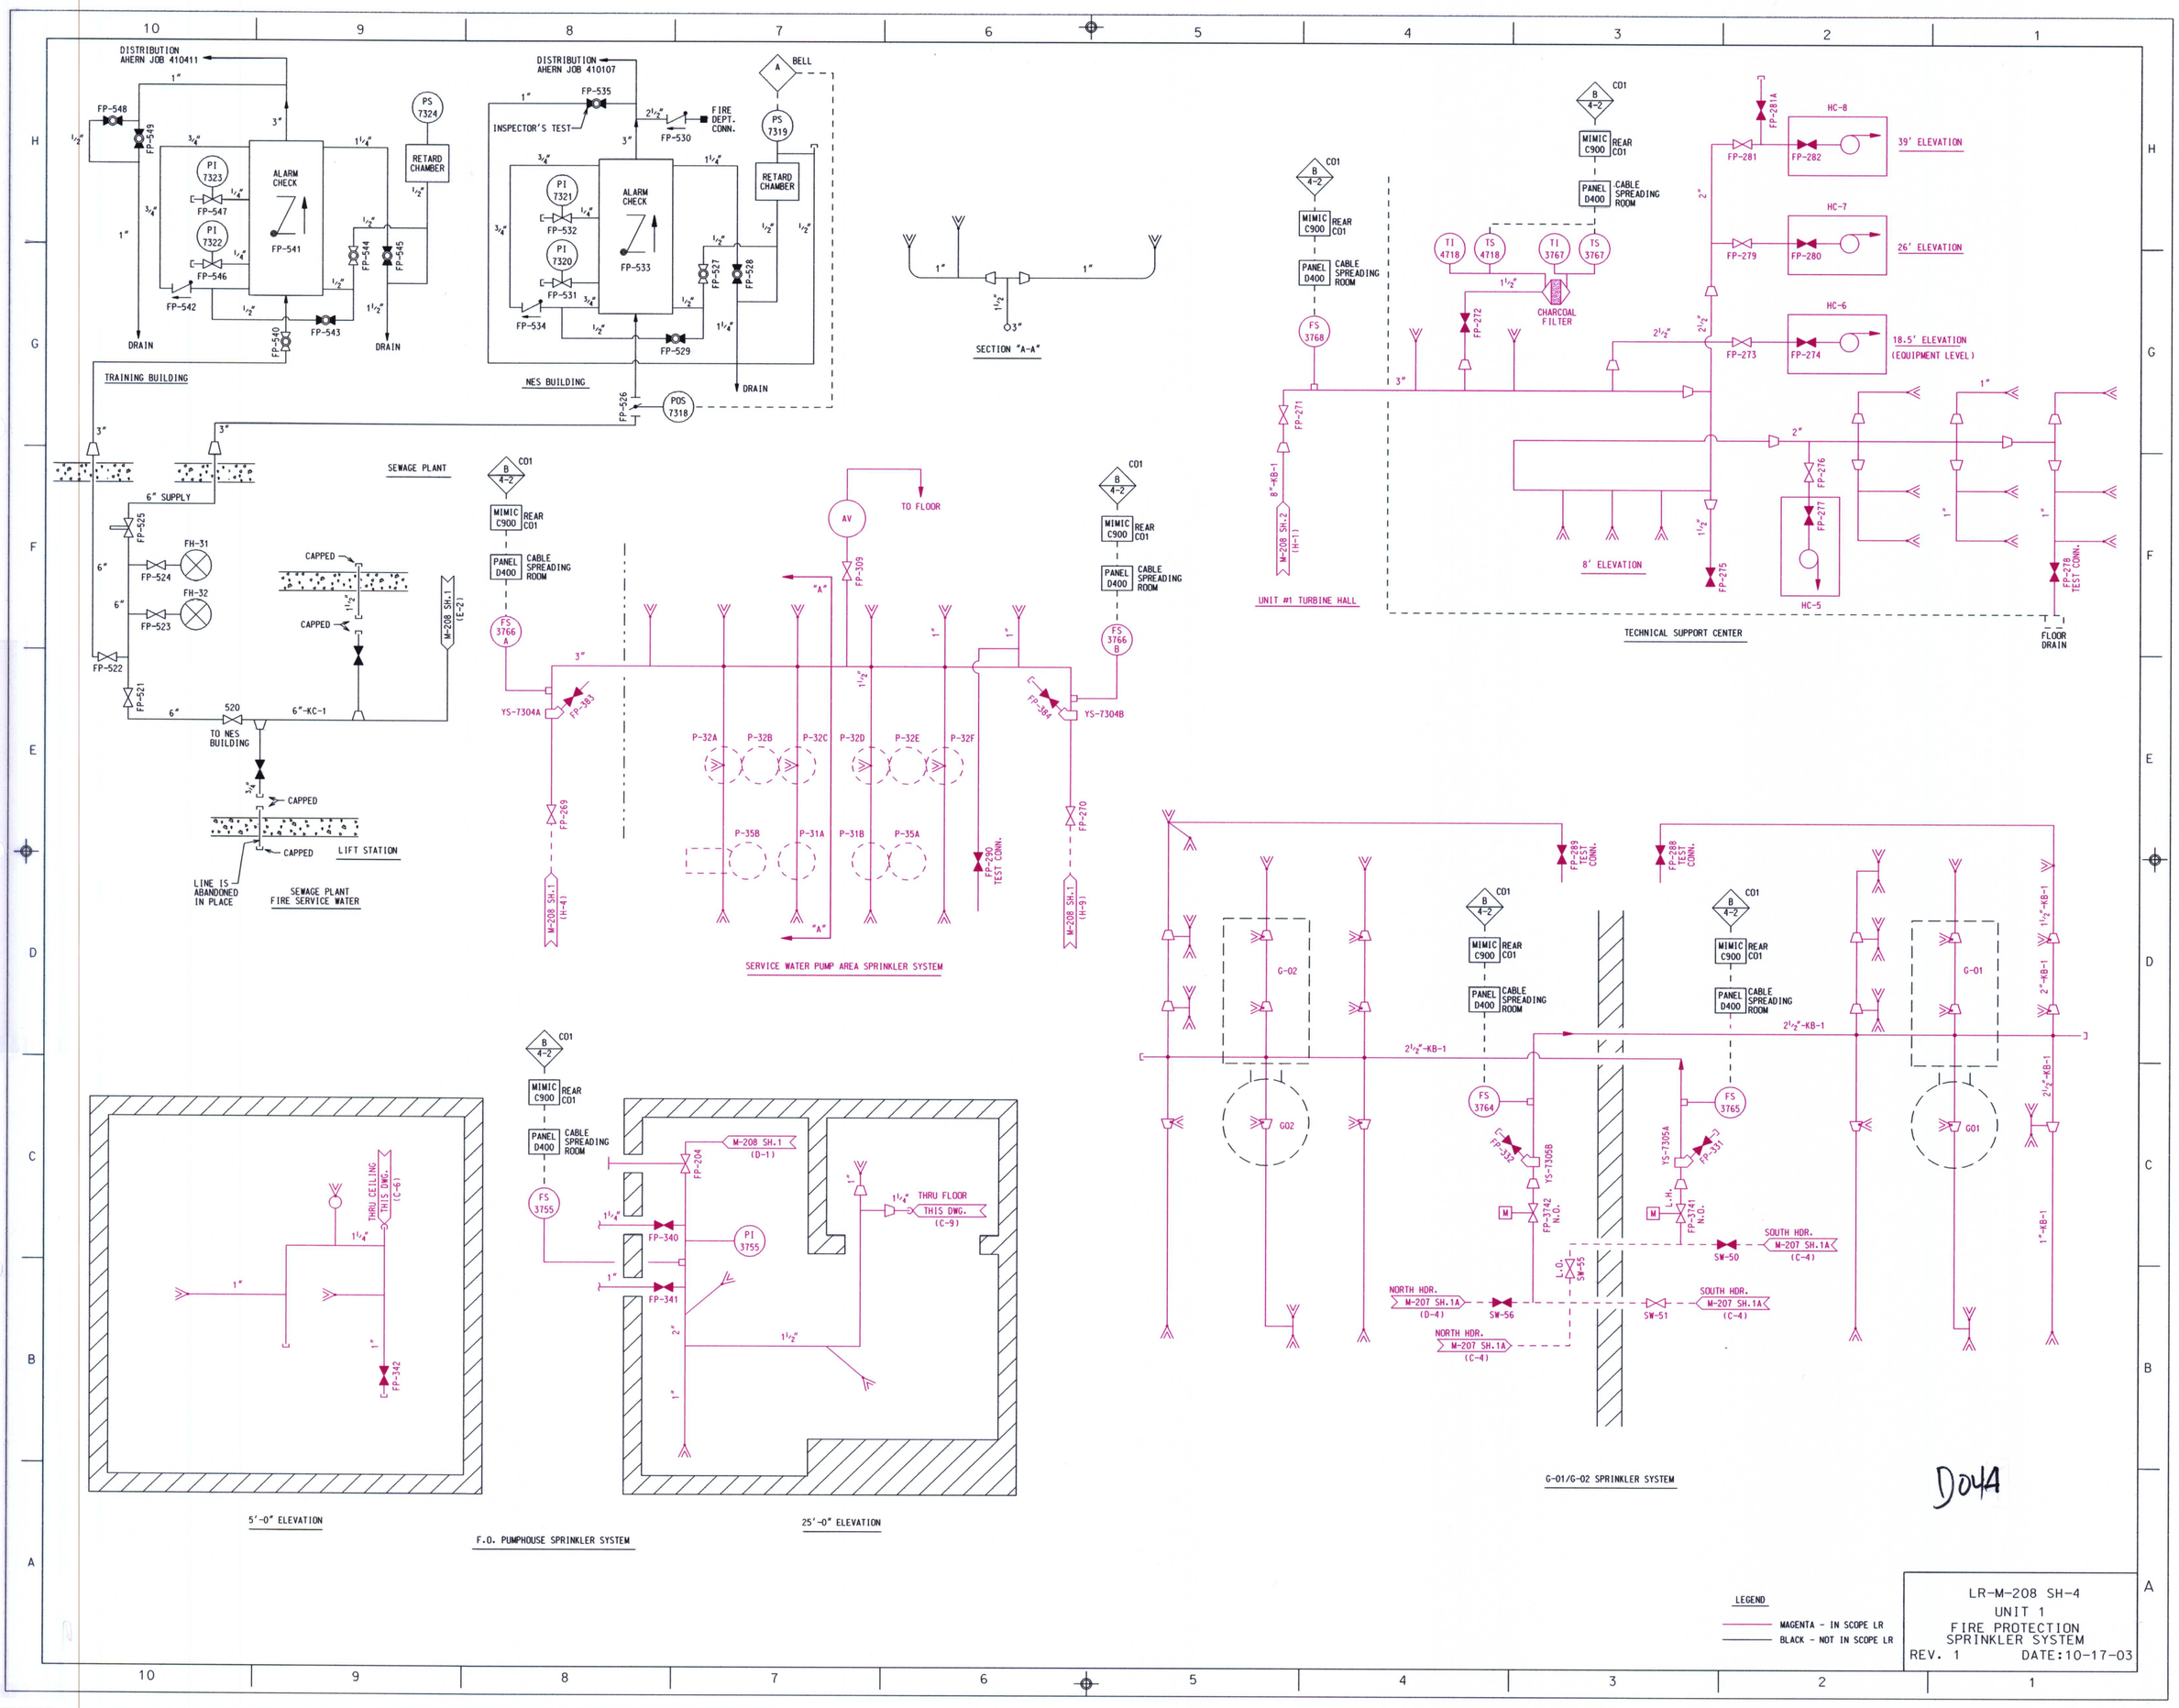
DISTRIBUTION AHERN JOB 410411
FP-548
FP-549
PI 7323
PI 7322
FP-547
FP-546
ALARM CHECK
FP-541
FP-542
FP-543
FP-540
FP-544
FP-545
PS 7324
RETARD CHAMBER
DRAIN
TRAINING BUILDING
DISTRIBUTION AHERN JOB 410107
FP-535
INSPECTOR'S TEST
FIRE DEPT. CONN.
FP-530
PI 7321
PI 7320
FP-532
FP-531
FP-533
FP-534
FP-527
FP-528
FP-529
FP-526
POS 7318
BELL
PS 7319
NES BUILDING
SECTION "A-A"
SEWAGE PLANT
6" SUPPLY
FP-525
FP-524
FP-523
FP-522
FP-521
FH-31
FH-32
CAPPED
M-208 SH.1 (E-2)
6"-KC-1
TO NES BUILDING
LIFT STATION
LINE IS ABANDONED IN PLACE
SEWAGE PLANT FIRE SERVICE WATER
MIMIC C900 REAR CO1
PANEL D400 CABLE SPREADING ROOM
FS 3766 A
FS 3766 B
YS-7304A
YS-7304B
FP-383
FP-384
FP-269
FP-270
M-208 SH.1 (H-4)
M-208 SH.1 (H-9)
AV
TO FLOOR
FP-309
P-32A
P-32B
P-32C
P-32D
P-32E
P-32F
P-35B
P-31A
P-31B
P-35A
FP-290 TEST CONN.
SERVICE WATER PUMP AREA SPRINKLER SYSTEM
TI 4718
TS 4718
TI 3767
TS 3767
CHARCOAL FILTER
FP-272
FS 3768
FP-271
8"-KB-1
M-208 SH.2 (H-1)
UNIT #1 TURBINE HALL
FP-281A
HC-8
FP-281
FP-282
39' ELEVATION
HC-7
FP-279
FP-280
26' ELEVATION
HC-6
FP-273
FP-274
18.5' ELEVATION (EQUIPMENT LEVEL)
8' ELEVATION
FP-276
FP-277
HC-5
FP-275
FP-278 TEST CONN.
FLOOR DRAIN
TECHNICAL SUPPORT CENTER
FP-289 TEST CONN.
FP-288 TEST CONN.
G-02
G02
G-01
G01
2½"-KB-1
1½"-KB-1
2"-KB-1
1"-KB-1
FS 3764
FS 3765
FP-332
FP-331
YS-7305B
YS-7305A
FP-3742 N.O.
FP-3741 N.O.
L.H.
SW-50
SW-51
SW-55
SW-56
SOUTH HDR. M-207 SH.1A (C-4)
NORTH HDR. M-207 SH.1A (D-4)
NORTH HDR. M-207 SH.1A (C-4)
G-01/G-02 SPRINKLER SYSTEM
THRU CEILING THIS DWG. (C-6)
FP-342
5'-0" ELEVATION
FS 3755
M-208 SH.1 (D-1)
FP-204
FP-340
FP-341
PI 3755
THRU FLOOR THIS DWG. (C-9)
25'-0" ELEVATION
F.O. PUMPHOUSE SPRINKLER SYSTEM
D044
LEGEND
MAGENTA - IN SCOPE LR
BLACK - NOT IN SCOPE LR
LR-M-208 SH-4
UNIT 1
FIRE PROTECTION
SPRINKLER SYSTEM
REV. 1
DATE:10-17-03