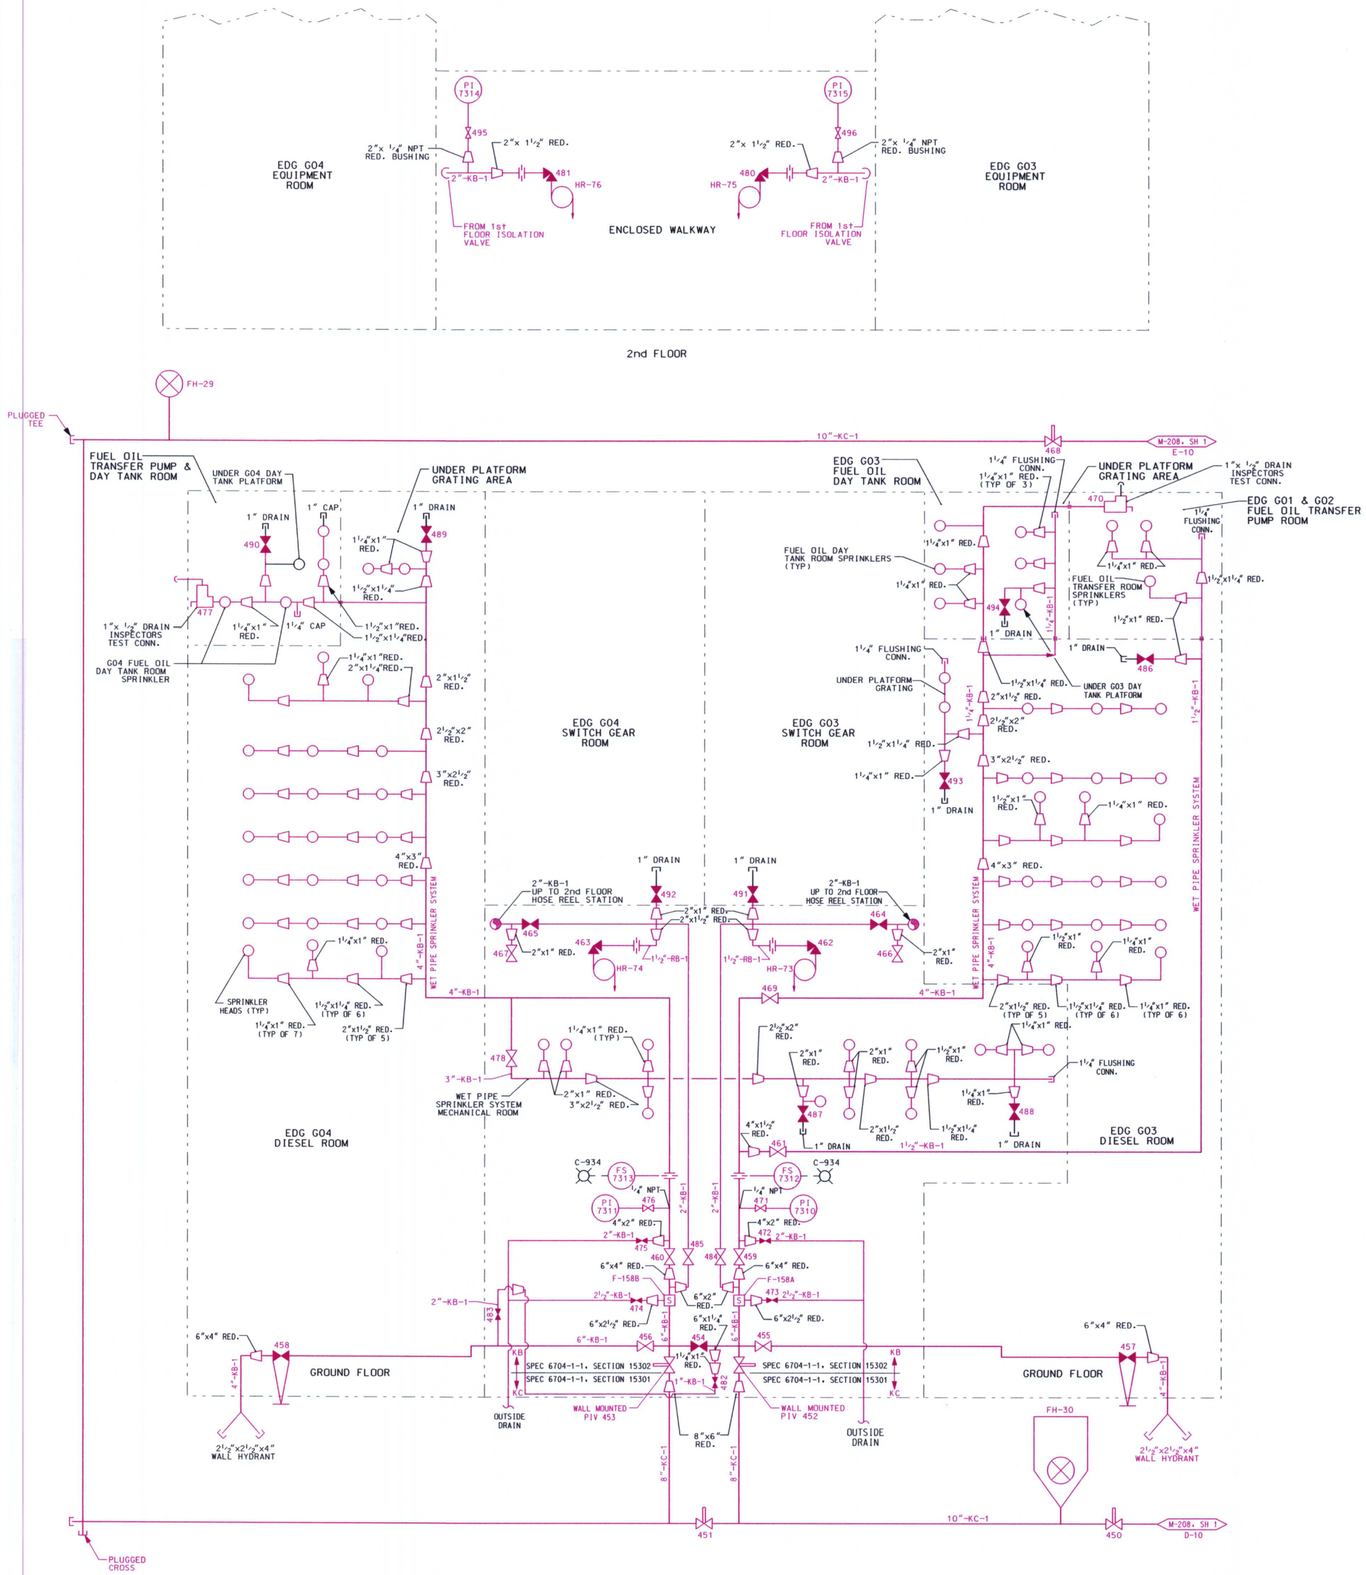

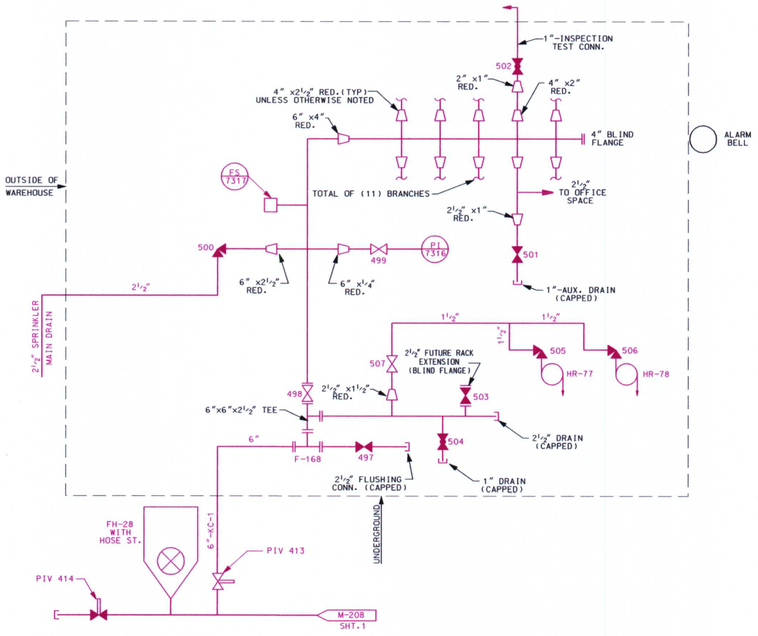

FIRE PROTECTION WAREHOUSE No. 4

NOTE:

1.
2. ALL VALVE NUMBERS PRECEDED BY FP.
3. ALL INSTRUMENTATION IS NON-SAFETY RELATED UNLESS NOTED OTHERWISE.
4. FOR PIPING AND ISOMETRICS OF THE FP LINES INSIDE EDG BUILDING REFER TO BECHTEL DWGS. NO. PF-PF-001 TO 004.

KEY TO SYMBOLS

- POST INDICATOR VALVE
- HOSE REEL
- INDICATING LIGHT
- HOSE HOUSE WITH HYDRANT
- WALL HYDRANT
- ½" UPRIGHT SPRINKLER HEAD INSERTED INTO A RED., ELL. OR TEE
- HYDRANT
- STRAINER

Doss

LEGEND

- MAGENTA - IN SCOPE LR
- BLACK - NOT IN SCOPE LR

LR-M-208 SH-15
UNIT 1 & 2
FIRE PROTECTION SYSTEM
DG BUILDING
REV. 1 DATE:10-17-03