NOTES:

1. FOR DET. MARK SEE DWG. M-214 SH.2 OF 2 FOR ASSOC. VALVE NO'S SEE CHECKLIST CL-17C
2. ALL COND. LINE (JB-13) SHALL SLOPE TO CONDENSATE RETURN UNIT.
3. ALL STEAM SUPPLY LINES (JB-12) SHALL SLOPE TOWARDS HEATING UNITS.
4. ALL STEAM MAIN RISERS SHALL HAVE MAIN DRIPS.
5. FOR FULL DETAILS OF GAS STRIPPER, CONDENSATE, PIPING & INSTRUMENTS SEE DWG. SENTRY A04408-58 AND A04408-60.
6. FOR EQUIPMENT CONNECTIONS VENDER FURNISHED ITEMS SEE DWG. AMF 89-112-7000.
7. IVTC VALVES ARE LOCATED IN THE CAPS OF THESE CHECK VALVES. VALVE NOS.:

   1HV-1003 P82A
   1HV-1004 P82B

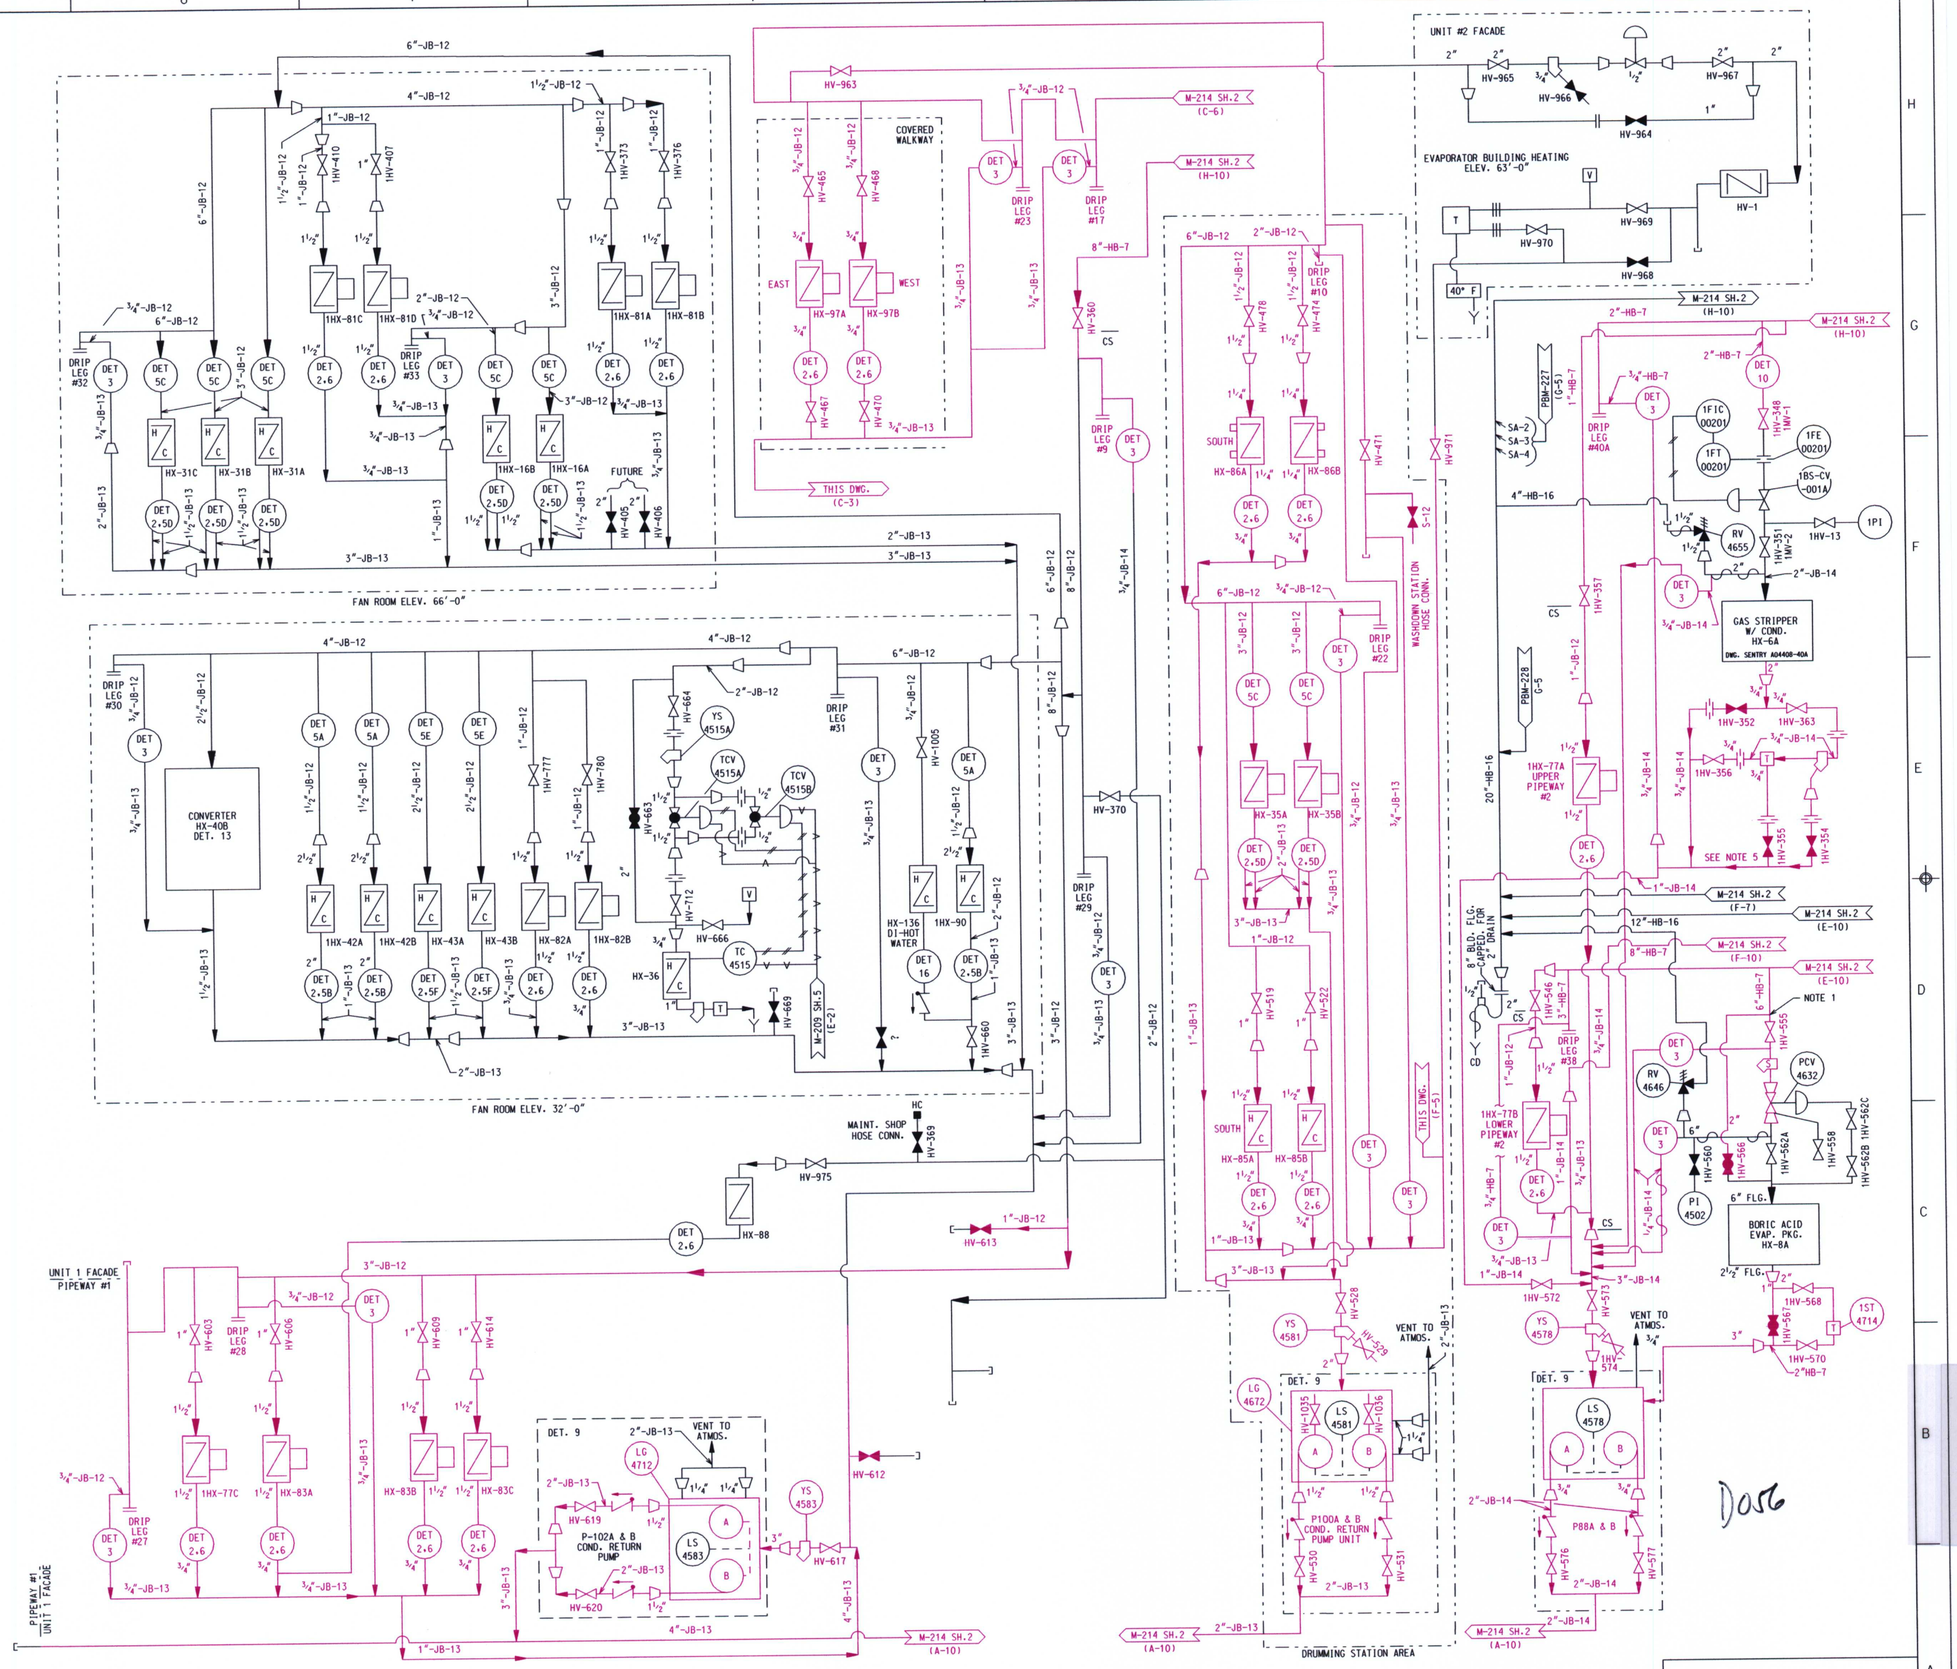

LEGEND

MAGENTA - IN SCOPE LR
BLACK - NOT IN SCOPE LR

LR-M-214 SH-1
UNIT 1 & 2
AUXILIARY STEAM HEATING SYS
REV. 1 DATE:10-17-03