NOTES:

1. FOR TURB BLDG. & OFFICE AREA VENTILATION DIAG. SEE DWG. 6118-M-211.
2. FOR GEN. NOTES, LEGEND, & REF. DWGS. M-200.
3. SPACE ALLOWED FOR INSTALLATION OF CHARCOAL FILTERS IF REQUIRED.
4. FOR ISOKINETIC SAMPLE NOZZLE SEE FP 6118-M2-1771.
5. FOR FURTHER DETS. OF INTERLOCKS & CONTROLS OF ALL H/V SYSTEMS EXT. TO THE CONTAINMENT SEE TEMP. CONTROL DWG. M-143 & M-144.
6. FOR DETS. OF CONTAINMENT PURGE VALVES INSTR. AIR CONTROL SCHEME SEE FISCHER DWG. H-15746 REV. A. 1J3933 REV.A & WE PBM-332.
7. THIS SIGNAL IS GENERATED WHEN EITHER VALVE 1CV-3213 OR 1CV-3212 IS CLOSED.

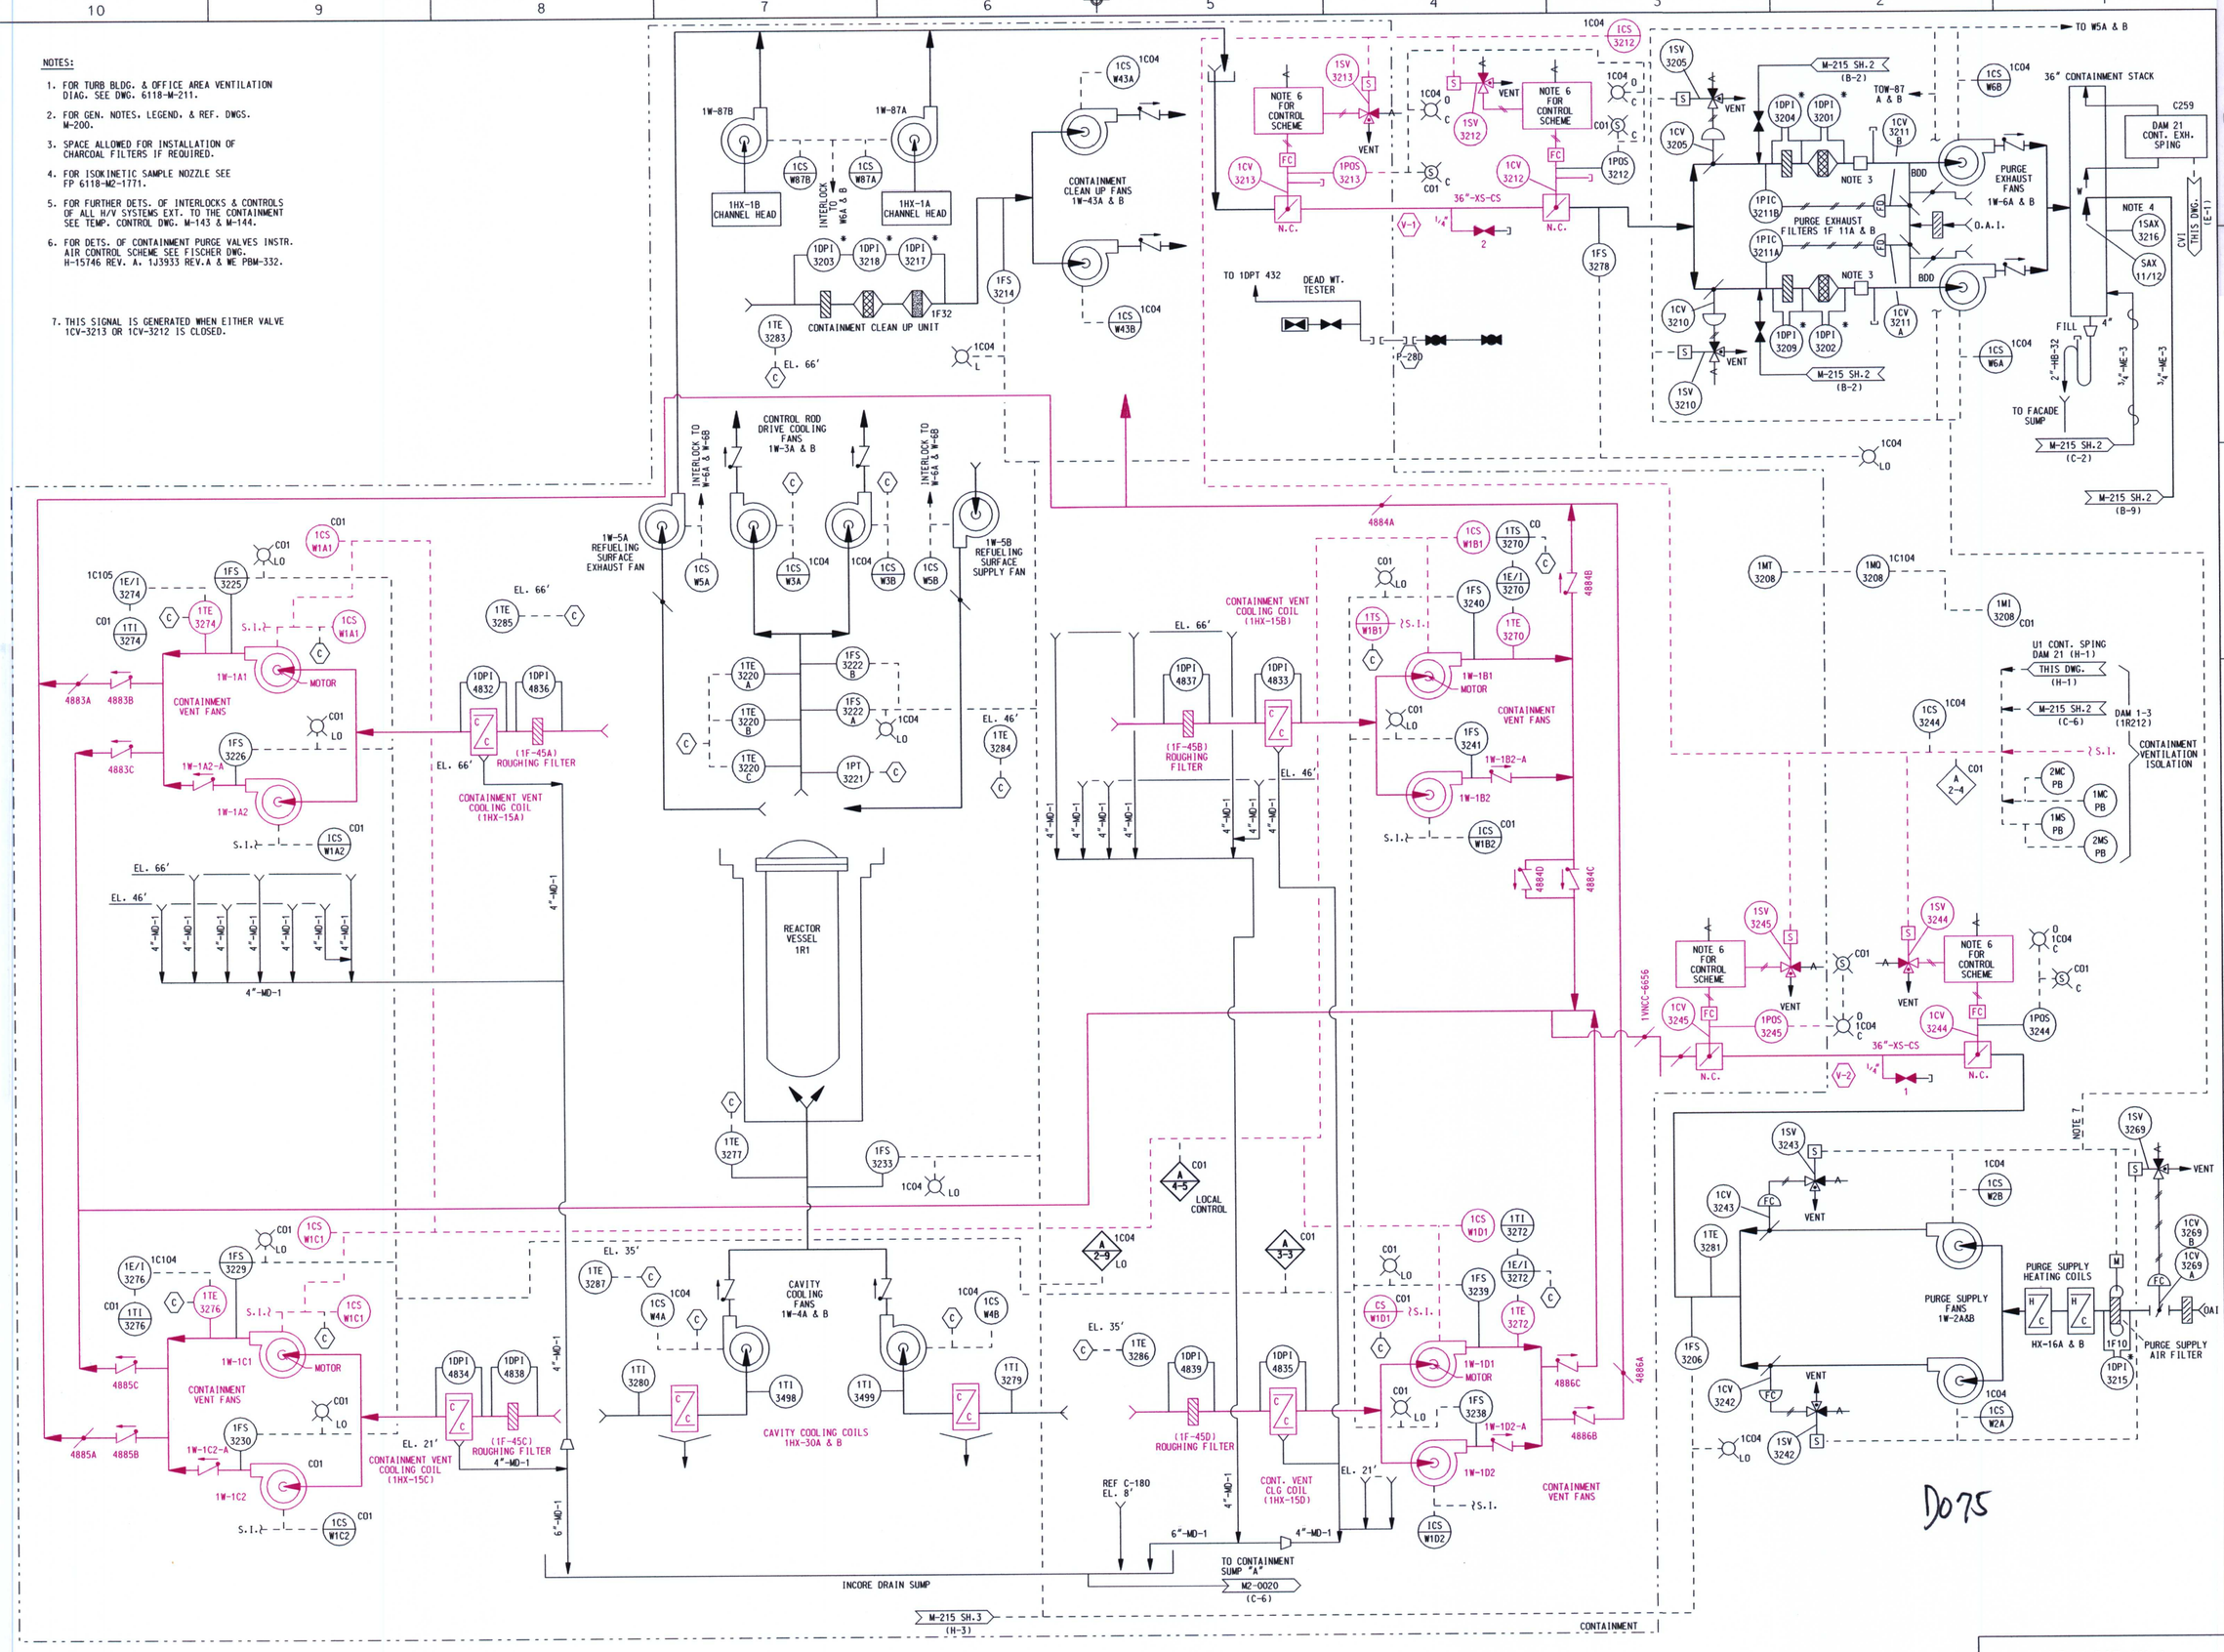

LEGEND

MAGENTA - IN SCOPE LR

BLACK - NOT IN SCOPE LR

LR-M-215 SH-1
UNIT 1
HEATING & VENTILATION SYSTEM
REV. 1 DATE:10-17-03