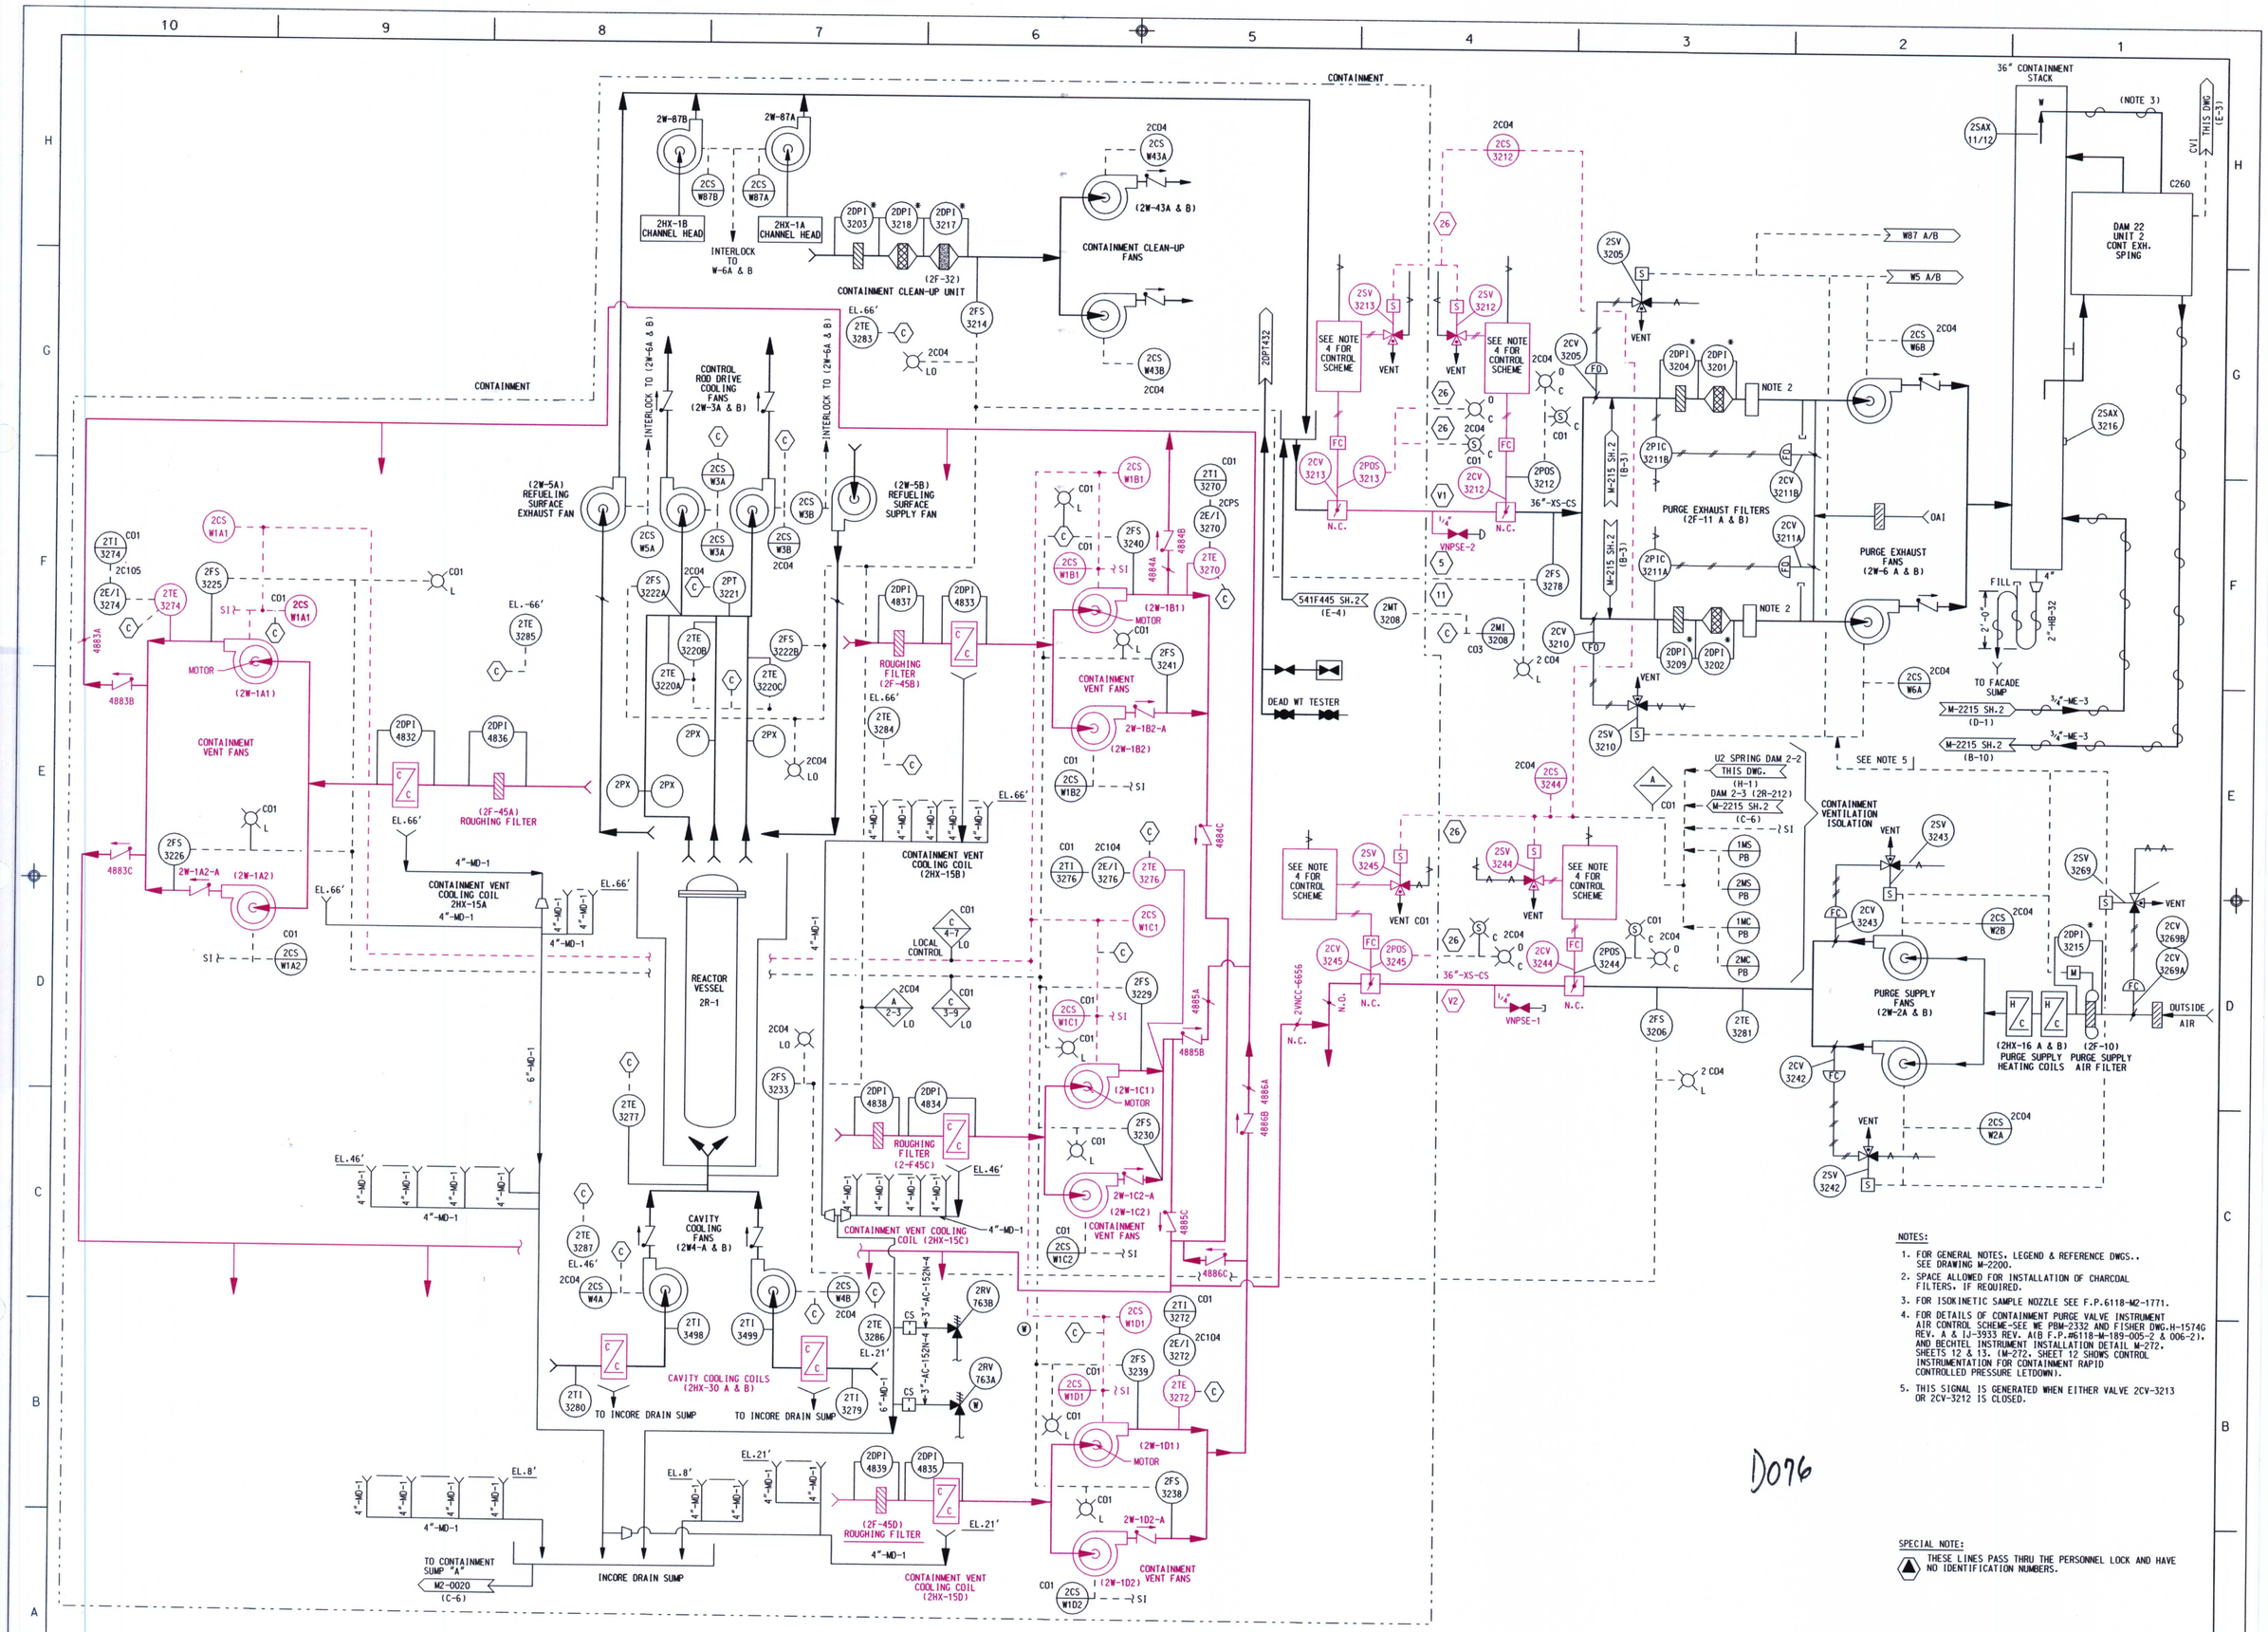

NOTES:

1. FOR GENERAL NOTES, LEGEND & REFERENCE DWGS.. SEE DRAWING M-2200.
2. SPACE ALLOWED FOR INSTALLATION OF CHARCOAL FILTERS, IF REQUIRED.
3. FOR ISOKINETIC SAMPLE NOZZLE SEE F.P.6118-M2-1771.
4. FOR DETAILS OF CONTAINMENT PURGE VALVE INSTRUMENT AIR CONTROL SCHEME-SEE WE PBM-2332 AND FISHER DWG.H-1574G REV. A & IJ-3933 REV. A(B F.P.#6118-M-189-005-2 & 006-2). AND BECHTEL INSTRUMENT INSTALLATION DETAIL M-272, SHEETS 12 & 13. (M-272, SHEET 12 SHOWS CONTROL INSTRUMENTATION FOR CONTAINMENT RAPID CONTROLLED PRESSURE LETDOWN).
5. THIS SIGNAL IS GENERATED WHEN EITHER VALVE 2CV-3213 OR 2CV-3212 IS CLOSED.

SPECIAL NOTE:

▲ THESE LINES PASS THRU THE PERSONNEL LOCK AND HAVE NO IDENTIFICATION NUMBERS.

LEGEND

MAGENTA - IN SCOPE LR

BLACK - NOT IN SCOPE LR

LR-M-2215 SH-1
UNIT 2
HEATING AND VENTILATION

REV. 1 DATE:10-17-03