NOTES:

1. CONDENSING UNIT INSTALLED AT REMOTE LOCATION ON TOP OF OPERATIONS BUILDING (SEE PBM-89).
2. REFER TO BECHTEL DWG. NOs M-143 AND M-200 (JOB NO. 6118). FOR SYMBOLS LEGEND.
3. TIC-4976, TIC-4977, SET TO 77°F.

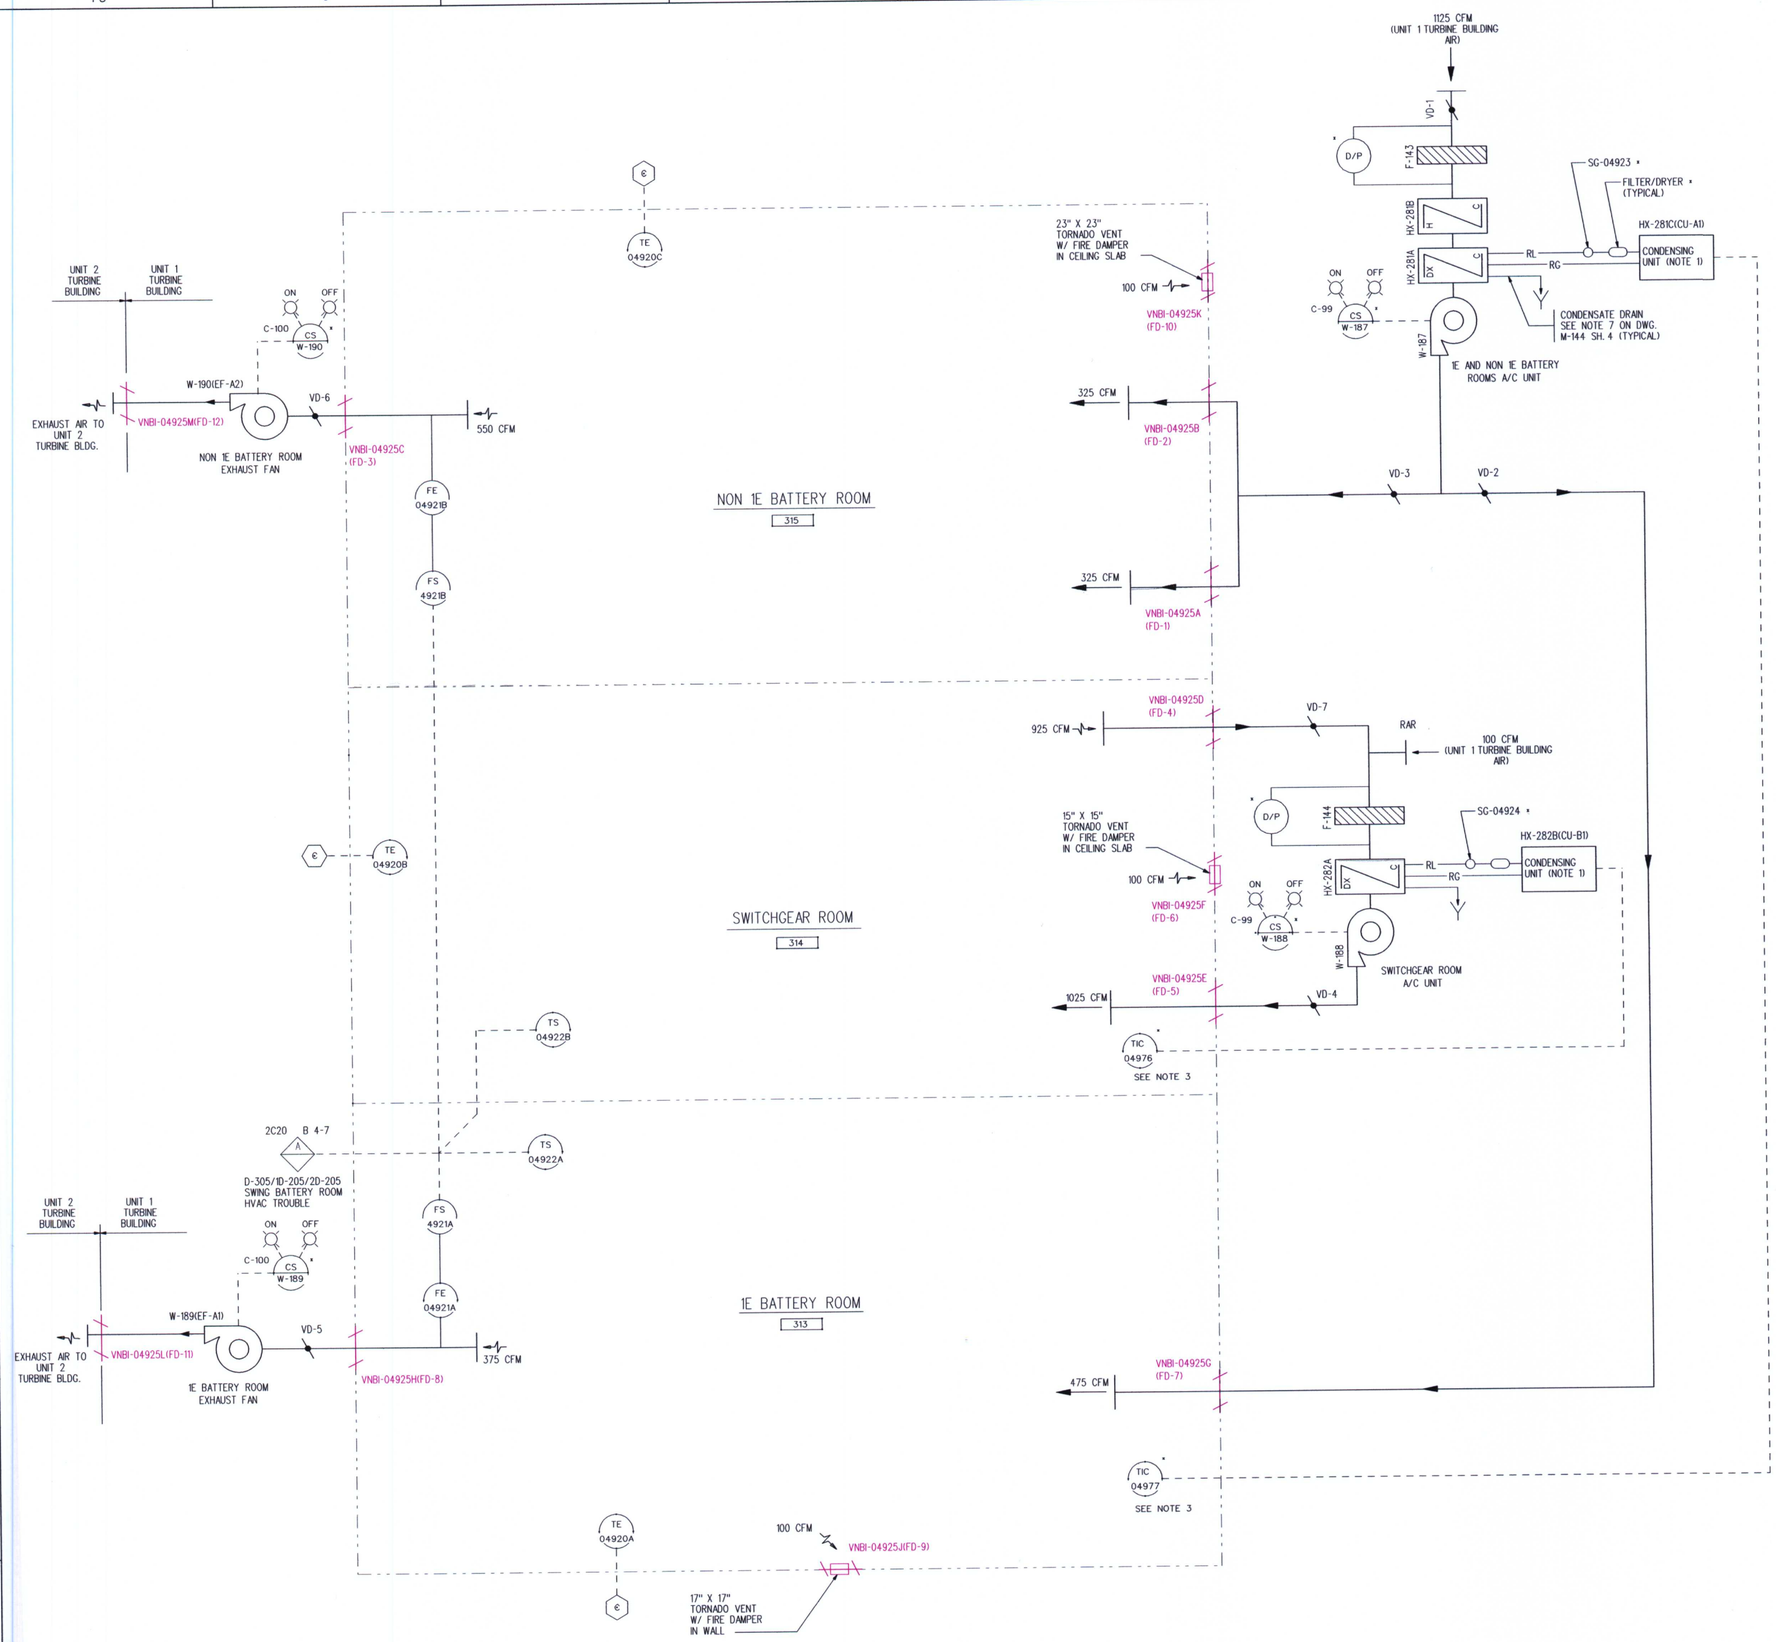

D082

LEGEND

MAGENTA - IN SCOPE LR

BLACK - NOT IN SCOPE LR

LR-M-144 SH-3
UNIT 1 & 2
HVAC
BATTERY & SWGR ROOMS
REV. 1 DATE:10-17-03