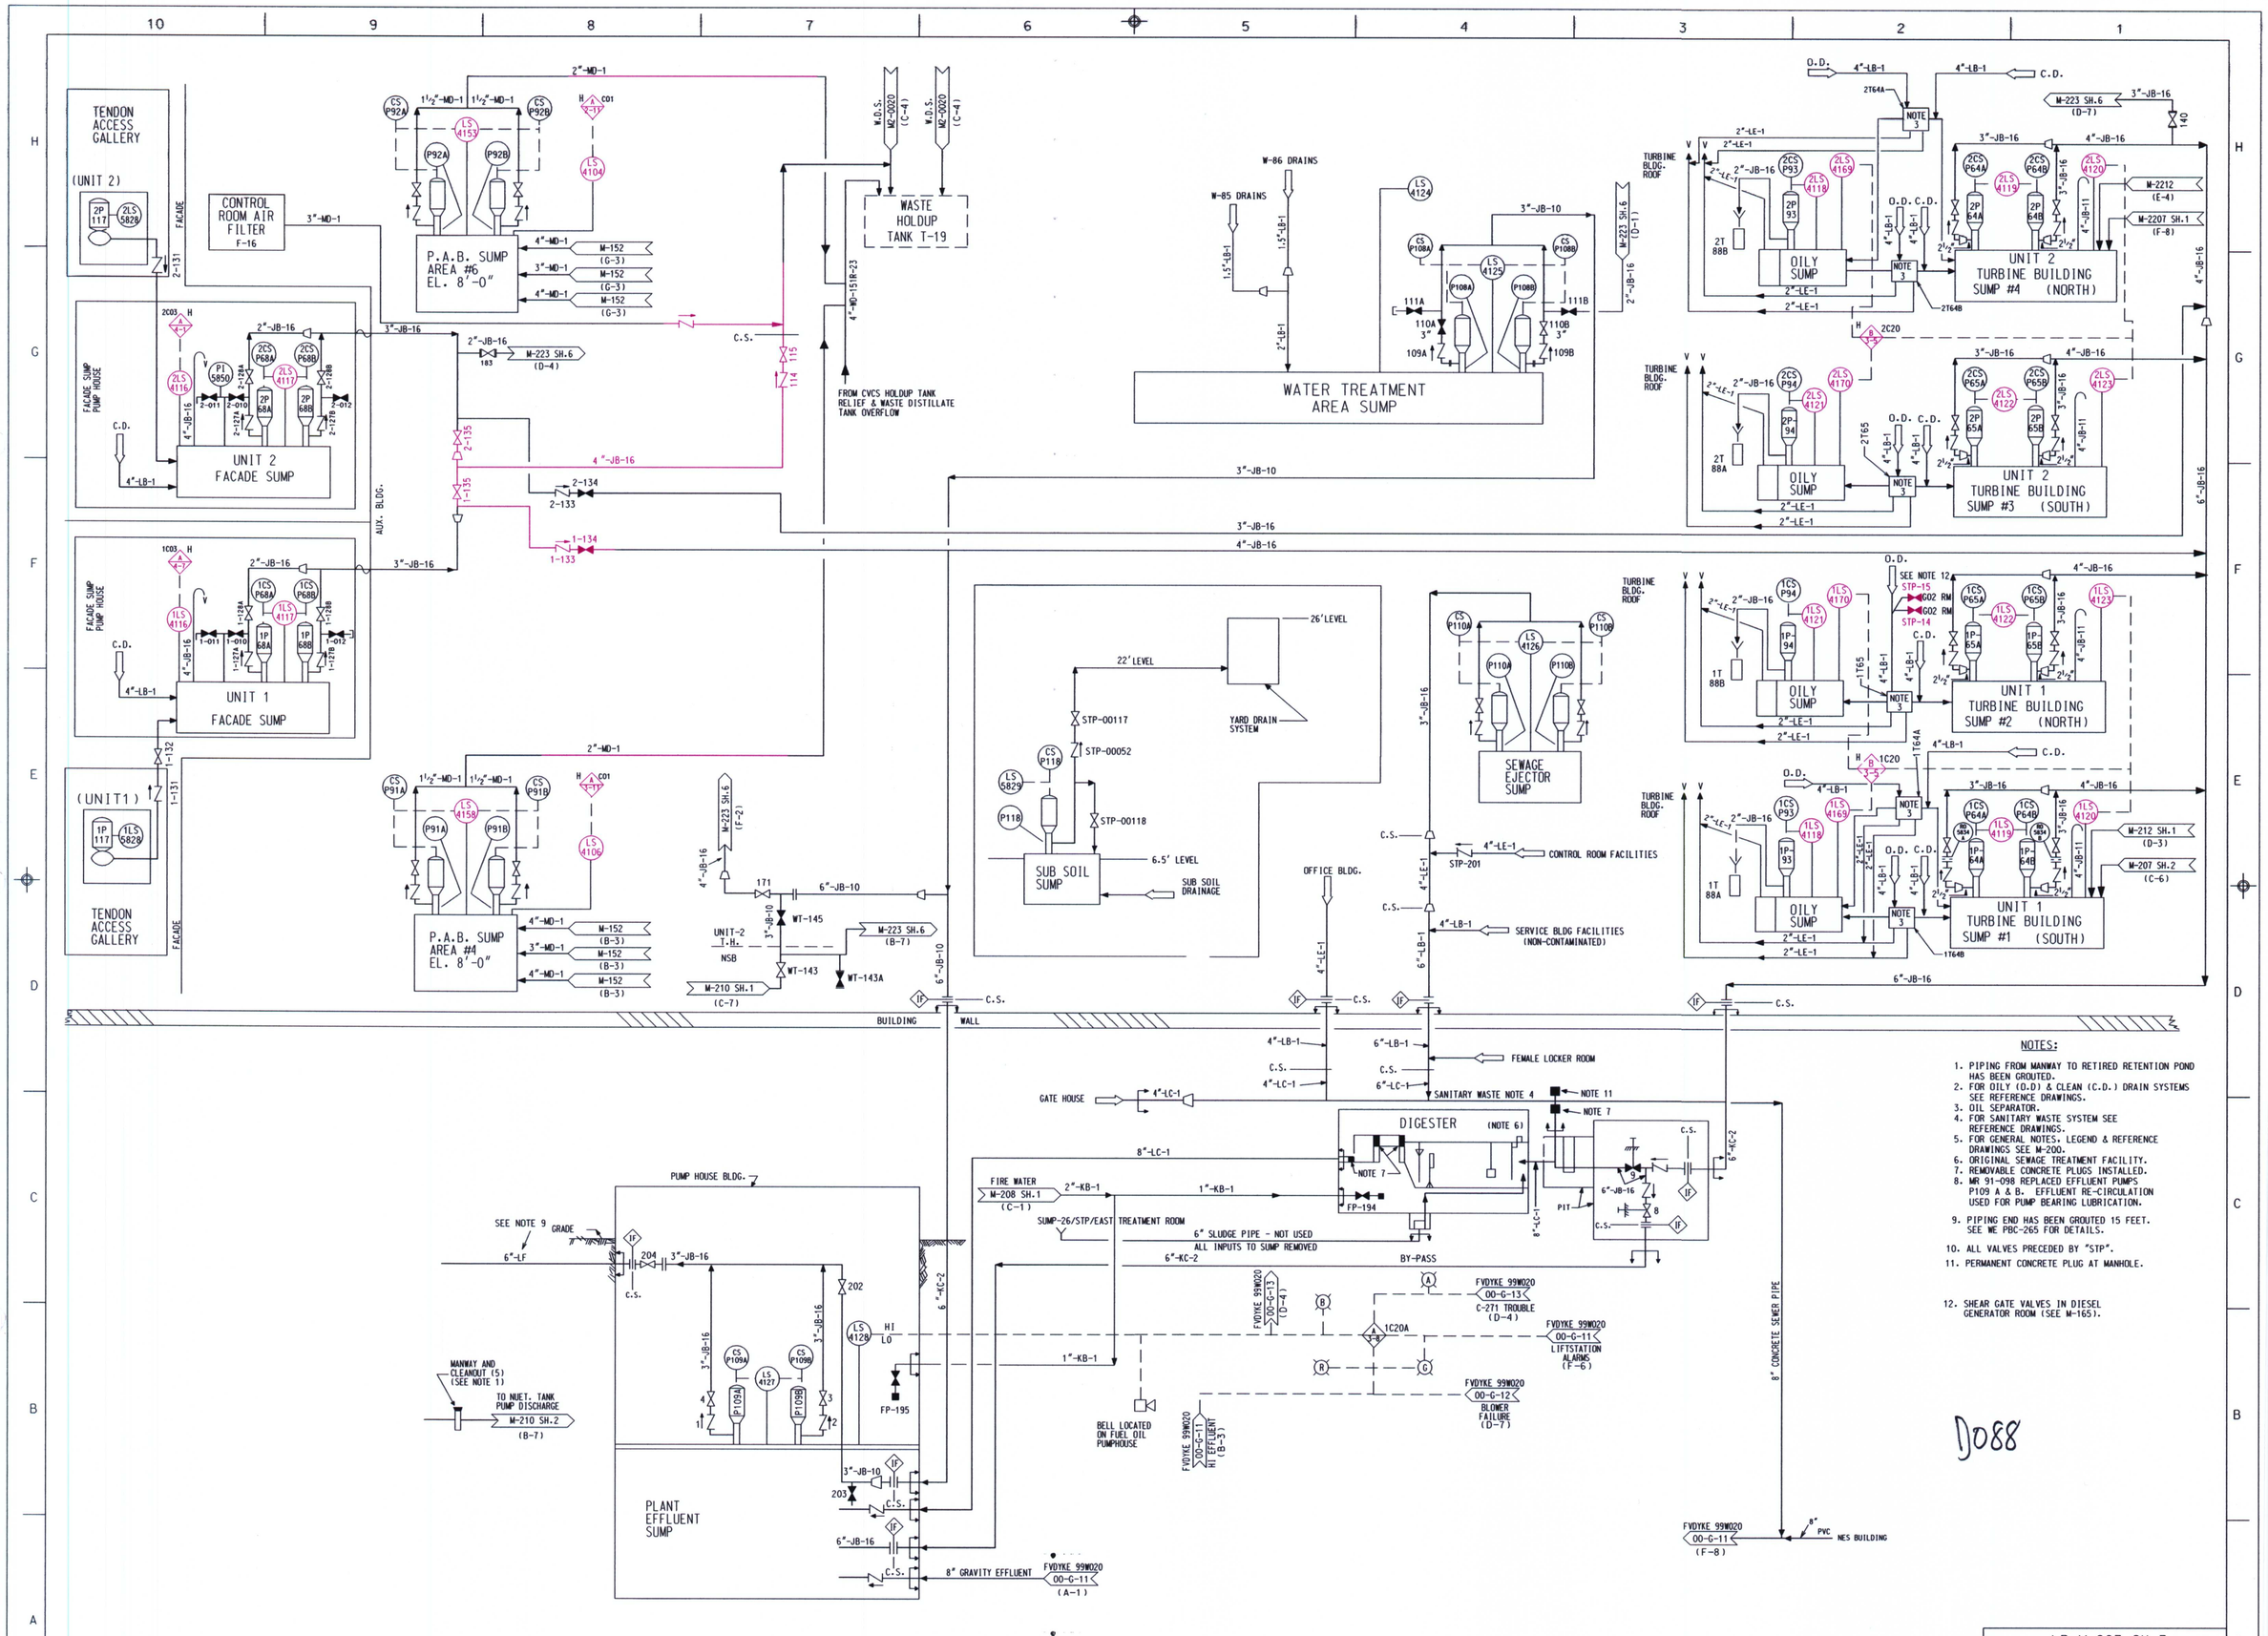

NOTES:

1. PIPING FROM MANWAY TO RETIRED RETENTION POND HAS BEEN GROUTED.
2. FOR OILY (O.D) & CLEAN (C.D.) DRAIN SYSTEMS SEE REFERENCE DRAWINGS.
3. OIL SEPARATOR.
4. FOR SANITARY WASTE SYSTEM SEE REFERENCE DRAWINGS.
5. FOR GENERAL NOTES, LEGEND & REFERENCE DRAWINGS SEE M-200.
6. ORIGINAL SEWAGE TREATMENT FACILITY.
7. REMOVABLE CONCRETE PLUGS INSTALLED.
8. MR 91-098 REPLACED EFFLUENT PUMPS P109 A & B. EFFLUENT RE-CIRCULATION USED FOR PUMP BEARING LUBRICATION.
9. PIPING END HAS BEEN GROUTED 15 FEET. SEE WE PBC-265 FOR DETAILS.
10. ALL VALVES PRECEDED BY "STP".
11. PERMANENT CONCRETE PLUG AT MANHOLE.
12. SHEAR GATE VALVES IN DIESEL GENERATOR ROOM (SEE M-165).

D088

LEGEND

MAGENTA - IN SCOPE LR

BLACK - NOT IN SCOPE LR

LR-M-223 SH-3
UNIT 1
DRAINAGE & SANITARY WASTE SYSTEMS
REV. 1 DATE:10-17-03