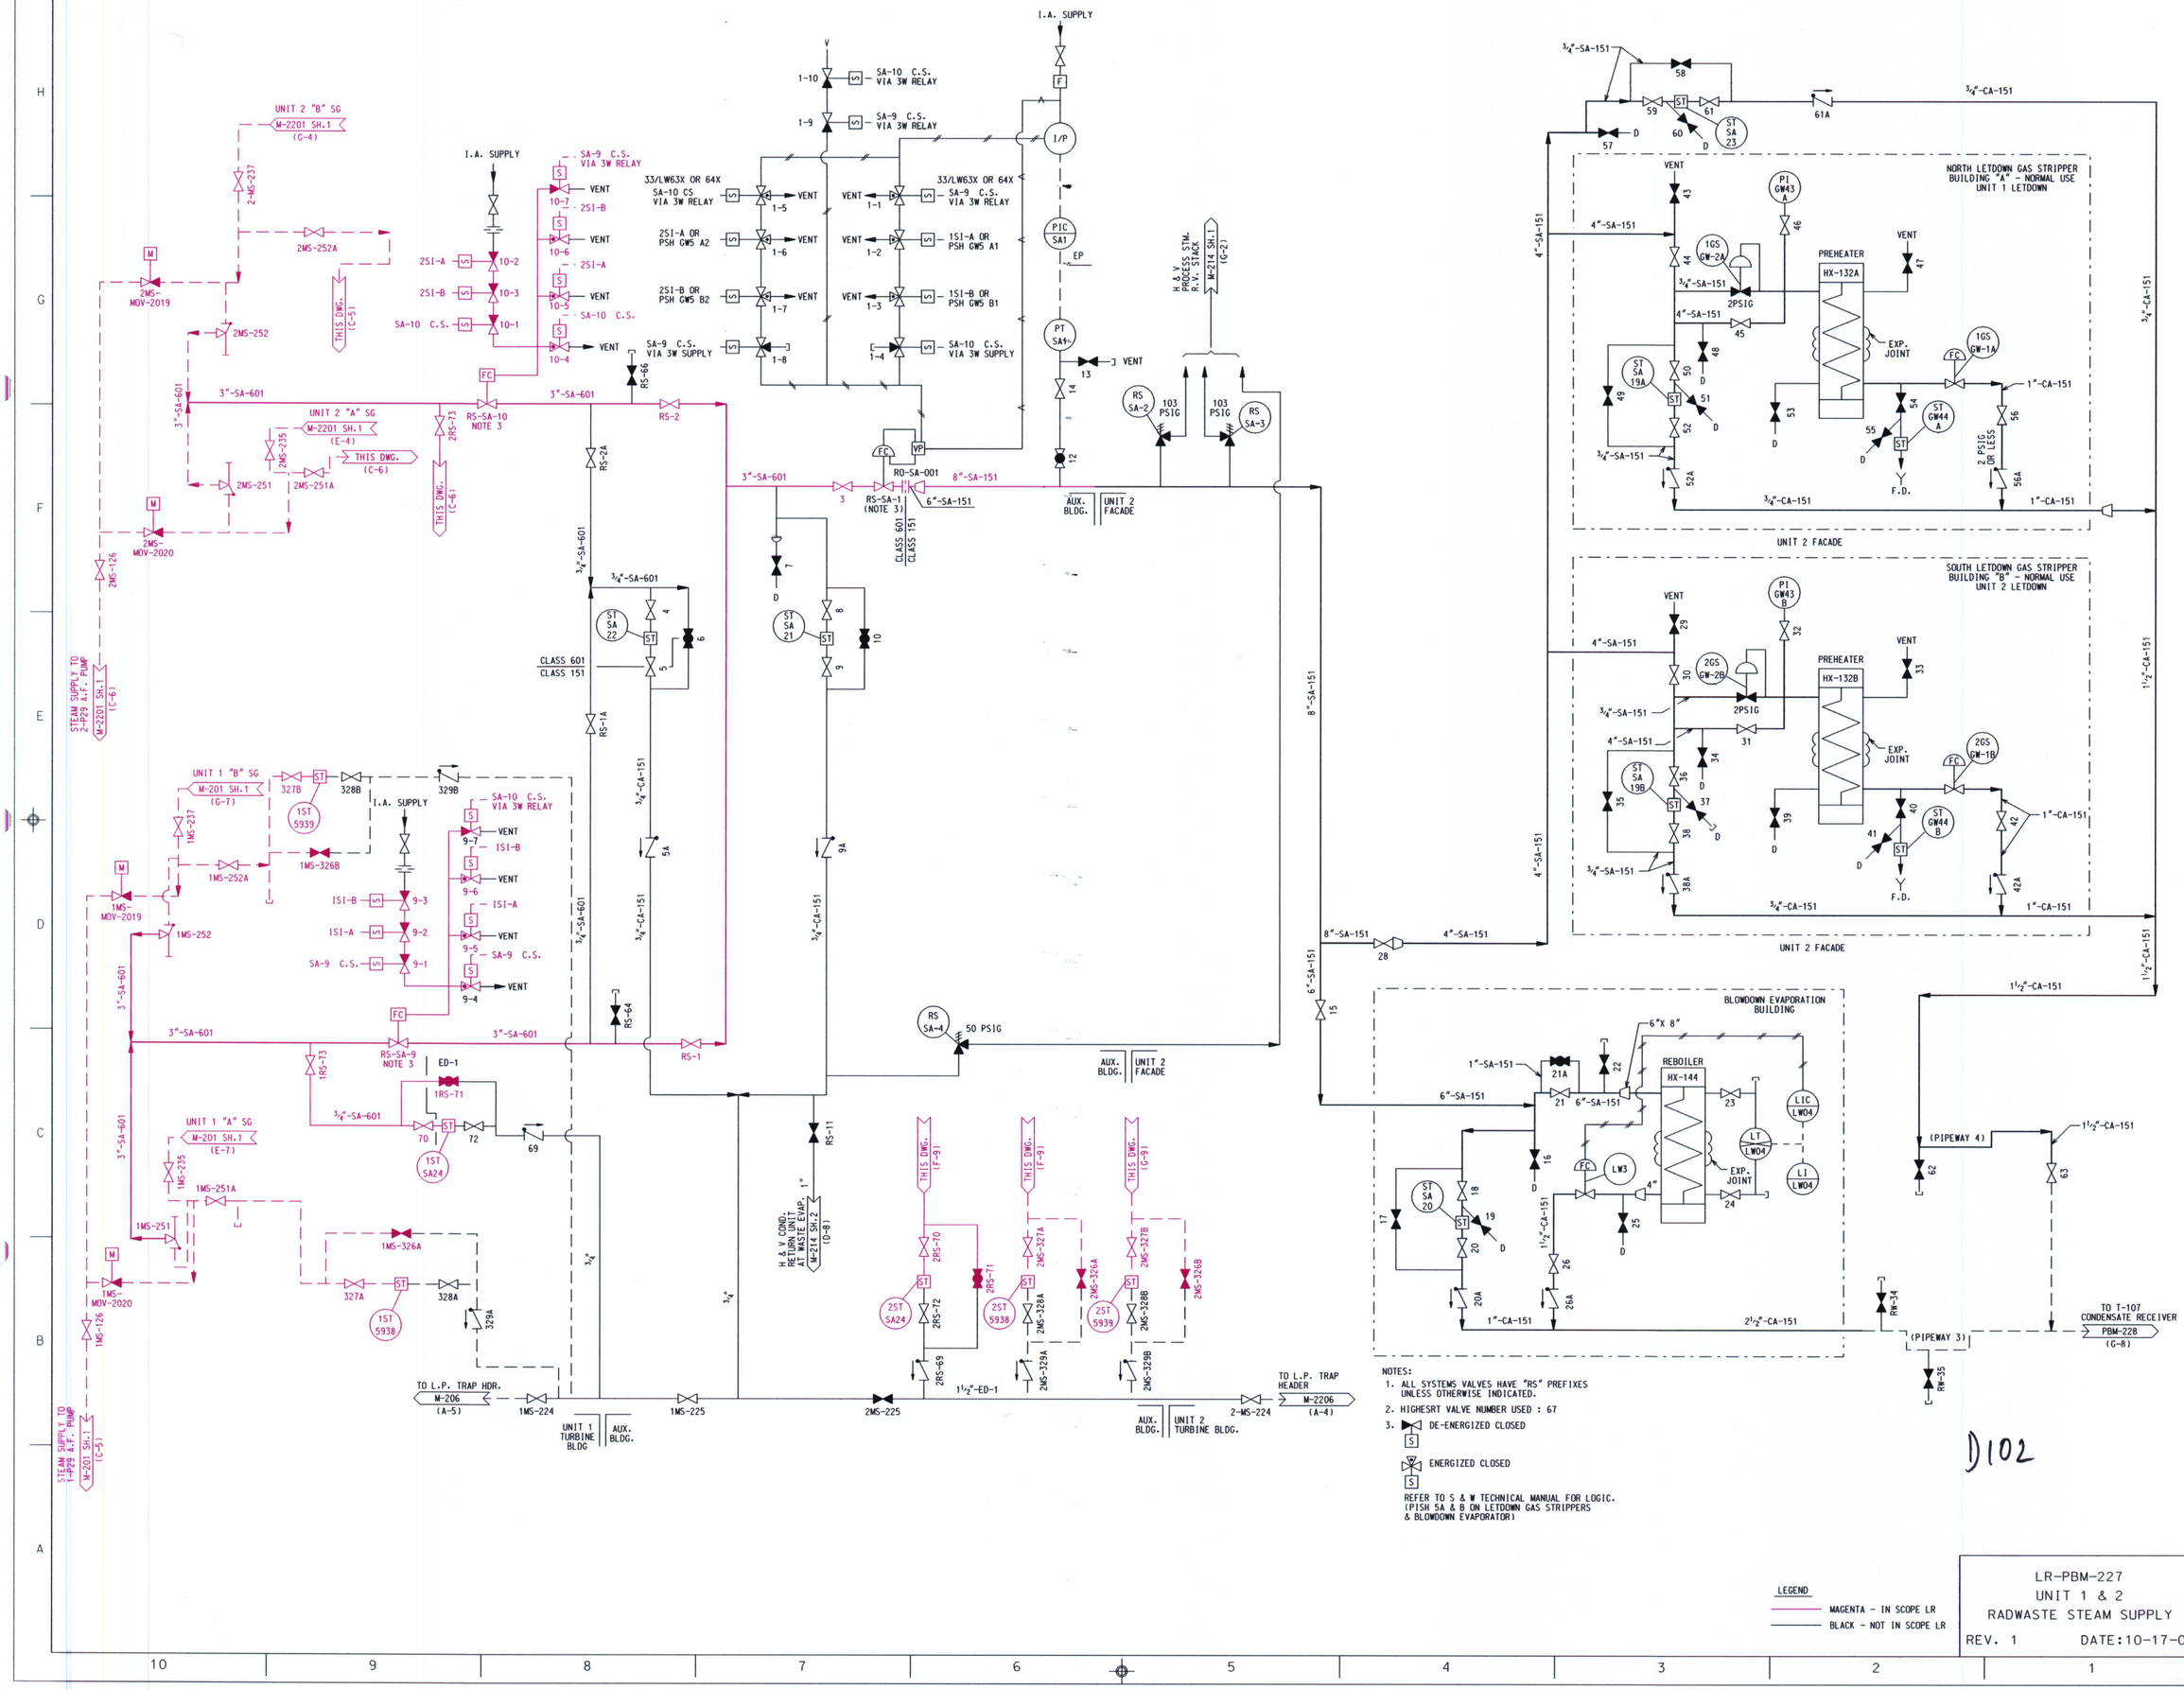

NOTES:
1. ALL SYSTEMS VALVES HAVE "RS" PREFIXES UNLESS OTHERWISE INDICATED.
2. HIGHESRT VALVE NUMBER USED : 67
3. DE-ENERGIZED CLOSED
   ENERGIZED CLOSED
   REFER TO S & W TECHNICAL MANUAL FOR LOGIC. (PISH 5A & B ON LETDOWN GAS STRIPPERS & BLOWDOWN EVAPORATOR)

D102

LEGEND
MAGENTA - IN SCOPE LR
BLACK - NOT IN SCOPE LR

LR-PBM-227
UNIT 1 & 2
RADWASTE STEAM SUPPLY
REV. 1 DATE:10-17-03