


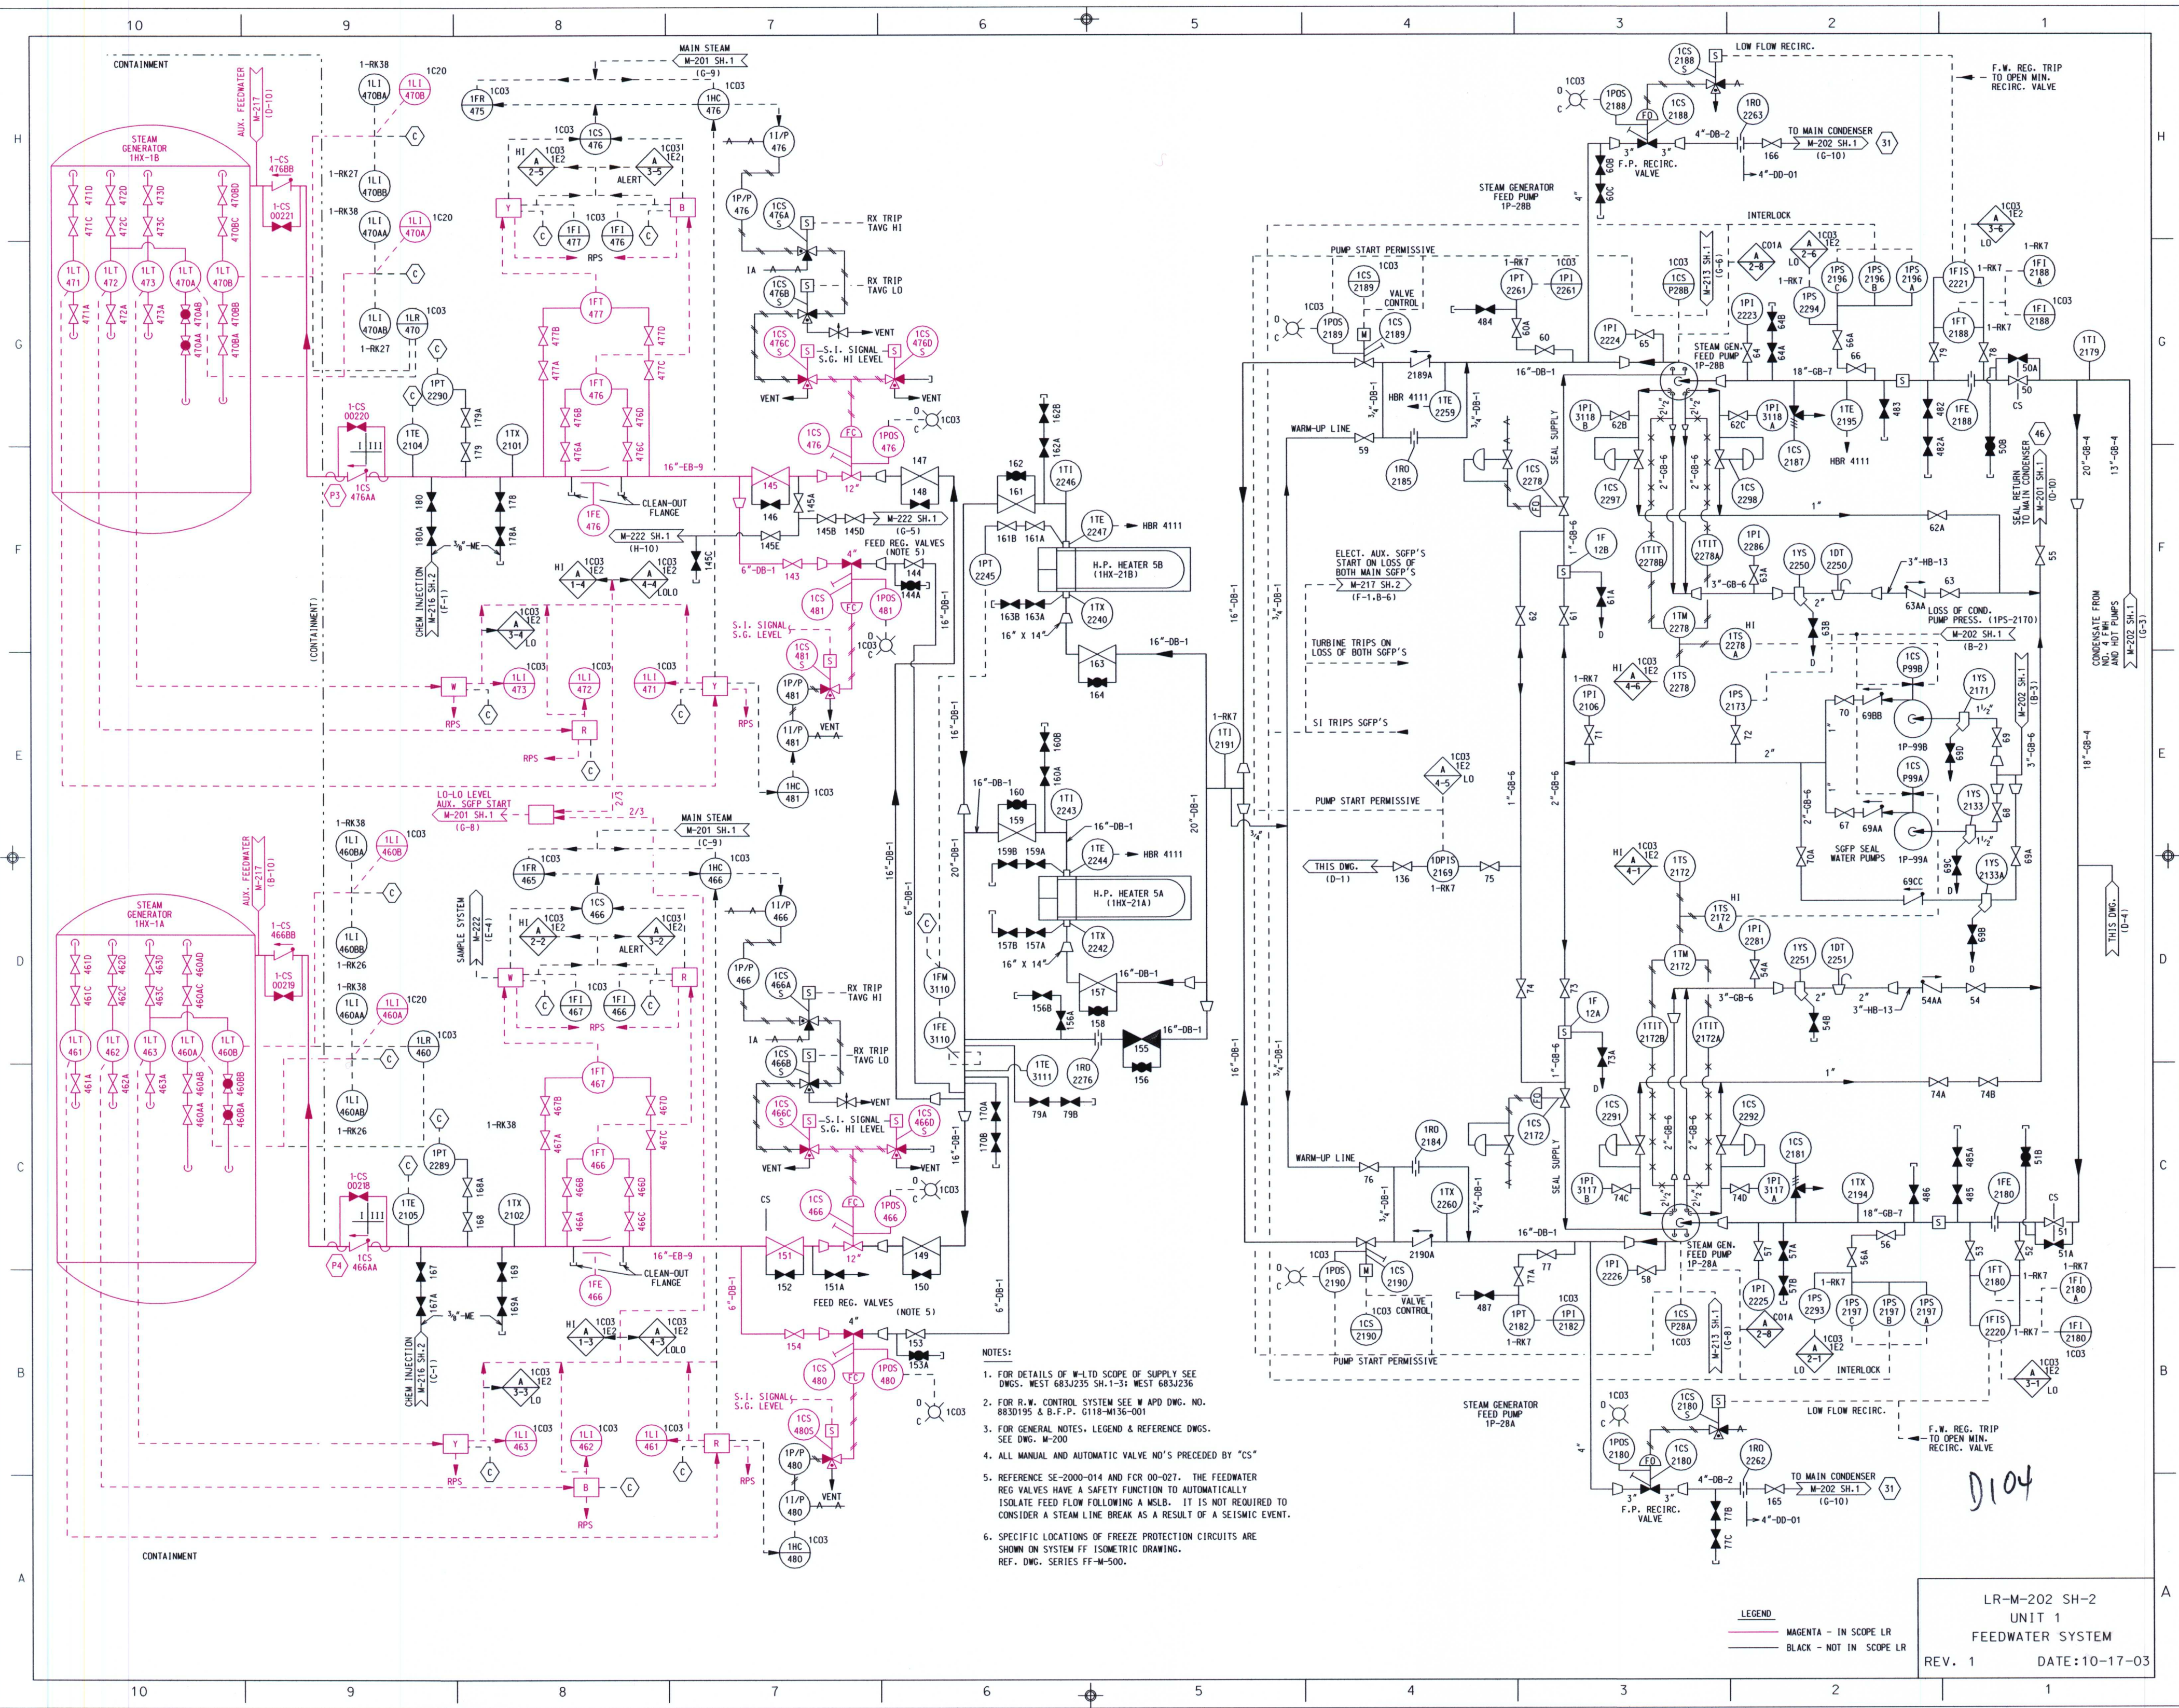

- NOTES:
1. FOR DETAILS OF M-202 SCOPE OF SUPPLY SEE DWGS. WEST 683J235 SH.1-31 WEST 683J236
 2. FOR R.W. CONTROL SYSTEM SEE W APD DWG. NO. 883D195 & B.F.P. G118-M136-001
 3. FOR GENERAL NOTES, LEGEND & REFERENCE DWGS. SEE DWG. M-200
 4. ALL MANUAL AND AUTOMATIC VALVE NO'S PRECEDED BY "CS"
 5. REFERENCE SE-2000-014 AND FOR 00-027. THE FEEDWATER REG VALVES HAVE A SAFETY FUNCTION TO AUTOMATICALLY ISOLATE FEED FLOW FOLLOWING A MSLB. IT IS NOT REQUIRED TO CONSIDER A STEAM LINE BREAK AS A RESULT OF A SEISMIC EVENT.
 6. SPECIFIC LOCATIONS OF FREEZE PROTECTION CIRCUITS ARE SHOWN ON SYSTEM FF ISOMETRIC DRAWING. REF. DWG. SERIES FF-M-500.

LEGEND
MAGENTA - IN SCOPE LR
BLACK - NOT IN SCOPE LR

LR-M-202 SH-2
UNIT 1
FEEDWATER SYSTEM
REV. 1 DATE:10-17-03

D104