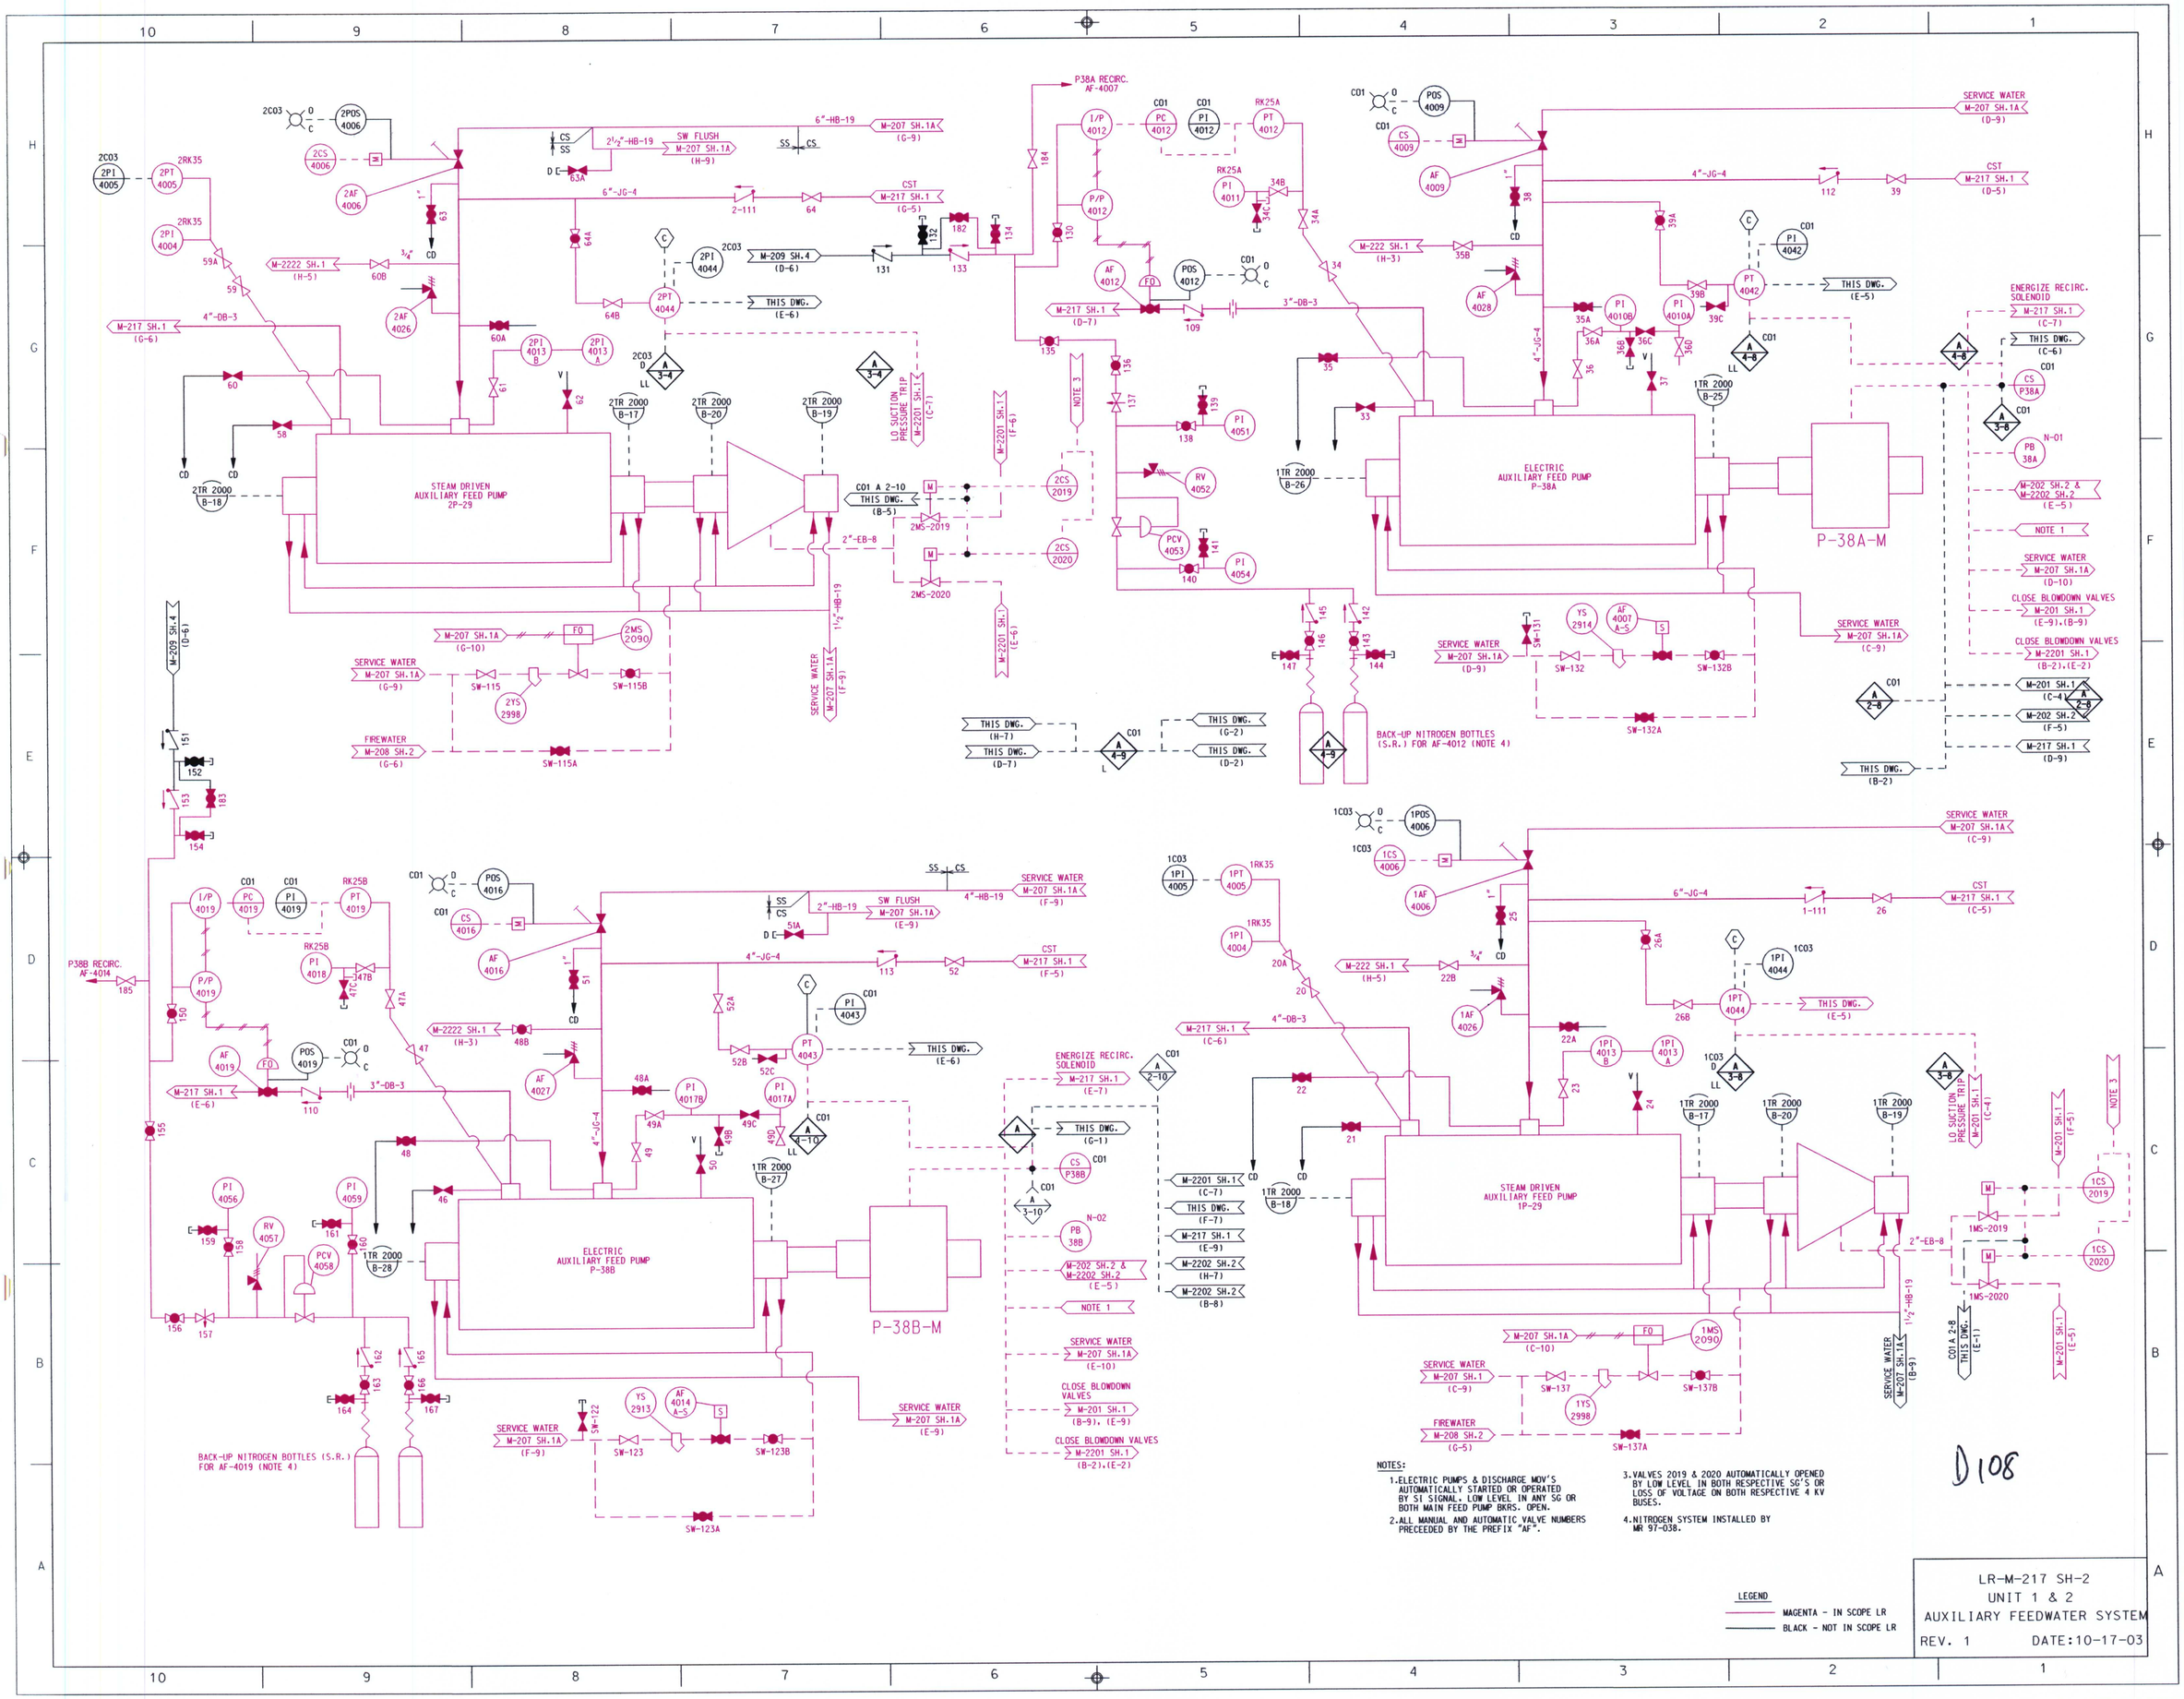

NOTES:

1. ELECTRIC PUMPS & DISCHARGE MOV'S AUTOMATICALLY STARTED OR OPERATED BY SI SIGNAL. LOW LEVEL IN ANY SG OR BOTH MAIN FEED PUMP BKRS. OPEN.
2. ALL MANUAL AND AUTOMATIC VALVE NUMBERS PRECEEDED BY THE PREFIX "AF".
3. VALVES 2019 & 2020 AUTOMATICALLY OPENED BY LOW LEVEL IN BOTH RESPECTIVE SG'S OR LOSS OF VOLTAGE ON BOTH RESPECTIVE 4 KV BUSES.
4. NITROGEN SYSTEM INSTALLED BY MR 97-038.

LEGEND

MAGENTA - IN SCOPE LR

BLACK - NOT IN SCOPE LR

LR-M-217 SH-2
UNIT 1 & 2
AUXILIARY FEEDWATER SYSTEM

REV. 1 DATE:10-17-03