

March 30, 2004
PY-CEI/NRR-2778L

United States Nuclear Regulatory Commission
Document Control Desk
Washington, D.C. 20555

Perry Nuclear Power Plant
Docket No. 50-440
Submittal of Emergency Plan Changes


Ladies and Gentlemen:

Pursuant to 10CFR50.54(q), enclosed are changes to the Emergency Plan for the Perry Nuclear Power Plant (PNPP). These changes constitute revisions, temporary changes, or reissued pages. Please follow the updating instructions per the attached Controlled Document Instruction Sheet and return the signed Acknowledgment of Receipt form.

The changes have been reviewed in accordance with 10CFR50.54(q) and it has been determined that the changes do not decrease the effectiveness of the Emergency Plan. It has also been determined that the Plan, as changed, continues to meet the standards of 10CFR50.47(b) and 10CFR50 Appendix E.

If you have questions or require additional information, please contact me at (440) 280-5889.

Very truly yours,



Todd A. Henderson, Acting Supervisor
Emergency Planning Unit

TAH:byr

Enclosure

cc: NRR Project Manager
NRC Resident Inspector
NRC Region III, Incident Response Center w/attachments

AX45

FirstEnergy Nuclear Operating Company
PERRY NUCLEAR POWER PLANT
UNIT 1

ACKNOWLEDGMENT OF RECEIPT

Title Emergency Plan for the Perry Nuclear Power Plant (EP), Rev. 19

Control No. **242**

Letter No./Date PY-CEI/NRR-2778L/March 30, 2004

Signature

Date

Title

Return to:

Perry Nuclear Power Plant
Attn: Beverly Richardson, A240
P. O. Box 97
Perry, Ohio 44081

**FirstEnergy Nuclear Operating Company
Perry Nuclear Power Plant**

Controlled Document Instruction Sheet

Manual: Emergency Plan for Perry Nuclear Power Plant (EP), REV. 19

Control Number 242

**Revision
Remove
18**

**Change No.
N/A**

**Insert
EP / Rev. 19**

EP
Page: 1
Rev.: 19

PERRY OPERATIONS MANUAL

Emergency Plan

PNPP
~~UPDATED~~
CONTROLLED COPY

No.

INFORMATION
ONLY

TITLE: EMERGENCY PLAN FOR PERRY NUCLEAR POWER PLANT

DOCKET NOS. 50-440

REVISION: 19

EFFECTIVE DATE: 3-8-04

PREPARED: Lawrence W. Burgwald

12-4-03
/ Date

EMERGENCY PLAN FOR PERRY NUCLEAR POWER PLANT
DOCKET NOS. 50-440

Table of Contents

<u>Section</u>	<u>Title</u>	<u>Page</u>
1.0	<u>DEFINITIONS</u>	1-1
2.0	<u>SCOPE AND APPLICABILITY</u>	2-1
2.1	Site Description	2-1
2.2	Population Distribution	2-1
2.3	Emergency Planning Zones	2-1
2.4	Purpose and Objectives	2-2
2.5	Summary of Emergency Plan Inter-Relationships	2-3
2.6	Participating Governmental Agencies	2-5
3.0	<u>SUMMARY OF THE EMERGENCY PLAN</u>	3-1
3.1	Emergency Plan Steps	3-1
3.2	Emergency Organizations	3-1
3.3	Emergency Classifications	3-3
4.0	<u>EMERGENCY CONDITIONS</u>	4-1
4.1	Emergency Classification System	4-1
4.2	State and County Classification System	4-5
5.0	<u>ORGANIZATIONAL CONTROL OF EMERGENCIES</u>	5-1
5.1	FirstEnergy Organization	5-1
5.2	Emergency Organization	5-1
5.3	Local Services Support	5-17
5.4	Government Agencies	5-20
6.0	<u>EMERGENCY MEASURES</u>	6-1
6.1	Activation of Emergency Organizations	6-1
6.2	Assessment Actions	6-5
6.3	Onsite Personnel Accountability	6-7
6.4	Offsite Protective Actions	6-8
6.5	Contamination Control Measures	6-11
6.6	Emergency Personnel Dose Control	6-13
6.7	Thyroid Blocking	6-14
7.0	<u>EMERGENCY FACILITIES AND EQUIPMENT</u>	7-1
7.1	Emergency Centers	7-1
7.2	Communications Systems	7-4
7.3	ERO Notifications	7-9
7.4	Prompt Alert Siren System	7-9
7.5	Assessment Facilities	7-10
7.6	First Aid and Decontamination Facilities	7-21
7.7	Protective Equipment and Supplies	7-21

EMERGENCY PLAN FOR PERRY NUCLEAR POWER PLANT
DOCKET NOS. 50-440

Table of Contents (Cont.)

<u>Section</u>	<u>Title</u>	<u>Page</u>
8.0	<u>MAINTAINING EMERGENCY PREPAREDNESS</u>	8-1
8.1	Organizational Preparedness	8-1
8.2	Review and Updating of the Emergency Plan and Implementing Instructions	8-5
8.3	Annual Emergency Preparedness Program Review	8-5
8.4	Maintenance and Inventory of Emergency Equipment and Supplies	8-6
8.5	Maintenance of Emergency Telephone Numbers	8-6
8.6	Public Education and Information	8-6
8.7	News Media Training	8-7
8.8	Drills and Exercises	8-8
9.0	<u>RE-ENTRY AND RECOVERY</u>	9-1
9.1	Re-entry Phase	9-1
9.2	Recovery Phase	9-2
9.3	Recovery Notifications	9-4

EP
Page: iv
Rev.: 19

EMERGENCY PLAN FOR PERRY NUCLEAR POWER PLANT
DOCKET NOS. 50-440

LIST OF APPENDICES

- APPENDIX A INDEX OF EMERGENCY PLAN IMPLEMENTING AND SUPPORT INSTRUCTIONS
- APPENDIX B LETTERS OF AGREEMENT
- APPENDIX C LIST OF EMERGENCY EQUIPMENT AND SUPPLIES
- APPENDIX D LIST OF SUPPORTING PLANS
- APPENDIX E NUREG-0654/FEMA-REP-1 CROSS REFERENCE TO PERRY PLANT EMERGENCY PLAN INDEX

EMERGENCY PLAN FOR PERRY NUCLEAR POWER PLANT
DOCKET NOS. 50-440

LIST OF TABLES

<u>Section</u>	<u>Title</u>	<u>Page</u>
3-1	Emergency Classifications and the Degree of Involvement by Participating Groups	3-4
4-1	Emergency Action Levels (EALs)	4-7
4-2	EAL Abbreviations/Acronyms	4-58
4-3	NUMARC/NESP-007 Cross-Reference	4-59
5-1	Perry Plant Emergency Response Organization Functions and Shift Staff Augmentation Plan	5-22
6-1	Guideline for Protective Actions Against Ingestion of Contamination	6-15
6-2	Recommended Protective Actions for Ingestion Pathway	6-16
8-1	Training Provisions for Offsite Emergency Response Personnel	8-12

EMERGENCY PLAN FOR PERRY NUCLEAR POWER PLANT
DOCKET NOS. 50-440

LIST OF FIGURES

<u>Section</u>	<u>Title</u>	<u>Page</u>
2-1	10 Mile Emergency Planning Zone	2-6
2-2	50 Mile Emergency Planning Zone	2-7
4-1	Initiating Condition Index	4-6
4-2	Fission Product Barrier Matrix	4-10
5-1	Emergency Response Organization (Interim Phase)	5-26
5-2	Emergency Response Organization (Final Phase)	5-27
6-1	Emergency Notification	6-18
6-2	Offsite Monitoring/Decontamination Center Locations	6-19
6-3	Protective Action Flow Chart	6-20
6-4	Containment Radiation Plot	6-21
7-1	Relative Locations of Emergency Response Facilities	7-25
7-2	Technical Support Center (TSC) Layout	7-26
7-3	Operations Support Center (OSC) Layout	7-27
7-4	Emergency Operations Facility (EOF) Layout	7-28
7-5	Dedicated Emergency Telephone Communications	7-29
7-6	Siren Locations for PNPP	7-30
9-1	Recovery Organization	9-5

SCOPE OF REVISION:

- Rev. 19 -
1. Defined HCL figure limits have been exceeded for EALs BS1 and CG1. (CA 03-04182-03)
 2. Inserted Fission Product Barrier Matrix PNPP No. 9855, Rev. 12/02/03. (CA 03-04182-01)
 3. Table 5-1 - changed Shift Technical Advisor to Shift Engineer.
 4. Removed deleted definition 1.39 and renumbered definitions accordingly.
 5. Section 6.0 - removed deleted table 6-1 and renumbered tables 6-2 and 6-3 to 6-1 and 6-2. Corrected table reference in Section 6.0.
 6. Section 7.0 - removed deleted tables 7-1 and 7-2. No reference to these tables existed in Section 7.0.
 7. Appendix A - removed information on deleted references.

EMERGENCY PLAN FOR PERRY NUCLEAR POWER PLANT
DOCKET NOS. 50-440

COMMITMENTS:

The following commitments are addressed by the PNPP Emergency Plan (EP):

B01028	S00388	S00548	S00563
E00058	S00535	S00549	S00564
F01025	S00538	S00550	S00565
F01557	S00539	S00551	S00566
L00115	S00540	S00552	S00567
L00454	S00541	S00554	S00568
L00513	S00542	S00556	
L00537	S00543	S00557	
N00274	S00544	S00558	
P00098	S00545	S00560	
P00125	S00546	S00561	
S00321	S00547	S00562	

1.0 DEFINITIONS

Listed below are terms used in the Emergency Plan, along with definitions that should be applied to these terms. Footnotes are found at the end of this list.

1.1 Adverse Meteorology

The meteorology which results in the conservative accident atmospheric dilution factor value of $\geq 6.7E-4 \text{ sec/m}^3$.

1.2 Alert

The occurrence of an event or events that involve an actual or a potentially substantial degradation of the level of safety of the plant. The consideration is to prepare to cope with potentially more serious emergencies. Any radioactive releases are expected to be limited to a small fraction of the Environmental Protection Agency (EPA) Protective Action Guideline (PAG) Levels. (1)

1.3 Assessment Actions

Those actions taken during or after an accident to obtain and process information necessary to make decisions to implement specific emergency measures. (1)

1.4 Average Meteorology

That meteorology which results in the average atmospheric dilution factor value of $< 6.7E-4 \text{ sec/m}^3$ but $\geq 4.4E-5 \text{ sec/m}^3$.

1.5 Computer-Aided Dose Assessment Program (CADAP)

The software program designed to provide an automated method for determining the present and/or potential offsite consequences of a significant release to the environment from the Perry Plant during Emergency Plan event.

1.6 Central Alarm Station (CAS)

The continuously manned alarm station where all security alarms annunciate.

1.7 Committed Effective Dose Equivalent (CEDE)

The sum of the products of the weighting factors applicable to each of the body organs or tissues and the committed dose equivalent to these organs or tissues. CEDE is the internal dose component of TEDE.

1.8 Committed Dose Equivalent (CDE)

The dose equivalent to organs or tissues of reference that will be received from an intake of radioactive material by an individual during the 50 year period following the intake.

NOTE: For dose assessment purposes, CDE for child thyroid is calculated.

1.9 Contaminated Area

Any material or area accessible to personnel with a loose surface contamination greater than or equal to 1000 dpm/100cm² beta-gamma and/or 100 dpm/100cm² alpha. (2)

1.10 Control Room

The onsite location from which the reactor and its auxiliary systems are controlled. The location of the Control Room is on Elevation 654' of the Control Complex.

1.11 Corrective Actions

Those emergency measures taken to mitigate or terminate an emergency situation at or near the source of the problem in order to prevent an uncontrolled release of radioactive material or to reduce the magnitude of the release, e.g., shutting down equipment and damage control. (1)

1.12 Deep Dose Equivalent (DDE)

The dose equivalent measured at a tissue depth of 1 cm (1000 mg/cm²). DDE is the external dose component of TEDE.

1.13 Design Basis Accident (DBA)

Occurrences that are not expected to occur but are postulated because their consequences may result in the release of significant amounts of radiation.

1.14 Dose Projection

The calculated estimate of a radiation dose to individuals at a given location (usually offsite), determined from the quantity of radioactive material released and the appropriate meteorological transport and dispersion parameters. (3)

1.15 Drill

A supervised instruction period aimed at testing, developing, and maintaining skills in a particular operation. (1)

1.16 Emergency Action Levels (EALs)

Levels which consist of specific sets of plant parameters (i.e., instrument indications, system status, radiological doses and dose rates) that shall be used for emergency classification. EALs are used specifically to provide for early readiness status of emergency response personnel, organizations, and facilities.

1.17 Emergency Operations Center (EOC)

An offsite location utilized by State, County and other government agencies and organizations to perform assessments of radiological conditions and to coordinate offsite activities (access, evacuation, etc.). (4)

1.18 Emergency Operations Facility (EOF)

A specifically designated location for the management of overall emergency response activities, the coordination of radiological assessments, and the control of offsite emergency support activities. The Perry Plant Emergency Operations Facility (EOF) is located within the Owner-Controlled Area on the lower floor of the Training and Education Center (TEC) Building, approximately one-half mile from the plant.

1.19 Emergency Planning Zones (EPZ)

Two zones that the EPA recommends be established around all nuclear power stations. One zone with a radius of approximately 10 miles (16090 meters) for airborne exposure, and the other with a radius of approximately 50 miles (80450 meters) for contaminated food. In these zones, predetermined protective action plans are needed. (1,3)

1.20 Exclusion Area

The area surrounding the plant in which the licensee has the authority to determine all activities including the exclusion or removal of persons and property from the area. At the Perry Plant this area is established as the area that falls inside the 2900 foot radii centered on the Unit 1 reactor.

1.21 Exercise

An exercise is a simulated event or series of events that tests the integrated capability and a major portion of the basic elements existing within emergency preparedness plans and organizations. (1)

1.22 Functional

A system, subsystem, train, component or device, though degraded in equipment condition or configuration, is functional if it is capable of maintaining respective system parameters within acceptable design limits.

1.23 Gap Release

A fission product release that occurs when fuel cladding experiences initial rupture. This consists mostly of activity that was released to void spaces within the fuel rods during normal reactor operation. Rapid depressurization provides the driving force for fission product escape. (5)

1.24 General Emergency

The occurrence of an event or events which involve actual or imminent substantial core degradation or melting with the potential for loss of containment integrity. Radioactive releases may exceed the EPA levels for more than the immediate site area. (1)

1.25 Implementing Instructions

Those detailed procedures which provide guidance to individuals and groups for implementation of the provisions of this plan.

1.26 Joint Public Information Center (JPIC)

A specifically designated offsite location and point of contact for the dissemination of information to the news media during an emergency by Company, Federal, State and Local officials.

1.27 Loss

Unless defined by specific Emergency Action Level (EAL) indications, loss shall be defined as a state of inoperability in which functional and operable status cannot be maintained. A system, subsystem, train, component or device is not lost if its functionality is assured.

1.28 Offsite

Any area outside the Owner-Controlled Area fence surrounding the Perry Plant.

1.29 Offsite Assembly

Evacuation of onsite personnel to designated locations offsite for the purpose of performing personnel accountability or further personnel contamination monitoring.

1.30 Onsite

The area within the Owner-Controlled Area fence surrounding the Perry Plant.

1.31 Onsite Assembly

Evacuation of personnel from areas within the plant that would be required for any emergency situation with assembly at designated locations as directed by the Operations Manager.

1.32 Operable/Operability

A system, subsystem, division, component, or device shall be operable or have operability when it is capable of performing its specified safety function(s) and when all necessary attendant instrumentation, controls, normal or emergency electrical power, cooling and seal water, lubrication, and other auxiliary equipment that are required for the system, subsystem, division, component or device to perform its specified safety function(s) are also capable of performing their related support function(s). (6)

1.33 Operations Support Center (OSC)

The onsite location in close proximity to the Control Room and Technical Support Center (TSC) to which plant support personnel and other emergency response team personnel report and await instructions. The Operations Support Center (OSC) is located on the 599' level of the Control Complex.

1.34 Owner-Controlled Area

Areas owned by the FirstEnergy Corporation which are located within or adjacent to the Site Boundary security fence.

1.35 Personnel Monitoring Equipment

Devices designed to be worn or carried by an individual for the purpose of measuring the radiation dose received (e.g., direct reading dosimeters, thermoluminescent dosimeters etc.).

1.36 Plume Exposure Pathway

The means by which a radioactive cloud (plume) can expose the population at risk and/or onsite personnel to radiation. The time of potential exposure could range from hours to days. The principal exposure sources for this pathway are: (1,3)

1. Whole body external exposure to gamma radiation from the radioactive plume and from deposited material; and,
2. Inhalation exposure from the passing radioactive plume.

1.37 PNPP

Abbreviation for the Perry Nuclear Power Plant used throughout this document.

1.38 Population at Risk

Those persons for whom protective actions are being or would be taken. (1,7)

1.39 Projected Exposure Time (PET)

The estimated period of time that the population in the area surrounding the Perry Plant may be exposed to radiation as a result of an accidental airborne radioactive release. Projected exposure time starts when the airborne radioactivity release is estimated to cross the exclusion area, and ends when the radiation levels offsite are expected to return to normal. (4)

1.40 Protected Area

The area encompassing the Vital Areas, all areas inside the double perimeter barrier fence and the Primary Access Control Point (PACP). (8)

1.41 Protective Actions

Those emergency measures taken before or after an uncontrolled release of radioactive material has occurred for the purpose of preventing or minimizing radiological exposure to persons who would likely be exposed if the actions were not taken. (1,7)

1.42 Protective Action Guides (PAGs)

Projected radiological dose to individuals in the general population that warrant protective actions following a release of radioactive material. Protective actions would be warranted provided the reduction in individual dose is not offset by excessive risks to individual safety in taking the protective actions. The protective action guides (PAGs) do not include the dose that has unavoidably occurred prior to the assessment. (1,7)

1.43 Public Information Response Team (PIRT)

Selected staff of the Emergency Public Information Organization who are responsible for dissemination of information during a Perry Plant emergency. They are assigned emergency response duties during an emergency situation that does not require activation of the Joint Public Information Center (JPIC), during the initial stages of an emergency prior to operation of the JPIC, or during the recovery of an emergency after deactivation of JPIC.

1.44 Radiological Restricted Area (RRA)

Any area to which access is limited by the licensee for purposes of protecting individuals against undue risks from exposure to radiation and radioactive materials. All areas accessible to individuals, in which radiation levels could result in an individual receiving a dose that is greater than or equal to 0.5 mrem (0.005 mSv) in 1 hour measured 30 centimeters from the radiation source or from any surface that the radiation penetrates. (2)

1.45 Recovery Actions

Those actions taken after an emergency to restore the plant as nearly as possible to pre-emergency conditions. (1)

1.46 Reentry Actions

The return to an evacuated area, in either the plant or site, for such actions as search and rescue, first aid, fire fighting, manipulation or repair of critical equipment or systems, and to assess conditions in preparation for recovery operations.

1.47 Secondary Alarm Station (SAS)

The continuously manned security station where most initial offsite and Emergency Response Organization (ERO) personnel notifications are conducted, and fire alarms annunciate. The Secondary Alarm Station (SAS) is located in the Unit 1 Control Room.

-1.48 Site Boundary

The area within the Owner-Controlled Area which is encompassed by a security fence surrounding the Perry Plant. (8)

1.49 Site Area Emergency

The occurrence of an event or events which involve actual or likely major failures of plant functions needed for the protection of the public. The potential for a situation hazardous to the general public is the major concern of the Site Area Emergency classification. Radioactive releases are not expected to exceed the EPA protective action guideline levels except within the Site Boundary. (1)

1.50 System Control Center (SCC)

The Off-site facility located in Wadsworth, Ohio, which controls and coordinates the generation and transmission within the FirstEnergy Corporation

1.51 State

The State of Ohio.

1.52 Technical Support Center (TSC)

The onsite location which will serve as the focal point for gathering information on current and projected plant status and for the orderly implementation of emergency procedures in support of reactor command and control functions. The TSC is located on the 603'6" level of the Service Building.

1.53 Technical Support Guidelines (TSGs)

Provide a method for supporting and optimizing the accident management strategies contained in the generic Emergency Procedure Guidelines/Severe Accident Guidelines (EPGs/SAGs). The TSGs describe enhancements to technical activities performed by the ERO, and consist of the following four inter-related assessments: control parameter, plant status, system status, and EPG/SAG action.

1.54 Total Effective Dose Equivalent (TEDE)

The sum of DDE (external dose) and CEDE (internal dose). For dose assessment purposes, DDE is considered the whole body dose in accordance with NUMARC "White Paper: Implementation of the New EPA Protective Action Guides in Existing Emergency Programs, April 1993."

1.55 Unrestricted Area

Any area, to which access is not controlled by FirstEnergy Corporation, for purposes of protection of individuals from exposure to radiation and radioactive materials.

1.56 Unusual Event

The occurrence of an event or events which indicate a potential degradation of the level of safety of the plant. Unusual Event emergencies involve minor situations that have the potential to escalate to more serious emergencies. No releases of radioactive material requiring offsite response or monitoring are expected unless further degradation of safety systems occur. The Unusual Event classification corresponds to the Notification of Unusual Event classification specified in federal guidance. (1)

FOOTNOTE REFERENCES FOR DEFINITIONS:

- 1 NUREG-0654/FEMA-REP-1, Criteria for Preparation and Evaluation of Radiological Emergency Response Plans and Preparedness in Support of Nuclear Power Plants, November 1980.
- 2 Plant Administrative Procedure, (PAP) 0114, Radiation Protection Program.
- 3 NUREG-0396 (EPA 520/1-78-016), Planning Basis for the Development of State and Local Government Radiological Emergency Response Plans in Support of Light Water Nuclear Power Plants, NRC/EPA, December 1979.
- 4 Plan for Response to Radiation Emergencies at Licensed Nuclear Facilities, State of Ohio.
- 5 NUREG/CR-2925; SAND 82-2004, In-Plant Considerations for Optional Offsite Response to Reactor Accidents, November 1982.

FOOTNOTE REFERENCES FOR DEFINITIONS (Cont.):

- 6 Technical Specifications, Perry Nuclear Power Plant, Unit No. 1 (Docket No. 50-440). Appendix "A" to License No. NPF-58.
- 7 BWR Owners' Group Accident Management Guidelines (AMG) Overview Document.
- 8 EPA-400-R-92-001, Manual of Protective Action Guides and Protective Actions for Nuclear Incidents.
- 9 Perry Plant Security Plan.

2.0 SCOPE AND APPLICABILITY

This plan is written for, and the provisions are applicable to, the Perry Plant Unit 1.

2.1 Site Description

The Perry Plant, Unit 1, is located on the southeastern shoreline of Lake Erie in Lake County, Ohio, approximately seven miles northeast of Painesville, Ohio. FirstEnergy Corporation is responsible for the operation of the plant.

The Perry Plant, Unit 1 is a (3758 MWt) Boiling Water Reactor (BWR) of the General Electric Company design, supplying steam to a General Electric turbine generator.

The plant site covers approximately 1100 acres located on an ancient lake plain approximately 50 feet above the lake low water datum. Although relatively flat, the site has a very gentle slope toward the lake. A large portion of the site is forested, some 250 acres are devoted to the plant structural complex. A comprehensive description of site characteristics and plant location is contained in Chapter 2.0 of the Updated Safety Analysis Report (USAR) for the Perry Nuclear Power Plant.

The primary source of potable water in the area is Lake Erie. The nearest potable water intake is the Painesville Water Supply, approximately 3.9 miles west-southwest of the site.

2.2 Population Distribution

The population in the area surrounding Perry Plant is distributed from the northeast around to the west southwest. Preparedness Support Instruction (PSI) 0013 provides a breakdown of the total permanent resident population within 10-mile EPZ of the plant, and contains the Evacuation Time Estimates (ETE) for areas around the Perry Plant and discusses population distributions in detail.

2.3 Emergency Planning Zones <P00058>

Emergency planning zones (EPZs) are areas designated for which planning is recommended to assure that prompt and effective actions are taken to protect the public in the event of an accident.

Two primary zones have been established for the purposes of emergency planning around the Perry Plant. The first is the Plume Exposure Pathway EPZ. This zone, commonly referred to as the "10-mile EPZ," encompasses an area roughly corresponding to the area within a 10-mile radius of the Perry Plant. In defining the 10-mile EPZ for the Perry Plant, the following criteria were applied:

1. The designated area must approximate the recommended 10-mile radius area as specified in Federal regulations.

2. The designated area must be readily identifiable and comprehensible to allow for effective public broadcasting of information and guidance during an emergency event requiring area evacuation.
3. The perimeter of the designated evaluation area should not have major irregularities to maintain a credible area boundary.

The 10-mile EPZ around the Perry Plant encompasses land areas in Ashtabula, Geauga and Lake Counties, and a defined "safety" zone extending north into Lake Erie. A total of 17 municipal jurisdictions are situated wholly or partially within the 10-mile radius area. Of primary concern in the 10-mile EPZ is direct exposure to a passing radioactive plume and inhalation of radioactive particulate materials. The protective actions for the 10-mile EPZ are discussed in Section 6.4. A review of the topographic conditions and jurisdictional boundaries in the area surrounding the Perry Plant has led to the definition of the EPZ as depicted in Figure 2-1, and described below. <E00058>

The eastern EPZ boundary follows the Geneva Township boundary south to Interstate 90, and west on I-90 to Route 534. It follows Route 534 south to the Harpersfield Township boundary and continues west to the Geauga/Ashtabula County line. At this point it follows the county line south to Route 166, and west on Route 166 to the county line. The EPZ boundary continues west along the county line to the Concord Township western boundary. From there it follows township line northward to the intersection with the Con Rail tracks, cross-country to Mentor Marsh, and then continues west through the marsh to Lake Erie. The EPZ extends into Lake Erie due north from the south shore at the 81° 20' West longitude; then easterly along the 41° 57' North latitude; and finally extends due south along the 80° 56' W longitude to the shoreline.

The second EPZ extends to a 50-mile radius of the Perry Plant. This zone, also known as the Ingestion Pathway EPZ, is shown in Figure 2-2. Once exceeding the 10-mile radius, direct exposure to a passing plume is no longer of significant concern. At this point, the ingestion pathway of exposure is of greatest concern. The State of Ohio has assumed primary responsibility for planning, coordination and implementation of protective actions for the general public within the Ingestion Pathway EPZ. The primary emphasis in the Ingestion Pathway EPZ is on the prevention of uptake by people and animals. Protective Actions for the Ingestion Pathway EPZ are discussed in Section 6.4.3 and in the State of Ohio Nuclear Power Plant Emergency Response Plan.

2.4 Purpose and Objectives

2.4.1 Regulatory Requirements

Section 50.34 to Title 10 of the Code of Federal Regulations (10CFR50.34) "Technical Information, Licensing of Production and Utilization Facilities," requires that a Licensee's Updated Safety Analysis Report (USAR) include specific plans for coping with emergencies which shall include the items specified in Appendix E to Part 50.

Supplemental guidance has been provided by the Nuclear Regulatory Commission (NRC) and the Federal Emergency Management Agency (FEMA) in NUREG-0654/FEMA-REP-1.

These documents describe methods acceptable for compliance with regulations regarding nuclear power plant emergency plans.

2.4.2 Purpose of Emergency Preparedness

The purpose of emergency preparedness is to provide a mechanism that would be utilized in making decisions in the event of an emergency, and to assure that the necessary equipment, supplies, and essential services are available.

2.4.3 Objectives of the Emergency Plan

The objectives of the Emergency Plan are as follows:

1. Outline an effective course of action to safeguard the public and plant personnel in the event of an emergency.
2. To establish an emergency organization and assign responsibilities in order to direct the response to an emergency condition or radiological incident and to limit the consequences of the incident.
3. Terminate or mitigate the radiological consequences of an emergency, both onsite and offsite.
4. Control onsite and offsite surveillance activities to include notifications and coordination of offsite supporting organizations as required.
5. To establish procedures to identify and classify the emergency condition.
6. Evaluate the necessity for public protective actions and implement any protective actions deemed appropriate to protect members of the general public and the plant staff.
7. Provide for the training of all emergency plan personnel.
8. To describe emergency facilities and communication systems available and their utilization by emergency personnel and organizations.
9. Describe an organization to direct and perform recovery and reentry operations.

2.5 Summary of Emergency Plan Inter-Relationships

This Emergency Plan should not, by itself, be considered the primary working document to be used during an emergency. The purpose of the Emergency Plan is to classify emergencies according to their nature and severity, assign responsibilities for actions, and clearly outline an effective course of action to safeguard the public and plant personnel in the event of an emergency.

Inter-relationships of this plan with procedures, other plans, and emergency arrangements are summarized as follows:

- 2.5.1 Detailed actions to be taken by individuals in response to onsite emergency conditions at the time of an event are directed by the Emergency Plan Implementing Instructions (EPIs). These instructions provide the detailed mechanisms for response as outlined in this plan. EPIs do not cover program administration or normal activities already covered by other plant procedures. As such, EPIs will only incorporate certain aspects of the plant's operating procedures, radiological control procedures, and security procedures, where clarification of the instructions is required.
- The listing of EPIs, contained in Appendix A, shall be considered implementing procedures in accordance with 10 CFR 50, Appendix E.V. Any changes to these instructions shall be submitted to the NRC within 30 days of implementation.
- 2.5.2 The Security Plan and procedures have been coordinated with this plan to ensure that appropriate emergency actions can be taken. For example, the Security Plan and procedures contain provisions for emergency response personnel and vehicle access when required by the EPIs.
- 2.5.3 The Plant Administrative Procedures (PAPs) define administrative controls such as radiological control limits and precautions, use of personnel monitoring devices, use of protective clothing and equipment, and personnel decontamination. Chemistry instructions govern counting of samples in lab. In addition, Health Physics Instructions provide guidance for performing surveys, analyzing samples, operating health physics/radiation protection equipment, etc. The relevant information and details provided in these documents have either been incorporated in the plan and/or implementing procedures, or have been appropriately referenced.
- 2.5.4 The Emergency Public Information Organization Instructions Manual (EPIOIM) and this plan are coordinated to ensure that a mechanism is in place to provide accurate and timely information to the public via the news media. The EPIOIM provides a means for exchanging information between each participating agency's spokesperson and for rumor control during emergencies.
- 2.5.5 The Preparedness Support Instructions (PSIs) provide administrative guidance on: (1) the conduct of emergency preparedness drills and exercises, and (2) the maintenance of emergency response facilities and equipment, and (3) the administration of the Emergency Preparedness Program. PSIs do not direct the implementation of any emergency actions in response to a classified emergency event. A listing of PSIs is provided in Appendix A.
- 2.5.6 Other plant procedures have been developed and issued to provide further guidance in various other areas affecting this plan. A listing of such procedures is provided in Appendix A.

2.5.7 The coordination and liaison with offsite organizations and agencies having radiological emergency planning responsibilities in the immediate offsite area. This includes formal agreements that individual organizations will perform their respective emergency functions in response to information or requests. Continuing liaison with the offsite organizations ensures compatibility and proper interfacing with this plan.

2.6 Participating Governmental Agencies

Participating governmental agencies whose emergency plans are inter-related with this plan include the following:

1. State of Ohio, Plan for Response to Radiation Emergencies at Licensed Nuclear Facilities.
2. Ashtabula County, Radiological Emergency Response Plan.
3. Geauga County, Radiological Emergency Response Plan.
4. Lake County Radiological Emergency Response Plan for the Perry Nuclear Power Plant, Annex M Appendix 2 - Radiological Protection.
5. U.S. Nuclear Regulatory Commission, Response Coordination Manual (RCM).
6. Pennsylvania Emergency Management Agency (PEMA), Commonwealth of Pennsylvania Disaster Operations Plan, Annex E, "Fixed Nuclear Facility Incidents".
7. Captain of the Port, Cleveland; Contingency Plan for the Perry Nuclear Power Plant.

LEGEND:

- EPZ/Subarea Boundary
- 7 Subarea Designator
- N Sector Designator
- A2 Grid Sector Coordinate


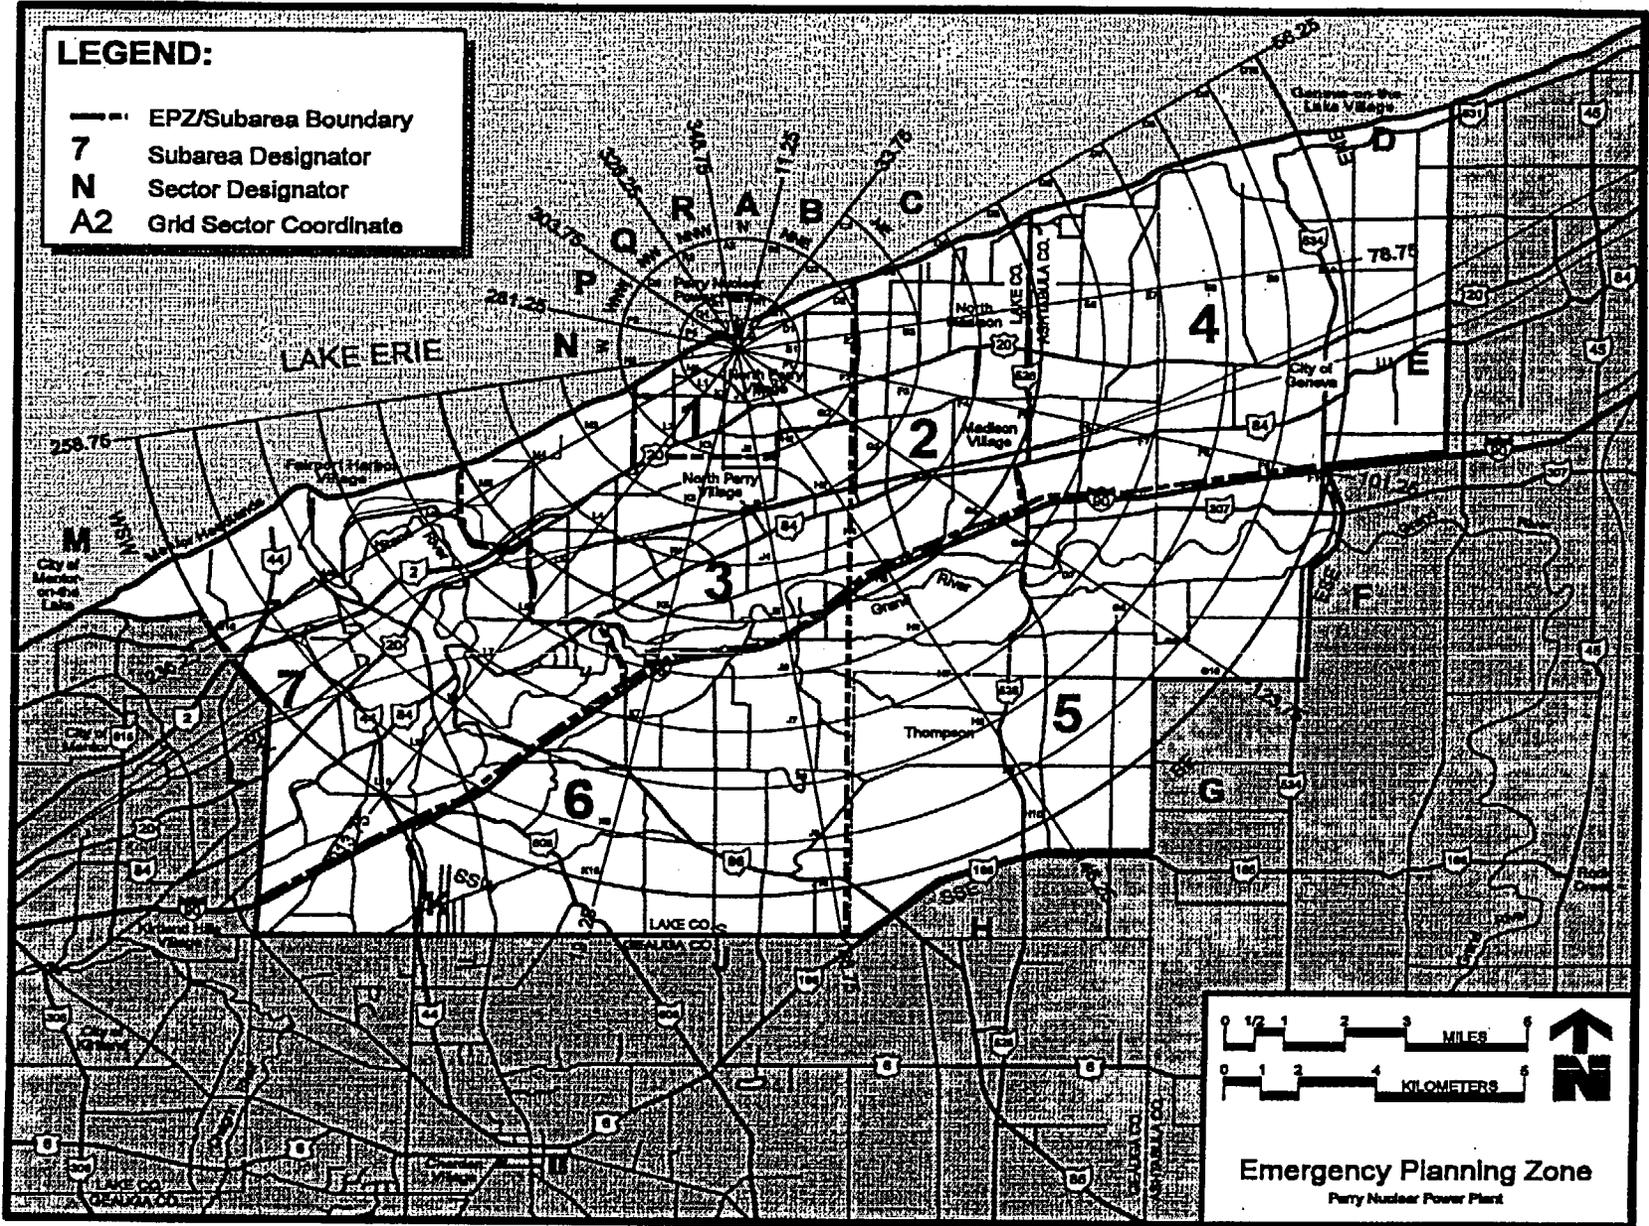


FIGURE 2-1 - 10-MILE EMERGENCY PLANNING ZONE

FIGURE 2-2 - 50-MILE EMERGENCY PLANNING ZONE

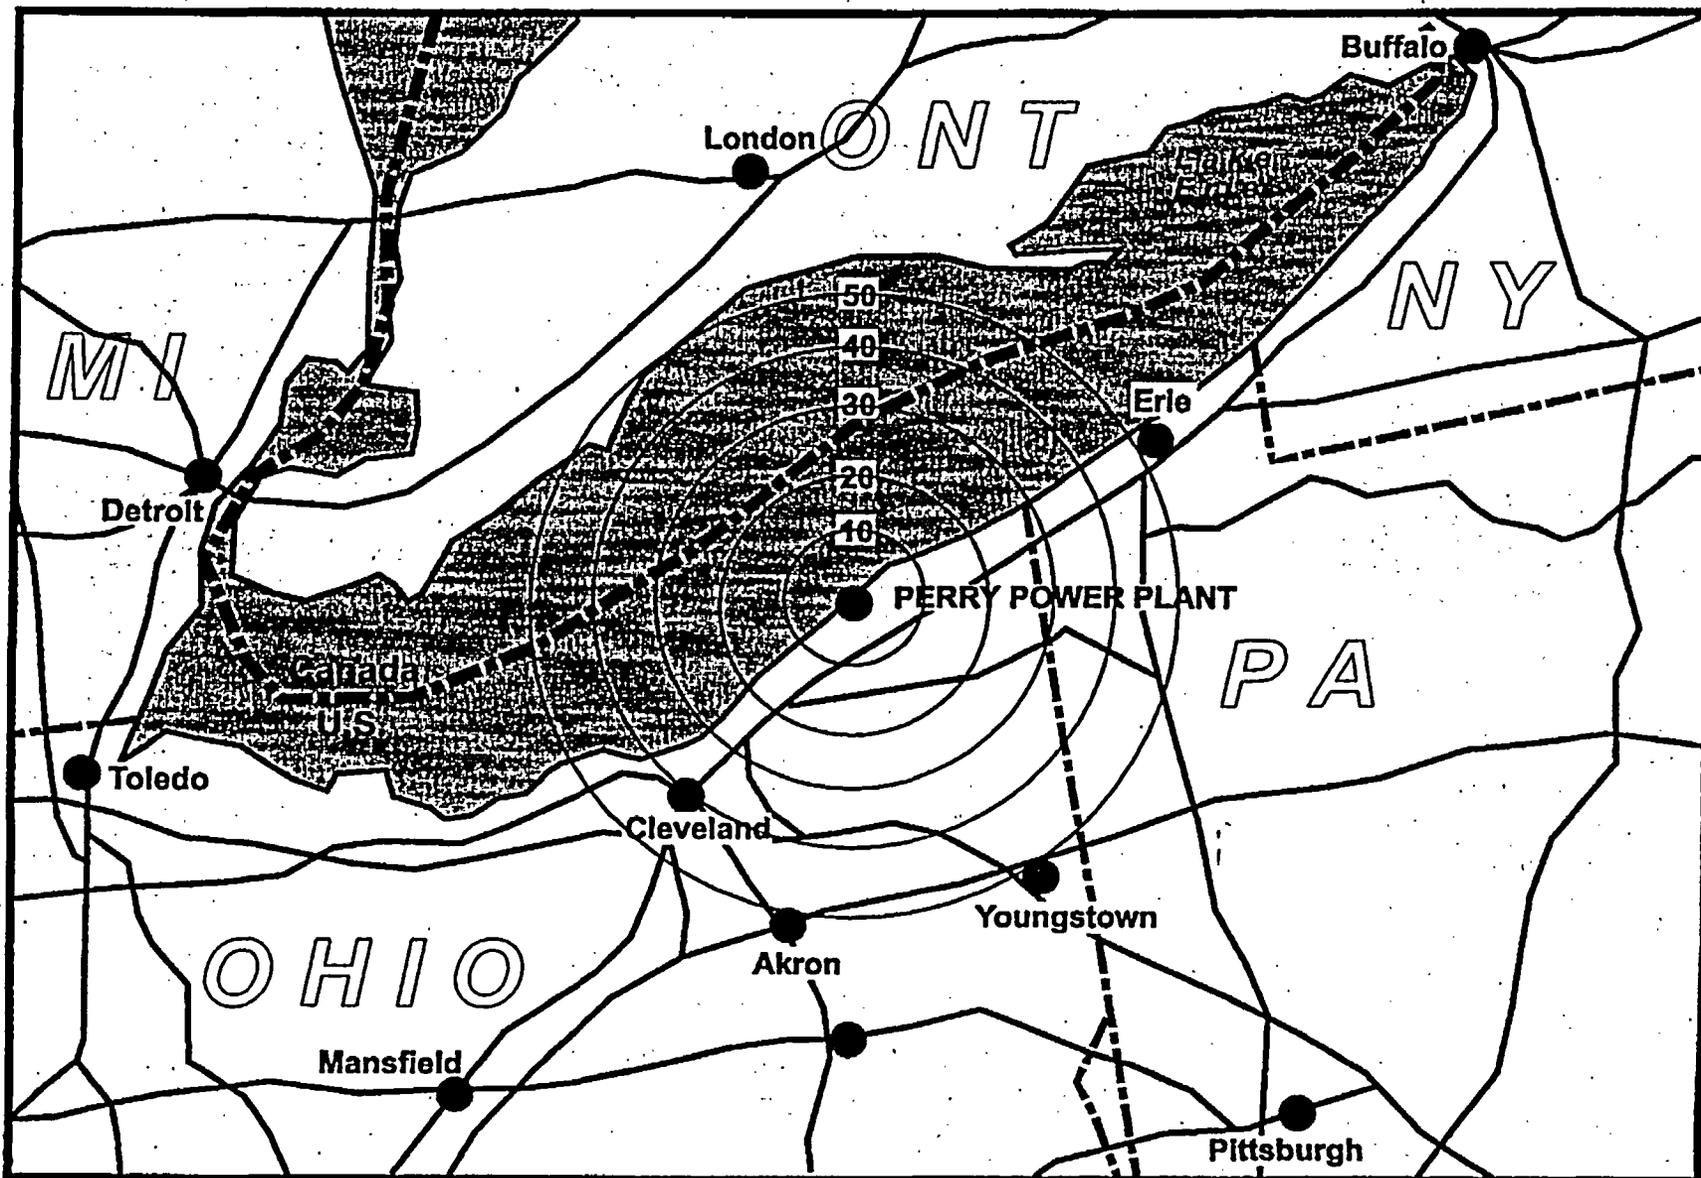

50-Mile Emergency Planning Zone

2/00

3.0 SUMMARY OF THE EMERGENCY PLAN

The Emergency Plan and EPIs have been established for coping with the various types of possible emergencies in an orderly, effective manner.

The Emergency Plan will be put into effect whenever a potentially hazardous situation or radiological emergency is identified. The information contained within the Emergency Plan is sufficient to demonstrate that appropriate actions will be taken to protect plant personnel and the general public during an emergency.

The Emergency Plan establishes the concepts, evaluation, assessment criteria, and protective actions, necessary to mitigate the consequences of potential or actual emergencies. The plan provides the necessary prearrangements, organization, and communications so that all plant emergencies may be handled effectively and efficiently resolved in order to safeguard plant personnel, property and the general public.

3.1 Emergency Plan Steps

In general, the Emergency Plan encompasses the following basic steps:

1. Detection of the emergency
2. Assessment of the situation
3. Classification of the emergency
4. Activation of the responding organization(s) as necessary
5. Notification of offsite response organizations
6. Initiation of protective action recommendations
7. Initiation of corrective actions
8. Aid to affected persons
9. Reentry and recovery

3.2 Emergency Organizations

This Emergency Plan establishes an organization capable of responding to the complete spectrum of incidents delineated in this Emergency Plan. Provisions are made for rapid notification of appropriate portions of the response organization and for expanding the response organization if the situation dictates.

An individual having the authority and the responsibility to initiate any emergency actions within the provisions of this plan, including providing protective action recommendations to offsite authorities is onsite at all times. This individual is the Shift Manager, who initially assumes the position of Emergency Coordinator and remains in that position until relieved by the Operations Manager in the Technical Support Center (TSC). The Shift Engineer assists the Shift Manager in reviewing dose projections and protective action recommendations developed by a Shift Chemistry Technician.

Emergency actions are the responsibility of the operating shift staff, who are supplemented by additional pre-assigned plant staff personnel which are rapidly alerted and mobilized to augment or relieve the operating shift personnel in accordance with the implementing instructions of this plan.

In addition, this plan includes offsite agencies and organizations. Their designated response functions include implementation of offsite protective actions, transportation and treatment of personnel requiring medical treatment, control of access to the plant, fire fighting support, radiological sampling and assessment, technical consultation, and testing. The major offsite agencies and organizations include the following:

3.2.1 State of Ohio

The Ohio Emergency Management Agency (OEMA), Department of Public Safety, is the lead planning agency for developing state nuclear incident plans for licensed nuclear facilities contiguous to and within the State. The specific tasks and responsibilities assigned to departments and agencies of the State of Ohio are specified in the State of Ohio's Plan for Response to Radiation Emergencies at Licensed Nuclear Facilities. Coordination with the Pennsylvania Emergency Management Agency for ingestion pathway control measures is also provided by the State of Ohio.

3.2.2 Local Governments

The actions of the local governments are delineated in the Local County Radiological Emergency Response Plans. The Emergency Management Agencies (EMA) for Ashtabula, Lake Counties, and Department of Emergency Service (DES) for Geauga County, are the lead planners and response agencies for each of the local counties.

3.2.3 Federal Agencies

1. U.S. Nuclear Regulatory Commission (NRC), Region III, Lisle, Illinois.
2. U.S. Department of Energy, Chicago Operations Office, Argonne, Illinois.
3. U.S. Coast Guard, Ninth Coast Guard District, Cleveland, Ohio.

3.3 Emergency Classifications

Emergencies are grouped into four (4) classifications listed below in order of increasing severity:

1. Unusual Event

The occurrence of an event or events which indicate a potential degradation of the level of safety of the plant. Unusual Event emergencies involve minor situations that have the potential to escalate to more serious emergencies. No releases of radioactive material requiring offsite response or monitoring are expected unless further degradation of safety systems occur. The Unusual Event classification corresponds to the Notification of Unusual Event classification specified in Federal guidance.

2. Alert

The occurrence of an event or events which involve an actual or potential substantial degradation of the level of safety of the plant. The consideration is to prepare to cope with potentially more serious emergencies. Any radioactive releases are expected to be limited to a small fraction of the EPA Protective Action Guideline exposure levels.

3. Site Area Emergency

The occurrence of an event or events which involve actual or likely major failures of plant functions needed for protection of the public. The potential for a situation hazardous to the general public is the major concern of the Site Area Emergency classification. Radioactive releases are not expected to exceed the EPA Protective Action Guideline exposure levels except within the site boundary.

4. General Emergency

The occurrence of an event or events which involve actual or imminent core degradation or melting with the potential for loss of containment integrity. Radioactive releases may exceed the EPA Protective Action Guideline exposure levels offsite for more than the immediate site area.

Section 4.0 contains a more detailed discussion of the classifications of emergencies. Table 3-1 shows, in columnar form, the emergency classifications and the degree of involvement of onsite and offsite organizations.

TABLE 3-1

EMERGENCY CLASSIFICATIONS AND THE DEGREE OF INVOLVEMENT
BY PARTICIPATING GROUPS

Emergency Classification	Necessity for Protective Actions		Necessity for Corrective Actions (3)	Degree of Participation by Various Organizations	
	Onsite	Offsite		FirstEnergy	Offsite Agencies
Unusual Event	None	None	Possible	Notification(1)	Notification(1)
Alert	Possible	None	Possible	Standby(2)	Standby(2)
Site Area Emergency	Probable	Possible	Probable	Action	Action
General Emergency	Probable	Probable	Probable	Action	Action

- NOTES:
1. Notification: Organizations informed of situation onsite.
 2. Standby: Organization staffs preplanned centers, establishes communications, and assembles emergency teams.
 3. Actions may include local fire support, ambulance service, medical assistance, or radiological assessment.

4.0 EMERGENCY CONDITIONS

4:1 Emergency Classification System <S00559>

The Perry Plant Emergency Plan provides for four (4) emergency classifications. A broad spectrum of postulated emergency situations is covered in mutually exclusive groupings. Each emergency classification invokes certain immediate actions which are explained in Section 6.0. The various classifications are arranged in a hierarchy of severity based on potential or actual hazards. Accidents may be classified in a lower category at first and then escalated to a higher classification should the situation deteriorate. Provisions are also made for de-escalation to a lower classification in certain situations as improved conditions may justify.

All emergency measures begin with the notification of the Shift Manager that a real or potential hazard exists. This is followed by assessment and evaluation by the Shift Manager, classification of the emergency, and activation of the appropriate emergency organizations.

The specific Emergency Action Levels (EALs) described in this section are not intended to be all inclusive. The Shift Manager, while acting as Emergency Coordinator, shall declare an appropriate emergency classification whenever, in his judgment, the plant status warrants such a declaration.

Each of the four (4) emergency classifications is characterized by EALs - see Figure 4-1. These levels consist of specific sets of plant parameters (i.e., instrument indications, system status, etc.) that shall be used for emergency classification. Specific readings and/or other indications which could possibly identify an emergency initiating condition are provided in Table 4-1. The format and wording of Table 4-1 are taken directly from EPI-A1.

The values shown in Table 4-1 are those at which an event must be classified in accordance with the guidance set forth in NUMARC/NESP-007, Methodology for the Development of Emergency Action Levels (Revision 2). Reaching these values, with valid indications in short periods of time, is sufficient to declare the appropriate classification. Some described are not, by their very nature, intended to be used during maintenance and/or testing situations.

A 15-minute goal has been established for assessing and classifying an emergency once indications are available to Control Room operators that an EAL has been exceeded.

Applicable Plant Emergency Instructions (PEIs), Off-Normal Instructions (ONIs), and Alarm Response Instructions (ARIs) are cross referenced at various steps to alert the operator that a specific emergency action level may be or has been reached. EALs are referenced in those instructions to ensure that the emergency is properly classified for the particular plant condition.

A conservative philosophy for classification is used. For example, a Site Area Emergency is declared directly if a Site Area EAL is exceeded, without other related events being previously identified and declared as an Unusual Event or an Alert.

EALs are used specifically to provide an early readiness status of emergency response personnel and organizations. The EALs have not been selected to infer any immediate need for protective actions, but rather to provide adequate time for assessment measures. Offsite dose projections, plant status assessments, and protective action recommendations are reported to the local County officials as inputs to their decision on whether or not protective actions for the public are to be implemented.

4.1.1 Unusual Event

An Unusual Event is the least severe of the four (4) emergency classifications defined in this plan. An Unusual Event is defined as the occurrence of an event or events that indicate or allow recognition of a potential degradation of the level of safety of the plant. The purposes for declaring an Unusual Event classification are to:

1. Ensure that the first step in any response is carried out.
2. Provide current information on Unusual Events to offsite authorities.
3. Bring the operating staff to a state of readiness.
4. Provide for the systematic handling of information and decision making.

An incident is classified as an Unusual Event if it is minor and no release of radioactive material requiring offsite response or monitoring is expected with no further degradation of safety systems. Events in this classification are selected based upon a potential to degenerate to a more severe situation rather than on the likelihood that an actual public hazard exists. Local county and State of Ohio authorities are promptly notified of any Unusual Event.

4.1.2 Alert

An Alert is the occurrence of an event or a series of events that indicate and allow recognition of an actual or potential substantial degradation of the level of safety of the plant. As in the case of the Unusual Event, the Alert classification includes emergency situations that are expected to be minor but where it has been deemed prudent to alert the offsite emergency participants and mobilize portions of the emergency organization. Any radioactive releases are expected to be limited to small fractions of the EPA Protective Action Guideline exposure levels.

The purposes of declaring an Alert classification are to:

1. Ensure that emergency personnel are readily available to respond if the situation becomes more serious;
2. Perform confirmatory radiation monitoring if required; and
3. Provide offsite authorities with current information.

In addition, because of the nature of the Alert classification, i.e., possible releases of radioactive material, broader assessment actions shall be initiated as described in Section 6.2.2.

4.1.3 Site Area Emergency

The Site Area Emergency classification includes events in which actual or likely major failures of plant functions needed for protection of the public have occurred. The purposes for declaring a Site Area Emergency are to:

1. Ensure that response centers are manned;
2. Ensure that the radiation monitoring teams (RMTs) are dispatched both onsite and offsite;
3. Ensure that personnel required for evacuation of offsite areas are available should the situation become more serious; and
4. Provide current information for, and consultation with, offsite authorities.

Although immediate protective actions are not automatically required, declaration of a Site Area Emergency sets into motion all personnel onsite and offsite that would be required to perform actions up to and including the evacuation of offsite areas. RMTs are required to make continuing assessments to provide officials with information to decide on protective actions. The Site Area Emergency classification includes accidents which have significant radioactive material release potential. Details of the emergency measures that will be implemented upon declaration of a Site Area Emergency are described in Section 6.0.

No radioactive releases are expected to exceed the EPA Protective Action Guideline exposure levels except within the site boundary. Accidents included in this classification have the potential for degradation to the General Emergency classification. Although the EALs for this classification have been selected at values well below the EPA PAGs, offsite monitoring team reports and continuing assessment actions will provide information for the final decision on protective actions to be taken.

4.1.4 General Emergency

This is the most severe classification of emergency defined by this Emergency Plan. The General Emergency classification covers accident sequences which involve actual or imminent substantial core degradation or melting with the potential for a large release of radioactive material and/or loss of containment integrity, and any other conditions that have large radioactive material release potential. The purposes for declaring a General Emergency are to:

1. Initiate predetermined protective action recommendations for the public;
2. Provide continuous assessment of information from PNPP and offsite radiological monitoring groups;
3. Initiate additional measures within the entire EPZ as indicated by actual or potential releases of radioactive material; and
4. Provide current information for, and consultation with, offsite authorities and the public.

The EALs identified for a General Emergency indicate that time should be available to provide confirmative assessments (as detailed in the EPI's) prior to implementation of extensive protective actions for the entire EPZ. However, the EPI's provide that immediately upon declaration of a General Emergency, the Emergency Coordinator will recommend, as a precautionary measure the following: evacuation for the general public within 2 miles of the plant, and in at least three downwind sectors out to 5 miles, as appropriate for Subareas 1 through 3 and Lake Erie, as identified on Figure 2-1. This protective action is consistent with the guidance outlined in Supplement 3 to NUREG-0654/FEMA-REP-1. <S00541>

Assessment actions, as described in Section 6.2 of the Emergency Plan and in the EPIs will continue to determine what additional protective actions should be recommended for the remainder of the EPZ. As described in Section 6.4, possible protective action recommendations may range from no action necessary, to the evacuation of the entire 10-mile EPZ.

4.2 State and County Classification System

The emergency classification scheme, as described in the preceding Section 4.1 and as set forth in NUMARC/NESP-007, have been discussed with and agreed on by the State of Ohio and local counties. To provide guidance for public protection, the PAGs of the "Manual of Protective Action Guides and Protective Actions for Nuclear Incidents" (EPA-400-R-92-001) have also been adopted by the State of Ohio and the local Counties.

Recommendations from the Perry Plant to the State of Ohio and the local Counties will be based on these same PAGs as discussed in Section 6.0 of this plan.

Standard Operating Procedures (SOPs) for the State of Ohio and county organizations will be utilized to determine protective actions based on the Perry Plant recommendations. Per the Ohio Plan for Response to Radiation Emergencies at Licensed Nuclear Facilities, a Site Area Emergency has been established as the minimum classification level to initiate waterway notification in coordination with affected counties.

(INTENTIONALLY BLANK)

FIGURE 4-1

INITIATING CONDITION INDEX

PNPP No. 8851 Rev. 11/20/00		EPLAN		
EVENT CATEGORY	UNUSUAL EVENT	ALERT	SITE AREA EMERGENCY	GENERAL EMERGENCY
A: FISSION PRODUCT BARRIER DEGRADATION	Fuel clad degradation AU1	Any loss or challenge to the Fuel Clad barrier. (PPB Matrix) - AA1	Loss of RPV water level that has or will uncover fuel. AB1	Loss of two barriers, AND a loss or challenge to the third barrier. (PPB Matrix) - AG1
	Reactor Coolant System leakage. AU2	Any loss or challenge to the Reactor Coolant System barrier. (PPB Matrix) - AA2	Either a challenge or loss of both the Fuel Clad barrier AND Reactor Coolant System barrier. (PPB Matrix) - AB2	
	Any loss or challenge to the Containment barrier. (PPB Matrix) - AU3		Challenge to either the Fuel Clad barrier OR Reactor Coolant System barrier, AND the loss of any additional barrier. (PPB Matrix) - AB3	
B: LOSS OF DECAY HEAT REMOVAL FUNCTIONS	NOT APPLICABLE	Inability to maintain plant in COLD SHUTDOWN BA1	Complete loss of functions needed to achieve COLD SHUTDOWN BB1	NOT APPLICABLE
C: LOSS OF SHUTDOWN FUNCTIONS OR FAILURE TO SHUTDOWN	Inability to reach required shutdown within Technical Specification limits CU1	Failure to initiate or complete an automatic Reactor Scram once an RPS function is required. CA1	Failure to initiate or complete an automatic Reactor Scram once an RPS function is required, AND a manual Scram was NOT successful. CB1	Failure to initiate or complete a successful shutdown, AND indication of an extreme challenge to the ability to cool the core. CD1
D: A.C. POWER LOSS	Loss of all offsite power to Division 1 and 2 EH Essential Busses for greater than 15 minutes. DU1	Power capability to Division 1 and 2 EH Essential Busses reduced to a single power source for greater than 15 minutes, such that any additional single failure would result in a Station Blackout. DA1	Loss of all offsite power AND onsite power to Division 1 and 2 EH Essential Busses for greater than 15 minutes. DB1	Prolonged loss of all offsite power AND onsite power to Division 1 and 2 EH Essential Busses, AND continuing degradation of core cooling capability. DD1
		Loss of all offsite power AND onsite power to Division 1 and 2 EH Essential Busses for greater than 15 minutes. DA2		
E: D.C. POWER DEGRADATION	Degradation of Division 1 and 2 essential DC power for greater than 15 minutes. EU1	NOT APPLICABLE	Degradation of Division 1 and 2 essential DC power for greater than 15 minutes. EB1	NOT APPLICABLE
F: FIRE OR EXPLOSION	Fire within a Safe Shutdown Building NOT extinguished within 15 minutes. FU1	Fire OR explosion affecting the operability of plant safety systems required to establish or maintain safe shutdown.	NOT APPLICABLE	NOT APPLICABLE
	Explosion affecting a Safe Shutdown Building. FU2	FA1		
G: INCREASED PLANT RADIATION LEVEL	Unexpected increase in plant radiation levels. GU1	Increase in radiation levels within Safe Shutdown Buildings that impede operation of systems required to maintain safe operations OR to establish or maintain COLD SHUTDOWN. GA1	NOT APPLICABLE	NOT APPLICABLE
	Uncontrolled fuel pool water level decrease with irradiated fuel outside the RPV remaining covered. GU2	Major damage to irradiated fuel. GA2		
H: INCREASED RADIATION RELEASE TO THE ENVIRONMENT	Any unplanned release of gaseous radioactivity to the environment that exceeds two times the DDCM Control Limit for 60 minutes or greater. HU1	Any unplanned release of gaseous radioactivity to the environment that exceeds 200 times the DDCM Control Limit for 15 minutes or greater. HA1	Site Boundary dose resulting from an actual or imminent release of gaseous radioactivity that exceeds 100 mrem TEDE OR 5000 mrem CDE Child Thyroid dose for the actual OR projected duration of the release. HB1	Site Boundary dose resulting from an actual or imminent release of gaseous radioactivity that exceeds 1000 mrem TEDE OR 5000 mrem CDE Child Thyroid dose for the actual or projected duration of the release. HD1
	Any unplanned release of liquid radioactivity to the environment that exceeds two times the DDCM Control Limit for 60 minutes or greater. HU2	Any unplanned release of liquid radioactivity to the environment that exceeds 200 times the DDCM Control Limit for 15 minutes or greater. HA2		
I: CONTROL ROOM EVACUATION	NOT APPLICABLE	Control Room Evacuation has been initiated. IA1	Control Room evacuation has been initiated, AND plant control CANNOT be established within 15 minutes. IB1	NOT APPLICABLE
J: LOSS OF ANNUNCIATORS OR INDICATIONS	Loss of most annunciators or indication in the Control Room for greater than 15 minutes. U1	Loss of most annunciators or indication in the Control Room with either: (1) a significant transient in progress; OR (2) compensatory indications are NOT available. JA1	Inability to monitor a significant transient in progress. JB1	NOT APPLICABLE
K: LOSS OF COMMUNICATIONS	Loss of onsite OR in-plant communications capabilities. KU1	NOT APPLICABLE	NOT APPLICABLE	NOT APPLICABLE
	Significant degradation of offsite communications capabilities. KU2			
L: NATURAL OR DESTRUCTIVE PHENOMENA	Natural OR destructive phenomena affecting the Protected Area boundary. LU1	Natural OR destructive phenomena affecting Safe Shutdown Buildings. LA1	NOT APPLICABLE	NOT APPLICABLE
M: RELEASE OF TOXIC OR FLAMMABLE GAS	Release of toxic OR flammable gases affecting the Protected Area boundary deemed detrimental to the safe operation of the plant. MU1	Release of toxic OR flammable gases within a Safe Shutdown Building which jeopardize operation of systems required to maintain safe operations OR to establish or maintain COLD SHUTDOWN. MA1	NOT APPLICABLE	NOT APPLICABLE
N: SECURITY EVENTS	Confirmed security event which indicates a potential degradation in the level of safety of the plant. NU1	Security event in the plant Protected Area. NA1	Security event in a plant Vital Area. NB1	Security event resulting in loss of ability to reach and maintain COLD SHUTDOWN. ND1
O: EMERGENCY COORDINATOR'S JUDGEMENT	Other conditions existing, which in the judgement of the Emergency Coordinator, warrant declaration of an Unusual Event. OU1	Other conditions existing, which in the judgement of the Emergency Coordinator, warrant declaration of an Alert. OA1	Other conditions existing, which in the judgement of the Emergency Coordinator, warrant declaration of a Site Area Emergency. OB1	Other conditions existing, which in the judgement of the Emergency Coordinator, warrant declaration of a General Emergency. OD1

Rev. 15

X M U Z - 2 0 - 1 - 0 2 0 0 0 2 - 1 1 - 1 - 2 -

TABLE 4-1 - EMERGENCY ACTION LEVELS

6.1 Category A: Fission Product Barrier Degradation

Initiating Conditions	Entry Criteria						
<p align="center">AU1</p> <p align="center">Fuel clad degradation</p> <p>Applicable Modes:</p>	<p>High Off-Gas pretreatment air activity greater than the Technical Specification 3.7.5 limit.</p>	<p>Reactor Coolant System sample indicates activity greater than Technical Specification 3.4.8 limits</p>					
<table border="1"> <tr> <td align="center">1</td> <td align="center">2</td> <td align="center">3</td> <td align="center">4</td> <td align="center">5</td> </tr> </table>	1	2	3	4	5		
1	2	3	4	5			

<p><u>AU1</u></p> <p>U N U S U A L E V E N T</p>

NOTE

Fuel clad degradation is NOT an issue when the Reactor is defueled. Damage to fuel in spent fuel pools is addressed in GU1.

TABLE 4-1 - EMERGENCY ACTION LEVELS (Cont.)

6.1 Category A: Fission Product Barrier Degradation (Cont.)

Initiating Conditions						Entry Criteria		
AU2						Greater than 10 gpm unidentified leakage in Drywell.	Greater than 30 gpm total leakage in Drywell averaged over the previous 24 hour period.	Greater than 30 gpm total leakage in Drywell.
Reactor Coolant System leakage								Greater than 2 gpm increase in unidentified leakage within the previous 24 hour period.
Applicable Modes:								
1	2	3						

<u>AU2</u>
U N U S U A L
E V E N T

TABLE 4-1 - EMERGENCY ACTION LEVELS (Cont.)

6.1 Category A: Fission Product Barrier Degradation (Cont.)

Initiating Conditions	Entry Criteria						
<p align="center">AS1</p> <p>Loss of RPV water level that has or will uncover fuel.</p>	<p>RPV water level <u>CANNOT</u> be maintained greater than 0".</p>						
<p>Applicable Modes:</p>	<p>Reactor is "shutdown" under all conditions without boron"</p>						
<table border="1"> <tr> <td align="center">1</td> <td align="center">2</td> <td align="center">3</td> <td align="center">4</td> <td align="center">5</td> <td></td> </tr> </table>	1	2	3	4	5		
1	2	3	4	5			

AS1

S
I
T
E

A
R
E
A

E
M
E
R
G
E
N
C
Y

TABLE 4-1 - EMERGENCY ACTION LEVELS (Cont.)

EPLANEPA1/PS1-0018

PNFP No. 8855 Rev. 12/203

FISSION PRODUCT BARRIER MATRIX

LOSS CRITERIA	REACTOR PRESSURE VESSEL LEVEL		DRYWELL RADIATION	REACTOR COOLANT SYSTEM ACTIVITY	EMERGENCY COORDINATOR JUDGEMENT
	CHALLENGE CRITERIA	RPV level is less than 0". ²	RPV level CANNOT be determined.	NOT APPLICABLE	NOT APPLICABLE

INSTRUCTIONS

- For each of the three barriers, determine if any LOSS or CHALLENGE criteria have been met.
- Compare the barrier LOSS(es) and CHALLENGE(s) to the initiating conditions listed, and make the appropriate event declaration.

INITIATING CONDITIONS

UNUSUAL EVENT

AA3 Any loss or challenge to the Containment barrier.
Method:

ALERT

AA1 Any loss or challenge to Fuel Clad barrier.
Method:

AA2 Any loss or challenge to the Reactor Coolant System barrier.
Method:

SITE AREA EMERGENCY

AB2 Either a challenge or loss of both the Fuel Clad barrier AND Reactor Coolant System barrier.
Method:

AB3 Challenge to either the Fuel Clad barrier OR Reactor Coolant System barrier, AND the loss of any additional barrier.
Method:

GENERAL EMERGENCY

AG1 Loss of two barriers, AND a loss or challenge to the third barrier.
Method:

LOSS CRITERIA	REACTOR PRESSURE VESSEL LEVEL	DRYWELL RADIATION	REACTOR PRESSURE CONTROL			DRYWELL PRESSURE	REACTOR COOLANT SYSTEM BYPASS	EMERGENCY COORDINATOR JUDGEMENT
	CHALLENGE CRITERIA	NOT APPLICABLE	NOT APPLICABLE	NOT APPLICABLE			NOT APPLICABLE	Unisolable primary system discharging outside Containment per PEI-N11. ⁴

LOSS CRITERIA	REACTOR PRESSURE VESSEL LEVEL	DRYWELL RADIATION	CONTAINMENT HYDROGEN	CONTAINMENT PRESSURE		CONTAINMENT ISOLATION		EMERGENCY COORDINATOR JUDGEMENT
	CHALLENGE CRITERIA	NOT APPLICABLE	Containment radiation monitor reading greater than 20,000 Rem/hr.	NOT APPLICABLE	In the UNSAFE region on the HCL figure.	HCL figure limits have been exceeded. ⁶	Containment pressure is greater than 15 psig and increasing.	NOT APPLICABLE

- FOOTNOTES: 1. Those thresholds for which a LOSS or CHALLENGE is determined to be IMMEDIATE (i.e., within the next 3 hours), classify as though the threshold(s) has been exceeded.
2. RPV level is less than 0" is both a FUEL CLAD BARRIER CHALLENGE CRITERIA and a REACTOR COOLANT SYSTEM BARRIER LOSS CRITERIA.
3. Entry into SAG-1, Primary Containment Flooding is both a FUEL CLAD BARRIER LOSS CRITERIA and a CONTAINMENT BARRIER LOSS CRITERIA.
4. Unisolable primary system discharging outside containment per PEI-N11 is both a REACTOR COOLANT SYSTEM BARRIER CHALLENGE CRITERIA and a CONTAINMENT BARRIER LOSS CRITERIA.
5. Sample activity is equal to or greater than 300 uCi/gm dose equivalent Iodine-131 is both a FUEL CLAD BARRIER LOSS CRITERIA and a contributor to a REACTOR COOLANT SYSTEM BARRIER LOSS CRITERIA.
6. HCL figure limits have been exceeded is defined as follows:
- Suppression Pool Temperature >185°F
 - Suppression Pool Level <14.25 Ft.

TABLE 4-1 - EMERGENCY ACTION LEVELS (Cont.)

6.2 Category B: Loss of Decay Heat Removal Functions (Cont.)

Initiating Conditions						Entry Criteria		
BS1 Complete loss of functions needed to achieve COLD SHUTDOWN Applicable Modes:						RHR Loops A and B are <u>NOT</u> capable of lowering RPV temperature.		
						The plant is operating in the UNSAFE Region on the HCL figure.	Suppression Pool temperature greater than 185°F.	Suppression Pool level less than 14.25 ft.
1	2	3						

BS1

 S
I
T
E

 A
R
E
A

 E
M
E
R
G
E
N
C
Y

TABLE 4-1 - EMERGENCY ACTION LEVELS (Cont.)

6.3 Category C: Loss of Shutdown Functions or Failure to Shutdown

Initiating Conditions	Entry Criteria						
<p align="center">CU1</p> <p>Inability to reach required shutdown within Technical Specification limits</p> <p align="center">Applicable Modes:</p>	<p>Plant is <u>NOT</u> brought to the required operating mode within the Technical Specification Required Action Completion Time following entry into an LCO.</p>						
<table border="1"> <tr> <td align="center">1</td> <td align="center">2</td> <td align="center">3</td> <td></td> <td></td> <td></td> </tr> </table>	1	2	3				
1	2	3					

<u>CU1</u> U N U S U A L E V E N T
--

NOTE

Declaration should be made because of equipment failures that prevent the performance of an orderly shutdown or failure to meet the shutdown completion time from the time discovered and a required action being entered. Declaration of an Unusual Event is based on the time at which the specified completion time period elapses and is NOT related to how long a condition may have existed before it was discovered.

TABLE 4-1 - EMERGENCY ACTION LEVELS (Cont.)

6.3 Category C: Loss of Shutdown Functions or Failure to Shutdown (Cont.)

Initiating Conditions	Entry Criteria							
<p align="center">CA1</p> <p align="center">Failure to initiate or complete an automatic Reactor Scram once an RPS function is required</p> <p>Applicable Modes:</p>	Actuation of RPS has occurred or should have occurred.	Actuation of RRCS has occurred or should have occurred.						
	The reactor is <u>NOT</u> "shutdown under all conditions without boron".							
<table border="1"> <tr> <td align="center">1</td> <td align="center">2</td> <td></td> <td></td> <td></td> <td></td> </tr> </table>	1	2						
1	2							

<p><u>CA1</u></p> <p>A L E R T</p>
--

NOTE

CA1 is applicable if either Mode 1 or 2 existed when the transient started and NOT the mode which exists at the time of classification.

Entry criteria is applicable for actions taken by an Operator to manually initiate either RPS or RRCS prior to or after exceeding an automatic actuation setpoint.

TABLE 4-1 - EMERGENCY ACTION LEVELS (Cont.)

6.3 Category C: Loss of Shutdown Functions or Failure to Shutdown (Cont.)

Initiating Conditions	Entry Criteria								
<p align="center">CS1</p> <p>Failure to initiate or complete an automatic Reactor Scram once an RPS function is required, AND a manual Scram was <u>NOT</u> successful.</p> <p>Applicable Modes:</p> <table border="1" data-bbox="183 999 542 1053"> <tr> <td>1</td> <td></td> <td></td> <td></td> <td></td> <td></td> </tr> </table>	1						Actuation of RPS has occurred or should have occurred.	Actuation of RRCS has occurred or should have occurred.	
	1								
	The reactor is <u>NOT</u> "shutdown under all conditions without boron".								
Manual operator actions taken at 1H13-P680 to insert control rods were <u>NOT</u> successful in lowering Reactor power to less than 4%.	Reactor power <u>CANNOT</u> be determined.	Suppression Pool temperature is greater than 110°F.							

CS1
 S
 I
 T
 E
 A
 R
 E
 A

 E
 M
 E
 R
 G
 E
 N
 C
 Y

NOTE
 Refer to next page

TABLE 4-1 - EMERGENCY ACTION LEVELS (Cont.)

6.3.3 Initiating Condition CS1 (Cont.)

NOTE

CS1 is applicable if Mode 1 existed when the transient started and NOT the mode which exists at the time for classification. Refer to CA1 for Mode 2 applicability.

"Manual Operator actions" are defined as any set of actions by the Reactor Operator at 1H13-P680 which results in a scram signal. These actions include placing the Reactor Mode Switch in the SHUTDOWN position, arming and depressing the RPS Manual Scram push buttons, and arming and depressing the RRCS Manual ARI push buttons. Injection of boron is NOT considered in reducing reactor power below 4%.

Entry criteria is applicable for actions taken by an Operator to manually initiate either RPS or RRCS prior to or after exceeding an automatic actuation setpoint.

TABLE 4-1 - EMERGENCY ACTION LEVELS (Cont.)

6.3 Category C: Loss of Shutdown Functions or Failure to Shutdown (Cont.)

Initiating Conditions	Entry Criteria		
<p align="center">CG1</p> <p>Failure to initiate or complete a successful shutdown, AND indication of an extreme challenge to the ability to cool the core</p> <p>Applicable Modes:</p>	Actuation of RPS has occurred or should have occurred.		Actuation of RRCS has occurred or should have occurred.
	The reactor is <u>NOT</u> "shutdown under all conditions without boron".		
	Manual operator actions taken at 1H13-P680 to insert control rods were <u>NOT</u> successful in lowering Reactor power to less than 4%.	Reactor power <u>CANNOT</u> be determined.	Suppression Pool temperature is greater than 110°F.
	<p>Any of the following conditions exist:</p> <ul style="list-style-type: none"> • Entry into SAG-1, Primary Containment Flooding. • In the UNSAFE region on the HCL figure. • Suppression Pool temperature greater than 185°F. • Suppression Pool level less than 14.25 ft. 		
1			

CG1

G
E
N
E
R
A
L
E
M
E
R
G
E
N
C
Y

NOTE

CG1 is applicable if Mode 1 existed when the transient started and NOT the mode which exists at the time of classification. Refer to CA1 for Mode 2 applicability.

Entry criteria is applicable for actions taken by an Operator to manually initiate either RPS or RRCS prior to or after exceeding an automatic actuation setpoint.

TABLE 4-1 - EMERGENCY ACTION LEVELS (Cont.)

6.4 Category D: A. C. Power Loss

Initiating Conditions	Entry Criteria						
<p style="text-align: center;">DUI</p> <p>Loss of all offsite power to Division 1 and 2 EH Essential Busses for greater than 15 minutes</p> <p>Applicable Modes:</p> <table border="1" style="width: 100%; text-align: center;"> <tr> <td>1</td> <td>2</td> <td>3</td> <td>4</td> <td>5</td> <td>D</td> </tr> </table>	1	2	3	4	5	D	<p><ONI-R10> entered for a Loss of Off-Site Power (LOOP).</p>
	1	2	3	4	5	D	
	<p><u>Either</u> of the following power sources <u>CANNOT</u> be made available within 15 minutes for energizing bus EH11.</p> <ul style="list-style-type: none"> • Normal Preferred • Alternate Preferred 						
<p><u>Either</u> of the following power sources <u>CANNOT</u> be made available within 15 minutes for energizing bus EH12.</p> <ul style="list-style-type: none"> • Normal Preferred • Alternate Preferred 							

DUI

U
N
U
S
U
A
L

E
V
E
N
T

NOTE

Failure of either bus EH11 or EH12 to be supplied from its respective diesel generator is evaluated for escalation to an Alert under DA1 for Modes 1, 2, and 3.

Failure of both EH11 and EH12 to be supplied from their respective diesel generators (Station Black Out) is evaluated for escalation to an Alert under DA2 for Modes 4 and 5, and to a Site Area Emergency under DS1 for Modes 1, 2, and 3.

TABLE 4-1 - EMERGENCY ACTION LEVELS (Cont.)

6.4 Category D: A. C. Power Loss (Cont.)

Initiating Conditions	Entry Criteria						
<p align="center">DA1</p> <p>Power capability to Division 1 and 2 EH Essential Busses reduced to a single power source for greater than 15 minutes, such that any additional single failure would result in Station Blackout</p> <p>Applicable Modes:</p>	<p>Essential AC power reduced to only <u>one</u> of the following power sources for greater than 15 minutes:</p> <ul style="list-style-type: none"> • Normal Preferred • Alternate Preferred • Division 1 Diesel Generator • Division 2 Diesel Generator <p>Loss of the single remaining power source will result in a loss of AC power to <u>both</u> busses EH11 and EH12.</p>						
<table border="1"> <tr> <td align="center">1</td> <td align="center">2</td> <td align="center">3</td> <td></td> <td></td> <td></td> </tr> </table>	1	2	3				
1	2	3					

<p><u>DA1</u></p> <p>A L E R T</p>
--

NOTE

Escalation to a Site Area Emergency is evaluated under DS1, for Operating Modes 1, 2, and 3, based on a total loss of AC power to both busses EH11 and EH12.

A total loss of AC power to busses EH11 and EH12 while in Operating Modes 4 and 5 is classified as an Alert under DA2. No escalation path exists to a Site Area Emergency for Operating Modes 4 and 5.

TABLE 4-1 - EMERGENCY ACTION LEVELS (Cont.)

6.4 Category D: A. C. Power Loss (Cont.)

Initiating Conditions	Entry Criteria						
<p>DA2</p> <p>Loss of all offsite power AND onsite power to Division 1 and 2 EH Essential Busses for greater than 15 minutes.</p> <p>Applicable Modes:</p>	<p>Both busses EH11 and EH12 <u>CANNOT</u> be energized from the Normal Preferred source within 15 minutes.</p>						
	<p>Both busses EH11 and EH12 <u>CANNOT</u> be energized from the Alternate Preferred source within 15 minutes.</p>						
	<p>Both busses EH11 and EH12 <u>CANNOT</u> be energized from the Associated Diesel Generator source within 15 minutes.</p>						
<table border="1"> <tr> <td></td> <td></td> <td></td> <td>4</td> <td>5</td> <td>D</td> </tr> </table>				4	5	D	
			4	5	D		

<p><u>DA2</u></p> <p>A</p> <p>L</p> <p>E</p> <p>R</p> <p>T</p>
--

TABLE 4-1 - EMERGENCY ACTION LEVELS (Cont.)

6.4 Category D: A. C. Power Loss (Cont.)

Initiating Conditions	Entry Criteria						
<p align="center">DS1</p> <p>Loss of all offsite power AND onsite power to Division 1 and 2 EH Essential Busses for greater than 15 minutes</p> <p>Applicable Modes:</p>	<p>Both busses EH11 and EH12 <u>CANNOT</u> be energized from the Normal Preferred source within 15 minutes.</p>						
	<p>Both busses EH11 and EH12 <u>CANNOT</u> be energized from the Alternate Preferred source within 15 minutes.</p>						
	<p>Both busses EH11 and EH12 <u>CANNOT</u> be energized from the Associated Diesel Generator source within 15 minutes.</p>						
<table border="1"> <tr> <td align="center">1</td> <td align="center">2</td> <td align="center">3</td> <td></td> <td></td> <td></td> </tr> </table>	1	2	3				
1	2	3					

DS1
 S
 I
 T
 E
 A
 R
 E
 A
 E
 M
 E
 R
 G
 E
 N
 C
 Y

NOTE

Escalation to a General Emergency is evaluated under DG1 for Modes 1, 2 and 3, based on a continuing degradation of core cooling capability.

TABLE 4-1 - EMERGENCY ACTION LEVELS (Cont.)

6.4 Category D: A. C. Power Loss (Cont.)

Initiating Conditions	Entry Criteria		
<p>DG1</p> <p>Prolonged loss of all offsite power AND onsite power to Division 1 and 2 EH Busses, AND continuing degradation of core cooling capability</p> <p>Applicable Modes:</p>	Both busses EH11 and EH12 <u>CANNOT</u> be energized from the Normal Preferred source.		
	Both busses EH11 and EH12 <u>CANNOT</u> be energized from the Alternate Preferred source.		
	Both busses EH11 and EH12 <u>CANNOT</u> be energized from the Associated Diesel Generator source.		
	<p>Restoration of power to either of the following busses is <u>NOT</u> likely in less than four hours.</p> <ul style="list-style-type: none"> • EH11 • EH12 	RPV level is less than 0".	RPV level <u>CANNOT</u> be determined.
1	2	3	

DG1

 G
E
N
E
R
A
L

 E
M
E
R
G
E
N
C
Y

TABLE 4-1 - EMERGENCY ACTION LEVELS (Cont.)

6.5 Category E: D. C. Power Degradation

Initiating Conditions	Entry Criteria						
<p align="center">EUI</p> <p align="center">Degradation of Division 1 and 2 essential DC power for greater than 15 minutes</p> <p align="center">Applicable Modes:</p> <table border="1" data-bbox="242 812 544 872"> <tr> <td></td> <td></td> <td></td> <td align="center">4</td> <td align="center">5</td> <td></td> </tr> </table>				4	5		<p>Voltage on ED-1-A buss is less than 105 VDC for greater than 15 minutes.</p>
				4	5		
<p>Voltage on ED-1-B buss is less than 105 VDC for greater than 15 minutes.</p>							

<p><u>EUI</u></p> <p>U</p> <p>N</p> <p>U</p> <p>S</p> <p>U</p> <p>A</p> <p>L</p> <p>E</p> <p>V</p> <p>E</p> <p>N</p> <p>T</p>

NOTE

The same set of conditions as described in the EAL would be classified as Site Area Emergency under ES1 if they occurred during Modes 1, 2, or 3.

TABLE 4-1 - EMERGENCY ACTION LEVELS (Cont.)

6.5 Category E: D. C. Power Degradation (Cont.)

Initiating Conditions	Entry Criteria						
<p align="center">ES1</p> <p align="center">Degradation of Division 1 and 2 essential DC power for greater than 15 minutes</p> <p align="center">Applicable Modes:</p>	<p>Voltage on ED-1-A buss is less than 105 VDC for greater than 15 minutes.</p>						
	<p>Voltage on ED-1-B buss is less than 105 VDC for greater than 15 minutes.</p>						
<table border="1"> <tr> <td align="center">1</td> <td align="center">2</td> <td align="center">3</td> <td></td> <td></td> <td></td> </tr> </table>	1	2	3				
1	2	3					

<u>ES1</u>
S
I
T
E
A
R
E
A
E
M
E
R
E
N
G
C
Y

TABLE 4-1 - EMERGENCY ACTION LEVELS (Cont.)

6.6 Category F: Fire or Explosion

Initiating Conditions	Entry Criteria							
<p align="center">FU1</p> <p>Fire within a Safe Shutdown Building <u>NOT</u> extinguished within 15 minutes</p> <p>Applicable Modes:</p> <table border="1" data-bbox="180 814 540 873"> <tr> <td>1</td> <td>2</td> <td>3</td> <td>4</td> <td>5</td> <td>D</td> </tr> </table>	1	2	3	4	5	D	<p>Fire within any Safe Shutdown Building.</p>	
	1	2	3	4	5	D		
<p>Fire <u>CANNOT</u> be extinguished within 15 minutes of the verification of alarm.</p>	<p>Fire <u>CANNOT</u> be extinguished within 15 minutes of the notification received in the Control Room from plant personnel that a fire exists.</p>							

<p><u>FU1</u></p> <p>U N U S U A L E V E N T</p>

NOTE

Verification in this context means those actions taken in the Secondary Alarm Station (SAS) to determine that the alarm is NOT spurious. Verification includes the receipt of multiple or independent alarms or confirmation of a single detector by visual inspection of the affected area by a first responder.

TABLE 4-1 - EMERGENCY ACTION LEVELS (Cont.)

6.6 Category F: Fire or Explosion (Cont.)

Initiating Conditions	Entry Criteria						
<p align="center">FU2</p> <p align="center">Explosion affecting a Safe Shutdown Building</p> <p>Applicable Modes:</p>	<p>Report by plant personnel confirming the occurrence of an explosion within the Protected Area resulting in visible damage to a Safe Shutdown Building.</p>						
<table border="1"> <tr> <td align="center">1</td> <td align="center">2</td> <td align="center">3</td> <td align="center">4</td> <td align="center">5</td> <td align="center">D</td> </tr> </table>	1	2	3	4	5	D	
1	2	3	4	5	D		

<p><u>FU2</u></p> <p>U N U S U A L E V E N T</p>

NOTE

No attempt is made to assess the magnitude of the damage. The occurrence of the explosion with reports of damage (deformation/scorching) is sufficient for declaration. Actual damage to safe shutdown equipment is covered under Alert FA1. List of Safe Shutdown Buildings is found in EPI-A1 section 3 "Definitions", sub step 3.10.

TABLE 4-1 - EMERGENCY ACTION LEVELS (Cont.)

6.7 Category G: Increased Plant Radiation Levels

Initiating Conditions	Entry Criteria				
<p style="text-align: center;">GU1</p> <p>Unexpected increase in plant radiation levels</p> <p>Applicable Modes:</p>	<p>Area radiation monitor (D21) reading increases by a factor of 1000 over normal levels.</p>	<p>Health Physics surveys indicate an increase by a factor of 1000 times over normally expected area radiation levels.</p>			
	<p>In-plant radiation level increase <u>CANNOT</u> be attributed to <u>any</u> of the following:</p> <ul style="list-style-type: none"> • the start-up and operation of plant equipment or systems within design parameters. • the planned movement of radioactive materials. • the planned movement of shielding (i.e., plugs, lead shot, etc.) 				
1	2	3	4	5	D

GU1

U
N
U
S
U
A
L

E
V
E
N
T

NOTE

"Normal" area radiation levels can be considered as the highest reading in the past 24-hour period, excluding the current peak value.

TABLE 4-1 - EMERGENCY ACTION LEVELS (Cont.)

6.7 Category G: Increased Plant Radiation Levels (Cont.)

Initiating Conditions	Entry Criteria						
<p align="center">GU2</p> <p>Uncontrolled fuel pool water level decrease with irradiated fuel outside the RPV remaining covered.</p> <p>Applicable Modes:</p>	<p>Uncontrolled decrease in <u>one or more</u> of the following fuel pools containing irradiated fuel:</p> <ul style="list-style-type: none"> • FHB Fuel Storage and Preparation Pool • FHB Fuel Transfer Pool • FHB Spent Fuel Storage Pool • FHB Cask Pit • CNTMT Fuel Storage Pool • CNTMT Fuel Transfer Pool 						
<table border="1"> <tr> <td align="center">1</td> <td align="center">2</td> <td align="center">3</td> <td align="center">4</td> <td align="center">5</td> <td align="center">D</td> </tr> </table>	1	2	3	4	5	D	
1	2	3	4	5	D		

<p><u>GU2</u></p> <p>U N U S U A L E V E N T</p>

TABLE 4-1 - EMERGENCY ACTION LEVELS (Cont.)

6.7 Category G: Increased Plant Radiation Levels (Cont.)

Initiating Conditions							Entry Criteria	
GA2							<p>HIGH alarm on one or more of the following radiation monitors resulting from damage to irradiated fuel:</p> <ul style="list-style-type: none"> • SPENT FUEL POOL • UPPER POOL • FUEL PREP POOL • FHB VENT GAS • CNTMT ATMOS GAS 	<p>Water level observed to be below top of the gate sill separating <u>any</u> of the following pools containing irradiated fuel:</p> <ul style="list-style-type: none"> • FHB Fuel Storage and Preparation Pool • FHB Fuel Transfer Pool • FHB Spent Fuel Storage Pool • FHB Cask Pit • CNTMT Fuel Storage Pool • CNTMT Fuel Transfer Pool
<p>Major damage to irradiated fuel</p> <p>Applicable Modes:</p>								
1	2	3	4	5	D			

GA2

A
L
E
R
T

NOTE

The intent of this EAL is to allow observations from plant personnel to be factored into the declaration decision and is not intended to direct an entry into an area solely to observe pool level. The gate sill is the lip between the pools where the bottom of the gate would sit if installed.

TABLE 4-1 - EMERGENCY ACTION LEVELS (Cont.)

6.8 Category H: Increased Radiation Release to the Environment

Initiating Conditions							Entry Criteria			
<p>HU1</p> <p>Any unplanned release of gaseous radioactivity to the environment that exceeds two times the ODCM Control limit for 60 minutes or greater.</p> <p>Applicable Modes:</p>							<p>Reading greater than TWO times the HIGH alarm setpoint on <u>one or more</u> of the following plant gaseous effluent monitors lasting greater than or equal to 60 minutes:</p> <ul style="list-style-type: none"> • PLANT VENT GAS 1D17-K786 • OG VENT PIPE GAS 1D17-K836 • TB/HB VENT GAS 1D17-K856 • PLANT VENT GAS 2D17-K786 		<p>Routine or as required sample analysis indicates a release rate greater than two times ODCM 3.11.2.1 limits.</p>	
							<p>Chemistry sample analysis methods <u>CANNOT</u> confirm within 60 minutes of receipt of the HIGH alarm, or <u>one or more</u> of the plant gaseous effluent monitors, that effluent levels are less than two times ODCM 3.11.2.1 limits.</p>		<p>The release lasts for greater than or equal to 60 minutes.</p>	
1	2	3	4	5	D					

HU1

U
N
U
S
U
A
L

E
V
E
N
T

NOTE

It is NOT intended that the release be averaged over 60 minutes. Further, the Emergency Coordinator should NOT wait until 60 minutes has elapsed, but should declare the event as soon as it is determined that the release will exceed TWO times the ODCM Control 3.11.2.1 limit for greater than 60 minutes.

TABLE 4-1 - EMERGENCY ACTION LEVELS (Cont.)

6.8 Category H: Increased Radiation Release to the Environment (Cont.)

Initiating Conditions							Entry Criteria					
<p>HU2</p> <p>Any unplanned release of liquid radioactivity to the environment that exceeds two times the ODCM Control limit for 60 minutes or greater.</p>							<p>Reading greater than 1.2E3 cpm above background for <u>one or more</u> of the following liquid process monitors lasting greater than or equal to 60 minutes:</p> <ul style="list-style-type: none"> • EMERGENCY SERVICE WATER LOOP A, 1D17-K604 • EMERGENCY SERVICE WATER LOOP B, 1D17-K605 	<p>Reading greater than 20 times the HIGH-HIGH alarm setpoint on RADWASTE TO ESW monitor OD17-K606.</p>	<p>Routine or as required sample analysis indicates a release rate greater than two times ODCM Control 3.11.1.1 limits.</p>			
							<p>Chemistry sample analysis methods <u>CANNOT</u> confirm within 60 minutes of receipt of the HIGH-HIGH alarm, on <u>either</u> ESW Loop A or B radiation monitor, that liquid release levels are less than two times the ODCM Control 3.11.1.1 limits.</p>	<p>Release <u>CANNOT</u> be terminated within 60 minutes of exceeding RADWASTE TO ESW HIGH-HIGH alarm setpoints.</p>	<p>The release lasts for greater than or equal to 60 minutes.</p>			
<p>Applicable Modes:</p>							1	2	3	4	5	D

HU2

U
N
U
S
U
A
L

E
V
E
N
T

NOTE

It is NOT intended that the release be averaged over 60 minutes. Further, the Emergency Coordinator should NOT wait until 60 minutes has elapsed, but should declare the event as soon as it is determined that the release will exceed TWO times the ODCM Control 3.11.2.1 limit for greater than 60 minutes.

TABLE 4-1 - EMERGENCY ACTION LEVELS (Cont.)

6.8 Category H: Increased Radiation Release to the Environment (Cont.)

Initiating Conditions							Entry Criteria					
<p>HA1</p> <p>Any unplanned release of gaseous radioactivity to the environment that exceeds 200 times the ODCM Control limit for 15 minutes or greater</p> <p>Applicable Modes:</p>							<p>Reading greater than 200 times the HIGH alarm setpoint OR offscale high on <u>one or more</u> of the following plant gaseous effluent monitors:*</p> <ul style="list-style-type: none"> • PLANT VENT GAS 1D17-K786 • OG VENT PIPE GAS 1D19-K836 • TB/HB VENT GAS 1D17-K856 • PLANT VENT GAS 2D17-K786 			<p>Routine or as required sample analysis indicates a release rate greater than 200 times ODCM Control 3.11.2.1 limits.</p>		<p>Portable survey instruments indicate radiation levels of greater than 10 mRem/hr at the Site Boundary for greater than or equal to 15 minutes.</p>
							<p>Chemistry sample analysis methods <u>CANNOT</u> confirm within 15 minutes of receipt of the HIGH alarm, on <u>one or more</u> of the plant gaseous effluent monitors, that effluent levels are less than 200 times ODCM Control 3.11.2.1 limits.</p>			<p>The release lasts for greater than or equal to 15 minutes.</p>		
1	2	3	4	5	D							

HA1

A
L
E
R
T

NOTE

* These Alert thresholds may exceed the Site Area Emergency thresholds (since the Site Area Emergency thresholds were established using a clad damage source term versus the ODCM [coolant activity] methodology used to determine Alert classification thresholds). Therefore, an emergency dose assessment (CADAP) run using the appropriate source term, determined at the time of event, must be performed within 15 minutes concurrently with ODCM calculations to determine if a Site Area Emergency entry criteria has been met.

It is NOT intended that the release be averaged over 15 minutes. Rather, the Emergency Coordinator should declare the event as soon as it is determined that the release will exceed 200 times the ODCM Control 3.11.2.1 limit for greater than 15 minutes.

TABLE 4-1 - EMERGENCY ACTION LEVELS (Cont.)

6.8 Category H: Increased Radiation Release to the Environment (Cont.)

Initiating Conditions							Entry Criteria								
<p>HA2</p> <p>Any unplanned release of liquid radioactivity to the environment that exceeds 200 times the ODCM Control limit for 15 minutes or greater</p>							<p>Reading greater than 1.2E5 cpm above background for <u>one or more</u> of the following liquid process monitors lasting greater than or equal to 15 minutes:</p> <ul style="list-style-type: none"> • EMERGENCY SERVICE WATER LOOP A, 1D17-K604 • EMERGENCY SERVICE WATER LOOP B, 1D17-K605 			<p>Reading greater than 2000 times the HIGH-HIGH alarm setpoint ON RADWASTE TO ESW monitor OD17-K606.</p>			<p>Routine or as required sample analysis indicates a release rate greater than 200 times ODCM Control 3.11.1.1 limits.</p>		
							<p>Chemistry sample analysis methods <u>CANNOT</u> confirm within 15 minutes of receipt of the HIGH-HIGH alarm, on <u>either</u> ESW Loop A or B radiation monitor, that liquid release levels are less than 200 times ODCM Control 3.11.1.1 limits.</p>			<p>Release <u>CANNOT</u> be terminated within 15 minutes of exceeding RADWASTE TO ESW HIGH-HIGH alarm setpoints.</p>			<p>The release lasts for greater than or equal to 15 minutes.</p>		
<p>Applicable Modes:</p>															
1	2	3	4	5	D										

HA2

A
L
E
R
T

NOTE

It is NOT intended that the release be averaged over 15 minutes. Rather, the Emergency Coordinator should declare the event as soon as it is determined that the release will exceed 200 times the ODCM Control 3.11.1.1 limit for greater than 15 minutes.

TABLE 4-1 - EMERGENCY ACTION LEVELS (Cont.)

6.8 Category H: Increased Radiation Release to the Environment (Cont.)

Initiating Conditions							Entry Criteria							
<p>HS1</p> <p>Site Boundary dose resulting from an actual or imminent release of gaseous radioactivity that exceeds 100 mRem TEDE dose OR 500 mRem CDE Child Thyroid dose for the actual or projected duration of the release</p>							<p>Greater than the listed reading for <u>one or more</u> of the following plant gaseous effluent monitors:</p> <ul style="list-style-type: none"> • PLANT VENT GAS 1D19-N300 3.8E-1 µCi/cc • OG VENT PIPE GAS 1D19-N400 2.2E0 µCi/cc • TB/HB VENT GAS 1D17-K856 1.6E4 cpm • PLANT VENT GAS 2D19-N300 6.0E-1 µCi/cc 				<p>Emergency dose calculations, using actual meteorology indicate that <u>one or more</u> of the following are met at the Site Boundary:</p> <ul style="list-style-type: none"> • Greater than 100 mRem TEDE • Greater than 500 mRem CDE Child Thyroid 		<p>Field survey results indicate that <u>one or more</u> of the following have been met at the Site Boundary:</p> <ul style="list-style-type: none"> • Greater than 100 mRem/hr Whole Body • Greater than 500 mRem CDE Child Thyroid 	
							<p>Emergency dose calculations <u>CANNOT</u> confirm, within 15 minutes of exceeding limit, that levels at the Site Boundary are less than 100 mRem TEDE and 500 mRem CDE Child Thyroid dose using actual meteorology.</p>						<p>Dose rates are expected to continue for greater than or equal to 1 hour.</p>	
Applicable Modes:														
1	2	3	4	5	D									

HS1

 S
I
T
E

 A
R
E
A

 E
M
E
R
G
E
N
C
Y

TABLE 4-1 - EMERGENCY ACTION LEVELS (Cont.)

6.8 Category H: Increased Radiation Release to the Environment (Cont.)

Initiating Conditions	Entry Criteria								
<p>HG1</p> <p>Site Boundary dose resulting from an actual or imminent release of gaseous radioactivity that exceeds 1000 mRem TEDE dose OR 5000 mRem CDE Child Thyroid dose for the actual or projected duration of the release</p> <p>Applicable Modes:</p>	<p>Greater than the reading listed for <u>one or more</u> of the following plant gaseous effluent monitors:</p> <ul style="list-style-type: none"> • PLANT VENT GAS 1D19-N300 3.8E-1 µCi/cc • OG VENT PIPE GAS 1D19-N400 2.2E0 µCi/cc • TB/HB VENT GAS 1D17-K856 1.6E4 cpm • PLANT VENT GAS 2D19-N300 6.0E-1 µCi/cc 	<p>Emergency dose calculations, using actual meteorology indicate that <u>one or more</u> of the following are met at the Site Boundary:</p> <ul style="list-style-type: none"> • Greater than 1000 mRem TEDE • Greater than 5000 mRem CDE Child Thyroid 	<p>Field survey results indicate that <u>one or more</u> of the following have been met at the Site Boundary:</p> <ul style="list-style-type: none"> • Greater than 1000 mRem/hr Whole Body • Greater than 5000 mRem CDE Child Thyroid 						
	<p>Emergency dose calculations <u>CANNOT</u> confirm, within 15 minutes of exceeding above limit, that levels at the Site Boundary are less than 1000 mRem TEDE and 5000 mRem CDE Child Thyroid dose using actual meteorology.</p>		<p>Dose rates are expected to continue for greater than or equal to 1 hour.</p>						
<table border="1"> <tr> <td>1</td> <td>2</td> <td>3</td> <td>4</td> <td>5</td> <td>D</td> </tr> </table>	1	2	3	4	5	D			
1	2	3	4	5	D				

HG1

G
E
N
E
R
A
L

E
M
E
R
G
E
N
C
Y

NOTE

Exceeding the entry criteria for HG1 may require the initiation of an RPV emergency depressurization per PEI-D17. Ensure Shift Manager is notified immediately whenever the above entry criteria for a General Emergency is met.

TABLE 4-1 - EMERGENCY ACTION LEVELS (Cont.)

6.9 Category I: Control Room Evacuation

Initiating Conditions							Entry Criteria						
IA1							Entry into ONI-C61.						
Control Room evacuation has been initiated													
Applicable Modes:													
1	2	3	4	5	D								

<u>IA1</u>
A
L
E
R
T

NOTE

An inability to establish plant control from outside the Control Room will escalate this event to a Site Area Emergency per ISI.

TABLE 4-1 - EMERGENCY ACTION LEVELS (Cont.)

6.9 Category I: Control Room Evacuation (Cont.)

Initiating Conditions	Entry Criteria						
<p align="center">IS1</p> <p>Control Room evacuation has been initiated, AND plant control <u>CANNOT</u> be established within 15 minutes.</p> <p>Applicable Modes:</p>	<p>Entry into ONI-C61.</p> <p>Within 15 minutes of entry into ONI-C61, Operator(s) located at the remote shutdown controls <u>CANNOT</u> establish control of <u>one or more</u> of the following parameters per IOI-11:</p> <ul style="list-style-type: none"> • RPV level • RPV pressure • Suppression Pool temperature • Reactor power • Decay heat removal, if required 						
<table border="1"> <tr> <td align="center">1</td> <td align="center">2</td> <td align="center">3</td> <td align="center">4</td> <td align="center">5</td> <td align="center">D</td> </tr> </table>	1	2	3	4	5	D	
1	2	3	4	5	D		

IS1

S
I
T
E

A
R
E
A

E
M
E
R
G
E
N
C
Y

NOTE

A maximum 15 minute time frame for the physical transfer of control of "required" systems was established by <NUMARC/NESP-007>. Control at the Remote Shutdown Areas is accomplished by the repositioning of control transfer switches per <IOI-11>. Control is assumed unless indication of the absence of control is present.

TABLE 4-1 - EMERGENCY ACTION LEVELS (Cont.)

6.10 Category J: Loss of Annunciators or Indication

Initiating Conditions	Entry Criteria				
<p style="text-align: center;">JUI</p> <p style="text-align: center;">Loss of most annunciators or indication in the Control Room for greater than 15 minutes</p> <p>Applicable Modes:</p>	<p>Unplanned loss of most Control Room annunciators for greater than 15 minutes.</p>	<p>Unplanned loss of most Control Room indication for greater than 15 minutes.</p>			
	<p>In the Shift Manager's opinion, increased surveillance is warranted to safely operate the plant.</p>				
1	2	3			

JUI

U
N
U
S
U
A
L

E
V
E
N
T

NOTE

Quantification of "most" is left to the Shift Manager. It is NOT intended that plant personnel perform a detailed count of the instrumentation lost, but rather make a judgment call with approximately 75% being the threshold.

TABLE 4-1 - EMERGENCY ACTION LEVELS (Cont.)

6.10 Category J: Loss of Annunciators or Indication (Cont.)

Initiating Conditions						Entry Criteria					
JS1 Inability to monitor a significant transient in progress Applicable Modes:						Loss of most Control Room annunciators.		Loss of most Control Room indication.			
						Compensatory indicators, i.e., ICS is <u>NOT</u> available.					
						A significant transient is in progress.					
						Sufficient indication is <u>NOT</u> available to directly monitor plant critical safety parameters for PEIs entered due to the transient.					
1	2	3									

JS1

 S
I
T
E

 A
R
E
A

 E
M
E
R
G
E
N
C
Y

TABLE 4-1 - EMERGENCY ACTION LEVELS (Cont.)

6.11 Category K: Loss of Communications

Initiating Conditions	Entry Criteria						
<p align="center">KUI</p> <p>Loss of onsite OR in-plant communications capabilities</p> <p>Applicable Modes:</p>	<p>Loss of <u>all</u> five Plant Public Address System channels.</p>						
	<p>Loss of <u>all</u> of the following Plant Radio System channels:</p> <ul style="list-style-type: none"> • Channel 1 • Channel 2 • Channel 3 						
<table border="1"> <tr> <td align="center">1</td> <td align="center">2</td> <td align="center">3</td> <td align="center">4</td> <td align="center">5</td> <td align="center">D</td> </tr> </table>	1	2	3	4	5	D	
1	2	3	4	5	D		

<p><u>KUI</u></p> <p>U</p> <p>N</p> <p>U</p> <p>S</p> <p>U</p> <p>A</p> <p>L</p> <p>E</p> <p>V</p> <p>E</p> <p>N</p> <p>T</p>

TABLE 4-1 - EMERGENCY ACTION LEVELS (Cont.)

6.11 Category K: Loss of Communications (Cont.)

Initiating Conditions	Entry Criteria						
<p align="center">KU2</p> <p align="center">Significant degradation of offsite communications capabilities</p> <p align="center">Applicable Modes:</p>	<p>Loss of the State and County Notification Circuit (5-way) reported to the Control Room.</p> <hr/> <p>Loss of offsite long distance calling capability on <u>all</u> of the following systems circuits for greater than 15 minutes:</p> <ul style="list-style-type: none"> • Control Room private (259-) lines • Private Branch Exchange, Service Building ("5000") Switch • Private Branch Exchange, Warehouse Building ("6000") Switch • Company Off-Premise Exchange 						
<table border="1"> <tr> <td align="center">1</td> <td align="center">2</td> <td align="center">3</td> <td align="center">4</td> <td align="center">5</td> <td align="center">D</td> </tr> </table>	1	2	3	4	5	D	
1	2	3	4	5	D		

<p><u>KU2</u></p> <p>U N U S U A L E V E N T</p>

NOTE

This EAL is intended to be used only when extraordinary means are being utilized to make communications possible. The radio link between the SAS/CAS and the Lake County Sheriff's Department, and use of cellular phones are considered extraordinary means and can be utilized outside the Control Room to provide notification capability upon the loss of dedicated and normal plant telephone lines.

A loss of the "5-Way" Circuit refers to the inability to contact one or more of the four offsite contacts: the State of Ohio, and the counties of Ashtabula, Geauga, and Lake.

TABLE 4-1 - EMERGENCY ACTION LEVELS (Cont.)

6.12 Category L: Natural or Destructive Phenomena

Initiating Conditions							Entry Criteria					
<p align="center">LU1</p> <p align="center">Natural OR destructive phenomena affecting the Protected Area boundary</p>							Control Room receives report from plant personnel who felt an earthquake.		Report by plant personnel confirming <u>either</u> of the following within the Protected Area boundary: <ul style="list-style-type: none"> • tornado strike • plane or train crash 	High sustained winds greater than 70 mph for equal to or greater than 15 minutes.	Indications in the Control Room of a Main Turbine Trip or failure	
							WHITE event indicator light on local Seismic Monitoring Panel 0H51-P021.	AMBER light(s) on Seismic Monitoring Panel 0H13-P969.			Turbine casing penetration.	Catastrophic damage to generator seals.
Applicable Modes:												
1	2	3	4	5	D							

LU1

U
N
U
S
U
A
L
E
V
E
N
T

TABLE 4-1 - EMERGENCY ACTION LEVELS (Cont.)

6.12 Category L: Natural or Destructive Phenomena (Cont.)

Initiating Conditions							Entry Criteria											
<p style="text-align: center;">LA1</p> <p style="text-align: center;">Natural OR destructive phenomena affecting Safe Shutdown Buildings</p>							Control Room receives report from plant personnel who felt an earthquake.			Report of visible damage to any Safe Shutdown Building caused by <u>any</u> of the following:			Sustained high winds with a velocity greater than 90 mph for 15 minutes or longer.		Greater than PEI-N11 Maximum Safe Operating Value for Area Water Level (internal flooding)		Report by plant personnel confirming a turbine failure which results in penetration of the turbine casing.	
							<p>Either of the following indications present:</p> <ul style="list-style-type: none"> • YELLOW seismic switch indicator light on local Seismic Monitoring Panel OH51-P021. • RED light on Seismic Monitoring Panel OH13-P969. 			<ul style="list-style-type: none"> • tornado • aircraft, barge or train crash • other natural or destructive phenomena 							<p>Missile generated from the turbine failure resulting in <u>either</u>:</p> <ul style="list-style-type: none"> • damage to Safe Shutdown equipment. • penetration of a Safe Shutdown Bldg. 	
Applicable Modes:																		
1	2	3	4	5	D													

LA1

A
L
E
R
T

TABLE 4-1 - EMERGENCY ACTION LEVELS (Cont.)

6.13 Category M: Release of Toxic or Flammable Gases

Initiating Conditions	Entry Criteria							
<p>MU1</p> <p>Release of toxic OR flammable gases affecting the Protected Area boundary deemed detrimental to the safe operation of the plant</p> <p>Applicable Modes:</p>	<p>Report or detection of potentially toxic or flammable gases from an offsite source that could enter within the Site's Owner Controlled Area.</p>	<p>Report by local, county, or State officials for a potential evacuation of site personnel based on an offsite event.</p>						
	<p>Normal operation of the plant is impeded due to access restrictions implemented by Control Room within the Protected Area.</p>							
<table border="1"> <tr> <td>1</td> <td>2</td> <td>3</td> <td>4</td> <td>5</td> <td>D</td> </tr> </table>	1	2	3	4	5	D		
1	2	3	4	5	D			

MU1

U
N
U
S
U
A
L

E
V
E
N
T

NOTE

A gas release is considered to be impeding normal operations if it is of sufficient magnitude that access to areas required to support plant operation is prohibited or is possible only through the use of protective equipment, such as respirators.

MU1 is based on releases, in concentrations within the Protected Area, that will affect the health of plant personnel or affecting the safe operation of the plant with the plant being within the evacuation area of an offsite event (i.e. tanker truck accident releasing potentially toxic gases, etc.).

TABLE 4-1 - EMERGENCY ACTION LEVELS (Cont.)

6.13 Category M: Release of Toxic or Flammable Gases (Cont.)

Initiating Conditions	Entry Criteria								
<p>MA1</p> <p>Release of toxic OR flammable gases within a Safe Shutdown Building which jeopardizes operation of systems required to maintain safe operations OR to establish or maintain COLD SHUTDOWN</p> <p>Applicable Modes:</p>	Entry of potentially toxic or flammable gases into Safe Shutdown Buildings or Areas.								
	Toxic gas in concentrations considered life-threatening	Flammable gas estimated or determined to be in explosive concentrations	Plant personnel <u>NOT</u> able to perform actions necessary to establish and maintain Mode 4 while utilizing appropriate protective equipment.						
<table border="1"> <tr> <td>1</td> <td>2</td> <td>3</td> <td>4</td> <td>5</td> <td>D</td> </tr> </table>	1	2	3	4	5	D			
1	2	3	4	5	D				

MA1

A
L
E
R
T

NOTE

This IC addresses increased toxic or flammable gas levels that impede necessary access to operating stations or other areas containing equipment that must be operated manually in order to maintain safe operation or perform a safe shutdown. It is this impaired ability to operate the plant that results in the actual or potential substantial degradation of the level of safety of the plant.

TABLE 4-1 - EMERGENCY ACTION LEVELS (Cont.)

6.14 Category N: Security Events

Initiating Conditions	Entry Criteria							
<p align="center">NU1</p> <p>Confirmed security event which indicates to potential degradation in the level of safety of the plant</p> <p>Applicable Modes:</p>	<p>Bomb device discovered within Protected Area.</p>	<p>Any security event resulting in the declaration of a SECURITY ALERT in accordance with the PNPP Physical Security Plan.</p>						
<table border="1"> <tr> <td align="center">1</td> <td align="center">2</td> <td align="center">3</td> <td align="center">4</td> <td align="center">5</td> <td align="center">D</td> </tr> </table>	1	2	3	4	5	D		
1	2	3	4	5	D			

<p><u>NU1</u></p> <p>U N U S U A L E V E N T</p>

NOTE

A bomb device discovered in a plant Vital Area is classified under NS1 as a Site Area Emergency.

TABLE 4-1 - EMERGENCY ACTION LEVELS (Cont.)

6.14 Category N: Security Events (Cont.)

Initiating Conditions							Entry Criteria	
NA1							Intrusion into Protected Area by hostile force.	Any security event resulting in a declaration of a SECURITY EMERGENCY in accordance with the PNPP Physical Security Plan.
Security event in the plant Protected Area								
Applicable Modes:								
1	2	3	4	5	D			

<u>NA1</u>
A
L
E
R
T

NOTE

An individual or group of individuals with known or suspected malicious intent, which penetrates the Protected Area boundary, can be considered a hostile force.

TABLE 4-1 - EMERGENCY ACTION LEVELS (Cont.)

6.14 Category N: Security Events (Cont.)

Initiating Conditions	Entry Criteria									
<p align="center">NS1</p> <p align="center">Security event in a plant Vital Area</p> <p>Applicable Modes:</p>	<p>Intrusion into a plant Vital Area by a hostile force.</p>	<p>Explosive device discovered in a plant Vital Area.</p>	<p>Confirmed act of sabotage within a plant Vital Area.</p>	<table border="1"> <tr> <td align="center">1</td> <td align="center">2</td> <td align="center">3</td> <td align="center">4</td> <td align="center">5</td> <td align="center">D</td> </tr> </table>	1	2	3	4	5	D
1	2	3	4	5	D					

NS1

S
I
T
E

A
R
E
A

E
M
E
R
G
E
N
C
Y

NOTE

An individual or group of individuals with known or suspected malicious intent, which penetrates the Protected Area boundary, can be considered a hostile force. However, this hostile force must occupy or gain control of a vital area to meet the criteria for the declaration of a Site Area Emergency.

If there is conclusive evidence that a vital area has been entered by a hostile force, even though he is no longer present, the intrusion had been made and a Site Area Emergency is therefore warranted.

TABLE 4-1 - EMERGENCY ACTION LEVELS (Cont.)

6.14 Category N: Security Events (Cont.)

Initiating Conditions	Entry Criteria							
<p>NG1</p> <p>Security event resulting in loss of ability to reach and maintain COLD SHUTDOWN</p> <p>Applicable Modes:</p>	<p>Loss of physical control of the Control Room due to a hostile force or act.</p>	<p>Loss of physical control of the Division 1 and 2 Remote Shutdown Areas due to a hostile force or act.</p>						
<table border="1"> <tr> <td>1</td> <td>2</td> <td>3</td> <td>4</td> <td>5</td> <td>D</td> </tr> </table>	1	2	3	4	5	D		
1	2	3	4	5	D			

NG1

G
E
N
E
R
A
L

E
M
E
R
G
E
N
C
Y

NOTE

An individual or group of individuals with known or suspected malicious intent, which penetrates the Protected Area boundary, is considered a hostile force. This hostile force must occupy or gain control of either the Control Room or Division 1 and 2 Remote Shutdown Areas to meet the criteria for the declaration of a General Emergency.

TABLE 4-1 - EMERGENCY ACTION LEVELS (Cont.)

6.15 Category 0: Emergency Coordinator's Judgment

Initiating Conditions	Entry Criteria						
<p align="center">OUI</p> <p>Other conditions existing, which in the judgment of the Emergency Coordinator, warrant declaration of an Unusual Event</p> <p>Applicable Modes:</p>	<p>Events are in process or have occurred which indicate a potential degradation of the level of safety of the plant.</p>						
<table border="1"> <tr> <td align="center">1</td> <td align="center">2</td> <td align="center">3</td> <td align="center">4</td> <td align="center">5</td> <td align="center">D</td> </tr> </table>	1	2	3	4	5	D	
1	2	3	4	5	D		

<p><u>OUI</u></p> <p>U N U S U A L E V E N T</p>

NOTE

For those cases where the degradation in the level of safety of the plant is tied to equipment or system malfunctions, the decision that the component is degraded should be based upon its functionality and NOT its operability.

TABLE 4-1 - EMERGENCY ACTION LEVELS (Cont.)

6.15 Category O: Emergency Coordinator's Judgment (Cont.)

Initiating Conditions	Entry Criteria						
<p align="center">OAI</p> <p>Other conditions existing, which in the judgment of the Emergency Coordinator, warrant declaration of an Alert</p> <p>Applicable Modes:</p>	<p>Events are in progress or have occurred which indicate an actual or potential degradation of systems needed for the protection of the public and which warrant increased monitoring of plant functions.</p>						
<table border="1"> <tr> <td>1</td> <td>2</td> <td>3</td> <td>4</td> <td>5</td> <td>D</td> </tr> </table>	1	2	3	4	5	D	
1	2	3	4	5	D		

<p><u>OAI</u></p> <p>A L E R T</p>
--

NOTE

This IC is intended to address unanticipated conditions NOT addressed explicitly elsewhere but that warrant declaration of an emergency because conditions exist which are believed by the Emergency Coordinator to fall under the Alert emergency class. This includes a determination by the Emergency Coordinator that additional assistance similar to that provided by the TSC and OSC staffs, including a transfer of the Emergency Coordinator responsibilities to the TSC, is necessary for the event to be effectively mitigated. Transfer of Emergency Coordinator duties for classification, offsite notifications and PAR decisions, is used as an initiator since an event significant enough to warrant transfer of command and control is a substantial reduction in the level of safety of the plant.

TABLE 4-1 - EMERGENCY ACTION LEVELS (Cont.)

6.15 Category O: Emergency Coordinator's Judgment (Cont.)

Initiating Conditions	Entry Criteria						
<p align="center">OS1</p> <p>Other conditions existing, which in the judgment of the Emergency Coordinator, warrant declaration of a Site Area Emergency</p> <p>Applicable Modes:</p>	<p>Other conditions exist which indicate an actual or likely major failure of plant functions needed for protection of the public.</p>						
<table border="1"> <tr> <td align="center">1</td> <td align="center">2</td> <td align="center">3</td> <td align="center">4</td> <td align="center">5</td> <td align="center">D</td> </tr> </table>	1	2	3	4	5	D	
1	2	3	4	5	D		

<p><u>OS1</u></p> <p>S</p> <p>I</p> <p>T</p> <p>E</p> <p>A</p> <p>R</p> <p>E</p> <p>A</p> <p>E</p> <p>M</p> <p>E</p> <p>R</p> <p>G</p> <p>E</p> <p>N</p> <p>C</p> <p>Y</p>
--

TABLE 4-1 - EMERGENCY ACTION LEVELS (Cont.)

6.15 Category O: Emergency Coordinator's Judgment (Cont.)

Initiating Conditions							Entry Criteria									
OG1 Other conditions existing, which in the judgment of the Emergency Coordinator, warrant declaration of a General Emergency							Other conditions exist which indicate an actual or imminent substantial core degradation with the potential loss of Containment integrity.	Potential for an uncontrolled release which can reasonably be expected to be greater than 1Rem TEDE at the Site Boundary.	Potential for an uncontrolled release which can reasonably be expected to be greater than 5 Rem CDE Child Thyroid at the Site Boundary.							
Applicable Modes:																
1	2	3	4	5	D											

<u>OG1</u> G E N E R A L E M E R G E N C Y
--

TABLE 4-2 - EAL ABBREVIATIONS/ACRONYMS

AC	-	Alternating Current
CADAP	-	Computer Aided Dose Assessment Program
CAS	-	Central Alarm Station
CDE	-	Committed Dose Equivalent
CNTMT	-	Containment (Primary)
DC	-	Direct Current
E	-	Essential
EAL	-	Emergency Action Level
ECCS	-	Emergency Core Cooling System
EOF	-	Emergency Operations Facility
ESW	-	Emergency Service Water
FHB	-	Fuel Handling Building
GPM	-	Gallons Per Minute
HB	-	Heater Bay
HCL	-	Heat Capacity Limit
IC	-	Initiating Conditions
ICS	-	Integrated Computer System
IOI	-	Integrated Operating Instruction
LCO	-	Limiting Condition of Operation
LOOP	-	Loss of Offsite Power
MSIV	-	Main Steam Isolation Valve
MSL	-	Main Steam Line
NSSS	-	Nuclear Steam Supply System

TABLE 4-2 - EAL ABBREVIATIONS/ACRONYMS (Cont.)

ODCM	-	Offsite Dose Calculation Manual
OG	-	Off-gas
OGB	-	Off-Gas Building
ONI	-	Off-Normal Instruction
OSC	-	Operations Support Center
PAR	-	Protective Action Recommendation
PEI	-	Plant Emergency Instruction
PNPP	-	Perry Nuclear Power Plant
RCS	-	Reactor Coolant System
RHR	-	Residual Heat Removal
RPS	-	Reactor Protection System
RPV	-	Reactor Pressure Vessel
RRCS	-	Redundant Reactivity Control System
SAG	-	Severe Accident Guidelines
SAS	-	Secondary Alarm Station
SRV	-	Safety Relief Valve
TB	-	Turbine Building
TEDE	-	Total Effective Dose Equivalent
TSC	-	Technical Support Center
VDC	-	Volts Direct Current

TABLE 4-3 - NUMARC/NESP-007 Cross-Reference

PERRY IC	NUMARC/NESP-007 IC
UNUSUAL EVENT	
AU1	SU4
AU2	SU5
AU3	FU1
CU1	SU2
DU1	SU1
EU1	SU7
FU1	HU2
FU2	HU1
GU1	AU2
GU2	AU2
HU1	AU1
HU2	AU1
JU1	SU3
KU1	SU6
KU2	SU6
LU1	HU1
MU1	HU3
NU1	HU4
OU1	HU5

TABLE 4-3 - NUMARC/NESP-007 Cross-Reference (Cont.)

PERRY IC	NUMARC/NESP-007 IC
ALERT	
AA1	FA1
AA2	FA1
BA1	SA3
CA1	SA2
DA1	SA5
DA2	SA1
FA1	HA2
GA1	AA3
GA2	AA2
HA1	AA1
HA2	AA1
IA1	HA5
JA1	SA4
LA1	HA1
MA1	HA3
NA1	HA4
OA1	HA6

TABLE 4-3 - NUMARC/NESP-007 Cross-Reference (Cont.)

PERRY IC	NUMARC/NESP-007 IC
SITE AREA EMERGENCY	
AS1	SS5
AS2	FS1
AS3	FS1
BS1	SS4
CS1	SS2
DS1	SS1
ES1	SS3
HS1	AS1
IS1	HS2
JS1	SS6
NS1	HS1
OS1	HS3

PERRY IC	NUMARC/NESP-007 IC
GENERAL EMERGENCY	
AG1	FG1
CG1	SG2
DG1	SG1
HG1	AG1
NG1	HG1
OG1	HG2

5.0 ORGANIZATIONAL CONTROL OF EMERGENCIES

Emergency planning includes recognition of the capabilities of the shift staff, prompt augmentation by off-duty Perry Plant emergency response personnel, the support available from other Company personnel, and support available from local, State and Federal agencies to comprise an effective Emergency Response Organization (ERO). The initial response to an emergency will be handled by the normal shift staff which is capable of:

1. Determining that an emergency exists;
2. Performing initial classification and assessment;
3. Promptly notifying other agencies and individuals;
4. Initiating actions to protect the general public.

Augmentation of the shift staff will be provided by the ERO. The response organization provides additional personnel to mitigate the consequences of an emergency. Beyond this, additional personnel may be called upon to provide specific assistance for specialized tasks. These needs will be determined by the ERO on a case by case basis.

This section of the Emergency Plan addresses the emergency response assignments, authorities, and responsibilities of the normal plant organization and the emergency organization.

5.1 FirstEnergy Organization

Perry Nuclear Power Plant Department (PNPPD), Perry Nuclear Services Department (PNSD), Perry Nuclear Engineering Department (PNED), and Perry Nuclear Maintenance Department (PNMD) activities at the Perry Plant are under the control of the Vice President, Nuclear - Perry. Emergency Planning Unit (EPU), is under the control of the Director, PNSD.

The Perry Plant Organization as well as the FirstEnergy Corporate Organization are discussed in Chapter 13.1 of the Perry Plant Updated Safety Analysis Report (USAR).

5.2 Emergency Organization <F01025, S00321>

5.2.1 Shift Staffing

The plant is continuously manned with a minimum shift complement which facilitates normal plant operation as well as providing the initial response to an emergency condition as required under Table 5-1. This minimum shift crew composition for single unit operation are outlined in <PAP-0126>, "Shift Staffing and Shift Relief":

The Shift Manager is responsible for operating the plant in compliance with licensing requirements, administrative controls and operating instructions. This includes, when warranted, approving on-shift operations that deviate from established procedures and instructions, evaluating operating experiences, and providing on-shift technical advice to the Unit Supervisors.

During the initial response to an emergency, the Shift Manager assumes the position of Emergency Coordinator until properly relieved of emergency response functions by the designated Emergency Coordinator in the EOF or the TSC Operations Manager. Any individual fulfilling the position of Emergency Coordinator, has the responsibility and the authority to direct any and all phases of emergency response. The Emergency Coordinator shall not delegate the following responsibilities: <S00543, S00545>

1. The decision to notify offsite authorities.
2. The decision to make protective action recommendations to offsite authorities.
3. The decision on determination of emergency classification including reclassification or termination.

The Unit Supervisor is responsible for assisting the Shift Manager on duty in operating the plant in a safe and dependable manner. This includes supervising the Reactor Operators, plant operators and attendants required to operate the unit, instructing the shift operating crew concerning temporary and permanent changes to the Perry Plant Operations Manual and assisting the Shift Manager in his administrative duties. The Unit Supervisor reports to the Shift Manager.

The Shift Engineer (SE) will be on-shift reporting to the Shift Manager and available to provide technical support to the Shift Manager, including advising him on the safety status of the plant, diagnosing plant accidents and recommending actions to mitigate the consequences of accidents. The SE will provide on shift reactor and system engineering support, if qualified.

The Reactor Operators are responsible for directing the activities of the non-licensed shift employees including plant operators, attendants, assistants, and others as may be assigned for special tasks to insure proper operation and monitoring of plant systems and equipment. The Reactor Operators report to the Unit Supervisor.

The on-shift Supervisor of Nuclear Security Operations is directly responsible for the coordination of the specific functions of the plant security force as outlined in the Security Plan and EPI.

5.2.2 Emergency Response Organization (ERO)

In the event of an emergency, the ERO will be notified. The assignment of responsibility in the ERO is ultimately the responsibility of the Vice President, Nuclear - Perry. However, to provide automatic, clearly defined manning of the Perry Plant Emergency Response Facilities, an ERO is pre-defined. This includes the assignment of alternates for the major positions.

The majority of the ERO will be housed in five locations: Control Room (CR), Technical Support Center (TSC), Operations Support Center (OSC), Emergency Operations Facility (EOF), and Joint Public Information Center (JPIC).

The Control Room will continue to control the operation of the plant. During an emergency additional staff will be assigned to the Control Room to aid in mitigation of the effects of the emergency.

The TSC will provide management of onsite emergency activities. The TSC will also be the primary communications link between the Control Room and the balance of the ERO. During emergencies when the EOF is not operational, the TSC will perform the functions of the EOF.

The OSC will serve as the assembly point for Radiation Protection, Maintenance, I&C, and Operations personnel during an emergency. The OSC will utilize the available personnel present or will call in the personnel necessary to support first aid, fire fighting, radiation monitoring, and emergency assessment and repair activities.

The EOF will provide overall management of all Company emergency activities. The EOF will be the central point for receipt and analysis of field monitoring data and will be the primary communications contact for all offsite organizations such as the State and the local Counties. The EOF will also provide information to the Public Information Response Team (PIRT) and the JPIC for dissemination to the news media.

The JPIC will be the central location for dissemination of information to the general public regarding an emergency at the Perry Plant during Site Area or General Emergencies. The JPIC will provide a focal point for federal, state, local and FirstEnergy officials to coordinate emergency information received from the EOF and promptly inform the public utilizing local and national media outlets located at the JPIC. Prior to the activation of the JPIC, the PIRT, functioning out of the EOF, will provide an interim location for the dissemination of information to the media.

The functional interfaces between and among the ERO, local services support, and State and local governments are specified in the following sections.

Table 5-1 depicts the functional areas of emergency response activities, the normal position title (or expertise), and the major emergency tasks to be performed including the goals for augmentation of the shift staff by the response organization as outlined by Table B-1 from NUREG-0654. <S00547>

Each ERO staff position described in Sections 5.2.2.2 through 5.2.2.4 will have at least three (3) individuals qualified at any one time to fill the position.

1. Control Room (CR)

The Shift Manager on duty assumes the position of Emergency Coordinator when an emergency occurs and is in command of the ERO until relieved by the TSC Operations Manager. While acting as Emergency Coordinator, the Shift Manager has the

responsibility and authority to direct any and all phases of the emergency response and shall not delegate the following responsibilities: <S00545>

- a. The decision to notify offsite authorities.
- b. The decision to make protective action recommendations to offsite authorities.
- c. The decision on determination of emergency classification including reclassification or termination.

In the event the Shift Manager is incapacitated, his duties and responsibilities will be assumed by the Unit Supervisor until such time as a relief Shift Manager is available.

The duties of the Shift Manager in an emergency include the following:

- a. Maintaining the plant in a condition that minimizes the danger to the general public.
- b. Verifying the existence and initial classification of an emergency condition.
- c. Notifying plant personnel and offsite support groups, as required.
- d. Activating the first aid and fire brigade teams, and directing their response.
- e. Controlling access of personnel to the Control Room.
- f. Initiating protective measures, as required.

The Shift Engineer (SE) provides an independent assessment of plant conditions and technical advice to the Shift Manager. The SE will also review initial offsite dose assessment activities and protective action recommendations generated by an on-shift Chemistry Technician. Prior to the TSC becoming operational, the SE will provide technical information to the on-call Media Relations Representative or Information Liaison as time and plant conditions allow.

The on-shift Chemistry Technician will perform initial offsite dose assessment activities and development of protective action recommendations, until such time as the Radiation Protection Coordinator at the TSC assumes this responsibility.

The on-shift Instrument and Control (I&C) Technician will report to the Control Room, when requested, to act as communicator for the Shift Manager. The Control Room Assistant (CRA) or a second communicator-qualified I&C Technician may be used, if on-shift and available, to serve as a back-up communicator.

2. Operations Support Center (OSC)

During an emergency, the OSC serves as an assembly area for Radiation Protection Section, Radwaste, Chemistry and Environmental Section, Perry Maintenance Section, and Perry Operations Section personnel.

The OSC Coordinator directs the assembly and dispatching of repair and assessment teams, as well as Health Physics and Chemistry personnel from the OSC to support emergency operations. If required, the Shift Manager can assign an interim OSC Coordinator from the personnel present in the facility until the designated OSC Coordinator arrives to aid in the timely activation of this facility.

The following plant supervisory positions have also been identified as part of OSC staffing to assist the OSC Coordinator in directing facility operations: --

- Mechanical Supervisor,
- Electrical Supervisor,
- Instrument and Control Supervisor,
- Health Physics Supervisor,
- Chemistry Supervisor.

Radiation Monitoring Teams (RMTs) are composed of two members each - an RMT Leader and Helper. The RMT Leader will be trained to perform plume monitoring and sample collection, and to oversee contamination control measures. The RMT Helper will be primarily responsible for driving the RMT vehicle, team communications, and to assist in sample collection and recordkeeping. The number of teams responding is dependent on the emergency classification. For an Alert, two (2) RMTs will respond to perform monitoring; for a Site Area or General Emergency, three (3) teams will respond. Additional teams may be organized as the situation warrants. Radio-equipped, four-wheel drive vehicles will be obtained from EPU for RMT use. RMTs are equipped to perform direct radiation measurements, airborne radioactivity sampling (capable of measuring radioiodine concentrations in air as low as $1.0E-7$ uCi/cc), and environmental sample collection. <S00548>

3. Technical Support Center (TSC)

The Operations Manager is the head of onsite ERO activities and is responsible for the following:

- a. Manage onsite ERO activities.
- b. Provide guidance and direction to assist the Control Room personnel in identifying and mitigating the effects of the emergency condition and in the assessment of plant conditions.

- c. Coordinate the combined activities of the TSC, Control Room, and the OSC and all emergency teams and support personnel dispatched from the OSC.
- d. Provide information and assistance to the Information Liaison stationed in the TSC and approve Company press statements.
- e. Authorize emergency radiation exposure limit extensions.
- f. Coordinate all technical and radiological aspects of re-entry.
- g. Keep the EOF Emergency Coordinator apprised of onsite activities.

Once the TSC is operational, the Operations Manager will relieve the Shift Manager as acting Emergency Coordinator and assume the responsibilities of the Emergency Coordinator position in the TSC allowing the Shift Manager to concentrate on plant operations. While acting as Emergency Coordinator, the Operations Manager has the responsibility and the authority to direct any and all phases of the emergency response and shall not delegate the following responsibilities: <S00545>

- a. The decision to notify offsite authorities.
- b. The decision to make protective action recommendations to offsite authorities.
- c. The decision on determination of emergency classification including reclassification or termination.

The Radiation Protection Coordinator is responsible for the following:

- a. Coordinate all Health Physics and in-plant Chemistry activities in support of emergency operations, including assessment of radiological hazards within the Protected Area.
- b. Coordinate interim offsite radiological monitoring, dose assessment, and development of protective action recommendations.
- c. Coordinate the processing of emergency exposure limit extensions.
- d. Coordinate the monitoring of area and airborne radiation levels in the TSC.
- e. Evaluate and make recommendations for plant evacuation and evacuation routes.

TSC Radiation Protection Assistant(s) are available to assist the Radiation Protection Coordinator in the assessment of and response to in-plant radiological concerns.

A qualified Chemistry Unit specialist or technician referred to as the Dose Assessor, is utilized to direct RMTs, perform offsite dose assessment, and develop protective action recommendations in relief of the Control Room staff. The Dose Assessor may relocate to the EOF once operational and responsibility for offsite dose assessment activities has been transferred.

The Plant Technical Engineer is responsible for the following:

- a. Assessment of plant parameters to determine the condition of the core, safety-related systems and fission product barriers.
- b. Analyze plant conditions and develop guidance for protection of the core.
- c. Supervise engineering and design activities in support of emergency operations.
- d. Provide a liaison between the ERO, General Electric Company, other outside engineering support organizations, and the Institute of Nuclear Power Operations (INPO).
- e. Keep the Operations Manager apprised of all plant technical and engineering activities.

The TSC Core/Hydraulic Engineer is responsible to the Plant Technical Engineer for the following:

- a. Assist Chemistry in performing core damage assessments and determining the amount of fuel damage or failure.
- b. Assist in determining the shutdown status of the reactor.
- c. Perform decay heat, core thermal limit, and thermodynamic calculations.
- d. Recommend fuel-related priorities in recovery/re-entry operations.
- e. Support Accident Management Team (AMT) activities in evaluating severe accident mitigation strategies.

The Operations Advisor is responsible for the following:

- a. Continuously review plant conditions and recommend reclassification of the emergency event, if required.
- b. Continuously apprise TSC staff of Control Room operations, and the Shift Manager of TSC priorities and TSC/OSC activities.
- c. Supervise radwaste processing activities in support of emergency operations.

- d. Assist the Plant Operations Advisor (EOF) in the development of release duration estimates for protective action calculations.
- e. Direct the activities of the Accident Management Team (AMT) members per the Technical Support Guidelines (TSG) in Severe Accident Guideline (SAG) assessment and in providing recommendations on severe accident mitigation strategies. The TSG will be used as an aid in making these recommendations.
- f. Communicate directly with the Control Room Shift Manager, Unit Supervisor and TSC Operations Manager to recommend severe accident mitigation strategies in accordance with the SAGs.

The Maintenance Coordinator is responsible for the following:

- a. Coordinate the utilization of OSC personnel, through the OSC Coordinator, in addressing priorities established by the TSC.
- b. Coordinate with key TSC personnel in the dispatching of OSC personnel and requests for additional support personnel from the OSC.
- c. Provide the OSC with plant technical, operations, and maintenance information, and continuously apprise the OSC Coordinator of current plant status and transient conditions.
- d. Periodically apprising the Operations Manager of current OSC and emergency team operations.

The Security Coordinator is responsible for the following:

- a. Coordinate all onsite security operations with the Supervisor of Nuclear Security Operations in support of the emergency condition.
- b. Coordinate the accountability of onsite personnel, as necessary, in support of the Operations Manager.
- c. Provide a liaison between the Perry Plant and any Federal, State, or local law enforcement agencies.
- d. Assist in the classification or reclassification of security-related events.
- e. Periodically apprise the Operations Manager of current security operations onsite.

The Administrative Assistant is responsible for the following:

- a. Coordinate the activation and manning of the TSC.
- b. Direct TSC support staff in support of other TSC personnel to ensure the proper and efficient operation of the TSC.
- c. Direct TSC communicators as necessary to ensure the efficient transfer of information from and to the TSC.
- d. Coordinate the augmentation and relief of TSC staff.
- e. Assist TSC staff in obtaining available resources within the Perry Plant departments, and within the Company prior to the EOF being declared operational, which may be required.
- f. Coordinate personnel access and accountability in the TSC, and operation of the TSC heating, ventilation, and air conditioning (HVAC).

The Regulatory Affairs Coordinator will perform the following (prior to relocating to the EOF when operational):

- a. Serve as a source of plant and event information for FirstEnergy Liaisons located in County Emergency Operations Centers (EOCs) or EMA offices.
- b. Oversee telephone communications with Federal, State, and local county officials, outside of formal notifications performed in accordance with Section 6.1.
- c. Contact a second Regulatory Affairs Coordinator or relocate to the EOF, when notified that representatives from the State of Ohio are being dispatched to the Perry Plant.
- d. Dispatch a FirstEnergy Liaison to the State EOC at a Site Area Emergency or when requested by the Ohio Emergency Management Agency (OEMA).

The Information Liaison is responsible for assembling the information for use in preparing periodic press releases concerning the status of the Perry Plant. The Information Liaison is the primary contact between the ERO and the PIRT and JPIC. Once the EOF is declared operational, the Information Liaison may transfer to the EOF or call-in a second Information Liaison. <P00034>

4. Emergency Operations Facility (EOF)

The Emergency Coordinator in the EOF is responsible for and has authority to direct any and all emergency response activities. In addition to this overall authority, the Emergency Coordinator is also responsible for the following:

- a. Coordinate the overall activities of the Perry Plant ERO.

- b. Assist the Operations Manager in the TSC in coordinating onsite emergency response effort.
- c. Provide corporate, management-level, policy decisions necessary to support emergency operations.
- d. Interface with senior levels of offsite government and support agencies.
- e. Apprise the FirstEnergy corporate management of emergency response activities.
- f. Ensure timely and accurate information is provided to the Emergency Public Information Organization.

Once the EOF is operational, the EOF Emergency Coordinator will relieve the TSC Operations Manager as the acting Emergency Coordinator and shall assume the following non-delegable responsibilities: <S00545>

- a. The decision to notify offsite authorities.
- b. The decision to make protective action recommendations to offsite authorities.
- c. The decision on determination of emergency classification including reclassification or termination.

Prior to assuming control over any emergency response activities, the Emergency Coordinator will be briefed on plant status, dose projections, offsite protective actions and recommendations, notification status, and any other information pertinent to the emergency response by the TSC Operations Manager. <S00546>

The EOF Manager is responsible for the following:

- a. Coordinate the activation and manning of the EOF.
- b. Direct EOF support staff in support of other EOF positions to ensure the proper and efficient operation of the EOF.
- c. Direct the EOF communicators as necessary to ensure the efficient transfer of information from and to the EOF.
- d. Coordinate the augmentation and relief of the EOF staff.
- e. Arrange and obtain necessary FirstEnergy, or other offsite resources as requested.
- f. Coordinate personnel access and accountability in the EOF.
- g. Arrange for food and lodging of emergency response personnel.

Personnel, assigned from various Perry Plant departments, serve as EOF Communicators and assist with the communications requirements of the facility.

The Regulatory Affairs Coordinator is responsible for the following:

- a. Acting as a liaison between the Perry Plant ERO and Federal, State of Ohio, and local county officials present in the EOF.
- b. Serve as a source of plant and event information for FirstEnergy Liaisons located in the State and local county EOCs.
- c. Oversee telephone communications with Federal, State and local county officials, outside of formal notifications performed in accordance with Section 6.1.

The Information Liaison is responsible for assembling information for use in preparing periodic press releases concerning the status of Perry Plant. The Information Liaison is the primary contact between the ERO and the PIRT/JPIC. If the Information Liaison position was previously staffed in the TSC prior to EOF activation, the Information Liaison will have the option of either relocating to the EOF or calling in an additional qualified individual to staff the EOF.

The Plant Operations Advisor is responsible for the following:

- a. Provide the Emergency Coordinator with an operational insight of the emergency event and interpret plant design and system operation issues when required.
- b. Assist the Regulatory Affairs Coordinator in briefing Federal, State of Ohio and local county officials present in the EOF on operational and technical aspects of the emergency event.
- c. Assist the Offsite Radiation Advisor in accurately determining the duration of an offsite release.

The Plant Operations Assistant will assist and be under the direction of the Plant Operations Advisor. The Plant Operations Assistant will be responsible for the operation of the plant Integrated Computer System (ICS) in the EOF and the acquisition and analysis of plant operational data.

The Offsite Radiation Advisor is responsible for the following:

- a. Coordinate RMT operations.
- b. Coordinate the performance of offsite dose projections and development of protective action recommendations for the general public.

- c. Direct continuing offsite radiological assessment activities, including environmental sampling.
- d. Coordinate the monitoring of area and airborne radiation levels in the EOF and personnel entering the EOF for contamination.

Chemistry Unit specialists and technicians, functioning as Dose Assessor(s), are available to assist the Offsite Radiation Advisor in the performance of his responsibilities.

The Environmental Liaison is responsible for the following:

- a. Coordinating RMT activities in support of dose assessment activities.
- b. Assisting the Offsite Radiation Advisor in the development of an environmental sampling plan.--
- c. Packaging and shipping of environmental samples to the offsite contractor laboratory for analysis.
- d. Interpretation of environmental sample analysis results.

5. Joint Public Information Center (JPIC)

Once the JPIC is operational, the JPIC Manager manages and overall coordinates JPIC activities. The JPIC Manager is responsible for the operation of the FirstEnergy Corporate Communications and Public Information effort; has final approval on all press statements; serves as liaison to FirstEnergy Corporate Management; and coordinates news statements with State, County and Federal public information officials.

Reporting to him/her are the Information Supervisor, the Media Relations Supervisor, and the Support Services Supervisor.

The Information Supervisor is responsible for the flow of information to and from the JPIC, and coordinates the development and distribution of news statements.

The Technical Spokesperson, who is under the direction of the Information Supervisor, is the principal FirstEnergy technical resource at the JPIC. The Technical Spokesperson works with the appropriate JPIC staff to develop news statements; has responsibility for giving or securing technical approval of press statements or other public statements of a technical nature; is the principal FirstEnergy spokesperson on technical matters at media briefings; and makes himself available to the media for technical background information.

The Media Relations Supervisor is responsible for supervising all activities in the media work areas; ensuring that all reporters are cognizant of scheduled and unscheduled briefing; acting as a resource for general information; scheduling

interviews; assisting the media as required; and reporting to the JPIC Manager any media inquiries, problems, trends, etc., for discussion/action.

The Support Services Supervisor is responsible for setting up the JPIC at the direction of the JPIC Manager; obtaining support services for the JPIC staff; providing and supervising the administrative and clerical personnel and equipment operators; arranging delivery of necessary equipment and supplies and repair services to support JPIC operation, and arranging for transportation, food, lodging, etc., for an extended period of time.

6. Public Information Response Team (PIRT)

Regardless of whether the Perry Plant Emergency Plan has been entered, the PIRT may be activated to handle increased media interest which may not warrant JPIC activation. The decision to activate the PIRT is based on the discretion of the Control Room Shift Manager and the on-call Media Relations Representative. A detailed discussion of PIRT staffing and duties is contained in the EPIOIM.

The PIRT will be activated for an Alert or for events with higher emergency classifications.

While located in the EOF, the PIRT will operate independently from the EOF staff and will be de-activated once the JPIC is operational to avoid interference with EOF activities.

For a security or other event where the site is inaccessible, the JPIC will activate instead of the PIRT.

5.2.3 Activation and Staffing

The activation and staffing of the Perry Plant Emergency Response Facilities consists of three time periods: initial, interim and final. The initial phase consists of shift staff personnel and is the lowest stage of activation, whereas the final phase consists of the full activation and manning of the CR, TSC, OSC, EOF, and the JPIC. The interim phase is applicable only when the TSC is fully activated before the EOF is activated, or if activation of the EOF is not deemed necessary.

The initial phase will be implemented upon the declaration of an Unusual Event or higher level emergency. During this phase, various shift personnel support the emergency condition, with the Control Room as the command center and the Shift Manager as the acting Emergency Coordinator.

The interim phase will be implemented upon the declaration of an Alert or higher level emergency. During this phase, shift and various designated personnel support the emergency condition with the TSC as the command center and the Operations Manager as the acting Emergency Coordinator. Figure 5-1 illustrates the Perry Plant ERO during the interim phase.

The final phase, illustrated in Figure 5-1, will be implemented upon the declaration of a Site Area Emergency or a General Emergency. During this phase, the emergency condition will be supported by full activation of all the emergency response facilities, with the EOF as the command center under the direction of the Emergency Coordinator.

Staff arrival goals for designated on-call ERO positions as listed (as shown on Table 5-1) are 30 minutes for the TSC and OSC, and 60 minutes for the EOF. The goals are based on a normal response to the plant from an individual's home residence and does not take into account adverse weather conditions or factors which may delay one's arrival during a late evening response.

Fifteen minutes from the time of event classification or reclassification is allocated to successfully complete notification to on-call ERO responders. The TSC, OSC, and EOF are then expected to be fully functional within 15 minutes of the arrival of their respective staffs. This policy establishes overall goals of 60 minutes for the TSC and OSC, and 90 minutes for the EOF. The actual time required to staff and activate a facility may exceed its established goal depending on circumstances experienced at the time of the event which affect an individual's response. Additional time may, therefore, need to be allotted to account for these circumstances. <S00567>

Notification of the Perry Plant ERO is performed by the Secondary Alarm Station (SAS) Operator, who is a member of the Security force continuously manning the SAS in the Control Room. A pre-designated on-call individual can be used as an alternate to notify the ERO if the SAS operator is engaged in a security response that precludes diverting attention to notify the ERO.

Direction and control of the ERO will vary depending on the emergency classification and the degree of activation. During an Unusual Event or initial phase, the Shift Manager will assume the position of Emergency Coordinator and will continue in that position until properly relieved by the Operations Manager or his designated alternate. The Emergency Coordinator has the authority and the responsibility to direct any and all emergency response activities as necessary for any emergency condition.

The following specific responsibilities shall not be delegated by the Emergency Coordinator:

1. The decision to notify offsite authorities.
2. The decision to make protective action recommendations to offsite authorities.
3. The decision on determination of emergency classification including reclassification or termination.

During an Alert or the interim phase, the TSC Operations Manager upon arrival, will be briefed by the Shift Manager and will relieve the Shift Manager as the acting Emergency Coordinator once the TSC is operational. When a Site Area or General Emergency has been

declared, EOF Emergency Coordinator upon arrival will be briefed by the TSC Operations Manager and assume the position of Emergency Coordinator once the EOF is operational. In the final phase or full activation, the TSC Operations Manager will maintain control of onsite activities under the direction of the EOF Emergency Coordinator.

Plant operations under all phases are conducted by the normal shift staff. Once the TSC is operational during the interim or final phases, the TSC Operations Advisor will provide interface between the Control Room and the TSC under the direction of the TSC Operations Manager.

An Accident Management Team (AMT) will be mobilized in the TSC under the Operations Advisor to assist in evaluating severe accident mitigation strategies per the TSG. The ERO will provide the organizational structure and logistical support for the implementation of SAGs. Designated AMT personnel, who are not assigned specific ERO duties per Section 5.2.2, will be contacted as part of the TSC activation process. AMT personnel may be used prior to the implementation of SAGs to support designated TSC staff in the operational and technical assessment of an event classified in accordance with Section 4.0.

A communicator in the Control Room provides continuing communications with offsite agencies. When the TSC becomes operational or during the interim phase, at least one communicator in the TSC will relieve the Control Room Communicator of the responsibility for maintaining communications with offsite agencies. During the final phase or full activation, at least two communicators stationed at the EOF will relieve the TSC communicators of the responsibility for maintaining communications with offsite agencies.

Offsite dose assessment during the initial phase is the responsibility of a on-shift Chemistry Technician with the Unit Supervisor directing operational radiological activities. Protective action recommendations and their basis will be reviewed by the Shift Engineer SE and then referred to the Shift Manager for approval. During the interim phase, the TSC Radiation Protection Coordinator will relieve the on-shift Chemistry Technician of offsite dose assessment responsibilities and the Unit Supervisor of radiological support responsibilities. Upon activation of the EOF during the final phase, the EOF Offsite Radiation Advisor will control offsite dose assessment with the EOF Plant Operations Advisor assisting.

Radiological assessment, if required during the initial phase, will consist of Health Physics (HP) personnel either on-shift or called in support of the Control Room, under the direction of the Unit Supervisor. During the interim phase, two (2) RMTs will assemble and will be under the direction of the TSC Radiation Protection Coordinator. During the final phase, an additional RMT will assemble bringing the total to three (3) RMTs under the direction of the EOF Offsite Radiation Advisor.

All in-plant radiological surveys and chemistry/radio-chemistry activities during all phases of an emergency will be conducted by shift Health Physics Technician and Chemistry Technician(s), augmented as necessary by additional personnel, under the direction of the TSC Radiation Protection Coordinator. <S00547>

Technical support during the initial phase will be provided by the SE in the Control Room. During the interim or final phases, the SE will be relieved by the TSC Plant Technical Engineer.

Engineering support is not specifically assigned during the initial phase, but will be designated for the following specialty areas during the interim and final phases, under the direction of the TSC Plant Technical Engineer.

Core/Thermal Hydraulics	-	Reactor Engineer
Electrical	-	Electrical Engineer
Mechanical	-	Mechanical Engineer

Repair and corrective actions during the initial phase of an emergency will be assigned to designated shift personnel as follows:

Mechanical/Electrical Maintenance - Plant Operator (collateral duty),
Instrumentation and Controls - I&C Technician

During interim and final phases, repair and corrective actions will be managed by the OSC Coordinator, under the direction of the Shift Manager or TSC Maintenance Coordinator (once the TSC is operational), with the following designated personnel in specialty areas utilized at the OSC Coordinator's discretion:

Mechanical Maintenance - Maintenance Supervisor (Mechanical)
Electrical Maintenance - Maintenance Supervisor (Electrical)
Instrument and Controls - I&C Supervisor
Health Physics Control - Health Physics Supervisor
Chemistry Analysis - Chemistry Supervisor/Specialist

Radwaste Operations during all emergency phases will be controlled by the shift Radwaste Supervising Operator stationed in the Radwaste Control Room, under the direction of the Shift Manager. During the interim and final phases, the TSC Operations Advisor will assist the Shift Manager in coordinating radwaste activities.

Health Physics activities during the initial phase is the responsibility of the shift HP Supervisor or Technician-In-Charge. Health Physics staffing will be augmented per Table 5-1 to support interim and final phase emergency response activities.

Fire-fighting response will be provided by shift personnel in accordance with PAP-1910 and the Pre-Fire Plan Instruction (FPI's).

Security personnel, trained in American Red Cross First Aid and Cardiopulmonary Resuscitation (CPR, are available onsite on a 24-hour basis to provide immediate assistance at the scene of an accident per EPI-B4. In addition, a dispensary is located onsite for treatment of routine medical emergencies. For injuries inside the RRA, an on-shift HP technician will respond to the accident scene to assist. <S00563>

Agreements have been entered with Perry Township Fire Department and Lake Hospital System for the support of onsite fire-fighting, and the transportation and treatment of injuries per Section 5.3. Copies of these letters of agreement are contained in Appendix B.

Security during all phases of an emergency is covered by the Security Plan, and personnel accountability is conducted in accordance with EPI-B5.

The EOF Manager will assume responsibility for required resources (food/lodging, additional personnel, payment/disbursements) during the full activation of the Perry Plant Emergency Response Facilities.

During the initial and interim phases of an emergency, plant status and information are conveyed to the media and general public either by an on-call Media Relations Representative directly or through the activation of the PIRT. When informed that the Nuclear Regulatory Commission (NRC) Regional Site Team is being dispatched to the plant the EOF and the JPIC will be activated. The PIRT will transfer duties to the JPIC upon the notification that a NRC site Team is being dispatched to the plant. In the event of a Site Area or General Emergency (final phase), or if media interest warrants, the JPIC will be activated. All official information dissemination to the media will occur at the JPIC.

Once the JPIC is operational, the Technical Spokesperson is the designated FirstEnergy spokesperson for the emergency situation. Arrangements have been made with the three local counties, State of Ohio, FEMA, and NRC designated spokespersons (Public Information Officers) to utilize the JPIC, maintain a timely exchange of information, and provide for rumor control.

Upon the declaration of an Alert or higher classification, the State of Ohio and local counties may dispatch representatives to the Perry Plant, and JPIC if activated. Upon notification of the pending arrival of the State representatives, the TSC Regulatory Affairs Coordinator will either contact a second individual or relocate to the EOF and act as an interface between government officials or representatives in the EOF and the Perry Plant ERO. Once the EOF is operational, the TSC Regulatory Affairs Coordinator will relocate to the EOF to assist in communications between the NRC, State of Ohio, and local counties.

To ensure an effective interface with the State to Ohio, a FirstEnergy Liaison will be dispatched to the State EOC at a Site Area Emergency or when requested by the OEMA. Representatives from the EPU may also respond to the local county EOCs upon their activation or at the request of the EMA Director. The TSC/EOF

Regulatory Affairs Coordinator(s) will serve as the EOC's point of contact with the Perry Plant ERO. However, the primary communications link between the Perry Plant and State and local county EROs will remain the Emergency Response Network ("5-way") telephone circuit discussed in Section 7.2.2.2.

5.3 Local Services Support

The nature of an emergency may require utilizing assistance furnished by local personnel, organizations, or agencies. Since it is necessary that support from the local law enforcement agencies, fire department, hospitals, and ambulance services be available on short notice, letters of agreement have been signed with those personnel, organizations, and agencies which may be expected to provide assistance and are contained in Appendix B.

5.3.1 Fire Fighting

The Perry Township Fire Department (PTFD) provides fire fighting assistance to supplement onsite fire fighting efforts.

5.3.2 Law Enforcement

The Lake County Sheriff's Department is the lead offsite agency for law enforcement at the Perry Plant. The letter of agreement with the Lake County Sheriff's Department is referenced in and reviewed in accordance with the Perry Plant Security Plan.

5.3.3 Medical Treatment and Support

Arrangements have been made to ensure that proper medical services and support are provided for the handling and treatment of injured individuals, including those involving radiological contamination, a significant over-exposure to radiation, or ingestion of radioactive materials.

On-shift first aid response capabilities and site medical facilities are described in Sections 5.2.3 and 7.6.

1. Emergency Transportation

Ambulance services for the transportation of injured individuals from the Perry Plant to an offsite hospital for definitive medical treatment, including radiologically contaminated injuries, is provided by Perry Township Fire Department (PTFD). Other local fire departments have established mutual aid agreements with PTFD to provide backup or alternate fire and ambulance support for these responsibilities. A letter of agreement with the Perry Township Trustees is contained in Appendix B.

Members of the PTFD and other mutual aid departments are trained in methods for the proper handling of radiologically contaminated individuals per Table 8-1.

In the event that offsite medical assistance is required in support of a medical emergency, the Secondary Alarm Station (SAS) Operator, located in the Control Room, will contact the Lake County "911" Central Dispatch via telephone. It is the responsibility of the "911" Dispatcher to notify PTFD or an alternate mutual aid fire department. <S00549>

Injured personnel, who are known or suspected to be radiologically contaminated, will be accompanied by a supervisor or technician from the Health Physics Unit (HPU). If during the same incident, more than one victim is involved, the first victim will be accompanied by a member of the HPU who will remain at the offsite hospital and coordinate monitoring and contamination control measures for other victims as they arrive. Transportation of non-radiologically contaminated injuries, requiring advanced trauma or medical care, is also available through Metro General Hospital's "Life Flight" service. A letter of agreement with Metro General-Hospital is contained in Appendix B.

2. Offsite Medical Facilities <L00454>

In the event of an injury or medical emergency requiring offsite medical treatment, arrangements have been made with Lake Hospital Systems, Inc. Lake East Hospital (Painesville, OH) has been designated in EPI-B4 as the primary medical facility for the treatment of medical emergencies from the Perry Plant. Lake West Hospital (Willoughby, OH) will serve as the backup facility.

The SAS Operator will notify the appropriate hospital via telephone prior to the injured victim(s) leaving the Protected Area if the individual(s) is known or suspected to be radiologically contaminated. Primary contact with the offsite hospital, regarding the medical condition and treatment of the victim(s), is via radio directly with the offsite ambulance personnel. <S00549>

Training is provided to these hospitals per Table 8-1 for the handling, treatment, and decontamination of radiologically contaminated injuries. These facilities will be used for the initial treatment and decontamination of injured persons requiring immediate medical attention or hospitalization. A letter of agreement with Lake Hospital System, Inc. is contained in Appendix B.

Per the letter of agreement with Lake Hospital Systems, Inc., plant health physics support will be provided to assist in radiological monitoring, contamination control, and decontamination measures.

3. Definitive Medical Assessment and Treatment

Advanced medical expertise on the assessment and treatment of radiologically contaminated injuries, significant over-exposures of radiation, or assessment of internal radiological

contamination, may be requested by the Perry Plant and local hospitals through the State of Ohio per Section II.L of the Ohio Plan for Radiological Emergencies at Licensed Nuclear Facilities. <S00565>

5.4 Government Agencies

A description of the duties and responsibilities of the various government agencies involved in the response to an emergency at the Perry Plant can be found in federal, the State of Ohio, or local county emergency plans.

5.4.1 Local Government Agencies

The County Commissioners of Lake, Ashtabula, and Geauga Counties have primary responsibility for conducting the appropriate emergency response within their respective counties. The County EMA/DES have primary responsibility for developing emergency plans and implementing emergency response. The County Commissioners and the EMA/DES are supported by various other county agencies. Details of the Counties' emergency response functions are contained in the respective County Radiological Emergency Response Plans and corresponding Standard Operating Procedures (SOPs).

5.4.2 State of Ohio Agencies

Details of the State of Ohio's emergency response functions and capabilities are contained in their plan, entitled, "Plan for Response to Radiation Emergencies at Licensed Nuclear Facilities, State of Ohio."

5.4.3 Federal Government Agencies

The Nuclear Regulatory Commission (NRC) will serve as the Lead Federal Agency (LFA) for an emergency at the Perry Plant in accordance with the Federal Radiological Emergency Response Plan (FRERP). NRC responsibilities as the LFA include the following:

- Coordinating all Federal onscene actions;
- Overseeing the onsite response, monitoring and supporting the owner or operator's activities, and providing Federal information about onsite conditions;
- Assisting the State and local governments in determining measures to protect life, property, and the environment by providing technical information and protective action recommendations, if possible in conjunction with the Federal Emergency Management Agency (FEMA), Environmental Protection Agency (EPA), the U.S. Department of Health and Human Services (HHS), the U.S. Department of Agriculture (USDA), and other Federal agencies, as necessary;
- Coordinating Federal information to the public, the media, the White House, and Congress; and

- Coordinating the overall activity of Federal agencies involved in the recovery process.

As the LFA, additional assistance can be requested by the Perry Plant through the NRC for U.S. Department of Energy (DOE) or other Federal support. A detailed listing of Federal agency response missions, capabilities, and authorities is contained in the FRERP. <S00544>

Section Q (Concept of Operations - NRC Incident Response) of the Response Coordination Manual (RCM) 1996 describes the NRC concept, purposes, and organization for performing essential functions during a Federal response to a severe radiological accident, with an emphasis on State and Federal coordination. A discussion of NRC response modes based on event classification and severity is also provided in Section Q to RCM-96.

5.4.4 U.S. Coast Guard

The U.S. Coast Guard (USCG), upon request, will broadcast an emergency notice to mariners. Additional assistance will be provided based on operational requirements and priorities. A memorandum of understanding is in effect between the Ninth District of the U.S. Coast Guard (USCG) and the State of Ohio, whereby the OEMA has been designated the cognizant State agency for requesting USCG support. <S00388>

5.4.5 Bordering Counties and Contiguous States

Based upon the criteria stated in the State Disaster Plans, the OEMA will be notified in the event of certain conditions. The OEMA has accepted the responsibility for notification of the following:

1. Ohio counties within the Ingestion Pathway Emergency Planning Zone
2. Commonwealth of Pennsylvania
3. Canada

5.4.6 Industry Support

Technical and engineering assistance can be provided by General Electric (GE) through the BWR Emergency Support Program. This assistance will be in the form of technical support, both onsite and in San Jose, CA.

Assistance from other nuclear utilities and support groups can also be coordinated through INPO in accordance with the INPO Emergency Resources Manual. A description of the level of support provided through INPO is contained in Appendix B.

TABLE 5-1 <S00547>

PERRY PLANT EMERGENCY RESPONSE ORGANIZATION FUNCTIONS AND
SHIFT STAFF AUGMENTATION PLAN

GOALS FOR ADDITION⁽⁵⁾

MAJOR FUNCTIONAL AREA	MAJOR TASKS	POSITION TITLE OR EXPERTISE (FROM NUREG 0654 TABLE B-1)	ON SHIFT MIN. NO./TITLE (LOCATION)	30 MIN TITLE (LOCATION)	60 MIN TITLE (LOCATION)
Emergency Direction and Control		Senior Manager	1 Shift Mgr. (1)	Operations Manager (TSC)	Emergency Coordinator (EOF)
Plant Operation & Assessment of Operational Aspects		Shift Supv. Shift Foreman C.R. Operators Aux. Operators	1 Shift Mgr. (1) 1 Unit Supv. 2 Reactor Operators 1 Plant Operator 1 Plant Attendant	Operations Advisor (TSC)	
Notification/Communication	Notify Local, State & Federal Personnel & Maintain Communications. Notify FirstEnergy Personnel		1 I&C Tech. (2) 1 SAS Operator (6)	1 Communicator (TSC)	2 Communicator (EOF)
Radiological Accident Assessment & Support of Operational Accident Assessment	Offsite Dose Assessment Operational Aspects of Dose Assessment	Senior HP Expertise	1 Chemistry Technician (3)	Rad. Prot. Coordinator (TSC)	Offsite Rad. Advisor (EOF) Plant Ops. Advisor (EOF)

TABLE 5-1 (Cont.)

GOALS FOR ADDITION⁽⁵⁾

MAJOR FUNCTIONAL AREA	MAJOR TASKS	POSITION TITLE OR EXPERTISE (FROM NUREG 0654 TABLE B-1)	ON SHIFT MIN. NO./TITLE (LOCATION)	30 MIN TITLE (LOCATION)	60 MIN TITLE (LOCATION)
Radiological Accident Assessment and Support of Operational Accident Assessment (Cont'd)	Onsite (out of plant) and offsite surveys <S00548> In-Plant Surveys Chemistry/Radio-chemistry	HP Technicians Rad/Chem Tech.	1 HP Tech (4) 1 Chem. Tech. (3)	2 RMT Leaders 2 RMT Helpers 1 HP Tech.	1 RMT Leader 1 RMT Helper 1 HP Tech. 1 Chem. Tech.
Plant System. Engineering, Repair & Corrective Actions	Technical Support Repair and Corrective Actions	Shift Tech. Advisor Core/Thermal Hydraulics Electrical Mechanical Mech. Maint. RW Operator Elec. Maint. Instrument & Control (I&C) Tech.	1 Shift Engineer 1 Plant Operator 1 Radwaste Tech. 1 Plant Operator 1 I&C Tech.	1 Plant Technical Engr. (TSC) 1 Core/Hydraulic Engr. (TSC) Maintenance Coord. (TSC) OSC Coordinator (OSC)	1 Electrical Engr. (TSC) 1 Mechanical Engr. (TSC) 1 Maint. Supv. Mechanical (OSC) 1 Maint. Supv. Electrical (OSC) 1 I&C Supv. (OSC)

TABLE 5-1 (Cont.)

GOALS FOR ADDITION⁽⁵⁾

MAJOR FUNCTIONAL AREA	MAJOR TASKS	POSITION TITLE OR EXPERTISE (FROM NUREG 0654 TABLE B-1)	ON SHIFT MIN. NO./TITLE (LOCATION)	30 MIN TITLE (LOCATION)	60 MIN TITLE (LOCATION)
Protective Actions (In Plant)	Radiation Prot. <S00547> a. Access Control b. HP Coverage for Repair, Corrective Actions, Search & Rescue, First-Aid and Fire Fighting c. Pers. Monitoring d. Dosimetry	HP Technicians	1 HP Tech. (4)	2 HP Techs.	2 HP Techs.
Fire Fighting Rescue Operations and First-Aid Site Access Control and Personnel Accountability	Fight Fires Security, Fire Fighting, Communications, Personnel Accountability	Security Personnel	Fire Brigade (per Fire Protection Program) 1 HP Tech. (4) 2 Security Force (7) All per Security Plan	Local Support Local Support	

TABLE 5-1 (Cont.)

GOALS FOR ADDITION⁽⁵⁾

MAJOR FUNCTIONAL AREA	MAJOR TASKS	POSITION TITLE OR EXPERTISE (FROM NUREG 0654 TABLE B-1)	ON SHIFT MIN. NO./TITLE (LOCATION)	30 MIN TITLE (LOCATION)	60 MIN TITLE (LOCATION)
Administrative/ Logistical Support	a. Direct facility clerical staff and communicators b. Arrange for additional staffing or relief c. Facility logistics			Administrative Asst. (TSC)	EOF Manager (EOF)

NOTE:

1. The Shift Manager provides interim Emergency Management until senior management personnel arrive.
2. The on-shift Control Room Assistant (CRA) is also trained to perform this communication function, but this position does not Maintain 7-day a week, 24-hour coverage. Additional communicator-qualified I&C Technicians may also be on-shift, but are not designated to perform this function.
3. The on-shift Chemistry Technician will perform initial dose assessment actions and protective action development which will be reviewed by the Shift Engineer, prior to being forwarded to the Shift Manager for approval. Additionally, the on-shift Chemistry technician will provide chemistry/radiochemistry support.
4. On-shift Health Physics Technician will provide necessary health physics coverage for in-plant surveys and protective actions.
5. These goals are for the response of designated Emergency Response Organization positions and individuals, and reflect the time it should take an individual under normal day-to-day condition to respond to the Perry Plant site from his/her home residence. As such, these goals do not take into account delays which may be incurred due to adverse weather or a late evening/early morning response.
6. The on-call Emergency Planning Unit representative may be used as an alternate for notifying the ERO if the SAS operator is involved in an event response.
7. Overall shift staffing of security remains capable of responding with 2 security officers, however, normal response to a medical emergency will be one security officer.

TSC - Technical Support Center
 EOF - Emergency Operations Facility
 OSC - Operations Support Center

FIGURE 5-1 - EMERGENCY RESPONSE ORGANIZATION (INTERIM PHASE)


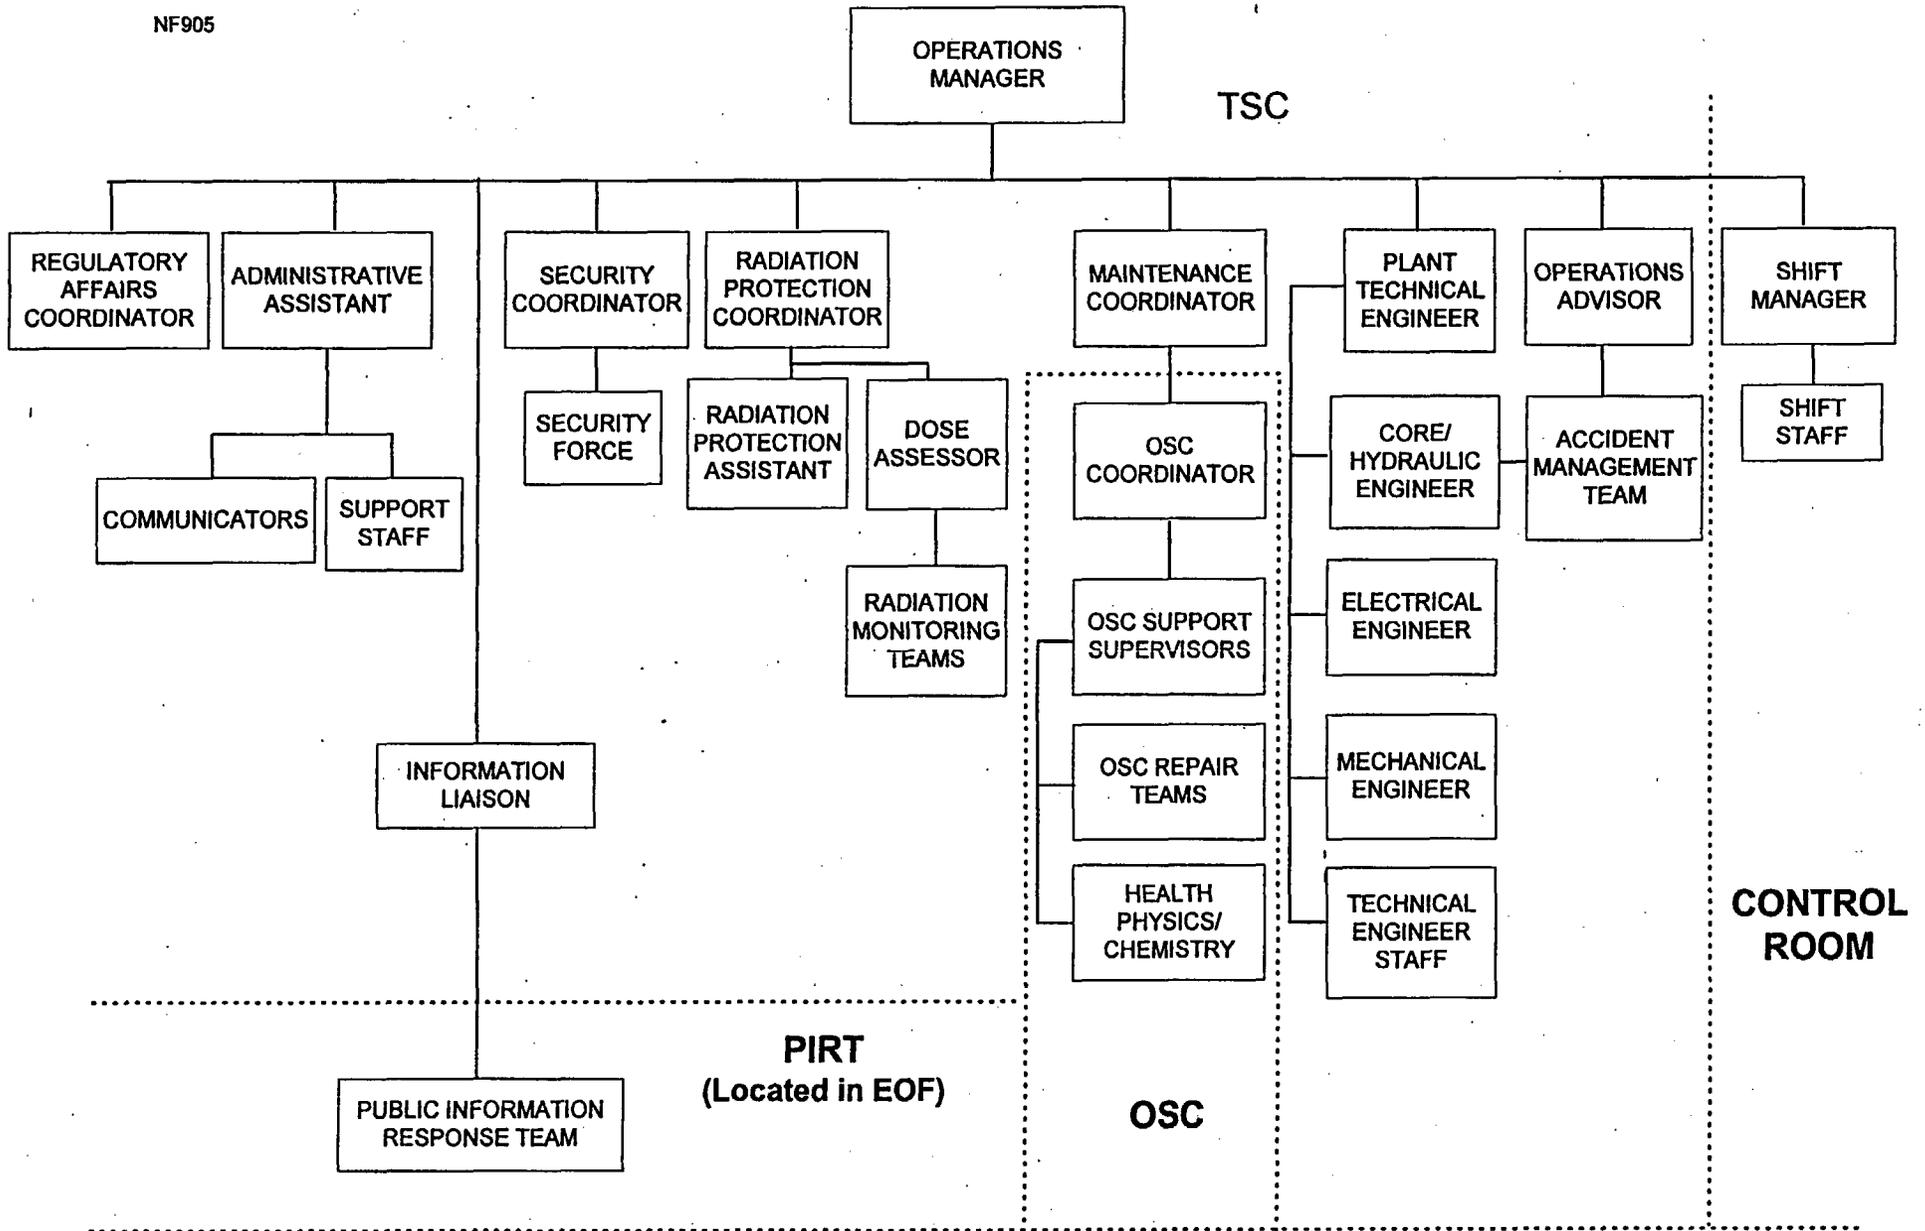


FIGURE 5-1 - EMERGENCY RESPONSE ORGANIZATION (FINAL PHASE)

NF904

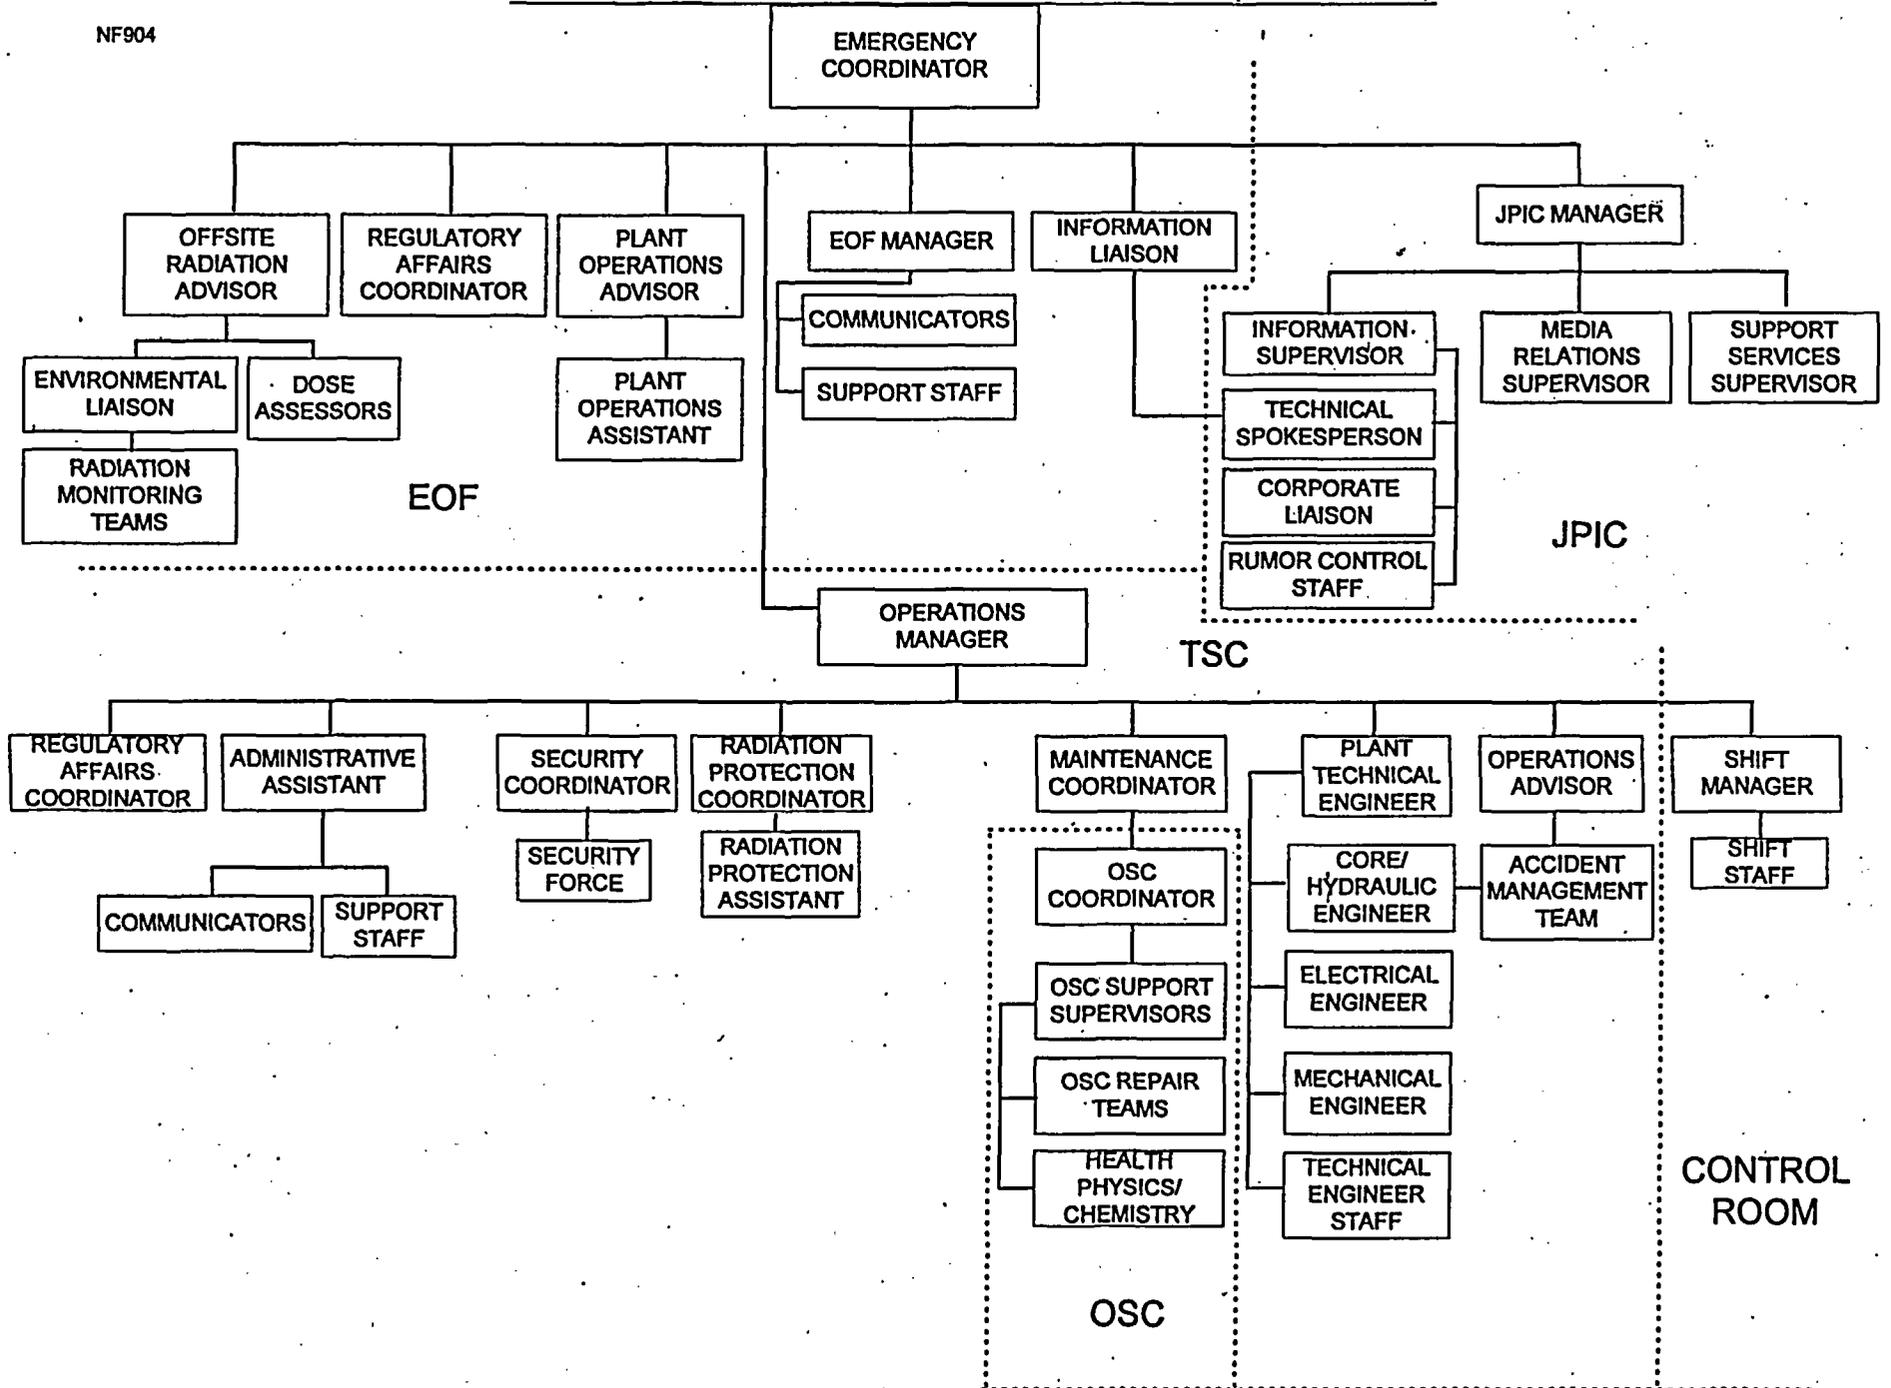

6.0 EMERGENCY MEASURES

This section identifies the specific measures to be taken for each class of emergency defined in Section 4.0 of this plan. The logic presented in this section is used as the basis for detailed EPI's which define the emergency actions to be taken for each emergency classification. Emergency measures begin with the following:

1. The recognition and declaration of an emergency classification.
2. Notification of the applicable agencies.
3. Mobilization of the appropriate portions of the emergency organization.

The additional measures are organized into the following categories:

1. Assessment Actions.
2. Corrective Actions.
3. Protective Actions.
4. Aid to Affected Personnel.

These measures are described in the sections below for each emergency classification. Figure 6-1 indicates the individuals and organizations which may be notified as required within each emergency classification.

6.1 Activation of Emergency Organizations

When it becomes apparent that a predetermined value or condition specified as an EAL in EPI-A1 may be met or exceeded, implementation of the provisions of this plan is required.

The Perry Plant EALs for each emergency classification are defined in Section 4.0. The Shift Manager, in implementing this plan, initially classifies the emergency and notifies the local counties, the State of Ohio, the NRC, and the Perry Plant ERO.

The Perry Plant, in conjunction with the State of Ohio, Ashtabula, Geauga, and Lake County EMAs, has established initial notification and follow-up emergency messages to be sent from the plant in the event that an emergency condition is declared.

The initial notification will be sent to the OEMA and local counties within fifteen (15) minutes of the declaration of an emergency condition at the Perry Plant or upon the decision to issue or revise an offsite protective action recommendation (PAR) for the general public, using the Initial Notification form contained in the <EPI-B1>. The Initial Notification Form includes information about the class of emergency, a brief description of the cause of the emergency, whether a release is taking or has taken place, potentially affected population and areas, and protective measures that may be necessary.

The Perry Plant will send a follow-up message to the OEMA and the local counties no later than one hour after the declaration or reclassification of an emergency event to keep the responsible agencies/organizations informed of the emergency condition. Subsequent follow-up messages will be sent on approximately an hourly basis, unless an alternative is agreed upon at the time by all parties concerned.

Follow-up messages will utilize the Follow-up Notification form, also provided in EPI-B1, and will contain the following information if it is known and appropriate:

1. Location of incident, and name and telephone number of caller.
2. Date/Time of incident.
3. Class of emergency.
4. Type of actual or projected abnormal release (airborne or liquid) and estimated duration/impact times.
5. Estimate of quantity of radioactive material released or being released and the points of releases.
6. Meteorological conditions wind speed, direction (from), stability class, precipitation, if any.
7. Actual or projected dose rates and integrated dose at the projected peak and at the Site Boundary 2, 5 and 10 miles, including sector(s) affected.
8. Estimate of any abnormal surface radioactive contamination in plant, onsite or offsite.
9. Perry Plant emergency response actions underway.
10. Recommended public protective actions.
11. Request for onsite support by offsite organizations.
12. Prognosis for event based on plant information.

If notifications are made using other than dedicated telephone lines, a separate verification response will be made by the notified persons/agency to the notifier to verify authenticity.

6.1.1 Shift Manager/Unit Supervisor/Reactor Operator(s)

If emergency conditions (real or potential) arise, the Reactor Operator(s) and/or the Unit Supervisor will be initially made aware of the situation by alarms, instrument readings, reports, etc. The Reactor Operator(s) shall ensure that the Unit Supervisor and the Shift Manager are immediately informed of the situation.

The Shift Manager, when informed of an emergency situation, is responsible for the assessment of the emergency in the following manner:

1. Determine the immediate actions that must be taken to ensure the safe and proper operation of the plant. The Shift Engineer is available to assist the Shift Manager on matters pertaining to nuclear safety.
2. If the situation requires implementation of the Perry Plant Emergency Plan, the Shift Manager shall classify the emergency and implement the appropriate event EPI which will direct the following:
 - a. Ensure that the appropriate alarm, and the Exclusion Area Paging system if required, are sounded.
 - b. Announce the location, type and classification of the emergency on the plant public address system.
 - c. Ensure the following agencies and organizations are notified of the emergency conditions as shown on Figure 6-1.
 - 1) Perry Plant ERO via the SAS Operator, or the on-call Emergency Planning Unit representative.
 - 2) Lake County, Ashtabula County, Geauga County, and State of Ohio. These notifications are to be made within fifteen (15) minutes of the declaration or reclassification of the emergency condition or upon the decision to issue or revise an offsite protective action recommendation (PAR) for the general public, using the Initial Notification form contained in the <EPI-B1>.
 - 3) NRC Headquarters Operations Center, White Flint, Maryland. This notification is to be made as soon as possible upon completion of the notifications to the State of Ohio, and the local counties, but must be made within one (1) hour of the declaration or reclassification of an emergency.
3. Due to the numerous responsibilities assigned to the Shift Manager at the onset of an emergency, he shall perform the following actions in the priority listed below:
 - a. Ensure the safe operation of the plant.
 - b. Ensure that immediate notification requirements are met.
 - c. Make appropriate protective action recommendations to offsite authorities.
 - d. Dispatch, in the event of radiological emergencies, Health Physics personnel to locations onsite.

- e. Perform additional emergency actions as time and conditions permit.

6.1.2 Local Counties

Upon receipt of notification from the Perry Plant, each of the three county Sheriff's Dispatchers will initiate their notification procedures. The Counties will notify their response personnel based on the classification of the emergency. The County Commissioners and the EMA/DES Directors for each county will be notified by the Sheriff's Dispatchers, who begin the notifications. The EOCs will complete these notifications.

The notifications by the counties of their response agencies will be by radio and/or telephone depending on each agency's communications capabilities. Further detail regarding these notifications is contained in each local County Radiological Emergency Response Plan.

The local counties will also notify the general public as required by their respective response plans. The primary means of public notification is through the use of the Prompt Alert Siren System, discussed in Section 7.4. These sirens alert the public to turn to the Emergency Alert System (EAS) for further information. It is expected that this method will notify essentially 100 percent of the population within 10 miles of the Perry Plant within 15 minutes after the decision is made to implement a protective action by the appropriate government officials.

Boaters on Lake Erie will be notified by either the United States Coast Guard (USCG), Ohio Department of Natural Resources (ODNR), Ohio Department of Transportation (ODOT), or National Oceanic and Atmospheric Administration (NOAA) in accordance with the appropriate State and local county response plans.

Information available to the general public, which describes actions to be taken in the event of an emergency at the Perry Plant, are discussed in Section 8.6.

6.1.3 State of Ohio

Upon receipt of notification of an emergency at the Perry Plant, the OEMA will notify the appropriate officials and agencies in the State of Ohio, the Commonwealth of Pennsylvania, and the Province of Ontario, as well as other organizations as described in the State Emergency Plan. The State of Ohio will also notify the USCG of an emergency at the Perry Plant involving USCG territorial jurisdiction.

6.1.4 Federal Agencies

Upon receipt of notification of an emergency at the Perry Plant, the NRC will notify other federal agencies when and if deemed appropriate. Federal agencies may also be contacted by their state counterparts should it become necessary.

If it becomes necessary for the Perry Plant to request federal assistance, the Emergency Coordinator will make this request.

6.2 Assessment Actions

Effective coordination and direction of all elements of the emergency organization requires continuing accident assessment throughout an emergency situation. Each emergency class shall invoke similar assessment methods; however, each classification imposes a different magnitude of assessment effort. In the following sections, assessment actions to be taken for each emergency classification are outlined. During an emergency, conditions will be periodically evaluated to determine if the emergency should be reclassified.

6.2.1 Assessment Actions for Unusual Events

The detection of an Unusual Event arises from either exceeding a specific emergency action level for this case, or as a result of alarms, instrument readings, recognition through experience, or any combination thereof. The continuing assessment action to be performed for this classification of emergency shall be in accordance with the EPIs. This consists of monitoring Control Room and other plant instrumentation and status indication until the situation is resolved. The Shift Engineer assists the Shift Manager by providing independent assessments and technical advice. If a fire is the reason for the declaration of an Unusual Event, the Shift Manager will direct the SAS to request offsite fire fighting support.

6.2.2 Assessment Actions for Alerts

Once an accident has been classified as an Alert, assessment actions shall be performed in accordance with the EPIs for an Alert. These actions include:

1. Increased surveillance of in-plant instrumentation.
2. If possible, the dispatching of shift personnel to the identified problem area for confirmation and visual assessment of the problem.
3. The mobilization of two RMTs to monitor for possible releases.
4. If a radiological accident is occurring, surveillance of the in-plant instrumentation necessary to obtain meteorological and radiological data required for calculation or estimating projected doses. This dose assessment activity continues until termination of the emergency in order that the updating of initial assessments may be provided to all concerned offsite agencies by the acting Emergency Coordinator. EPIs are provided to allow a rapid, consistent projection of doses.

6.2.3 Assessment Actions for Site Area Emergencies

The assessment actions for the Site Area Emergency classification are similar to the actions for an Alert; however, due to the increased magnitude of the possible release of radioactive material, a significantly larger assessment activity shall occur.

Specifically:

1. An increased amount of plant instrumentation shall be monitored. In particular, indications of core status shall be monitored.
2. Radiological monitoring efforts shall be greatly increased. An additional RMT shall be mobilized to obtain air samples and perform beta-gamma field measurements, if required. The collection of environmental media for assessment of material, transport and deposition shall be performed, as necessary, by qualified FirstEnergy personnel.
3. Dose assessment activities shall be conducted more frequently, with an increased emphasis on dose projection for use as a factor in determining the necessity for protective actions. Radiological and meteorological instrumentation readings shall be used to project the dose rate at predetermined distances from the plant, and to determine the integrated dose received. In reporting the dose projections to offsite agencies, the dose rate, dose, and basis for the time used for the dose estimate should be provided. Any confirmation of dose rates by RMTs shall be reflected in reporting and/or revising dose estimate information provided to offsite agencies.

Dose projections shall be considered by plant personnel in relation to the EPA PAGs. Reporting of assessments to offsite authorities shall include the relationship of dose to these guidelines. EPIs are provided for recording all pertinent information.

6.2.4 Assessment Actions for General Emergencies

Assessment actions for the General Emergency classification are to be the same as for the Site Area Emergency with some possible shift of emphasis to greater offsite monitoring efforts and dose projection efforts extending to distances much further from the plant. Additionally, since the projected doses are likely to be much closer to the EPA PAGs, greater emphasis is placed on the assessment of release duration.

6.2.5 State and County Accident Assessment

The OEMA may send field monitoring teams, equipped with all necessary field monitoring equipment, to the local area upon declaration of an Alert. Upon arrival, teams will report to a staging area designated by OEMA. Monitoring teams will then be deployed to designated field monitor locations. Additionally, Lake County Health District deploys two field monitoring teams; these teams are utilized until the OEMA teams arrive and also supplement the State teams. The Lake County teams are equipped to perform plume monitoring, including air sampling.

They will report these readings, by radio, to the State EOC in Columbus, the EOF, and the local County EOC. The readings from the Lake County teams are reported to the Lake County EOC, which relays this data to the State EOC and EOF.

Based on OEMA and Lake County monitoring as well as data from the Perry Plant, the State EOC will assess the hazard consequences of the radiological releases from the Perry Plant. This assessment will guide the decision making group at the Ohio EOC on the protective actions to be recommended to the local Counties.

6.3 Onsite Personnel Accountability <S00554>

In the event of a Site Area or General Emergency, or in the judgment of the acting Emergency Coordinator based on emergency conditions, site personnel will be instructed to begin personnel accountability. This notification will be performed essentially immediately using the Plant Public Address (PA) System and Exclusion Area Paging System as described in Section 7.2.1.2. To accomplish personnel accountability within 30 minutes, all personnel without an emergency response function will be directed to exit the site areas via normal exit routes and exit procedures. <S00560>

For the Protected Area, a list will be provided by the Fire/Security Computer of the personnel remaining within the area. This list will be compared to lists of personnel within emergency facilities to ascertain the names of missing individuals. If personnel are missing, security will begin searching at the individuals last known location.

Outside the Protected Area, personnel will be directed to exit the site by means of the Plant PA System and Exclusion Area Paging System. Security will then perform a sweep of controlled areas to locate any individuals who have not yet evacuated. Security will also check the visitor's log and any area access logs to determine if any individuals still remain.

At the Training and Education Center (TEC), the EOF Manager using the EOF staff will establish access control and then search the building, removing personnel who are not assembling in support of the TSC, OSC or EOF staffing.

Personnel accountability will be performed concurrently with the evacuation of personnel from the Perry Plant site. Monitoring of plant personnel exiting the Protected Area will be accomplished at the Primary Access Control Point, and appropriate decontamination measures implemented as needed per Section 6.5.

If a significant release of radioactive materials occurs onsite, personnel evacuating the Perry Plant site may be directed to monitoring and decontamination centers located outside the 10-mile EPZ. These centers are activated and staffed in accordance with their respective county response plans. Figure 6-2 illustrates the location of these centers in relation to the Perry Plant. Specific directions to the centers are contained in EPI-B5, posted in specific site locations, and provided as part of Plant Access Training (PAT).

6.4 Offsite Protective Actions

6.4.1 Protective Action Based on Plant Status <S00541>

In addition to the PAGs established by the EPA, the following plant status PAGs have been established. These PAGs are based on the potential for major radioactive material releases from the Perry Plant rather than the projected dose approach used by the EPA's PAGs per the guidance set forth in Supplement 3 to NUREG-0654/FEMA-REP. Implicit in these recommendations is that assessment activities will continue to determine what additional protective actions should be recommended for the entire EPZ.

The minimum plant status PAGs, as applicable, for Subareas 1 through 3 and Lake Erie (as identified on Figure 2-1), are as follows:

WIND DIRECTION - "FROM" (in degrees)	AFFECTED SUBAREAS
102 to 213	EVACUATE 1 & Lake
214 to 281	EVACUATE 1, 2 & Lake
282 to 11	EVACUATE 1, 2 & 3
12 to 33	EVACUATE 1 & 3
34 to 101	EVACUATE 1, 3 & Lake

These protective action recommendations assume that conditions listed in Table 4-1 for a General Emergency have been met or exceeded.

Additional protective action recommendations will be made for the entire EPZ as indicated by assessments performed in accordance with EPI-B8. Possible protective action recommendations made by the Perry Plant may range from no action necessary, to the evacuation of the entire 10-mile EPZ.

The following table summarizes these additional protective actions above the minimum plant status PAGs, which may be recommended based on a projected or actual dose of ≥ 1 rem TEDE or ≥ 5 rem CDEct from 5 to 10 miles:

WIND DIRECTION - "FROM" (in degrees)	AFFECTED SUBAREAS
102 to 213	EVACUATE 1 & Lake
214 to 258	EVACUATE 1, 2, 4 & Lake
259 to 281	EVACUATE 1, 2, 4, 5 & Lake
282 to 304	EVACUATE 1, 2, 3, 4 & 5
304 to 326	EVACUATE 1, 2, 3, 4, 5 & 6
327 to 348	EVACUATE 1, 2, 3, 5 & 6
349 to 11	EVACUATE 1, 2, 3, 5, 6 & 7
12 to 33	EVACUATE 1, 3, 6 & 7
34 to 56	EVACUATE 1, 3, 6, 7 & Lake
57 to 101	EVACUATE 1, 3, 7 & Lake

Recommended protective actions may be extended or modified depending on population distribution, meteorological conditions, and condition of roads and major traffic ways, following discussions with County and State officials.

6.4.2 Accident Assessment and Decision-Making

The responsibility for actions to protect persons in offsite areas rests with the State of Ohio and the local government officials. The chain of events which precede protective actions for the general public are described here and illustrated in Figure 6-3. Information is gathered by the EOF Plant Operations Advisor and the EOF Offsite Radiation Advisor to begin formulating PARs. The Plant uses the Integrated Computer System (ICS), described in Section 7.5.1 to obtain information concerning the status of plant systems and to estimate the duration of any release of radioactive material. The Plant Operations Advisor can also contact the TSC to obtain further assistance and assessment information. This estimate of release duration is then provided to the Offsite Radiation Advisor for use in dose projection calculations.

The Offsite Radiation Advisor will be simultaneously using the Computer-Aided Dose Assessment Program (CADAP) software program, described in Section 7.5.10, to obtain information concerning the present meteorological conditions, release rates from the effluent monitors, and other applicable data source to perform offsite dose projections. In addition, the Offsite Radiation Advisor will utilize the field information obtained by the RMTs to verify an estimated offsite dose or dose rate projections which may have been made.

In the event that CADAP is unavailable, the Offsite Radiation Advisor can obtain meteorological and release information directly from the ICS or locally at the on-site meteorological tower. The Offsite Radiation Advisor will also have a manual method for performing dose projections. This manual method, described in Section 7.5.10.2, provides several levels of assumptions for available data and allows projections to be performed with minimal information if necessary.

Evacuation time estimates (ETE) for areas near the Perry Plant have been generated and are contained in PSI-0013, "Control and Revision of the Evacuation Time Estimates for Areas Near the Perry Plant." The ETE was developed in accordance with Appendix 4 of NUREG-0654 and provides evacuation estimates for various areas, times, and weather conditions. These estimates represent the times required for completing the following actions:

1. public notification,
2. preparation and mobilization, and
3. actual movement out of the 10-mile EPZ (i.e., on-road travel time including delays associated with vehicle queuing).

Using the offsite dose projection, the evacuation time estimates, representative shielding factors, known or estimated isotopic compositions and projected exposure periods, the Offsite Radiation Advisor will determine an estimated dose for both Total Effective Dose Equivalent (TEDE) and Committed Dose Equivalent (CDE) - child thyroid exposures. These doses will then be compared to the EPA-400 protective action guidelines (PAGs) to arrive at a PAR. All recommendations will then be reviewed and approved by the Emergency Coordinator. The recommendation will be transmitted to the EMAs in each of the local Counties and State via the dedicated telephone system.

In the event that immediate offsite dose projections are required, they can be performed by the on-shift chemistry technician(s). During this initial phase, the Shift Manager, in his capacity of Emergency Coordinator, will evaluate the available information and recommend appropriate protective actions to the offsite agencies in accordance with Section 6.4.1.

In parallel with the activities at the Perry Plant, the State of Ohio will also develop PARs. The OEMA and Department of Health will establish a Radiological Assessment Team at the State EOC to develop a recommendation. The State will deploy field monitoring teams to the vicinity of the Perry Plant to collect field monitoring data and will use a computerized link to the Perry Plant to obtain site meteorological and release data. Should this data link be unavailable, the State can also obtain meteorological and release information directly from the Perry Plant via the dedicated communications line.

The State Radiological Assessment Team will develop a protective action recommendation using meteorological and release information similar to that used by the Offsite Radiation Advisor. The State PAR will be reviewed and approved by the Office of the Governor per the State's response plan prior to being transmitted to the three counties for consideration.

In accordance with the emergency plans for each of the three counties, their respective county EROs will receive the recommendations from the Perry Plant and the State of Ohio. The County EOC Executive Groups will coordinate with one another via a telephone conference network and make a final decision on protective actions to be implemented for the general public. Lake County will develop the appropriate Emergency Alert System (EAS) message and will coordinate the transmission and broadcasting of the appropriate message over EAS.

While the EAS message is being sent, Lake County will activate the Prompt Alerting System for the entire EPZ. This activation of the Prompt Alerting System is a signal to the public that an important message is being broadcast by EAS. By procedure, the County EOCs will implement the Radiological Emergency Response Plans and applicable SOPs to carry out the agreed upon protective actions.

In the event of a rapidly escalating emergency, the county plans and procedures direct the dispatcher to attempt to contact a higher authority to make the protective action decision. If a higher authority cannot be contacted, the dispatcher has the authority and responsibility to activate the Prompt Alerting System and to place a message on EAS implementing a protective action recommendation.
<S00539>

Detailed discussions of the specific actions to be taken by the State and local county agencies are contained in the respective county Radiological Emergency Response Plans and the corresponding SOPs.

6.4.3 Ingestion Pathway Control Measures

Provisions are made for implementing protective measures against excessive radiation exposure within the 10-mile EPZ due to direct radiation exposure and inhalation of radioactive material from the plume, in addition to exposure via the food ingestion pathway. The ingestion pathway control measures extend to a 50-mile radius. Table 6-2 provides guidance for the control of water and agricultural products within the Ingestion EPZ.

State and local agencies will implement ingestion exposure control measures in accordance with these tables, based on field monitoring data and/or projected surface contamination concentrations. Interface with the Pennsylvania Emergency Management Agency (PEMA) for ingestion pathway exposure control measures is provided by the State of Ohio.

6.5 Contamination Control Measures <S00560>

This section describes provisions for preventing or minimizing direct exposure to radiation or subsequent ingestion exposure to radioactive materials deposited on the ground or other surfaces.

6.5.1 Site Areas

Access to the site area is controlled. In-plant contamination control is exercised in accordance with PAPS and Health Physics Instructions (HPIs). The methods include isolation of contaminated areas to the extent feasible. Necessary occupancy of contaminated areas requires the use of appropriate protective equipment. If contamination is suspected outside the Protected Area, a personnel monitoring control point will be established at the EOF entrance.

Contamination control measures for equipment, tools, and other materials will be implemented in accordance with the Radiation Protection Program procedures and instructions. These measures may include decontamination, marking for controlled use, or disposal as radioactive waste.

6.5.2 Offsite Areas

Measures available to minimize radiation exposure due to offsite surface contamination include evacuation, sheltering, or relocation of the affected population, and control of drinking water and agricultural products. Federal government guidance for implementation of these measures is contained in Tables 6-1 and 6-2. The Emergency Coordinator will provide projected and/or measured offsite surface contamination concentrations to Federal, State and local agencies based on the Perry Plant emergency environmental monitoring activities. These sampling activities, as well as the transfer of analyses results, will be coordinated with Federal and State monitoring efforts.

6.5.3 Decontamination <S00564>

Individuals are considered contaminated when any area of the body surface is contaminated to levels of 1000 dpm/100 cm² beta-gamma and/or 100 dpm/100 cm² alpha or greater. Personnel found to be contaminated will undergo decontamination by Health Physics personnel or other qualified personnel, in accordance with approved plant instructions. It is preferred that personnel decontamination be performed by trained HP personnel, however, other Perry Plant personnel are instructed in both decontamination and first aid procedures.

Measures will be taken to prevent the spread of contamination. Such measures may include isolating the affected areas, placing contaminated personnel in "clean" clothing before moving them, and decontamination of affected personnel, their clothing and equipment prior to release. Contaminated equipment and items generated as a result of the accident or decontamination process will be disposed of as radioactive waste.

Provisions have been made to ensure contaminated and injured personnel receive specialized medical treatment if necessary. Refer to Section 5.3.3 for contamination control and decontamination efforts associated with a radiologically contaminated injury. If contaminated injured personnel must be transported, measures shall be taken to prevent the spread of contamination. Such measures may include placing the affected person in "clean" protective clothing, wrapping in blankets or plastic sheeting, and alerting the organizations which provide transportation and treatment.

6.6 Emergency Personnel Dose Control

Emergency measures may warrant the acceptance of above-normal radiation exposures. Saving a life, measures to circumvent substantial exposures to population groups, or even preservation of a valuable installation, may all be sufficient cause for above normal exposures.

The Perry Plant's Radiation Protection Program provides procedural guidance for increased administrative dose control level authorization during emergency circumstances, and provides specific emergency exposure guides for the following situations:

1. Emergency conditions where immediate action is required to prevent destruction of equipment.
2. Emergency conditions where immediate action is required for life-saving actions.

While specific exposure limits can be difficult to specify under emergency circumstances, exposures should be commensurate with the significance of the objective and held to the lowest practicable level that the emergency permits.

The procedural guidance identifies individuals, by position or title, responsible for authorizing plant personnel to receive doses in excess of 10CFR20 limits under emergency situations. The guidance also provides for permitting onsite volunteers to receive radiation exposures in the course of carrying out lifesaving and other emergency activities.

Dose rates during emergency situations will be evaluated utilizing normally available survey equipment. Special portable survey instruments with an extended range to 1000 rem/hr are also available for conditions involving abnormally high radiation fields.

Respiratory equipment is available for issuance by HP Unit during emergency conditions. This equipment includes full-faced particulate and iodine respirators, and self-contained breathing apparatus.

Emergency dosimetry, stored in emergency response facilities, will be issued, accounted for, and maintained in accordance with EPIs. Each emergency worker will be issued a permanent recording dosimeter and a direct reading dosimeter prior to either: (1) entering a RRA, (2) leaving or if located outside of the Control Room, TSC or EOF upon the declaration of a Site Area Emergency, or (3) as conditions warrant. The emergency personnel dosimetry program includes the capability to determine individual exposure on a 24-hour per day basis. <S00566>

Conduct of normal operations and maintenance inside the RRA requires utilization of a radiological work permit (RWP). During emergency conditions, provisions have been made to direct radiological surveillance and perform emergency work without a RWP. Radiological conditions and other applicable information will be documented as soon as possible after the emergency.

6.7 Thyroid Blocking

A potassium iodide (KI) dose of 130 mg per day (one tablet) will be recommended for Perry Plant ERO personnel, who have no known thyroid problems or iodine allergies, if the potential exists for a radiiodine exposure to the thyroid at the following levels:

1. Radiation Monitoring Teams (RMTs) - 10 Rem Committed Dose Equivalent to Adult Thyroid
2. ERO personnel onsite - Derived Airborne Concentration (DAC) of 4000 (Corresponds to 10 Rem CDE Adult Thyroid)

Approval for the issuance of KI and its distribution shall be in accordance with EPI-B8.

A sufficient quantity of KI to allow administration to onsite emergency workers for a period of ten days will be available.

TABLE 6-1

GUIDELINE FOR PROTECTIVE ACTIONS AGAINST INGESTION OF CONTAMINATION

1. Response Levels for Emergency PAG:

<u>Isotope</u>	<u>DIL (1) (Bq/kg) (2)</u>
Sr-90	160
I-131	170
Cs-134 + 137	1,200
Pu-238 + Pu-239 + Am-241	2
Ru-103 + 106	(Ru-103)/6800 + (Ru-106)/450 <1 (3)
Sr-89	1400
Y-91	1200
Zr-95	4000
Nb-95	12000
Te-132	4400
I-129	56
I-133	7000
Ba-140	6900
Ce-141	7200
Ce-144	500
Np-237	4
Np-239	28000
Pu-241	120
Cm-242	19
Cm-244	2

(1) DIL (Derived Intervention Level) is the concentration in food, in the absence of intervention, which could lead to an individual receiving a radiation dose equal to the PAG (0.5 Rem CEDE or 5 Rem CDE).

(2) 1 bequerel = 27 pCi

(3) Divide the concentration of Ru-103 by 6800, then divide the concentration of Ru-106 by 450. If the sum is less than 1, the food is edible; if the sum is equal to or greater than 1, then the food is inedible.

TABLE 6-2

RECOMMENDED PROTECTIVE ACTIONS FOR INGESTION PATHWAY

Approximate Initiation Time	Exposure of Pathway	Action to be Initiated
0-4 hours	inhalation of gases or particulates	evacuation, shelter, access control, respiratory protection, prophylaxis (thyroid protection)
	direct radiation	evacuation, shelter, access control
4-48 hours	milk	take cows off pasture, prevent cows from drinking surface water, quarantine contaminated milk
	harvested fruits and vegetables	wash all produce, or impound produce
	drinking water	cut off contaminated supplies, substitute from other sources
	unharvested produce	delay harvest until approved
2-14 days	harvested produce	substitute uncontaminated produce
	milk	discard or divert to stored products, as cheese
	drinking water	filter, demineralize

FIGURE 6-2 - OFFSITE MONITORING/DECONTAMINATION CENTER LOCATIONS

Directions to Monitoring and Decontamination Centers

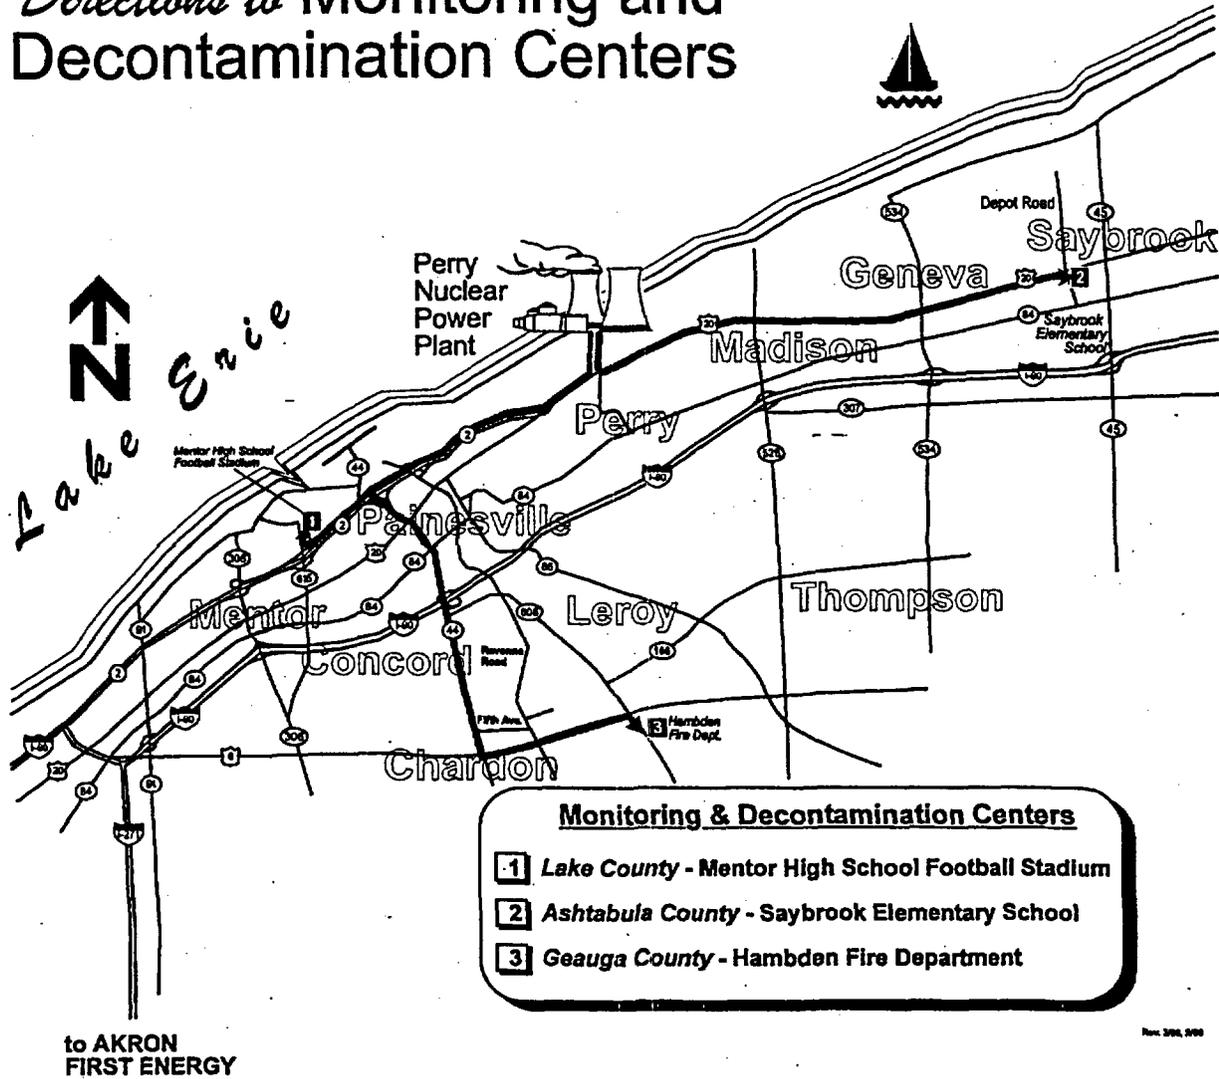


FIGURE 6-4 - CONTAINMENT RADIATION PLOT

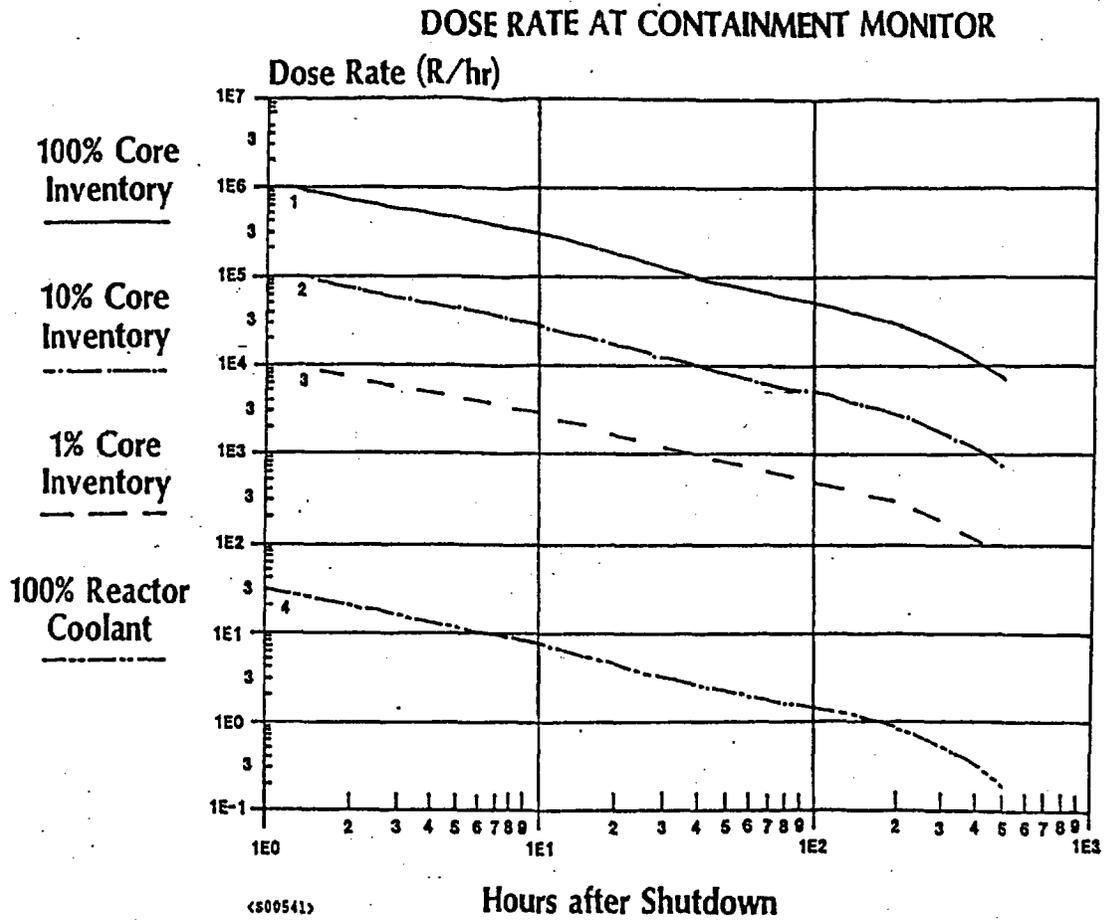


FIGURE 6-4 - CONTAINMENT RADIATION PLOT (Cont.)

<S00541>

Figure 6-4 provides theoretical curves of gross gamma dose rate versus time for a range of potential source terms. To determine the meaning of the measured dose rates:

1. Determine the Time after reactor shutdown.
2. Locate the radiation monitor Dose Rate Reading on the graph for the time after shutdown.
3. Determine the percent fuel inventory released to the containment air corresponding to the measured dose rate by taking the ratio of the measured dose rate to the dose rate given on one of the curves for a known percent inventory, i.e., interpolate between curves.
4. Relate the percent fuel inventory released, as calculated in the previous step, to the approximate source and damage estimate.

Curve No. Estimate	% Fuel (4) Inventory (1,2,3) Released	Approximate Source and Damage
1	100	100% Fuel Damage, potential core melt
2	10	Total clad failures, core partially uncovered
3	1	Approximately 10% clad failure
4	-	100% coolant release

NOTE:

- (1) The curves represent direct readings from the Containment Post Accident Radiation Monitors (D19-K100 & K200), at elevation 689 feet, inside containment.
- (2) The curves account for the finite containment volume seen by the detector but do not account for any physical or shielding characteristics or calibration uncertainties of the radiation monitor.
- (3) The curves assume that only airborne noble gases and iodines are significant. Sprays (if used) would make the iodine and any particulate contribution insignificant. However, particulate plateout on surfaces and direct shine doses from components may make the readings unreliable.
- (4) 100% Fuel Inventory = 100% Noble Gas, 25% Iodine

The calculation of monitor response did not include any particulates since the noble gases and iodine are the most significant contributors to dose rate in the containment.

7.0 EMERGENCY FACILITIES AND EQUIPMENT

This section describes the facilities and equipment that are available for support in case of an emergency. A diagram identifying the emergency facilities and their general location relative to each other is shown in Figure 7-1. Most of the facilities and the equipment are normally used for routine plant operations. Other items are reserved for use only on an "as needed" basis.

Alternate locations for the TSC, OSC and EOF are discussed in the following sections. In the event that the site becomes inaccessible or if an evacuation of the onsite emergency response facilities is required (e.g. for security reasons, personnel safety), an alternate assembly area will be pre-designated as a muster point for the Emergency Response Organization. JPIC will be activated if the PIRT is required and cannot be established on the plant site.

7.1 Emergency Centers

7.1.1 Technical Support Center (TSC)

The TSC for Perry Plant is in the basement (603' elevation) of the Service Building, which is adjacent to the Control Complex Building. The TSC has been designed to have the same radiological habitability as the Control Room under accident conditions.

The TSC will be staffed as described in Section 5.2.2.3 to provide management, engineering, and technical support to the Control Room in an emergency. The TSC will also function as the EOF for an Unusual Event or Alert or until such time as the EOF is activated and staffed. The TSC is large enough to provide adequate space for performance of its required functions. The layout of the TSC is illustrated on Figure 7-2.

The TSC ventilation system has an isolable, high-efficiency particulate absorber and charcoal filter system which functions in a manner similar to the Control Room ventilation system. The proper operation of the TSC ventilation system, while in its emergency recirculation mode, is periodically tested per PTI-M52-P0003.

Included in the ventilation system is a particulate, iodine, and noble gas radiation monitor which will distinguish radioiodines at concentrations as low as $1.0E-7$ microcuries/cc. This monitor provides continuous indication and has an alarm which indicates when levels increase to a predetermined value. An area radiation monitor indicates the radiation dose rate inside the TSC and provides an alarm when levels increase above a predetermined value.

A description of the communications available in the TSC is provided in Section 7.2.

The technical data and instrumentation available in the TSC includes computer terminals to access the ICS and CADAP programs which are described in Sections 7.5.1 and 7.5.10.1 respectively.

Up-to-date records, procedures, and instructions required to support the technical analysis and evaluation of emergency conditions are available in the TSC Records Room.

In the event that the 603' elevation of the Service Building is uninhabitable or inaccessible, the onsite EOF or BEOF (both described in Section 7.1.3) will be used as an alternate location for the TSC.

7.1.2 Operations Support Center (OSC)

The OSC for the Perry Plant is on the 599' elevation of the Control Complex Building and encompasses Radiation Protection work areas, and Chemistry Labs. Protective clothing and radiation survey instruments are available in this area and can be used to support routine plant operations. A conference room, located with the OSC, is used by the OSC Coordinator as the command center for OSC operations. The layout of the OSC is illustrated on Figure 7-3.

The 599' level of the Control Complex provides habitability which is comparable to that of the Control Room for direct radiation exposure. Periodic habitability surveys will be performed by Health Physics personnel assigned to the OSC.

The OSC will be staffed as described in Section 5.2.2.2 to provide an area for assembly and dispatch of support personnel during an emergency.

A description of the communications available in the OSC is provided in Section 7.2.

At the OSC Coordinator's discretion, other plant areas such as the I&C lab, Maintenance Building machine shop, etc. may be utilized to provide additional space for assembling support personnel depending on plant conditions and habitability considerations in the area being considered.

If the 599' level of the Control Complex elevation becomes uninhabitable or inaccessible, the Unit 2 Control Room can be used as an alternate location for the OSC.

7.1.3 Emergency Operations Facility (EOF) <L00537>

The EOF for the Perry Plant is a portion of the ground floor of the Training and Education Center (TEC). The TEC is located about 1/2 mile from the Protected Area along the site access road. It is a 105' x 175', two story, filled concrete block, brick-faced building which provides a protection factor of greater than or equal to 5 for .7 MeV Gamma Radiation for the EOF portion.

The EOF will be staffed as described in Section 5.2.2.4 to provide overall management of emergency response, coordination of offsite radiological and environmental assessment activities, determination of public protective action recommendations, and coordination of emergency response activities with Federal, State, and Local agencies. The EOF is also the central point for receipt and analysis of field monitoring data and coordination of sample media during an emergency.

The EOF has been sized to provide adequate space to perform all required functions including space for designated Federal, State of Ohio, and local county officials which may be sent to the EOF. There is a Personnel Decontamination Room in the EOF for decontamination of site evacuees should it be necessary.

In addition to supporting NRC site response team operations, the EOF NRC Office has been set-up to support interim public information activities being carried out by the Public Information Response Team (PIRT). The Tim Corbett Auditorium on the second floor of the TEC can be used for conducting small news media briefings.

The functions of the PIRT do not take precedence over the Perry Plant's commitment to support NRC site operation; therefore, public information activities will be transferred to the JPIC when activated at a Site Area Emergency or upon notification that an NRC Site Team has been dispatched.

The layout of the EOF is illustrated in Figure 7-4.

The EOF has an isolable, high-efficiency particulate air filtered ventilation system which functions in a manner comparable to the Control Room ventilation system. The proper operation of the EOF ventilation system while in its emergency isolation mode is periodically tested per PTI-M53-P0002.

Included in the ventilation system is a particulate, iodine, and noble gas radiation monitor which will distinguish radioiodines at concentrations as low as $1.0E-7$ microcuries/cc. This monitor provides continuous indication and has an alarm which activates when levels increase to a predetermined value. An area radiation monitor is also installed to indicate the radiation dose rate inside the EOF and provide an alarm when levels increase above a predetermined value.

A description of the communications available in the EOF is provided in Section 7.2.

The technical data and instrumentation available in the EOF include computer terminals to access the ICS and the CADAP programs, which are described in Sections 7.5.1 and 7.5.10.1 respectively.

Up-to-date records, drawings, procedures, and instructions required to support overall management of emergency response are available in the EOF Records Room and the Simulator

The Backup EOF is at the FirstEnergy Ashtabula Service Center (ASSC), on State Route 84 in Saybrook, OH, which is located approximately 18 miles ESE of the Perry Plant. Backup EOF functions will be carried out in the second floor of the ASSC Service Building. Provisions have been made for transmission of data and information between the Backup EOF, and the TSC or the Control Room to allow continued dose assessments and decision-making. Further details on the activation and operation on the Backup EOF are provided in EPI-A11.

7.1.4 Joint Public Information Center (JPIC)

The JPIC for the Perry Plant is located at Lakeland Community College in Kirtland, OH, about 16 miles from the site. The facilities used as the JPIC provide space for over 350 media personnel as well as work space for Company, Federal, State and County public information personnel. <S00535>

The JPIC will be staffed as described in Section 5.2.2.5 to coordinate the release of emergency information and to provide the media, and hence the public, a single point of contact. The JPIC also has provisions for media monitoring and rumor control.

JPIC personnel receive emergency information from the Perry Plant and from this coordinate the development and distribution of news statements. Information is then given to members of the news media in the form of typewritten copy and oral briefings. The JPIC will also provide logistics assistance to members of the news media present.

A detailed layout of the JPIC is contained in the Emergency Public Information Organization Manual.

7.2 Communications Systems

7.2.1 Normal Communications Systems

1. Plant-to-Offsite Communications

Voice communications between administrative office areas, the Control Room, selected plant areas, onsite emergency response facilities, and points outside the plant are provided by a commercial Private Branch Exchange (PBX) Telephone System.

A backup communications link to the PBX system between various Perry Plant areas and offsite emergency response locations will be provided by the Off-Premise Exchange (OPX) Telephone System. The OPX system is a part of the Centrex based telephone system and is connected to the Perry Plant via the company owned and operated microwave relay system.

Microwave and radio communications are also established between the Control Room and the System Control Center (SCC) to transmit voice, analog, and digital signals. The Microwave communication system is backed by very high frequency (VHF) radio.

A detailed description of these telephone communications systems, including normal and backup power supplies, is provided in Section 9.5.2.2.1 of the USAR.

2. Intra-Plant and Site Communications

Voice communications between various plant buildings and locations is provided by a page/party, public address (PA) system. The Plant PA is specifically designed for utility and heavy industrial applications where intelligible communication in areas of high ambient noise is desired.

Manually actuated Plant Emergency and Fire Alarms are activated from the Control Room. A multitone generator system provides high volume or alarm signals which are broadcast through the Plant PA speakers.

A Maintenance and Calibration Communication System provides a 12 channel headset communicator network. A Control Room patch panel is used to connect up to 12 parties on one channel to allow communication between the Control Room and jack locations where equipment is being tested, maintained, or calibrated.

The Exclusion Area Paging System is an independent PA system consisting of power amplifiers and high power speakers. The system is capable of broadcasting either a prerecorded message, or voice message using a hand-held microphone, which are audible over the entire exclusion area.

A detailed description of these systems, including their operation and normal backup power supplies, is provided in Section 9.5.2.2.2 of the USAR.

7.2.2 Emergency Communications

The various communications systems described in Section 7.2.1 provide reliable and redundant means for communicating between areas throughout the Perry Plant. To enhance the reliability of communications with offsite areas, agencies and authorities, various dedicated leased telephone lines are employed. Several automatic ringdown circuits have also been programmed using the Perry Plant PBX Telephone System to assist in the rapid and unfiltered transfer of information between key ERO positions in each of the onsite Emergency Response Facilities.

In the event that one or more of the dedicated line networks are inoperative, commercial telephone lines, the Perry Plant's PBX, and Company's OPX systems will provide a back-up means of communications between the Perry Plant, Federal, State and local governments with primary responsibilities during an emergency. A block diagram illustrating dedicated emergency telephone communications, used for offsite notification purposes between the Perry Plant and Federal, State and local counties authorities, is provided in Figure 7-5.
<S00551>

1. Emergency Telecommunications System (ETS)

In the event of a serious emergency at a nuclear power reactor site, the NRC considers it essential that certain communication pathways are established and maintained in order for the NRC to fulfill its emergency response mission. The Emergency Telecommunications System (ETS) provides a network for essential communications functions. The system uses the licensees communication network to provide communications links to the NRC Operations Center on a regular basis and when normal telephone service (business dial tone) is unavailable.

These communications functions identified by the NRC as essential, particularly in the early phases of an accident, until an augmented response effort by NRC personnel and other agencies is established at the scene of the emergency, are discussed below.

- a. The Emergency Notification System (ENS) serves as the Perry Plant's primary means of initial notification of an event to the NRC, as well as ongoing information on plant systems, status, and parameters. Instruments dedicated for ENS use are located in the following facilities:
 - 1) Unit 1 Control Room (CR)
 - 2) Technical Support Center (TSC)
 - 3) Emergency Operations Facility (EOF)
- b. The Health Physics Network (HPN) serves as the Perry Plant's communication link with the NRC on radiological conditions (in-plant and offsite) and meteorological conditions, as well as discussions on the assessment of trends and the need for protective measures onsite and offsite. Instruments dedicated for HPN use are located in the following facilities:
 - 1) Technical Support Center (TSC)
 - 2) Emergency Operations Facility (EOF)
- c. The Emergency Response Data System (ERDS) channel over which raw reactor parametric data will be transmitted from the Perry Plant site. ERDS activation will be accomplished as part of TSC mobilization within one hour of an Alert declaration.
- d. Various counterpart and data links in support of NRC Regional Site Team personnel dispatched to the Perry Plant can be established using the Emergency Telecommunications System (ETS) network. These counterpart links are established exclusively for NRC communications. Instruments dedicated for the following uses are installed in the TSC and EOF:
 - 1) Management Counterpart Link (MCL)
 - 2) Reactor Safety Counterpart Link (RSCL)
 - 3) Protective Measures Counterpart Link (PMCL)
 - 4) Local Area Network (LAN) Access

In addition to the Emergency Telecommunications System (ETS) network, additional plant Private Branch Exchange (PBX) extensions are also available in the Control Room, TSC and EOF to support the NRC Resident Inspector(s) and Regional Site Team personnel.

Emergency Telecommunications System (ETS) network drops are also available at the Perry Plant's Backup EOF with the exception of the ERDs and the Local Area Network (LAN) Access.

Testing of the Emergency Telecommunications System (ETS) network by the Perry Plant will be conducted in accordance with Section 8.5. Needed repairs to the Emergency Telecommunications System (ETS) network when discovered will be reported to the NRC per PSI-0007.

2. Emergency Response Network ("5-Way")

The primary communications link between the Perry Plant and the offsite State and local county EOCs or 24-hour notification points will be through a dedicated telephone conference loop, referred to as the "5-Way". Instruments off the "5-Way" Circuit are located in the following locations:

- a. Control Room
- b. Technical Support Center (TSC)
- c. Emergency Operations Facility (EOF)
- d. Ohio Emergency Management Agency (OEMA)
 - 1) EOC Emergency Operations Center; Columbus, OH
 - 2) 24 hour Backup - Ohio State Highway Patrol Office; Columbus, OH
- e. Ashtabula County
 - 1) Notification point - Sheriff's Department Dispatcher
 - 2) EOC (Jefferson, OH)
- f. Geauga County
 - 1) Notification point - Geauga County Central Communications Center
 - 2) EOC (Chardon, OH)
- g. Lake County
 - 1) Notification point - Lake County Emergency Operations and Communications Center, Central Communications Center
 - 2) EOC (Mentor, OH)

Commercial telephone lines have been installed in the Control Room, TSC and EOF to serve as a backup to the Emergency Response Network ("5-way") or the Emergency Telecommunications System (ETS) network ENS Circuit. These lines bypass the Perry Plant PBX and are routed via fiber optic cable to the telephone company's local central office in Perry, Ohio.

Communications from the Backup EOF will be via a commercial bridge established with the State and local counties using a private, local exchange, telephone line in lieu of the "5-way" circuit.

Telephone lines are used to link the Perry Plant to the OEMA via modem for transmission of limited plant operating data, site Meteorological Tower data, and plant effluent monitor data. A data link is also established with the Backup EOF via a commercial line, when the facility is activated. These modem links are used to support offsite radiological dose projections.

3. Onsite Inter-Facility Network ("3-Way")

The dedicated communications loop serving as a command and control circuit between the facility lead and Operations support positions in the Control Room, TSC, and EOF. The "3-Way" is used by the Emergency Coordinator to coordinate and disseminate onsite decision-making activities.

Communications from the Backup EOF will be via a conference call, initiated by the Backup EOF, to the Control Room and/or TSC.

4. Public Information Communications

Commercial telephone lines will be used to establish and maintain an open communications path between the onsite EOF or Backup EOF to the JPIC for updates on plant and event status, as well as the development and approval of Company press releases.

5. Radio Communications

Two-way radio communications at the Perry Plant are provided by a base to portable radio system. Separate radio channels are designated for specific in-plant and field functions.

The Plant Radio System can be accessed from the facilities onsite in support of emergency response activities via portable radio units assigned to the various plant elements and used on a daily basis.

The Central Alarm Station (CAS) can also establish radio communications with the Lake County Sheriff's Department.

A more detailed description of the Plant Radio System is contained in USAR Chapter 9.5.2.2.2.

In addition, the Perry Plant utilizes the FirstEnergy 800 MHz trunked radio system as its primary means of communicating with its RMTs in the field from the TSC, EOF, and Backup EOF dose assessment areas. Access to the FirstEnergy 800 MHz trunked radio system from the TSC and EOF, and Backup EOF is via radio-to-radio access. Commercial cellular telephones, installed in designated RMT vehicles, will serve as a backup to the FirstEnergy 800 MHz trunked system.

7.3 ERO Notifications

To provide for rapid augmentation of the shift staff by the ERO, an Emergency Paging System consisting of three separate modes has been devised. These modes consist of: (1) automated paging/callout system; (2) manual activation of pager utilizing the Site PBX Voice Mail feature; and (3) manual activation of pager utilizing the Corporate Voice Mail feature.

The objective of this system is to enhance the ability of the ERO to respond and augment the shift staff within the time frames identified in Table 5-1. Basically, the system will operate as follows:

1. The Shift Manager initially determines that an EAL will or has been exceeded.
2. The Shift Manager or designee will select or draft a message for playback to responders and direct the SAS Operator or available staff to record the message. A pre-designated on-call individual can also be contacted by the Shift Manager to initiate the emergency paging system if an event occurs where SAS and other on-shift personnel are unavailable to initiate the system.
3. Paging devices carried by designated ERO personnel are activated at this time by SAS, available on-shift personnel or pre-designated on-call personnel using either private commercial telephone lines, the Perry PBX or FirstEnergy telephone systems.
4. Paged personnel call in a response for their designated position and to hear recorded message. From the message received, the paged personnel will determine to what degree they should respond.
5. The paged personnel initiate callouts for which they are responsible to the degree necessary to ensure adequate personnel respond to the emergency.
6. The SAS Operator, available on-shift personnel, or pre-designated on-call individual will check which individuals have responded with the emergency callout list to ensure that the appropriate positions have been contacted.

7.4 Prompt Alert Siren System

Alerting and notification of the 10-mile EPZ population is accomplished under the direction of the local county EMA/DES. To facilitate the alerting of the public, a Prompt Alert Siren System, which meets the design objectives of NUREG-0654, Appendix 3, is installed throughout the EPZ in Lake, Geauga and Ashtabula Counties.

The Prompt Alert Siren System consists of 76 "electronic" sirens. Each siren consists of an electronic signal source (oscillator), power amplifiers, an array of loudspeakers, batteries and a battery charger, and a radio controller.

Sirens with nominal rated outputs of 109 decibels (dB), 115 dB and 123 dB have been incorporated into the Prompt Alert Siren System. The sirens are numbered separately in each county for ease of identification (e.g., L1 - Lake County, siren #1).

In general, the sirens have been located along public roadways, on the opposite side of the street from utility lines where possible. Most sirens have been mounted on wooden utility poles at least 60 feet above the ground with all sirens mounted at sufficient heights to avoid exposing the public to excessive noise levels. All sirens have a public address capability to broadcast voice messages at the discretion of the local county EMAs.

All sirens are operated by radio frequency (RF) control systems consisting of:

1. Three central-station control units, each having a backup power supply, are located in the local County EOCs.
2. Individual control-signal receivers at each siren location.

Each siren can also be operated manually at the siren site with an appropriate access key. The sirens in each county are under the control of the respective county officials.

Upon receipt of a START signal, a siren will produce the selected sound for approximately 3 minutes, or until a CANCEL signal is received. The sirens in this system are capable of continuous operation for up to 30 minutes from batteries, even in the event of a total distribution power failure. Figure 7-6 shows the locations of all sirens.

A siren test program has been established to include biweekly tests. For the most part, "quiet" tests are utilized, except for a quarterly audible test. The quiet test consists of the initiation from one of the local counties Emergency Operations Center (EOC) of an inaudible tone that verifies operation of the siren station components. Using the test results located at the siren station, a silent test will confirm the following: 1) AC power available; 2) DC power available; 3) partial and full amplifier and speaker driver operation, and 4) rotor operation (on those that have a rotating capacity).

The annual full operability test requirement will be met during one of the quarterly audible tests. The annual test consists of the activation of the full Prompt Alerting System from one or all of the county Emergency Operations Centers.

NEI-0951, serves as the controlling document for the performance of the tests. <S00568, S00562>

7.5 Assessment Facilities

The systems and equipment described in the following sections show that the capabilities and resources are available to provide valid and continuing assessment of conditions throughout the course of an accident.

7.5.1 Integrated Computer System (ICS)

ICS has been developed to furnish plant operators and other emergency personnel with critical plant data in the event of an emergency.

ICS is an integrated system that gathers the required plant data, stores and processes that data, generates visual displays for the operator and other personnel who need plant status information, and provides printed records of transient events. The basic components of ICS are the Data Acquisition System (DAS), the Central Processor Units, and the Graphic Display Consoles.

The DAS interfaces with existing plant sensors or devices, converts the acquired signal to digital data, and performs some pre-processing of the data before passing it on to the central processors.

The Central Processor Units (CPUs) are computer modules that accept data from the pre-processors, store the data, perform calculations, validate the information, and generate displays according to the programmed formats.

The Graphic Display Console (GDC) consists of a display and keyboard. The display generates a variety of graphic real-time displays that are available on command from the keyboard. The displays are capable of showing critical plant parameters such as water levels, temperatures, pressures, flows, and status of pumps, valves, and other equipment. More significantly, they provide the plant operator with a central display of critical "symptoms" of the plant conditions that assist the operator in entering and following the Plant Emergency Instructions (PEIs) and achieving the required actions. None of the GDCs are a control console; they are strictly a source of safety significant information which, when used in conjunction with the existing CR instrumentation, assists CR personnel in performing their emergency response functions. ICS data is available on a CRT monitor in the CR at various locations. GDCs are also located in the Remote Shutdown Room, TSC, OSC and EOF. Other equipment located in the TSC provides the capability of printing out in tabular or graphic formats all the ICS variables as a function of time. Statistical analysis and other analyses may also be performed.

In addition to providing an onsite data acquisition and assessment capability, ICS data can be accessed by the OEMA via dedicated telephone lines and the back-up EOF via the corporate network. These transmissions consist of data points from the Perry Plant Meteorological Tower, plant vent radiation monitor and flow data, and specific plant operating parameters, used to support offsite radiological release calculations.

7.5.2 Gamma Spectroscopy System (GSS)

The Gamma Spectroscopy System (GSS) is a multi-user computer based data information system provided for the operation of Radiochemistry and Health Physics. GSS consists of multiple gamma spectroscopy units.

* Validation is the action taken in using redundant signals or other secondary signals to increase the confidence in the data presented.

To enhance system reliability, GSS includes redundant computers. All data normally accumulated and stored on both computers is accessible. The system is configured for efficient multi-tasking operation.

7.5.3 Plant Radiological Monitors

Radiological monitors are installed throughout the plant to provide detection, measurement, and indication of area radiation, airborne radioactivity concentrations, and process radioactivity concentrations. A summary description of various radiation monitors which are generally described below, is provided in USAR Chapter 11.5.

In general, the plant radiological monitors have been designed in accordance with the following:

1. Area Radiation Monitoring System (ARMS)

The Area Radiation Monitoring System (ARMS) provides continuous detection, measurement, and indication of the ambient gamma radiation level through the use of gamma-sensitive detectors located in selected areas of the plant.

This system supplements radiological protection for plant personnel, helps to minimize personnel exposure to radiation, and aids the reactor operator by providing instrumentation which may be used for monitoring radiation levels throughout the plant during normal operation and following an incident. The system consists of independent channels strategically located throughout the plant in areas where radioactive material may be present or inadvertently introduced, in areas where high radiation levels may develop, or in areas where the operator may gain information regarding the nature and extent of an incident.

Most channels are operated from the Control Room panels. Each of these channels consists of three basic components: detector, alarm indicator unit, and a control room readout module. Local instrument channels consist of the detector and an enclosure containing a single channel ratemeter, alarm light, and horn. The detectors are wall-mounted gamma sensitive devices located in the specific areas of concern. The alarm and indicator units are located nearby the respective detectors to provide plant personnel in the area with radiation dose rate level indication, visual alarms, and an audible alarm. Where necessary, remote warning units are provided in addition to the local alarm and indicator units.

Each channel has two warning functions at the local alarm and indicator unit: a red warning light with an associated audible alarm corresponds to a high radiation level. Each channel has visual alarm indication of alert, high radiation, and channel failure on the readout module. In addition, all channels (except local channels) are recorded on multipoint recorders located in the Control Room.

To assist in post-accident evaluation, high range gamma monitors have been added to the reactor building and to the drywell to provide a range of 1 R/hr to 107 R/hr. They are powered from independent 120V AC, diesel-backed buses and are provided with continuous readout and multipoint recorders in the Control Room. Two monitors will be located in the drywell at approximately core midplane spread approximately 32° apart centered approximately at 225° azimuth.

Two monitors are located in the Reactor Building at approximately the 689' level, and the same degree spread and azimuth as those in the drywell.

2. Process Radiation Monitoring System

The Process Radiation Monitoring (PRM) System provides detection, measurement, and indication of either effluent stream radioactivity concentration, or gross gamma intensity at strategic plant locations. Several monitors provide trip signals which automatically initiate Reactor Protection System functions, Nuclear Steam Supply Shutoff functions, or the stoppage of radwaste effluent flow. All process monitors provide CR indication and alarm features for operator information. All process channels are continually energized. Each channel consists of a detector, log-ratemeter, and a recorder.

Sampling racks are provided for those channels that require laboratory analysis of the effluent stream being monitored. All liquid monitors utilize a sample pump to draw a representative sample, drive it past the detector, effect grab sampling (as necessary), and then return the fluid to the effluent stream.

3. Air Monitors

Fixed continuous air monitors and portable air monitors and samplers are utilized to determine the concentrations of airborne radioactivity throughout the plant.

The fixed air monitors provide continuous data to indicate trends throughout the various plant areas. Particulate filters and iodine sampling cartridges are removed periodically to identify the specific nuclides.

The airborne radiation monitor typically consists of a particulate measuring channel, an iodine measuring channel, and a gas measuring channel. These monitors provide supporting data for the surveillance of plant radioactivity levels and documentation for demonstrating compliance with regulatory requirements.

A typical airborne radiation monitor subsystem operates as follows: A representative sample of air from a ventilation duct is drawn through a sample line to the airborne monitor unit by means of an air pump. Sampling of the ducts is achieved by the use of a sample probe placed in the air stream. The area of the probe tip is sized so that the velocity of the sample at the probe tip approximates the velocity of the air at the design flow rate in the duct.

Sampling points on ventilation ducts are taken, whenever possible, at points such that the ventilation flow is fully developed and mixing is complete. The sample passes through a particulate, iodine, and gas channel in series. Each channel is independent. In the particulate channel, the sample air passes through a fixed or moving filter which collects particulates and is monitored by a beta scintillation detector, the output of which is preamplified and transmitted to a ratemeter located in the Control Room. The detector and filter are enclosed in a lead shield to reduce the background radiation effects.

In the iodine channel, the sample passes through an activated charcoal cartridge which traps the radioactive iodine. A shielded gamma scintillation detector monitors the cartridge. The output signal is preamplified and transmitted to a ratemeter located in the CR. In the gas channel, the sample enters a shielded volume monitored by a beta sensitive scintillation detector. The output signal is preamplified and transmitted to a ratemeter in the Control Room.

The gas is exhausted back to the ventilation duct. Differential pressure switches across the filter and charcoal cartridges are provided to give high and low flow alarms at the unit and in the CR. Flow regulation is used to maintain a constant flow through the filters. A flow indicator, flow alarms, and log ratemeter indication and alarms are also provided on the unit enclosure.

Sampling systems for the purpose of collecting radioiodines and particulate effluents are connected to the following effluent flow paths:

- a. Unit Vent (1 & 2)
- b. Heater Bay/Turbine Building Vent
- c. Off-Gas Vent

Monitoring of radioactive Iodine concentrations under accident conditions in areas where personnel may be present is accomplished with portable Iodine sampling cartridges and analyzed by gamma spectroscopy. The particulate prefilter will also be analyzed by gamma spectroscopy.

Fixed high range monitors will monitor noble gas concentrations under accident conditions.

7.5.4 Fire Protection System

Fire protection at the Perry Plant consists of water, halon, foam, and carbon dioxide fire protection systems. Fire detection systems also monitor the condition of numerous control valves and equipment of the fire protection system, and the condition of smoke, heat, and flame detectors located throughout the plant. If an alarm occurs on one of the detectors, the point address and type of alarm is transmitted to the Fire and Security Monitoring System which alarms in the SAS located in the Control Room. Appropriate action is then initiated by the SAS Operator to confirm the alarm or initiate fire fighting efforts.

A detailed description of the Fire Protection System's design and capabilities is provided in Chapter 9.5.1 of the PNPP USAR.

7.5.5 Seismic Event Monitors

The Environmental Monitoring System monitors and records any seismic event which affects the area surrounding the containment structure. Section 3.7.4.2 of the USAR contains a complete list of equipment.

The monitor's readings are recorded on recording plates, paper charts, and magnetic tape for future reference. Specific monitors will trip an annunciator in the CR if an abnormal seismic signal is detected. Upon receiving a signal, the plant operators will verify that the plant is still in a safe operating condition, or take steps to return the plant to a safe condition.

7.5.6 Hydrological Monitors

To assure that the underground hydrostatic pressure is less than that critical to structural stability, 21 standpipes are located in the basements of the safety related buildings. These will be checked and the levels recorded periodically.

A detailed description of the Underdrain and Gravity Discharge Systems, used to control groundwater around the Perry Plant, is contained in USAR Chapter 2:4.13.

7.5.7 Onsite Meteorological Measurement Program

The Onsite Meteorological Program at the Perry Plant site began in April 1972. The 60 meter tower was upgraded and moved 3,500 feet to a new location in August 1977. The tower was moved in 1977 in order to minimize any potential effect of the PNPP cooling towers under construction at the time and as a result of cooling tower operation.

Regional weather data is also available for manual input to the emergency dose assessment computer program from the Cleveland-Hopkins branch of the National Weather Service (NWS). This data is available on a 24-hour-per-day-basis and is representative of the meteorological conditions at the Perry Plant. <S00552>

7.5.8 Laboratory Facilities <S00542>

The Perry Plant laboratory facilities are equipped to provide the water chemistry and radiochemical analysis support required during normal plant operations and in the event of an emergency to assist in the diagnosis of plant conditions. This emergency sampling capability is part of the Post-Accident Sampling System (PASS).

The PASS is designed to:

1. Collect liquid and gaseous samples from containment after a loss-of-coolant accident.
2. Provide in-line analysis of collected liquid samples for total dissolved gas, pH, specific conductivity, and dissolved oxygen.
3. Provide samples for onsite and offsite laboratories for wet chemistry and isotopic analysis. --

In addition, the system is designed to minimize radiation exposure to operating personnel during post accident sampling conditions. The maximum exposure to each operator during sampling transport and analysis is limited to 5 Rem TEDE and 75 Rem to the extremities (hands and feet).

The shielding study conducted in response to NUREG-0737, TMI Action Plan, Item II.B.2 shows that the normal counting and laboratory facilities will be habitable in post accident conditions. Therefore the normal counting room will be used to perform isotopic analysis of post accident samples, and an offsite contractor laboratory will be used to provide backup liquid analysis capabilities, as required.

A backup counting room is provided in the TSC. This counting room is equipped with a Multi-Channel Analyzer.

7.5.9 Facilities and Equipment for Offsite Monitoring

1. Geophysical Phenomena Monitors

Information gathered by the natural phenomena monitors (meteorological and seismic) will be available in the Control Room. Detailed information from the seismic and hydrological indications in the plant will be collected, and relayed to the Control Room. The information, if required, may then be transmitted to offsite locations via telephone.

In the event that the information is not available, or cannot be relayed to offsite locations, the offsite locations may obtain some of the information from local airports and weather bureaus.

2. Radiological Environmental Monitors

The Radiological Environmental Monitoring Program (REMP) may be utilized to assess the emergency.

In the event of an accident, the sampling stations may be used to collect information to aid in the assessment of the accident. Instrumentation at the sampling stations includes radiation measuring devices with selected stations having equipment to continuously sample the air.

The sampling locations and types of samples are shown in Offsite Dose Calculation Manual (ODCM). In addition, the Perry Plant REMP Manual provides detailed information concerning sample types and locations.

In addition to the REMP instrumentation available for monitoring the area surrounding the Perry Plant, portable instrument readings will be taken during emergencies by RMTs. These teams will be trained and provided with equipment to monitor for direct radiation, airborne particulate activity, and radioiodines.

Radioiodine monitoring will be accomplished using a portable air sampler to draw air through a particulate filter then through a silver impregnated, silica gel cartridge. The cartridge will then be monitored and the results used in calculations to provide an airborne radionuclide concentration. This method has a minimum sensitivity of 1×10^{-7} $\mu\text{Ci/cc}$ under field conditions.

7.5.10 Dose Assessment Capabilities

1. Automated

Dose assessment in the event of an emergency at the Perry Plant will be accomplished using a computerized system that receives data automatically from the site meteorological (MET) tower, plant radiation monitors, and the Plant Integrated Computer System. The software package that performs these functions is referred to as CADAP (Computer-Aided Dose Assessment Program).

The CADAP software package is installed and operated on designated processors located in the Control Room, TSC, EOF and Backup EOF. Each processor runs in a multi-tasked environment under a "Windows" system and is capable of running independently. Individual processors interface with the Plant Integrated Computer System on a real time basis to obtain meteorological data, plant vent flow and radiation monitor data, and other plant status indicators used in the CADAP logic. Should this computer link fail, CADAP will allow the user to manually enter the necessary data using user-friendly prompts.

CADAP is entirely menu driven and is configured to provide for rapid calculation of offsite doses for a monitored release automatically seeking inputs for the calculation and formulation of decisions based on plant data. CADAP also provides for a summation of dose over multiple monitored release points and allows a user the ability to manually enter and edit data for an unmonitored release. Dispersion and dose calculations can be initiated by a single operator at any of the designated processors.

CADAP complies with EPA-400 in all facets of dose projection. CADAP complies for the projection of early phase (predominately plume exposure) and intermediate phase (ground exposure) doses, with the exception that Committed Dose Equivalent for a child thyroid is conservatively calculated in lieu of the generic EPA-400 thyroid.

The user is prompted to manually select the appropriate core state (i.e., coolant activity, clad damage, or fuel melt). The source term assigned to each specific core state is based on the guidance established in NUREG-1228. Thirty-three (33) nuclide species required by NUREG-1228 as well as Rb-88 and Cs-138 are considered. CADAP will also allow a user to manually enter an isotopic analyses if known, to more realistically determine the source term.

CADAP will then dynamically calculate the radiological inventory available for release, applying the applicable decay factors and radioiodine reduction factors per NUREG-1228 based on the release path. Nuclide decay is also taken into account for time after shutdown and downwind plume travel.

A straight-line, Class A, Gaussian model is used in CADAP for the real time, rapid estimation of dose in the 10-mile EPZ to the general public following the classification of an emergency event or the recognition of a severe radiological release. Any release from the plant is considered by CADAP to be ground level released in accordance with Regulatory Guide 1.145.

Atmospheric dispersion or CHI/Q values for plume centerline are dynamically calculated in accordance with Regulatory Guide 1.145 using actual 15-minute meteorological data from the site MET tower, as described in USAR Chapter 2.3.3.4. Should main and backup MET tower data become unavailable, CADAP offers alternative choices to the user for conservative dispersion coefficients based on other available indications.

Regional weather data is also available for manual input to the emergency dose assessment computer program from the Cleveland Hopkins Airport branch of the National Weather Service (NWS). This data is available on a 24-hour per day basis. <S00552>

CADAP dose projection results, provided in a tabular format, are sufficient to allow the user to identify the plume position, and the location, magnitude and arrival time of (1) the peak relative concentration and (2) the relative concentrations at appropriate locations.

CADAP allows a user to separately enter data from plant RMTs in the field, which can be used to: (1) compare calculations based on RMT data to effluent monitor readings, (2) extrapolate readings to other upwind and downwind locations, and (3) to display RMT information at other workstations.

Contingency calculations for releases from Containment and the Fuel Handling Building are analyzed. This option provides a user with contingency routines for dose calculations based on the potential for a release, allowing a user to diagnose ("what if") a potential radiological situation based on potential system failures.

Each dose projection, once accepted, will be assigned to the affected sector unless an evacuation in that sector has been ordered; in which case, the evacuation time estimate for that sector will be factored into the dose assigned to that sector.

CADAP will calculate an accumulated dose to the hypothetical highest exposed individual, i.e., one who was located at the plume centerline for the duration of the release(s). CADAP does not factor in census data to determine total population dose. Only the designated processors assigned as the "master" will be authorized to update the accumulated dose file maintained on the Plant Integrated Computer System. Control for updating the accumulated dose can be transferred by the user between the designated processors in the Control Room, TSC, EOF and Backup EOF.

CADAP provides the user with the ability to: (1) review and revise data received directly from the Plant Integrated Computer System until CADAP is directed to perform calculation, (2) lockout data points if the value is determined by the user to be in error, and (3) store each calculation based on actual releases for later recall until file maintenance is performed.

Once a dose projection is completed, CADAP will automatically provide the user with the most conservative protective action recommendation (PAR) based on the following options:

(1) General Emergency default based on guidance set forth in Supplement 3 to NUREG-0654/FEMA-REP-1, or (2) EPA-400 specified values of either 1 Rem Total Effective Dose Equivalent (TEDE) or 5 Rem Committed Dose Equivalent (CDE) - Child Thyroid. A detailed description of the default PARs based on plant status is contained in Section 6.4.1.

At the user's command, CADAP will provide printouts of all major assumptions, Plant Integrated Computer System inputs or manual inputs for each calculation (actual releases as well as contingency calculations), dose and dose rates in one-mile increments from the Site Boundary to 10-miles, and PARs based on subareas. Each printout will have a date and time stamp to document when the calculation or PAR was completed.

2. Backup Hand Calculations of Offsite Dose

EPI-B7b contains the information necessary to perform dose projections during emergency conditions at the Perry Plant in accordance with NUREG-0654 and EPA-400-92-R-001. The manual (hand calculational) method consists of the following attachments:

- a. Instructions for determining atmospheric dispersion parameters, or X/Q values, are presented for use in the event that atmospheric dispersion cannot be ascertained directly from the Site Meteorological Tower. Instructions are also provided on how to obtain or determine other meteorological parameters from alternate sources.
- b. The calculational methodology is provided for the various release points based on effluent monitor readings and accident type. The individual performing the calculation must choose which vent monitor(s) are indicating a release and perform the appropriate calculations. These calculations are broken down as follows:
 - Unit 1/Unit 2 Vent Monitors:
 - 1) Loss of Coolant Accident in Drywell
 - 2) Loss of Coolant Accident in Containment
 - 3) Fuel Handling Accident in Containment
 - 4) Fuel Handling Accident in the Fuel Handling Building
 - 5) Break Outside Containment/Auxiliary Building
 - Turbine Building/Heater Bay Vent Monitors
 - Offgas Vent Monitors
- c. A technique is provided to project doses at various points within the 10 mile EPZ using offsite radiation monitoring team (RMT) readings. This attachment also provides the charts necessary to convert offsite iodine count rates to CDE-child thyroid values.
- d. The final attachment is used to calculate accumulated doses after an accidental release of radioactivity. This calculation would usually be performed after the accident had been terminated, in order to determine the actual dose received by the public.

The calculation methodologies contained in EPI-B7b mimic the CADAP methodology described in Section 7.5.10.1 to obtain consistency between automated and manual methods. However, the resultant calculations from the manual method (EPI-B7b)

will not duplicate CADAP output precisely, due to approximations and assumptions made to make manual (hand calculations) feasible in an acceptable time period.

7.6 First Aid and Decontamination Facilities <L00454, S00560>

There is a dispensary located onsite which is capable of handling routine medical emergencies. This facility is equipped with normal industrial first aid supplies.

Located in strategic areas around the plant are additional first aid equipment such as first aid kits and stretchers. Site first aid equipment is periodically inspected and maintained under the plant repetitive task program.

A personnel decontamination area is located on the 599' elevation of the Control Complex (CC) adjacent to the RRA. This facility is equipped with showers and sinks that drain to the Radioactive-Waste Detergent Drain System. Supplies in the room include materials used to decontaminate wounds and personnel. This decontamination area is maintained by Health Physics and used to support routine plant operations and outage activities.

A Personnel Decontamination Room is also located adjacent to the main entrance to the EOF and is reserved for emergency use. This facility is equipped with first aid equipment as well as personnel decontamination supplies. The shower and sink in this room drain to a buried concrete holding tank prior to transfer to the Liquid Radwaste System. This facility will be used for decontamination and first aid treatment of site evacuees.

Both the EOF and 599' CC decontamination facilities, include supplies and plan-approved decontaminants required for the removal of radio-iodine skin contamination. <S00564>

7.7 Protective Equipment and Supplies

Various onsite locations have been designated as emergency assembly points and areas where emergency teams are assembled and equipped.

1. Control Room/Shift Manager's Office

The Control Room and Shift Manager's Office are designed to be habitable under accident conditions and serve as the initial onsite emergency response facility. Emergency lighting, power, air filtration/ventilation system, and shield walls enable operators to remain in the Control Room to ensure that the reactor will be maintained in a safe condition. In addition, the operators are able to evaluate plant conditions and relay pertinent information and data to the appropriate onsite and offsite personnel, agencies, and organizations during all emergencies.

To ensure the shift personnel and other personnel assembled at the location can remain self-sufficient, specific emergency equipment and supplies are available as specified in PSI-0018. Additional dosimetry and protective clothing, if required, are available from the Radiological Restricted Area (RRA) and the Operations Support Center (OSC) once operational. <S00550>

2. Radiological Restricted Area (RRA) Control Point

During normal operations, access to the RRA is through the Control Point, located at the 620' elevation of the Control Complex Building (CCB). Health Physics equipment is available in this area to support daily operation and maintenance, as well as OSC activities.

3. Emergency Operations Facility (EOF)

Emergency equipment and supplies located in this facility are maintained for such tasks as personnel monitoring, decontamination, and offsite radiological monitoring and sample collection.

4. Operations Support Center (OSC)

The 599' CCB Chemistry laboratories are co-located with and are an integral part of the OSC. Adequate radiation survey instruments and dosimetry, used on a daily basis to support plant operations, are immediately available at the 599' CCB to support OSC facility and repair team activities. Respiratory protection and protective clothing, maintained as part of normal plant operations, is also available in the immediate vicinity of the 599' CCB and at designated in-plant locations. Additional equipment and supplies required to support OSC activities are stored in or adjacent to the OSC Conference Room.

Decontamination facilities and supplies, are maintained by HPU in the vicinity of the OSC and are used on a daily basis. If required, these facilities and supplies are immediately available in support of emergency situations.

Extensive equipment and supplies, used for daily and routine maintenance and repairs on plant equipment, is available to support initial Control Room (on-shift) and subsequent OSC repair efforts. Fire fighting and first aid equipment is prepositioned and maintained per FPI-A-B01 and under the repetitive task program.

FIGURE 7-1 - RELATIVE LOCATION OF EMERGENCY RESPONSE FACILITIES

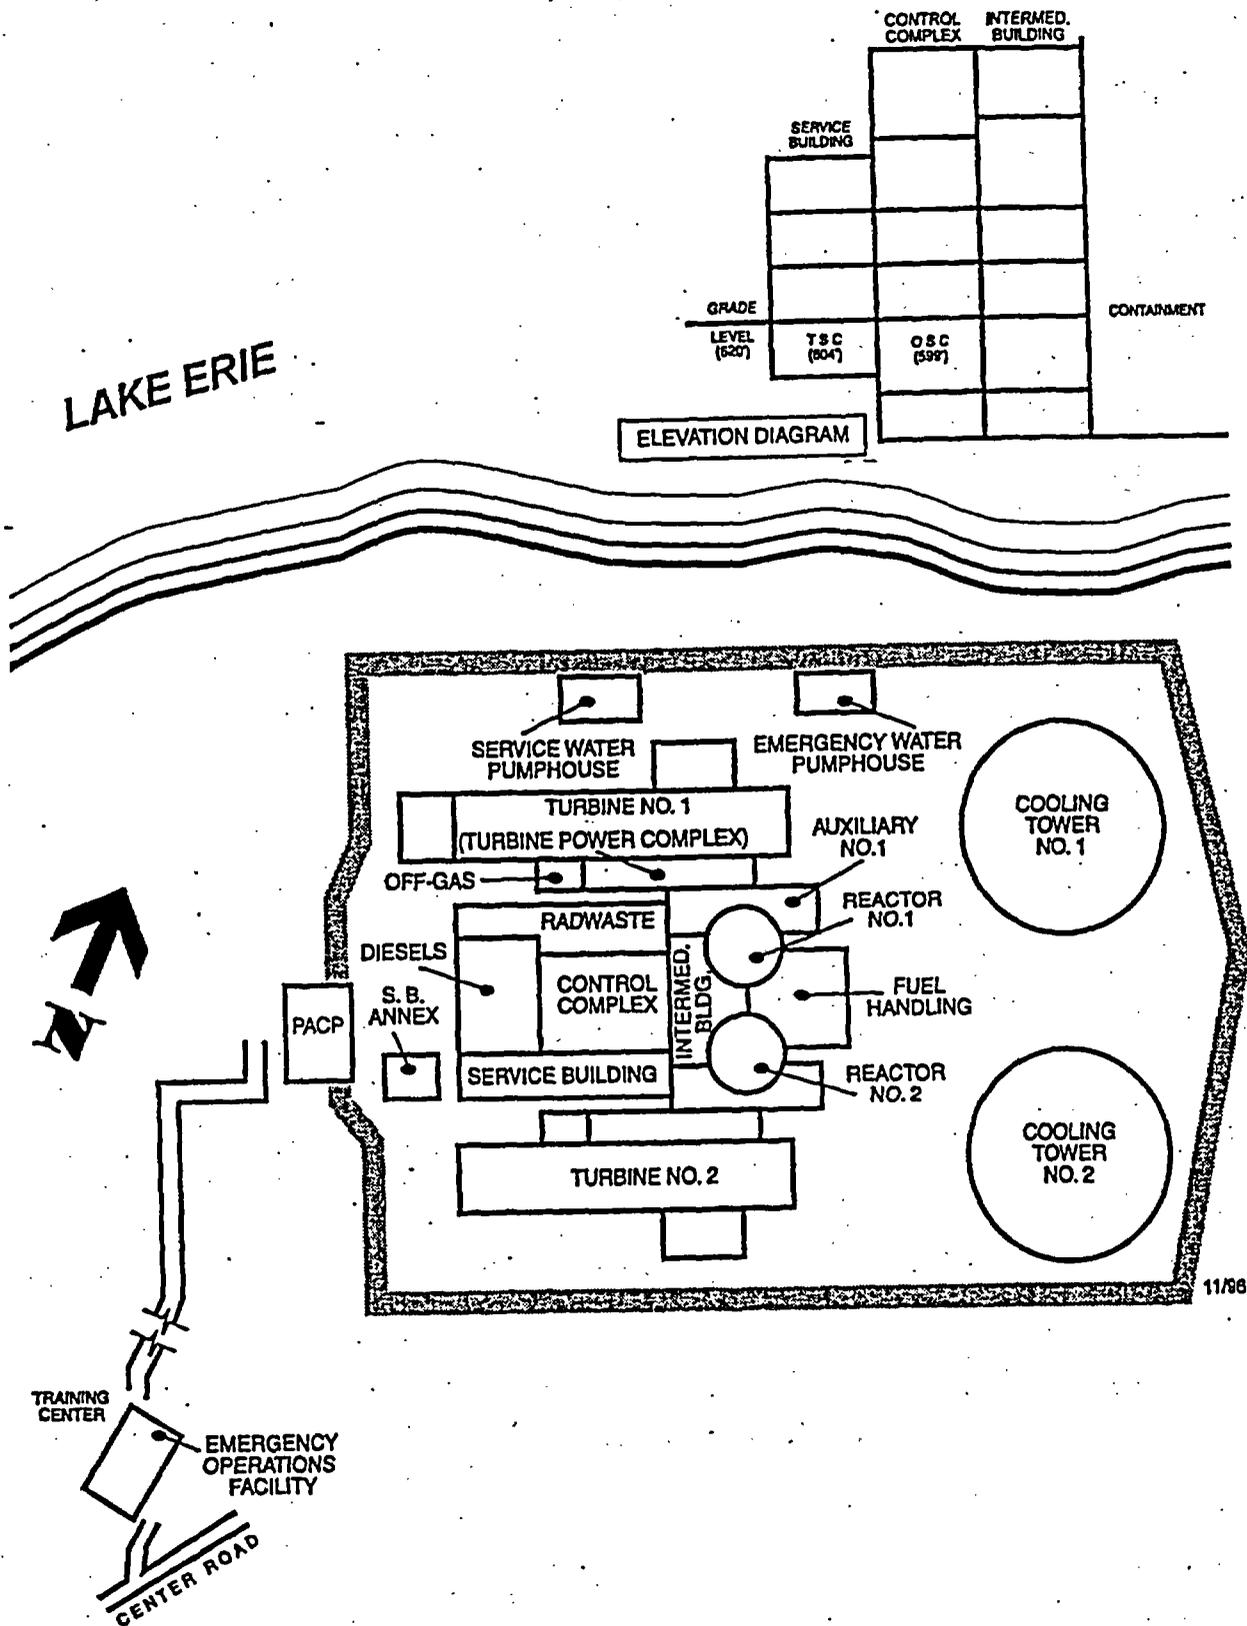


FIGURE 7-2 - TECHNICAL SUPPORT CENTER (TSC) LAYOUT

PERRY NUCLEAR POWER PLANT TECHNICAL SUPPORT CENTER (TSC) LAYOUT

SERVICE BUILDING
ELEVATION 603' 6"

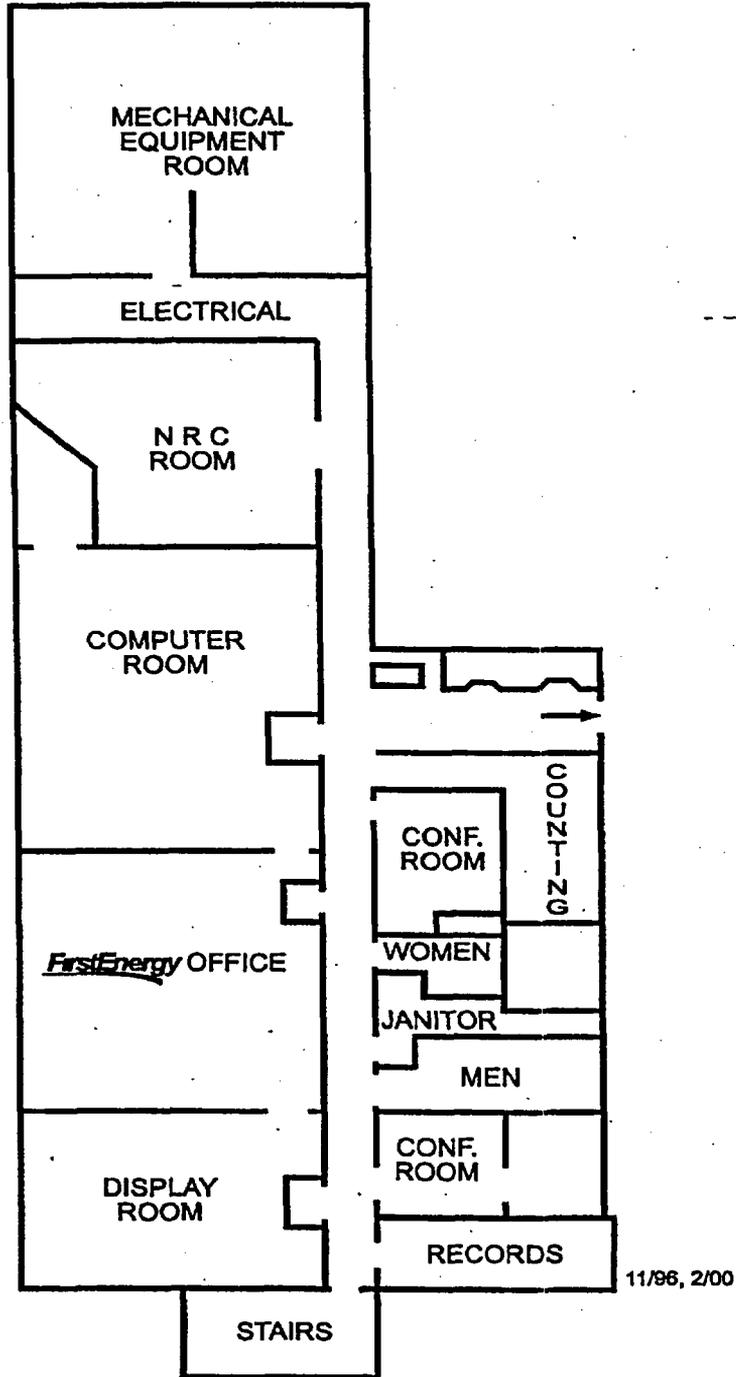


FIGURE 7-3 - OPERATIONS SUPPORT CENTER (OSC) LAYOUT

PERRY NUCLEAR POWER PLANT OPERATIONS SUPPORT CENTER (OSC) LAYOUT

CONTROL COMPLEX BUILDING
ELEVATION 599'

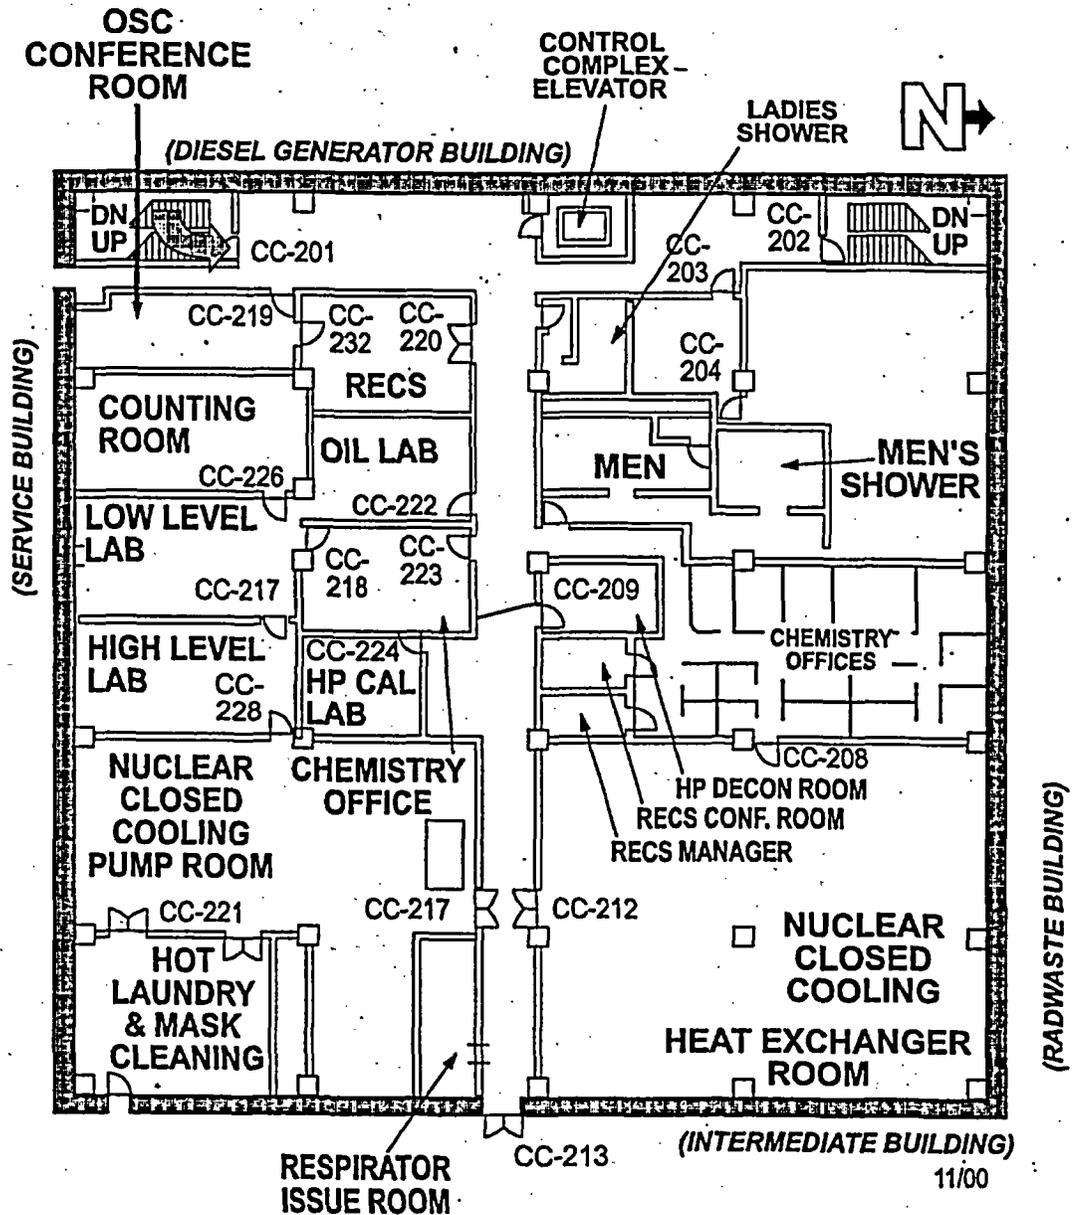


FIGURE 7-4 - EMERGENCY OPERATIONS FACILITY (EOF) LAYOUT

EMERGENCY OPERATIONS FACILITY (EOF) LAYOUT

EOF BOUNDARY

Perry Training Center/ First Floor

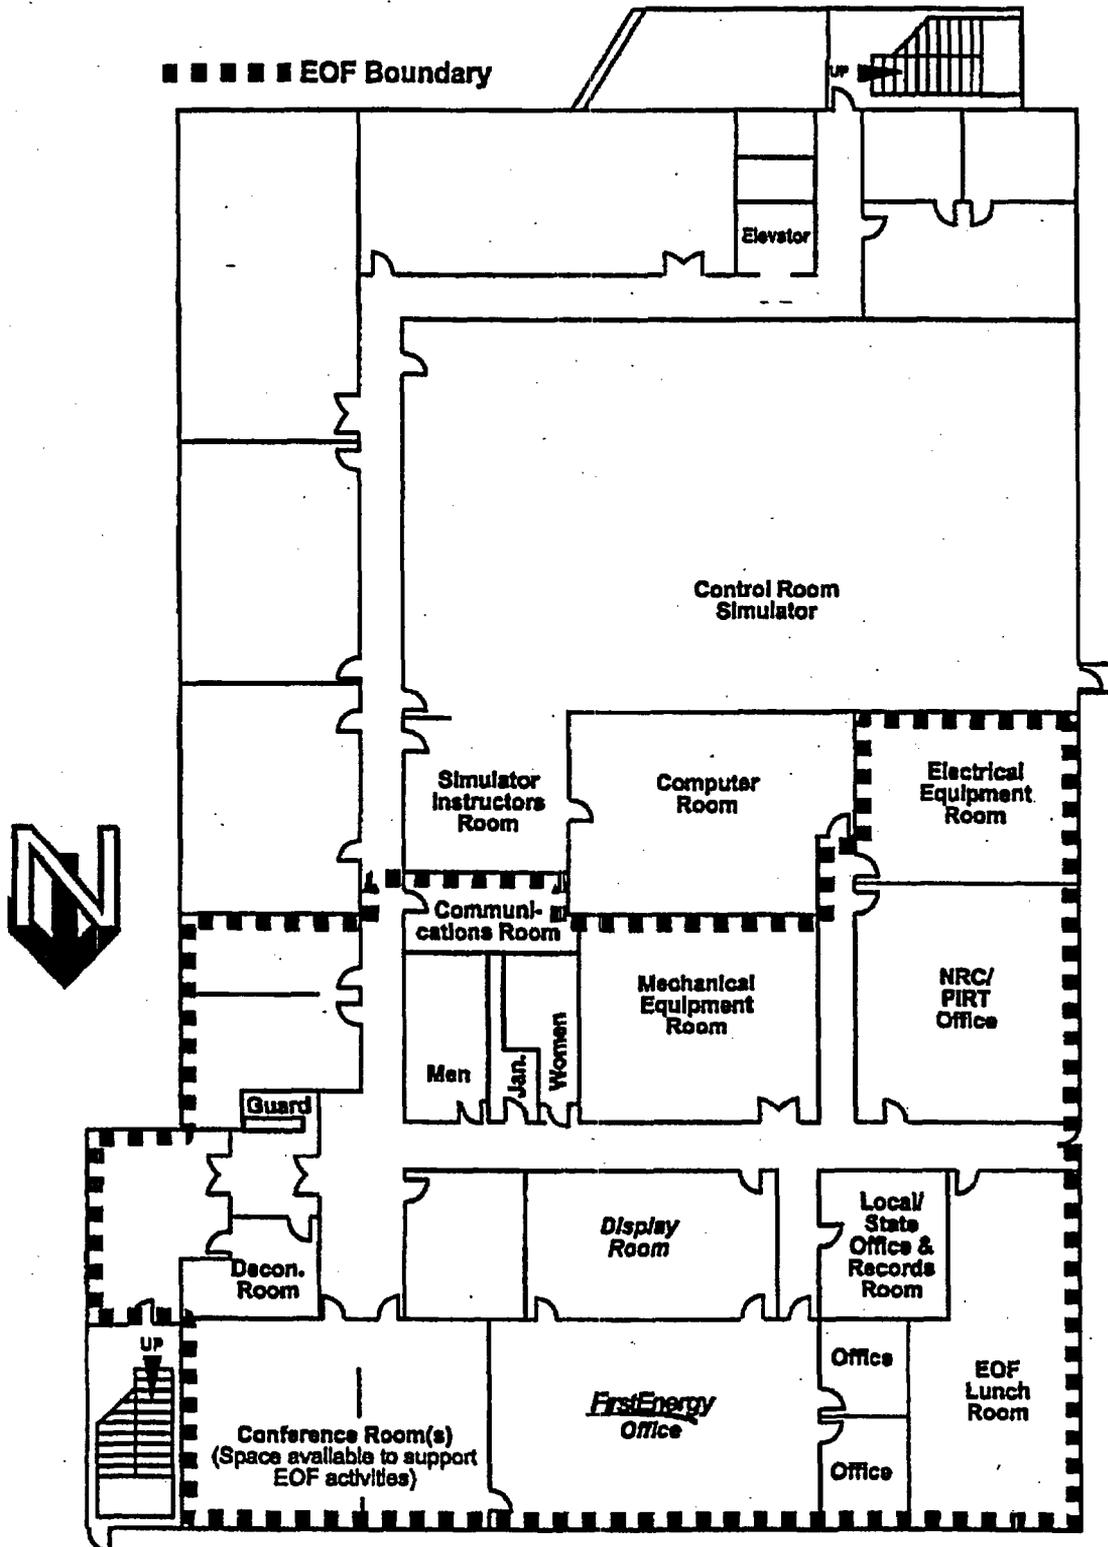


FIGURE 7-5 - DEDICATED EMERGENCY TELEPHONE COMMUNICATIONS <S00551>


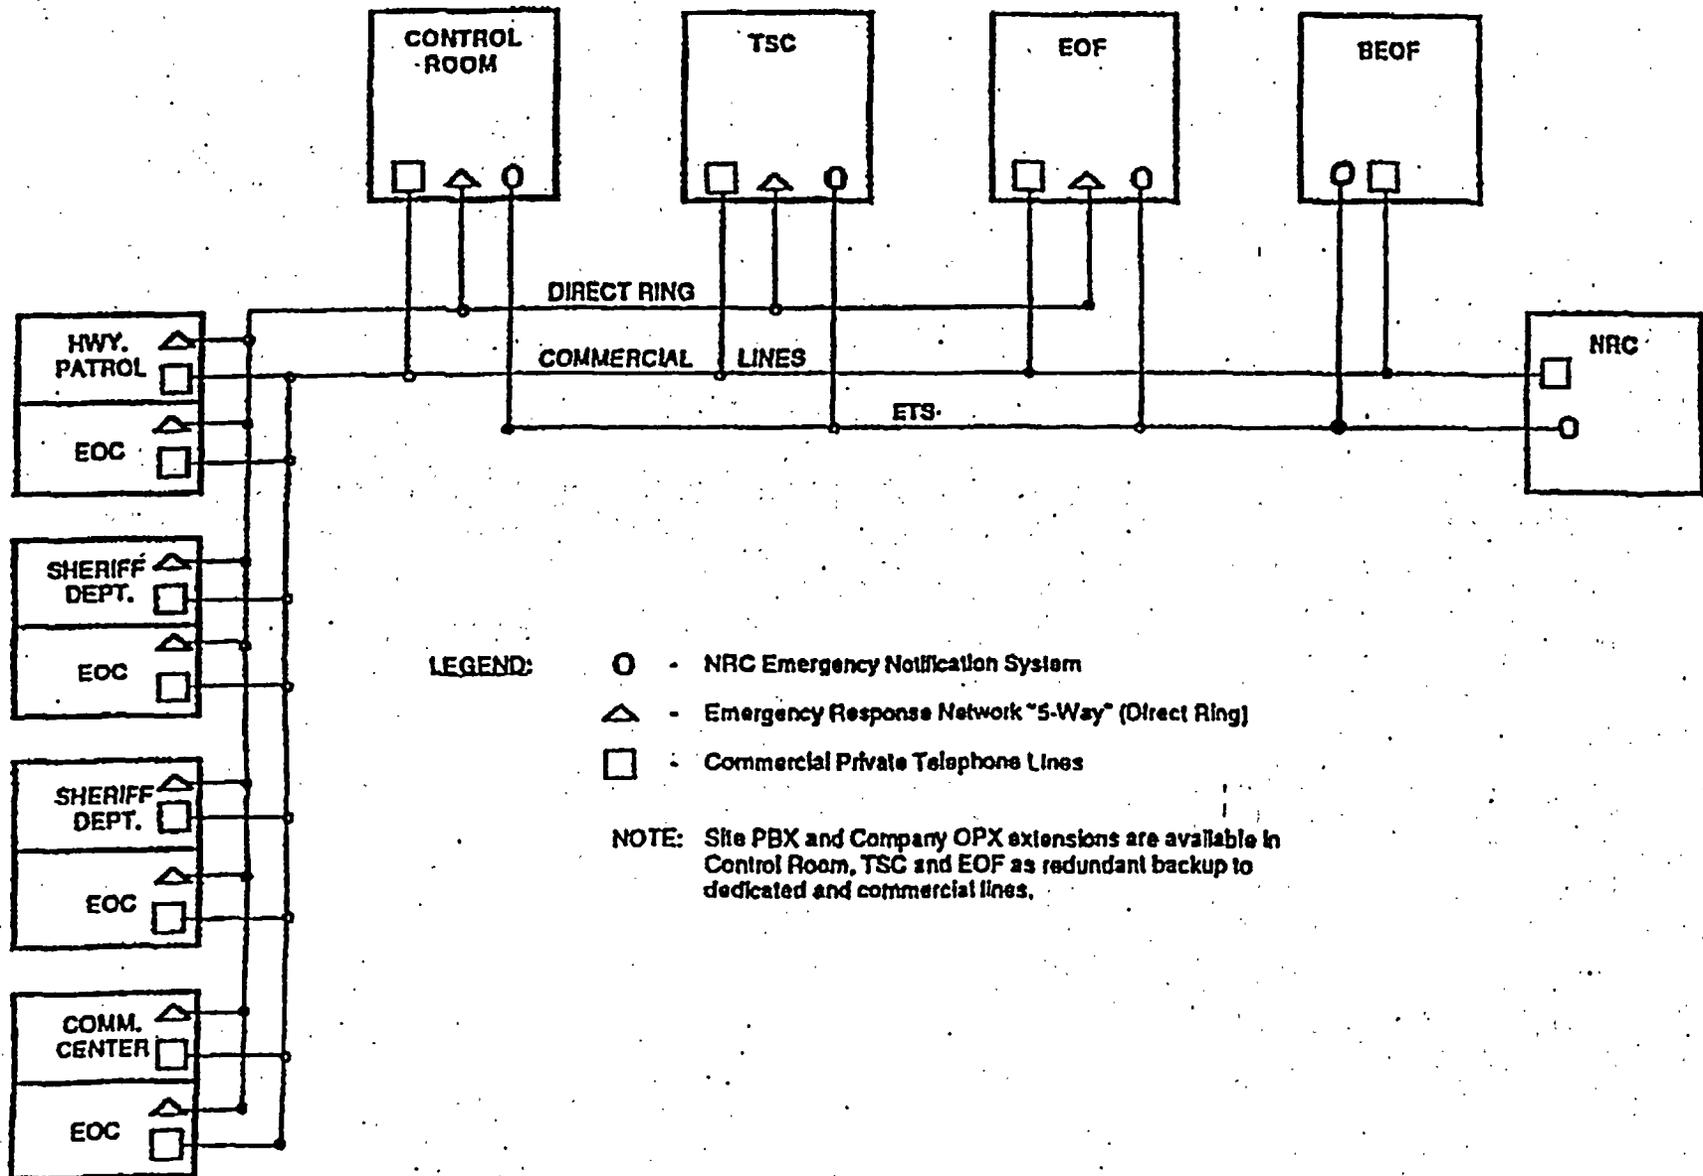


FIGURE 7-6 - SIREN LOCATIONS FOR PNPP

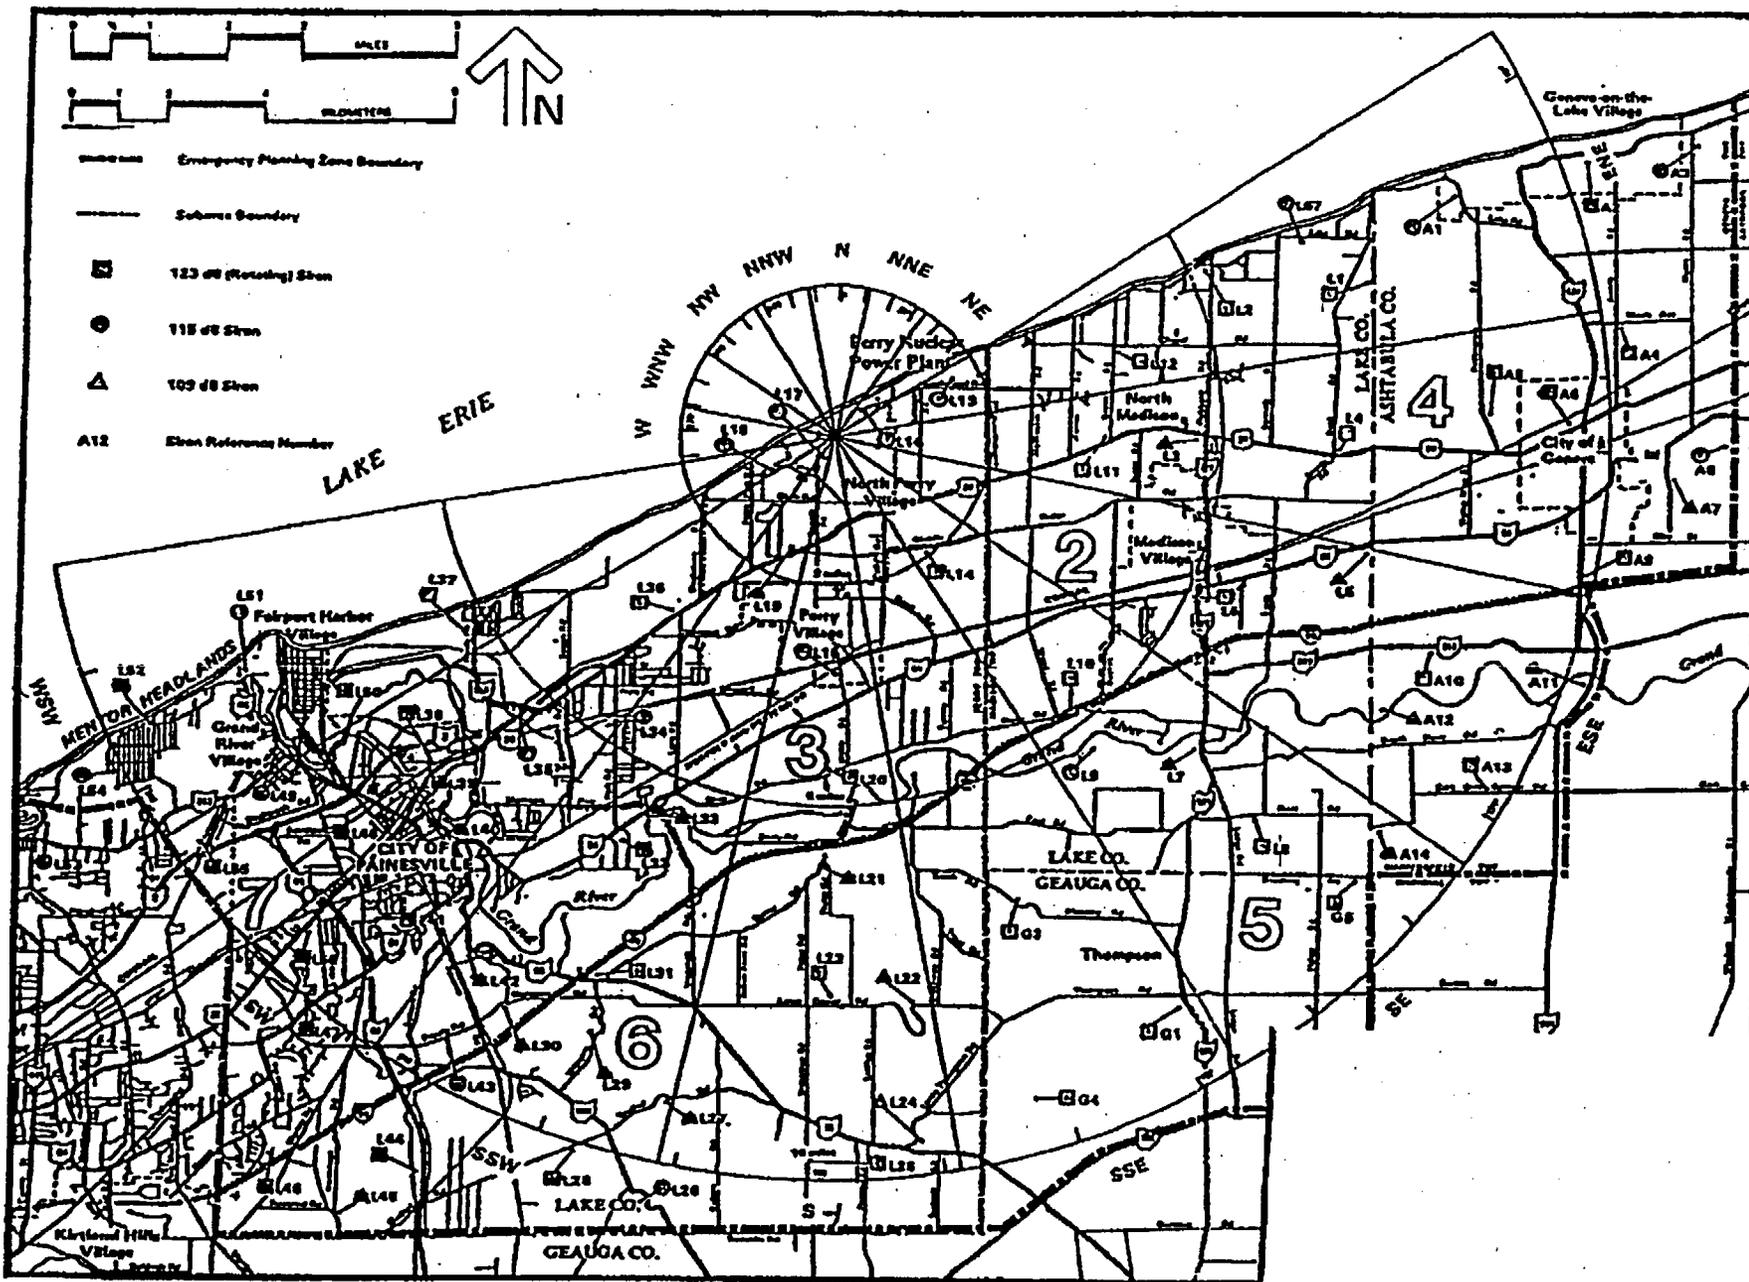

8.0 MAINTAINING EMERGENCY PREPAREDNESS

The Vice President, Nuclear - Perry has overall control of the Emergency Planning Program at the Perry Plant. This includes not only the Emergency Plan and Implementing Instructions, but also includes interrelationships with Federal, State, and County Plans, agreement letters, corporate policy, and other related plans, programs and procedures. The functional responsibilities for this program are outlined below.

8.1 Organizational Preparedness

8.1.1 Supervisor, Emergency Planning Unit (EPU)

The functional responsibility for the Emergency Preparedness Program at the Perry Plant rests with the Vice President, Nuclear - Perry. This responsibility is further delegated to the Emergency Planning Unit Supervisor. The Emergency Planning Unit Supervisor has the overall responsibility for the coordination and implementation of the Perry Plant Emergency Preparedness Program. The major responsibilities of the Emergency Planning Unit Supervisor include:

1. Directing the development and maintenance of emergency planning documents and specification of emergency response requirements which include the maintenance of the Perry Plant Emergency Plan EPIs, PSIs, and the EPIOIM.
2. Working with the local, State, and Federal governments to assure a smooth working interface during any planning or implementation activities in emergency planning.
3. Scheduling drills, practice exercises and inspections to evaluate the preparedness of the Perry Plant and offsite agencies to respond to radiological emergency conditions, and reporting results including identified deficiencies.
4. Initiating corrective action and developing responses to emergency preparedness deficiencies identified by drill, exercise, and reviews performed by regulatory agencies.
5. Evaluating progress of corrective action resulting from deficiencies identified by drill, exercise, or review of the Perry Plant and county emergency preparedness programs.

6. Assisting the local county EMA/DES in the development of training programs for local emergency response organizations, such as fire departments, emergency medical services, local hospitals, or others involved with public information, public evacuation, and assistance required in the event of a radiological emergency. <F01557>

Ashtabula, Geauga, and Lake counties have developed a single training program, referred to as the "Comprehensive Training Program (CTP)", to serve all three counties. The Radiological Emergency Response Plans for Ashtabula, Geauga, and Lake Counties identify each agency within their respective county that has emergency response responsibility related to an incident that may occur at the Perry Plant. The CTP specifies by title which persons in each agency should be trained, how many persons per each title should be trained, and the modules of training pertaining to each title.

Also, the Ohio EMA and FEMA have developed several courses appropriate to nuclear power plant incidents. These courses are delivered locally by Ohio EMA and elsewhere in the State as well as at FEMA's training facility in Maryland and Virginia.

Both OEMA and FEMA Region V annually review the training effort conducted in Ashtabula, Geauga, and Lake Counties. The training of off-site agencies, with which the Perry Plant has responsibility, are outlined in Table 8-1. Training of these entities will be made available annually either by the Perry Plant or through the local county CTPs.

7. Identifying facility and support equipment requirements for radiological emergency response and assuring the correct installation and functioning of these facilities and equipment.
8. Providing for the adequate initial and continuing training of EPU personnel responsible for maintenance and evaluation of Perry Plant Emergency Preparedness Program.
9. Maintaining the Public Education and Information Program outlined in Section 8.6.

EPU interfaces with the various plant departments and through PORC for the revision of the Perry Plant Emergency Plan and associated instructions per PAP-0507.

EPU interfaces with the Nuclear Communications Director, First Energy Corporation, to handle any media inquiries dealing with the operation of the Perry Plant. The Nuclear Communications Director has responsibility for the preparation and conduct of the annual Media Training program discussed in Section 8.7. The Nuclear Communications Director and the EPU maintain a close working relationship to ensure continued coordination of the Perry Plant Emergency Preparedness Program.

8.1.2 Manager, Perry Training Section (PTS)

The functional responsibility for the training needed to support the Perry Plant Emergency Preparedness Program rests with the Manager, Perry Training Section, who reports to the General Manager, Perry Nuclear Power Plant Department (PNPPD). These responsibilities include the coordination, development, administration, and implementation of the training necessary to support emergency preparedness.

This training is as follows:

1. All Perry Plant staff personnel having unescorted access privileges to the Protected Area are required to attend Plant Access Training (PAT) at least annually. New employees and contractor personnel are required to attend PAT prior to receiving unescorted access privileges.

With regard to emergency preparedness, the overall objective of PAT is to ensure that plant personnel are able to properly respond to an Emergency Plan activation. To meet this requirement, the following specific PAT objectives have been established.

- a. State the purpose of the emergency plan.
 - b. State the classifications of plant emergencies.
 - c. Recognize the emergency alarms, and state the proper response for each.
 - d. State the actions required during emergency plan implementation.
 - e. State the purpose of accountability during an emergency.
 - f. Discuss evacuation plans, including identification of offsite monitoring/decontamination centers and evacuation routes.
 - g. State the company's policy concerning the release of information to the public and news media regarding an emergency.
 - h. State the Company's policy regarding the fitness for duty requirements of 10CFR26.
2. Personnel assigned to the ERO with specific duties and responsibilities receive specialized training for their respective assignments. This training ensures that emergency response personnel maintain and improve their skills and are cognizant of applicable plant physical and procedural changes, changes in regulatory requirements, changes to initial training, and lessons-learned from in-house and industry wide operating experiences. Retraining will be conducted every 12 ± 3 months in accordance with TMP-2302, Emergency Plan Training Program. <S00561>

When practical, participation in drills and exercises can be used to meet the requalification requirements of TMP-2302 and to provide "hands-on" experience to ERO personnel.

Emergency Coordinator training will include a comprehensive review of the Emergency Plan and Implementing Instructions, with special attention to the areas of emergency classifications, protective action recommendations, and communications. Other topics to be included in this training are a basic review of: Local County Emergency Plans, the State of Ohio Emergency Plan, the NRC Incident Response Plan, and the interfaces of the Perry Plant Emergency Plan with each.

3. Plant personnel will receive basic radiological orientation training, including the risk and potential effects of radiation exposure, as part of PAT.

The majority of ERO personnel staffing-the Control Room, OSC and TSC will receive additional training as part of Radiation Worker Training (RWT), which is a requirement for their normal job duties. ERO personnel will also receive training on the issuance and use of dosimetry as it relates to their assigned ERO function, during their required emergency preparedness training.

ERO personnel with responsibility for recommending and approving the issuance of potassium iodide (KI) tablets to plant emergency workers per Section 6.7, will receive training as part of their required emergency preparedness training. Plant personnel, who may be issued KI based on the ERO function, will receive a briefing on the use and potential health effects of KI at the time of issuance in accordance with <EPI-B8>.

4. First aid team members receive Red Cross Multi-Media Training or equivalent. <S00563>
5. At a minimum, plant personnel designated as Accident Management Team (AMT) members or SAG evaluator, decision-maker, or implementer per the TSG, TSC Operations Advisors, and TSC Core/Hydraulic Engineers will receive training on Severe Accident Guidelines (SAGs) per lesson plan OT (Operator Training) 3410, "SAGs." Since SAG training is not required for the implementation of emergency response actions contained in this Plan, the frequency and content of SAG training is governed by OT 3410.

To support ERO operational and technical assessment activities, AMT members augmenting TSC staff will receive appropriate ERO training as specified in TMP-2302.

8.2 Review and Updating of the Emergency Plan and Implementing Instructions

The Perry Plant Emergency Plan and Implementing Instructions (EPIs) are included in the Perry Plant Operations Manual. Revisions and changes to the Emergency Plan and EPIs are reviewed by the Plant Operations Review Committee (PORC) and approved by the Plant Manager, PNPPD. As such, these documents will be controlled, distributed, and reviewed annually in accordance with PAP-0507 respectively. Revised pages to the Emergency Plan and EPIs will be marked to indicate where changes have been made. <L00513, S00556>

Document holders receive revisions to the Emergency Plan and EPIs in a controlled manner as they are issued. In addition, guidance will be provided to document holders on how to make comments and recommendations concerning the Emergency Planning Program to FirstEnergy Corporation.

The Perry Plant Emergency Plan, including EALs, will be reviewed at least annually with State and local officials. Letters of agreement contained in the Plan will also be reviewed annually to verify that they are maintained current. The results of each annual review are reported by the EPU Supervisor to the Company Nuclear Review Board (CNRB). Documentation of the annual Plan review will be retained as a "quality" record per <PAP-1701>.

Significant changes to EAL initiating conditions, including additions, deletions or change to intent, will be reviewed with the State of Ohio and local counties, and concurrence documented prior to implementation. Changes to EAL indicators, format, and minor revisions to initiating condition wording will be discussed within the State and local counties as part of the annual Plan review. <S00540>

8.3 Annual Emergency Preparedness Program Review <S00557>

A review of the Emergency Preparedness Program will be conducted as necessary based on an assessment by the licensee against performance indicators and as reasonably practicable after a change occurs in personnel, procedures, equipment or facilities that potentially could adversely affect the Emergency Preparedness program, but no longer than 12 months after the change. Each element of the emergency plan must be reviewed at least every 24 months in accordance with the requirements of 10CFR50.54(t). The audit will be conducted by a group that has no direct responsibility for implementation of the Emergency Preparedness Program for the Perry Plant, and will include an evaluation of the Emergency Plan and EPIs, drills and exercises, response capabilities, and the adequacy of interfaces with State and County officials. At the completion of the audit, a written report will be prepared including recommendations for improvements, and will be distributed to plant management per NOP-LP-2004, "Internal Assessment Process." Corrective actions for potential issues identified will be documented, evaluated, and resolution tracked in accordance with NOP-LP-2001, "Condition Report Process." Those portions of the report involving offsite interface will be made available to the appropriate State and local agencies by EPU.

The CNRB will review the results of any Internal audits of the Emergency Preparedness Program, and report to the Vice President, Nuclear - Perry on the overall adequacy of the program. The CNRB has no direct responsibility for emergency preparedness planning.

Documentation of the above reviews and resolutions will be retained in accordance with the FENOC Quality Assurance Program Manual.

8.4 Maintenance and Inventory of Emergency Equipment and Supplies

Emergency equipment and instruments, designated for use during an emergency, will be inspected, inventoried, and where applicable, operationally checked at least once each calendar quarter and after each use in accordance with PSI-0018.

The calibration of radiation survey equipment will be conducted and tracked by Radiation Protection Section (RPS) at the required frequencies to ensure sufficient numbers of instruments are continuously available to support ERO activities. Sufficient reserves of instruments/equipment will be available to replace those removed for calibration or repair.
<S00550>

8.5 Maintenance of Emergency Telephone Numbers --

Telephone numbers required to support emergency response notifications and communications commitments outlined in the Emergency Plan and EPIs are maintained in the Perry Plant Emergency Response Telephone Directory.

EPU will perform periodic reviews of the Directory to ensure that the following numbers are updated quarterly, at a minimum:

- Twenty-four hour points of contact and EOC numbers for official event notifications to the State of Ohio and local counties, as required by Section 6.1.1.
- Twenty-four hour numbers for the NRC ENS Circuit, as required by Section 6.1.1.
- Twenty-four hour numbers for Lake East and West Hospitals and ambulance services. As required by Section 5.3.3.2.
- Residential and pager numbers for ERO staff, required by Section 7.3. Quarterly review of the Directory will also perform a verification of qualifications for ERO staff listed.

Other telephone numbers contained in the Directory for other secondary emergency response or plant support functions shall be verified at least annually.

8.6 Public Education and Information

A Public Information and Education Program for members of the general public, including transients, within the Plume Exposure Pathway, or 10-mile Emergency Planning Zone (EPZ), surrounding the Perry Plant has been established in coordination with the State of Ohio EMA and the local county EMA/DES. This program addresses the requirements of Appendix E (IV.D.2) to Title 10, Part 50 of the Code of Federal Regulations (CFR).

The Public Information and Education Program will include the following methods for disseminating information related to a nuclear emergency at the Perry Plant: <S00569>

1. Telephone Directory Inserts

Emergency information inserts will be reviewed, and updated as needed, annually and included in the telephone directories for the areas encompassing the 10-mile EPZ, as defined in Section 2.3. The inserts will provide members of the general public with information on the following:

- Methods and times required for public notification;
- Planned protective measures to be taken if an accident occurs, e.g. evacuation routes and relocation/care centers, etc., based on the actions outlined in the State of Ohio and local county radiological response plans;
- General information as to the nature and effects of radiation;
- List of local broadcast stations that will be used for dissemination of information through the Emergency Alert System (EAS);
- Information for the special needs population, and
- Point of contact for additional written information.

2. Advertisements

Various company, State, or county-sponsored advertisements and mailings will be used to reference emergency information contained in the telephone directories and to identify a point of contact for additional written information. These may include, but are not limited to, quarterly newspaper siren announcements, enclosures contained in utility electric bills, internet web sites, and company mailings or other communications to the general public. These advertisements will identify to new residents and transients where to find this emergency information.

3. Special Mailing or Brochure

A mailing or brochure will be distributed once every three years to residents within the 10-mile EPZ or upon request. This will allow new residents or individuals without telephone service to be informed of emergency planning information and to capture changes which may have occurred over the past three years. In addition to the emergency information contained in the telephone directory insert, the mailing or brochure will also address the following:

- Nuclear energy overview;
- Description of emergency classification levels as defined by Appendix 1 to NUREG-0654/FEMA-REP-1, and
- Listing of transportation pick-up points, referral points, and evacuating/receiving schools for each 10-mile EPZ county.

8.7 News Media Training

The Perry Plant will conduct programs in conjunction with the State of Ohio EMA and local county EMAs at least annually to acquaint news media with the emergency plans, information concerning radiation exposure, points of contact and procedures for the release of information during an emergency, and specific topics dealing with actual or potential media interest. These programs may be conducted as formal training sessions or as annual mailings to the local news media.

If a mailing is used to meet this commitment, points of contact will be identified as sources of additional information.

8.8 Drills and Exercises

Periodic drills and exercises will be conducted to evaluate the status of emergency preparedness and to satisfy the requirements outlined in Section 8.8.4. The prime objective of this form of training is to verify the preparedness of all participating personnel, organizations, and agencies.

Separate training drills may also be conducted to meet the annual requalification requirements for ERO personnel. These drills will be approved, conducted, and evaluated in accordance with TMP-2302 and PSI-0017, "Drills and Exercises for Emergency Planning."

Drills and exercises required under 8.8.4, with the exception of communications testing, will be planned, performed, and findings reported as a formal self-assessment in accordance with the "FENOC Focused Self Assessment Guideline."

Fire emergency drills at the Perry Plant will be conducted, evaluated, and approved in accordance with TMP-2108, "Fire Protection Training and Certification Programs," and not by the Perry Plant Emergency Plan or Implementing Instructions. <L00115>

8.8.1 Objectives

Each drill or exercise conducted in support of the Perry Plant Emergency Preparedness Program should be developed to contain and accomplish, as a minimum, the following:

1. Basis objective(s) of the drill or exercise and appropriate evaluation criteria for:
 - a. Verifying the adequacy of the Perry Plant Emergency Plan and the methods used in the EPIs;
 - b. Ensuring that the participants are familiar with their respective duties and responsibilities;
 - c. Testing the proper use of communication networks and systems;
 - d. Checking the adequacy and availability of emergency supplies and equipment, and
 - e. Verifying the operability and proper use of emergency equipment.
2. Time period, place(s) of the drill or exercise, and the participating organizations.
3. Simulated events.
4. Time schedule of real and simulated events.

5. Narrative summary that describes the conduct of the exercise or drill, and includes such items as simulated casualties, offsite fire department assistance, rescue of personnel, use of protective clothing, deployment of radiological emergency teams, and public information activities.
6. Assignments for qualified controllers and evaluators, and provisions for observers from the federal, state, and local organizations.

8.8.2 Conduct of Drills and Exercises

Drills and exercises are held involving appropriate offsite as well as onsite emergency personnel, organizations, and agencies. Drills and exercises should simulate, as closely as possible, actual emergency conditions and may be scheduled such that one or more drills are held simultaneously. Exercise scenarios should involve participation of several emergency teams and all or specific parts of the onsite and offsite emergency organizations including varying degrees of participation of state, county, and federal organizations and agencies, and local services support personnel and organizations. Drills and exercise scenarios should allow free play for decision making by participants.

A critique will be held as soon as possible following a drill or exercise to review controller and evaluator comments and to obtain feedback from drill/exercise participants. The findings and observations from the post drill/exercise critiques(s) shall be factored into the formal critique report discussed in Section 8.8.3.

8.8.3 Evaluation and Documentation

A formal critique shall be compiled by the EPU Supervisor for drills or exercises in support of the Perry Plant Emergency Preparedness Program, with the exception of monthly communications drills. The critique will evaluate the adequacy in meeting established objectives, incorporate comments from drill/exercise participants, and contain a listing of recommendations for improving the Emergency Preparedness Program.

Issues and observations identified which do not meet expectations regarding the design, maintenance, or operation of emergency response facilities and equipment, or the ability of the ERO to perform its designated function, shall be documented and evaluated in accordance with <NOP-LP-2001>, Condition Report Process.

The critique for a formal self-assessment will be approved and distributed in accordance with FENOC Focused Self Assessment Guideline.

8.8.4 Frequency of Drills and Exercises <S00538>

Drills and exercises will be conducted at the frequencies indicated for each type of drill or exercise described below. Drills and exercises may be conducted simultaneously where appropriate.

8.8.4.1 Evaluated Emergency Plan Exercise <S00562>

1. A major evaluated exercise appropriate to a Site Area or General Emergency will be conducted biennially as required by 10 CFR 50 Appendix E. The Perry Plant will conduct at least one exercise every six years which starts between the hours of 6:00 p.m. to 4:00 a.m., or during a weekend. Consideration will also be given towards conducting exercises under varying weather conditions.
2. At least one drill will be conducted between biennial evaluated exercises involving a combination of the following principal functional areas to train and maintain emergency response capabilities and readiness:
 - a. Management and coordination of emergency response,
 - b. Accident assessment,
 - c. Protective action decision-making, and
 - d. Plant system repair and corrective actions.

Activation of all emergency response facilities (i.e., TSC, OSC, and EOF) is not necessary. Supervised instruction would be permitted, and drill can focus on onsite training objectives.

3. State or local agencies with the 10-mile Plume Exposure Pathway EPZ will be offered the opportunity to participate in utility-only exercises and drills when requested by such State or local authority.
4. The scenario for the exercise will be varied between exercises to ensure that all major portions of the Emergency Plan are tested over a six (6)-year period.

8.8.4.2 Communications Testing

Communications systems located in Perry Plant facilities which have been established and/or designated for use during an emergency plan event will be tested as follows to ensure the testing criteria specified by 10CFR50, Appendix E is met. Each communications test will involve evaluating the aspect of understanding the contents of the message including a check of hardware, voice quality and message clarity. <S00558, P00098>

1. Communications with the State of Ohio and local county governments will be tested monthly per PTI-R50-P0001 to meet the requirements of 10CFR50, Appendix E (IV.E.9.a). This test shall involve the dedicated "5-Way" circuit on a rotating basis from either the Control Room, TSC, and EOF.

2. Communications with the NRC Operations Center (White Flint, MD) will be tested monthly per PTI-R50-P0001 to meet the requirements of 10CFR50, Appendix E (IV.E.9.d). This test shall involve the Emergency Telecommunications System's ENS and HPN circuits on a rotating basis from either the Control Room, TSC, or EOF.
3. Testing of the ERDS will be conducted quarterly per PTI-GEN-P0002.
4. Communications among the Control Room, TSC and EOF; and among the Perry Plant, the State of Ohio and local county emergency operations centers (EOC), and Perry Plant RMTs will be tested annually to meet the requirements of 10CFR50, Appendix E (IV.E.9.c). This testing shall be done as part of the biennial NRC evaluated or other scheduled emergency preparedness drills in accordance with PSI-017.

Communications with other Federal emergency response organizations, Canada, and the Commonwealth of Pennsylvania will be tested by the State of Ohio in accordance with their "Plan for Response to Radiation Emergencies at Licensed Nuclear Facilities."

Staffing response times for the onsite Emergency Response Facilities will be tested quarterly utilizing PTI-GEN-P0003. <N00274, P00125>

Where possible, credit shall be taken for scheduled drills and exercises, or classification of an emergency event involving the notification of offsite agencies and Perry Plant ERO personnel.

8.8.4.3 Health Physics Drills

1. Health Physics Drills will be conducted semi-annually which involve response to, and analysis of, simulated elevated airborne samples and direct radiation measurements.

8.8.4.4 Medical Emergency Drills

1. A medical emergency drill involving a simulated contaminated individual which contains provisions for participation by the local support agencies (i.e., ambulance and offsite medical treatment facility) shall be conducted annually.

8.8.4.5 Radiological Monitoring Drills

1. Plant environs and radiological monitoring drills (onsite/offsite) will be conducted annually, as a part of the NRC biennial Emergency Plan Exercise or other scheduled emergency preparedness drills. The drill shall include collection and analysis of various sample media (e.g., air sample and the collection of grass, soil, etc. for determining possible ground deposition), and provisions for communications and recordkeeping.

TABLE 8-1

TRAINING PROVISIONS FOR OFFSITE EMERGENCY RESPONSE PERSONNEL

<u>Personnel/Organization</u>	<u>Training</u>
I <ul style="list-style-type: none"> • Local County EMA/DES Directors • Local County Commissioners 	<ol style="list-style-type: none"> 1. Organization Interrelations 2. Review of PNPP Emergency Plan and Implementing Instructions <ul style="list-style-type: none"> Classification System Reporting Requirements Assessment Actions Corrective Actions Protective Actions Communications Networks
II Local Mutual Aid Fire Departments/Ambulances <F01557> <ul style="list-style-type: none"> • Perry Township Fire Department • Painesville Township Fire Department • Madison Fire District 	<ol style="list-style-type: none"> 1. Basic health physics indoctrination. 2. Interface with Perry Plant Security force, including dosimetry issue, and vehicle access and dressout. 3. Interface with Perry Plant First Aid Team and hospital staff in the treatment and handling of a contaminated injured victims. 4. Interface with the Perry Plant Fire Brigade in response to a fire within the Protected Area.
<p><u>NOTE:</u> Training will be conducted annually as part of annual Standard Operating Procedure (SOP) training. These training requirements can also be met as part of periodic fire and/or medical drills conducted with fire departments. Drills conducted to meet the requirements of 10CFR50 Appendix R will be performed in accordance with TMP-2108.</p>	

TABLE 8-1 (Cont.)

TRAINING PROVISIONS FOR OFFSITE EMERGENCY RESPONSE PERSONNEL

<u>Personnel/Organization</u>	<u>Training</u>
<p>III Lake Hospital System, Inc.</p> <ul style="list-style-type: none"> • Lake East Hospital (Painesville, OH) • Lake West Hospital (Willoughby, OH) 	<ol style="list-style-type: none"> 1. Basic health physics indoctrination and training. 2. Lake Hospital System radiation emergency procedures. 3. Interface with PNPP Health Physics technician and ambulance personnel.
<p><u>NOTE:</u> Training will either be conducted as part of their annual Standard Operating Procedure (SOP) training or provided by a medical consultant under contract to the PNPP. Further training will also be provided as part of the annual MS-1 medical drill.</p>	
<p>IV Local media personnel (newspapers, radio, TV, etc.)</p>	<ol style="list-style-type: none"> 1. Overview of the PNPP and local County Emergency Plans. 2. Basic health physics indoctrination and training. 3. Review the points of contact for release of public information in an emergency.
<p>V Local Law Enforcement Agencies (LLEA)</p>	<ol style="list-style-type: none"> 1. Plant familiarization. 2. Actions required and interface with the PNPP for a response to a security contingency per the PNPP Security Plan. 3. Basic health physics indoctrination and training.
<p><u>NOTE:</u> Basic health physics training will be conducted annually as part of SOP training offered by local counties. Site Protection Section (SPS) provides training by sponsoring periodic "LLEA Days", and through periodic meetings with LLEA and the FBI to discuss current issues.</p>	

9.0 RE-ENTRY AND RECOVERY

The protection of plant personnel and the general public is of prime importance in any emergency. Once the immediate protective and corrective actions have been taken and the emergency has been brought under control, the emergency actions will shift into the Recovery phase, where all actions should be planned and deliberate.

Downgrading of a Site Area Emergency to a lesser classification can be directed by the Emergency Coordinator when the following conditions are met:

1. The intent of the EAL entry conditions for the classification are no longer met;
2. Plant conditions are stable, and the prognosis for improvement is good;
3. Downgrading the event does not interfere with the emergency response activities of the NRC, State of Ohio, and local-counties.

Due to the severity and potential of off-site consequences associated with a General Emergency, downgrading from this emergency classification is not permitted. Instead, the General Emergency will be terminated when the criteria outlined in <EPI-A1> are met, and a Recovery Phase implemented.

The Recovery plan will provide for a certain degree of flexibility to adapt to existing conditions, as it is not possible to anticipate in advance all of the conditions that may be encountered in any emergency situation. Therefore, the Recovery Plan is intended to address general principles that will serve as a guide for developing specific instructions for use at the time.

9.1 Re-entry Phase

Re-entry consists of the planned return to an evacuated area, either in-plant or onsite, to perform a specific operation, assessment or repair in support of Recovery efforts, i.e., manipulation or repair of critical equipment and systems.

Prior to the termination of the Emergency Phase and entry into recovery, re-entry into evacuated in-plant and site areas will be coordinated through the OSC per <EPI-A7> to ensure that appropriate radiological and safety precautions are evaluated. Upon entry into the Recovery Phase, re-entry activities will be prioritized, authorized and directed through the Recovery Organization discussed in Section 9.2. A Re-entry Team Coordinator shall be appointed following the de-activation of the OSC, to coordinate the briefing and provide logistical support to re-entry team members. Therefore, an organized structure is in place during the Emergency and Recovery Phases to assess existing and potential hazards to re-entry personnel and implement or relax protective measures as deemed appropriate.

Specific responsibilities and duties for re-entry activities are outlined in <EPI-A10>.

9.2 Recovery Phase

The Emergency Coordinator will have the responsibility to determine when the Emergency Phase will be terminated and Recovery Phase initiated. The entry into the Recovery Phase and the establishment of a Recovery Organization are mandatory when terminating an event from a Site Area Emergency or General Emergency. Entry into Recovery from any other emergency classification is optional and, therefore, at the discretion of the Emergency Coordinator.

Prior to entering the Recovery Phase, the Emergency Coordinator appoints a Recovery Director and Recovery Organization be assembled per Figure 9-1 to develop and coordinate a Recovery Plan, instructions, and schedules for the Recovery operations. The Emergency Coordinator may use his judgment in authorizing the interim use of existing, non-shift ERO personnel to meet initial Recovery Organization staffing.

Recovery actions should be preplanned with adequate evaluation of plant conditions and data acquired during the course of the emergency. Decisions to relax protective measures will be reviewed by the Recovery Organization to ensure that radiation exposure and personnel hazards are minimized. As Low As Reasonably Achievable (ALARA) radiation exposure practices shall apply during the Recovery and restoration.

The Recovery Plan program involves the determination of the damage to equipment; the installation of shielding, rope barriers and signs; the application of safety tags, performing decontamination and cleanup as required to place the plant in an acceptable long term condition, and the periodic determination of total population exposure. Recovery operations shall not be initiated until the area affected by the emergency has been defined. Particular attention shall be directed towards isolating components and systems as required to control or minimize the hazards. A systematic investigation shall be conducted to determine what equipment has been damaged and the extent of the damage.

The Recovery Plan shall also address actions needed to perform detailed investigation of the accident causes and consequences both to the plant and the environment; determine repair work or modifications to plant equipment, revisions to operating procedures, and test programs; and estimating accumulated dose to the general public.

Recovery operations that may result in the release of radioactive materials shall be evaluated by the Recovery Director and his Recovery Organization as far in advance as possible. Such events and data pertaining to the release shall be reported to the appropriate offsite emergency organizations and agencies.

The Recovery Organization may be modified by the Recovery Director to effectively assess and restore the plant to a long-term safe shutdown condition. At such time, the formal termination of the Recovery Phase and implementation of a restoration program shall be discussed with and concurred by the NRC, and State and local county officials.

9.2.1 Recovery Organization

An outline illustrating the recommended composition of the Recovery Organization is shown in Figure 9-1. The organization is made up of designated groups, each consisting of key personnel with authority to perform the functions within their responsibility. Brief descriptions of the Recovery Organization personnel and functions are listed below. Specific details on Recovery Organization responsibilities are delineated in <EPI-A10>.

1. The Emergency Coordinator shall be responsible for coordinating the completion of pre-recovery actions; and directing the entry into the Recovery phase.
2. The Recovery Director shall be responsible for directing the activities of the Recovery Organization; supporting Corporate Nuclear Review Board (CNRB); and serving as a point of contact for the Company Spokesperson.
3. The Engineering Manager shall be responsible for coordinating all engineering activities in support of plant recovery efforts, and interfacing with the Institute of Nuclear Power Operations (INPO) and other Industry and owners groups.
4. The Plant Recovery Manager shall be responsible for managing all onsite activities, including the re-entry into evacuated site areas, in support of plant recovery efforts.
5. The Operations Coordinator shall be responsible for coordinating all operations activities in support of plant recovery efforts.
6. The Maintenance Coordinator shall be responsible for coordinating all in-plant maintenance and instrumentation and control (I&C) activities, including the coordination and briefing of re-entry teams, in support of plant recovery efforts.
7. The Radiation Protection Coordinator shall be responsible for coordinating all health physics, in-plant radiological assessment, and dosimetry activities in support of plant recovery efforts, including re-entry team activities.
8. The Chemistry and Environmental Coordinator shall be responsible for coordinating all offsite dose assessment and environmental monitoring, in-plant chemistry, and radwaste activities in support of recovery efforts.
9. The Security Coordinator shall be responsible for coordinating all site protection activities, including interfaces with Federal, State of Ohio and local law enforcement agencies, in support of plant recovery efforts.
10. The OSC Coordinator or Re-entry Team Coordinator shall be responsible for the briefing and ensuring adequate health physics and material/equipment support for re-entry team personnel.

11. The **Planning and Logistics Manager** shall be responsible for the planning and scheduling of plant recovery activities, including the coordination of logistics in support of the Recovery Organization.
12. The **Offsite Recovery Assistant** shall be responsible for ensuring that Federal, State of Ohio and local officials are kept advised of plant and recovery status; and for coordinating Federal and State resources in support of plant recovery efforts.


9.3 Recovery Notifications

It is the responsibility of the Emergency Coordinator to notify offsite authorities, in a timely manner, that Recovery operations have been initiated. Additional notification will be made under the direction of the Recovery Director whenever operations have potential offsite effects.

FIGURE 9-1 - RECOVERY ORGANIZATION

NF1014

RECOVERY ORGANIZATION

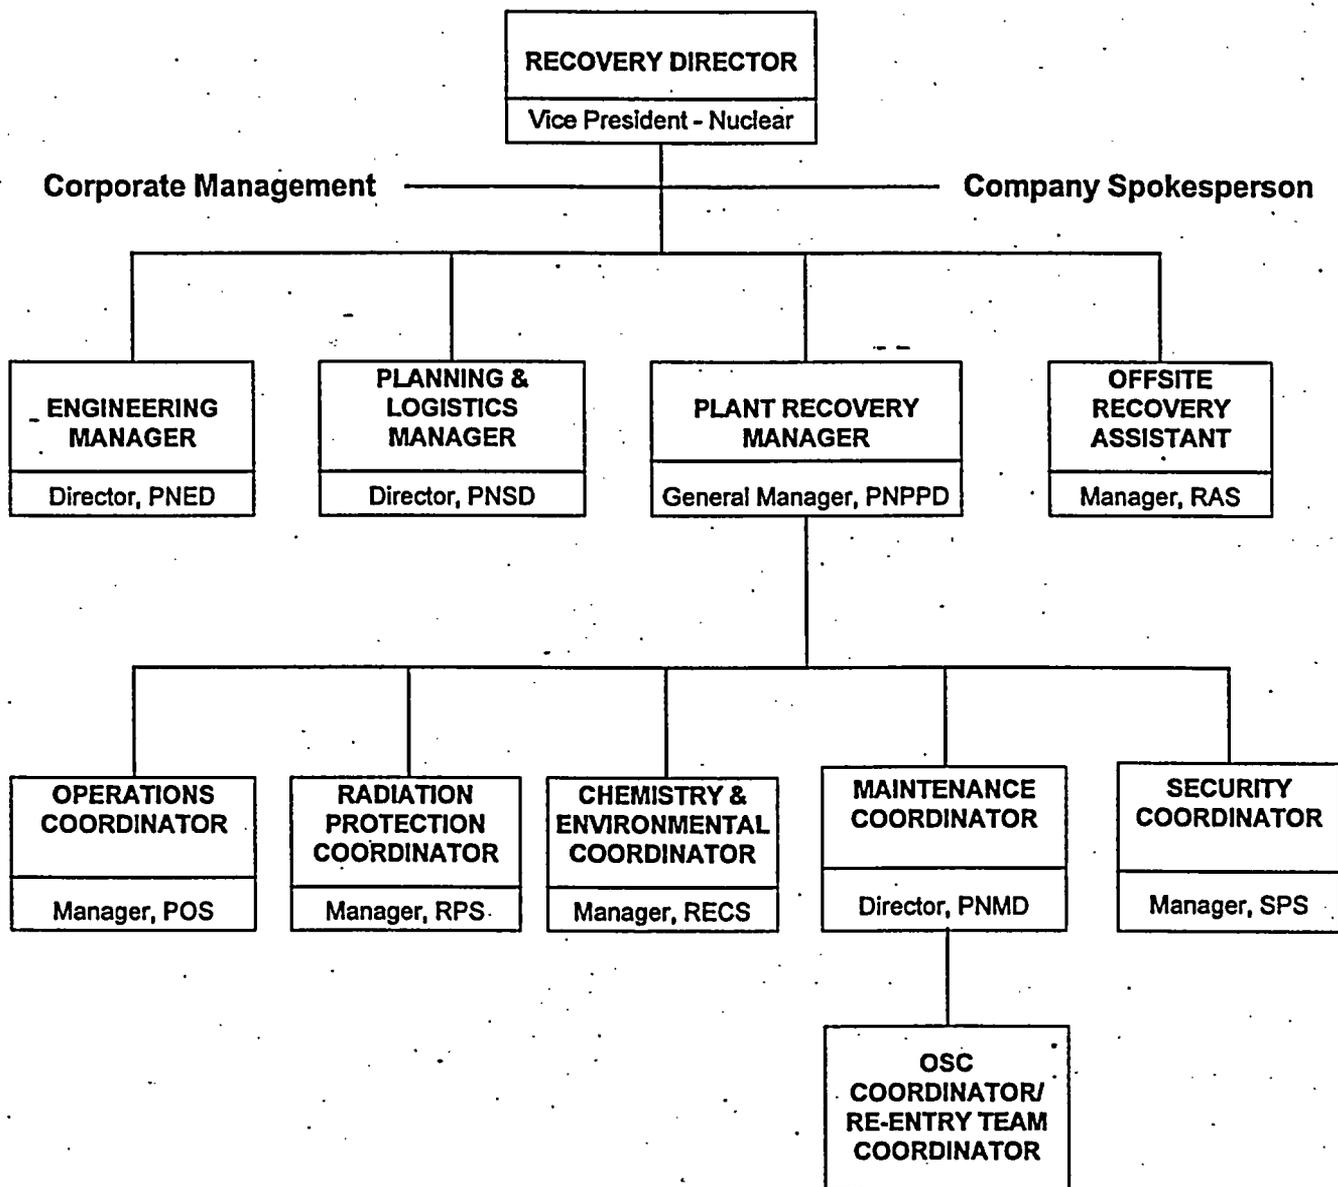

APPENDIX A

INDEX OF EMERGENCY PLAN IMPLEMENTING AND SUPPORT INSTRUCTIONS

APPENDIX A

INDEX OF EMERGENCY PLAN SUPPORT INSTRUCTIONS

<u>Instruction Type No.</u>	<u>Title</u>
A. <u>Emergency Plan Implementing Instructions (EPIs)</u>	
EPI-A1	Emergency Action Levels (EALs)
EPI-A2	Emergency Actions Based Event Classification
EPI-A6	Technical Support Center Activation
EPI-A7	Operations Support Center Activation
EPI-A8	Emergency Operations Facility Activation
EPI-A10	Re-Entry/Recovery
EPI-A11	Activation of the Backup Emergency Operations Facility
<hr/>	
EPI-B1	Emergency Notification System
EPI-B3	Radiological Surveys for Emergencies
EPI-B4	First Aid and Medical Care
EPI-B5	Personnel Accountability/Site Evacuation
EPI-B7a	Automated Offsite Dose Calculations
EPI-B7b	Manual Offsite Dose Calculations
EPI-B8	Protective Actions and Guides
EPI-B9	Emergency Records
EPI-B10	Emergency Radiological Environmental Monitoring Program (EREMP)
EPI-B11	Emergency Dosimetry Issue
EPI-B13	Determination of Core Damage Under Accident Conditions

APPENDIX A (Cont.)

<u>Instruction Type No.</u>	<u>Title</u>
B. <u>Preparedness Support Instructions (PSIs)</u>	
PSI-0001	Maintenance of the Emergency Response Telephone Directory
PSI-0007	Reporting Emergency Plan-Related Communications Equipment Problems
PSI-0008	Determining the availability of the Perry Plant On-Site Emergency Response Facilities
PSI-0013	Control and Revision of the Evacuation Time Estimates for Areas Near the Perry Plant
PSI-0016	Testing of Plant Support Callout Scenarios
PSI-0017	Drills and Exercises for Emergency Planning
PSI-0018	Maintenance and Inventory of Emergency Equipment
PSI-0019	Emergency Action Level (EAL) Bases Document

APPENDIX A (Cont.)

<u>Instruction Type No.</u>	<u>Title</u>
C. <u>Other Plant Procedures/Instructions Supplemental to the Emergency Plan:</u>	
ARIs	Alarm Response Instructions
EPIOIM	Emergency Public Information Organization Instructions Manual
FPIs	Pre-Fire Plans Instructions
HPI-H0004	Identification of Radioactive Material and Release of Materials from the RRA
NEI-0951	Prompt Alert System --
NOP-LP-2004	Internal Assessment Process
ODCM	Offsite Dose Calculations Manual
ONI-R10	Loss of AC Power
OT-3140	Severe Accident Guidelines
PAP-0114	Radiation Protection Program
PAP-0126	Shift Staffing and Shift Relief
PAP-0507	Perry Supplemental Procedure Requirements/ Guidance
NOP-SS-3001	Procedure Review and Approval
PAP-0527	Severe Accident Guidelines
PAP-0808	Environmental Programs and Reports
NOP-LP-2001	Condition Report Process
NOP-WM-3001	Preventative Maintenance Program
PAP-1701	Records Management Program
PAP-1910	Fire Protection Program

APPENDIX A (Cont.)

Instruction Type No.	Title
C. (Cont.)	
PEIs	Plant Emergency Instructions
PSAG	Perry Specific Accident Guidelines (PSAG)
PTI-D19-P0600	TSC Continuous Air Monitor Calibration for OD19-K600
PTI-D19-P0650	TSC Continuous Air Monitor Calibration for OD19-K650
PTI-D19-P0700	EOF Continuous Air Monitor Calibration for OD19-K700
PTI-D19-P0701	EOF Continuous Air Monitor Functional for OD19-K700
PTI-D19-P0750	EOF Area Radiation Monitor Calibration for OD19-K750
PTI-R50-P0001	Monthly Testing of Emergency Response Telephone Systems in the Onsite Emergency Response Facilities <P00098>
PTI-M52-P0003	Technical Support Center Ventilation System Recirculation Mode Functional Test
PTI-M53-P0001	In-Place HEPA Filter Testing of the Emergency Operations Facility (EOF) Emergency Recirculation Plenum
PTI-M53-P0002	Emergency Operations Facility Ventilation System Emergency Isolation Mode Functional Test
PTI-GEN-P0002	Quarterly Testing of Emergency Response Data System (ERDS)
PTI-GEN-P0003	Testing of the Emergency Pager System
PTI-GEN-P0018	In-Place HEPA and Charcoal Filter Testing of Non-ESF Filtered Exhaust Plenums
SAG-1	Primary Containment Flooding
SAG-2	RPV, Containment, and Radioactivity Release Control

APPENDIX A (Cont.)

<u>Instruction Type No.</u>	<u>Title</u>
C. (Cont.)	
SAI-0014	Security Training Program
SPI-0023	Site Evacuation/Personnel accountability and Emergency Facility access control measures.
SPI-0032	Notifications of Key Plant Organization Personnel
TMP-2108	Fire Protection Training and Certification Programs
TMP-2302	Emergency Plan Training Program
TSG	Technical Support Guidelines

This is a list of major supplemental plant procedures and instructions. During an emergency, any or all of the existing plant procedures and instructions may be employed to deal with the situation.

APPENDIX B

LETTERS OF AGREEMENT

C O N T E N T S

<u>Title</u>	<u>Page</u>
Institute of Nuclear Power Operations	B-3
Perry Township Trustees	B-4
Lake Hospital System, Inc. <S00565>	B-6
Lake County	B-8
Ashtabula County	B-9
Geauga County	B-10
State of Ohio, Agreement with FirstEnergy	B-11
General Electric BWR Emergency Support Program <B01028>	B-13
Lakeland Community College	B-16
Metro Health Medical Center (Metro General Hospital and Life Flight Services)	B-19

NOTE: Letters of agreement will be reviewed on an annual basis to ensure that they are current and continue in effect. Any agreement, written as a formal contract, will be considered effective for the specified duration.

Letters of agreement with the Lake County Sheriff Department and other Federal, State, and local law enforcement agencies (LLEAs) are updated if required, as part of the Perry Plant Security Plan.



**Institute of
Nuclear Power
Operations**

Suite 100
700 Galleria Parkway, SE
Atlanta, GA 30339-5957
770-644-8000
FAX 770-644-8549

September 24, 2003

Dear Ladies and Gentlemen:

This letter certifies that the plant emergency assistance agreement between INPO and its member utilities remains in effect. In the event of an emergency at your utility, INPO will assist you in acquiring the help of other organizations in the industry, as described in Section 1 of the *Emergency Resources Manual*, INPO 86-032. If requested, INPO will provide the following assistance:

- Facilitate technical information flow from the affected utility to the nuclear industry.
- Locate replacement equipment and personnel with technical expertise.
- Obtain technical information and industry experience regarding plant component and systems.
- Provide an INPO liaison to facilitate interface.

This agreement will remain in effect until terminated in writing. Should you have questions, please call me at (770) 644-8304 or e-mail mossdj@inpo.org.

Sincerely,

David J. Moss
Manager
Radiological Protection

DJM/jls

Perry Joint Fire District

P.O. Box 439 Perry, OH 44081

November 26, 2002

Mr. Vernon K. Higaki, E. P. Supervisor
Regulatory Affairs Section
Perry Nuclear Power Plant, A-250
10 Center Road
Perry OH 44081

Dear Mr. Higaki,

The Perry Joint Fire District agrees to provide both ambulance and fire fighting services to the Perry Nuclear Power Plant to the best of our ability, at their request, to assist in safeguarding the public health and safety and coping with radiological emergencies as required by regulations of the Nuclear Regulatory Commission 10 CFR 50, Appendix E.

Our services will include the transport of patients arising from radiation accidents under written procedures you will provide. Upon request, and after review and consent by our Board, the Fire Department will participate in periodic prescheduled drills coordinating our actions with the hospital and the Perry Nuclear Power Plant. Additionally, we will accept special training for ambulance attendants and firemen that you will provide, when required.


We understand that First Energy Corporation is financially responsible for modifications to existing vehicles, which may be required by the Nuclear Regulatory Commission, or others, for the transportation of patients exposed to radioactive materials. Further, First Energy Corporation is responsible for safeguarding officials, firemen, and ambulance attendants against radiation and for the complete decontamination and/or replacement of equipment and vehicles which may have been exposed in the process of providing emergency medical services.


This Agreement shall be in effect for a period of two (2) years, but may be terminated by either party with sixty days prior notification in writing.


The cooperation expressed in this Agreement is a part of the larger commitment of both the Perry Joint Fire District and First Energy Corporation to actively participate in the well-being and development of the local communities.


Sincerely,

PERRY JOINT FIRE DISTRICT


Thomas Williams, Chairman


John Young, Vice-Chairman


Thomas Advey

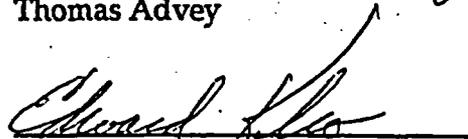
Edward Klco


Corbett Shaw


Walter Siegel

JMC:ljd

higaki@ppp.br

**Letter Of Agreement
Between
First Energy Nuclear Operating Company (FENOC)
And
Lake Hospital System, Inc.**

This letter of Agreement documents the willingness of the medical staff and Board of Trustees of Lake Hospital System, Inc. to accept patients with potential radiological complications from the Perry Power Plant for treatment. LakeEast Hospital in Painesville shall serve as the primary treatment facility with LakeWest Hospital in Willoughby serving as the backup treatment facility. Transport of an injured individual to LakeWest Hospital in lieu of LakeEast Hospital will be a judgment made by the LakeEast Hospital Emergency Department staff.

As part of the agreement, FENOC will be responsible for the following:

1. Maintaining Emergency Department Radiological Emergency Area (REA) equipment and supplies located at LakeEast and LakeWest hospitals.
2. Establishing and maintaining written procedures, in conjunction with Lake Hospital System medical staff, for the care of patients exposed to radioactive materials.
3. Providing training at least annually to LakeEast and LakeWest hospital personnel. The content of training materials and scheduling shall be agreed upon jointly by the hospital and FENOC.
4. Coordinating annual testing of the hospital's Disaster plan for the treatment of contaminated patients with the hospital's staff and the Federal Emergency Management Agency (FEMA).
5. Dispatching a Health Physics (HP) Technicians or Supervisor with the potentially radiologically contaminated patient and providing a back up HP Technician or Supervisor to assist with radiological release surveys of hospital personnel, treatment areas, and equipment.

Lake Hospital system may encounter radiological emergencies origination from locations other than the Perry Power Plant. In this event, Perry Plant HP personnel will provide timely radiological assistance at the discretion of the Perry Power Plant Control Room Shift Supervisor upon request from Lake Hospital System. However, due to plant staffing requirements, HP personnel may be not able to respond in the same time frame as for radiological injuries originating at the Perry Power Plant. Requests for assistance should be directed to the Perry Plant Control Shift Supervisor at 280-5763 or 479-3051.

FENOC will be required to replenish equipment and supplies expended as a result of scheduled training and drills or as a part of an actual medical emergency involving a patient transported from the Perry Power Plant.


This Agreement shall be for a term of two (2) years, unless terminated by either party upon sixty (60) days prior written notice.




Leslie A. Monitello
Vice President, Critical Care Services



7/20/02 to 7/20/04

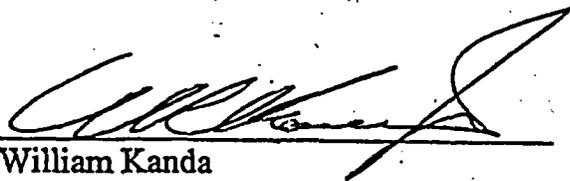

William Kanda
Vice President, Perry Nuclear Group
First Energy Nuclear Operating Company



7/20/02 to 7/20/04



COUNTY OF LAKE

BOARD OF COUNTY COMMISSIONERS

ROBERT E. AUFULDISH RAYMOND E. SINES
DANIEL P. TROY

PAINESVILLE
(440) 350-2745

TOLL FREE
800-899-5253

FAX
(440) 351-2672

Mr. Dave Bauguess, Supervisor
Emergency Planning
Perry Nuclear Power Plant
10 Center Road
North Perry, OH 44081

October 2, 2003

Dear Mr. Bauguess:

The Lake County Emergency Management Agency is designated as the lead and coordinating agency for response to area-wide emergencies within Lake County, Ohio.


Should an incident occur at the Perry Nuclear Power Plant, the Lake County Emergency Management Agency under the County Commissioners would assume leadership in the coordination of the countywide response actions.


Lake County has developed plans and procedures for response to an incident at the Perry Nuclear Power Plant and would implement them to the best of its ability and capability in the event of an emergency at the plant.

Through the implementation of these plans and procedures, Lake County intends to protect the health and welfare of all the residents and visitors in the County.


This agreement shall be for a term of two (2) years unless terminated by either party upon sixty (60) days prior written notice.

BOARD OF LAKE COUNTY COMMISSIONERS
LAKE COUNTY EMERGENCY MANAGEMENT AGENCY


Robert E. Aufuldish, President

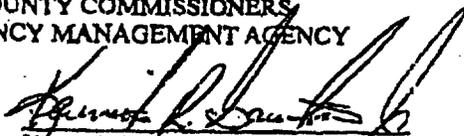
Kenneth R. Gauntner, Jr., Interim Director


Raymond E. Sines, Commissioner


Daniel P. Troy, Commissioner

H.T. NOLAN ADMINISTRATIVE CENTER
CARRIAGE HOUSES • P.O. BOX 490 • PAINESVILLE, OHIO 44077-0490



Ashtabula County Commissioners
Robert J. Boggs
Duane S. Feher
Deborah A. Newcomb



25 W. Jefferson Street
Jefferson, Ohio 44047-1092
(440) 576-3750
Fax: (440) 576-2344

July 23, 2002

Mr. Vernon Higaki, Supervisor
Perry Training Section
Perry Nuclear Power Plant
10 Center Road
P.O. Box 97
North Perry, Ohio 44081

Dear Mr. Higaki:


The Ashtabula County Emergency Management Agency is responsible for coordinating and leading all disaster responses within Ashtabula County, as well as leading and coordinating countywide area emergencies. It is therefore understood that the Ashtabula County Emergency Management Agency will assume the leadership and direction of any emergency that may occur at the Perry Nuclear Power Plant when Ashtabula County is concerned.


The Ashtabula County Emergency Management Agency has developed plans and procedures in order to respond to an incident at the Perry Nuclear Power Plant and will be responsible for their implementation. Through the plans and procedures the Ashtabula County Emergency Management Agency and the Emergency Operations Center staff intend to protect the lives and property of all the residents within Ashtabula County.

This agreement shall be for a term of two (2) years unless terminated by either party upon sixty (60) days prior written notice.

Very truly yours,

Ashtabula County Commissioners


Deborah A. Newcomb, President of the Board


Robert J. Boggs, County Commissioner


Duane S. Feher, County Commissioner



COUNTY OF GEAUGA, OHIO
Board of County Commissioners

Neil C. Hofstetter Wm. M. Repke William S. Young
470 Center Street, Building 4, Chardon, Ohio 44024-1071

April 22, 2003

Mr. Dave Bauguess, Supervisor
Emergency Planning Unit
Perry Nuclear Power Plant
10 Center Road
Perry, Ohio 44081

Dear Mr. Bauguess:


The Geauga County Department of Emergency Services is the lead agency in Geauga County for handling and coordinating response to area wide emergencies within the county. As such, the Geauga County Department of emergency Services would lead and coordinate County response to an incident at the Perry Nuclear Power Plant (PNPP).

Gauga County has developed plans and procedures to deal with an emergency at PNPP and would implement these plans and procedures to the best of its ability in the event of an incident at the plant.

The County intends to protect the health and welfare of the people in Geauga County through the implementation of its response plans and procedures.

Please consider this notice to be in effect until December 31, 2004 unless notified by either party upon sixty (60) days prior written notice.

GEAUGA COUNTY COMMISSIONERS


Wm. M. Repke

Neil C. Hofstetter


William S. Young

Tel: 440-285-2222 ext. 6150 • Fax: 440-286-9177 • Email: commissioners@geaugabocc.org

**LETTER OF AGREEMENT
BETWEEN
THE FirstEnergy NUCLEAR OPERATING COMPANY
AND
THE STATE OF OHIO
EMERGENCY MANAGEMENT AGENCY**

This letter will serve as a written agreement that the FirstEnergy Nuclear Operating Company will provide the State of Ohio with the following equipment at the locations indicated during a drill or emergency involving the Perry Nuclear Power Plant.

<u>Location</u>	<u>Equipment</u>
JPIC	Telephones Telecopier Copier Typewriter Work Space Status Boards Maps Administrative Support/Supplies
EOF	Telephones Telecopier Copier Typewriter Work Space Status Boards Maps Administrative Support/Supplies


Note: It is understood that this list is not all-inclusive, but is representative of the level of support needed by responders to these facilities.

Upon declaration of a Site Area Emergency at the Perry Nuclear Power Plant, The FirstEnergy Nuclear Operating Company (FENOC) will dispatch a technical liaison to the State Emergency Operations Center (EOC). In the event of an incident where further degradation of the plant appears likely, the Ohio Emergency Management Agency may request that the technical liaison be dispatched to the State EOC prior to a Site Area Emergency Declaration.

This Agreement shall be periodically reviewed and updated as necessary. The agreement will remain in effect until terminated by one party or the other through the submission of a sixty- (60) days written notice.

SIGNED:


For The FirstEnergy Nuclear
Operating Company



Plant Manager
Title

11/22/99
Date

For The State of Ohio Emergency
Management Agency.



Executive Director
Title

11/09/99
Date



BWR Nuclear Emergency Support Program

SIL No. 324
Revision 6

September 18, 1998

GE Nuclear Energy has made changes to the BWR Emergency Support Program. These changes are intended to improve GE Nuclear Energy responsiveness to site emergency drills or real plant nuclear emergencies. The emergency phone number is continuously monitored by the Security Operations Center at GE Nuclear Energy headquarters in San Jose.

The Duty Manager responsibility within GE Nuclear Energy has been transferred to an engineering group which has the direct capability to handle all requests for emergency services. For drills, the Security Officer answering the phone is now authorized to confirm contact with GE Nuclear Energy without requiring a return phone call from the GE Nuclear Energy Duty Manager. The Duty Manager will only be contacted if services from GE Nuclear Energy are requested.

Contact with GE Nuclear Energy for matters outside the scope of the Nuclear Emergency Support Program should not be made using the telephone number noted in this SIL.

The purpose of this Revision 6 to SIL No. 324 is to furnish a current description of GE Nuclear Energy's BWR Nuclear Emergency Support Program and to identify the method for requesting nuclear emergency assistance from GE. The information that appears in this Revision 6 should be incorporated into applicable BWR plant procedures as soon as practicable. This SIL No. 324 Revision 6 voids SIL No. 324 Revision 5.

Discussion

The GE Nuclear Energy BWR Nuclear Emergency Support Program provides expedited assistance to owners and operators of GE BWRs to minimize the effect of nuclear emergencies which potentially could affect the health and safety of the public or plant personnel. This program has access to the full resources of GE's engineering organizations in San Jose, California as well as GE personnel located elsewhere.

Please note that GE's Nuclear Emergency Support Program should be activated (i.e., the duty manager contacted) only during nuclear emergencies at GE BWRs, or during site emergency drills for which services from GE Nuclear Energy are required. Expedited services not related to such nuclear emergencies are available through the local GE Nuclear Energy Service Representatives.

GE Nuclear Energy BWR Nuclear Emergency Support Program description

1. Dedicated Emergency Communications Coverage

Dedicated emergency telephone communications coverage is available to owners and operators of GE BWRs 24 hours a day, 365 days a year for requesting assistance from GE for actual BWR nuclear emergencies or site emergency drills. The telephone number to call for GE's BWR Nuclear Emergency Support Program is (408) 971-1038. This number is monitored continuously by the Security Operations Center at GE Nuclear Energy, San Jose, CA.

During the telephone call to the Security Operations Center, the caller should give the Security Officer his or her name, telephone number, the name of the BWR utility and the name of the affected BWR. (For an actual nuclear emergency, BWR owners and operators may wish to dedicate a specific telephone number for communications exclusively with GE.) *If the call is for a drill, no further action will be taken.* If the BWR Nuclear Emergency Support Program is to be activated, the GE Security Officer will immediately contact a GE Nuclear Emergency Support Program Duty Manager by telephone.

2. Initial Telephone Contact

As soon as possible after a call concerning an actual BWR nuclear emergency, a GE Duty Manager will telephone the number provided by the BWR utility to the Security Officer. During this initial telephone contact, the BWR utility representative should define the scope of assistance desired from GE.

3. BWR Nuclear Emergency Support Program activation

Upon activation of the BWR Nuclear Emergency Support Program, GE will perform the following, if requested:

- a. Form and dispatch to the affected site, by chartered jet aircraft (if required), a GE Emergency Response Team composed of GE personnel from the technical disciplines requested by the BWR utility representative. It is GE's intention that the Team arrive at the affected BWR site within 24 hours after the time of the request. The BWR utility representative will arrange for the GE Emergency Response Team to pass through road blocks and plant security posts in a timely manner. GE will furnish to the BWR utility the name and social security number of each member of the Emergency Response Team.
- b. Form a Technical Support Team in San Jose composed of GE personnel from appropriate technical disciplines, and establish dedicated telephone communications with utility personnel at the affected BWR and with local GE Nuclear Energy personnel.
- c. Instruct local GE Nuclear Energy personnel to proceed immediately to the BWR site to establish dedicated communications with GE's Technical Support Center in San Jose, collect information requested by the Technical Support Team, and support the BWR utility as directed by the Technical Support Team until the Emergency Response Team arrives at the BWR site.
- d. Assist BWR utility personnel in recovering from the nuclear emergency.

4. GE Nuclear Energy Participation

GE Nuclear Energy maintains the BWR Nuclear Emergency Support Program in a standby mode at no cost to BWR utilities. If BWR utility personnel request GE's participation in a drill beyond the initial telephone contact, or request GE's assistance during an actual nuclear emergency, GE will provide such services in accordance with the terms and conditions under which GE Nuclear Energy routinely provides services to the BWR utility.

Recommended actions

GE Nuclear Energy recommends that owners and operators of GE BWRs implement the following to facilitate activation and coordination of GE's BWR Nuclear Emergency Support Program:

1. Inform GE Nuclear Energy in writing that BWR Nuclear Emergency Support Program services may be desired and that such services, when furnished by GE, will be furnished in accordance with the terms and conditions under which GE Nuclear Energy routinely provides services to the BWR utility.
2. Confirm that the BWR Nuclear Emergency Support Program telephone number (408) 971-1038 appears in site emergency procedures for initial telephone contact with GE's BWR Nuclear Emergency Support Program.
3. Provide instructions to GE Nuclear Energy describing site admission procedures during an actual nuclear emergency and identifying the conduct expected of local GE Nuclear Energy personnel and the Emergency Response Team while at the BWR site.
4. In the event an Emergency Response Team is dispatched to a BWR site:
 - a. Provide to the Technical Support Center in San Jose the name and telephone number of the BWR utility person assigned to coordinate the arrival of the Emergency Response Team. Arrival coordination activities should include the following:
 1. Identify the landing location for the aircraft on which the Emergency Response Team will arrive (if a chartered jet aircraft is required).
 2. If the affected BWR is located outside the United States and a chartered jet aircraft is required, secure overflight clearances as required by countries along the flight path of the aircraft as well as necessary landing and Customs clearances, such as visas, for the Emergency Response Team.
 3. Provide local transportation and escort for the Emergency Response Team to minimize delays in arriving at its assigned work location at the BWR site.

b. Assure that site procedures exist to permit local GE Nuclear Energy personnel and Emergency Response Team members to pass through security posts to the assigned work location in a timely manner.

c. Provide appropriate administrative support and physical facilities at the BWR site for the

Emergency Response Team, including communication facilities, health physics services and equipment, access to plant documents and living accommodations if the Emergency Response Team is to remain at the BWR site.

To receive additional information on this subject or for assistance in implementing a recommendation, please contact your local GE Nuclear Energy Service Representative.

This SIL pertains only to GE BWRs. The conditions under which GE Nuclear Energy issues SILs are stated in SIL No. 001 Revision 4, the provisions of which are incorporated into this SIL by reference.

Product Reference

A71 — Plant recommendations

Technical source

K. Faynshtein

Issued by

R.M. Fairfield

R. M. Fairfield, Project Manager
Service Information Communications
GE Nuclear Energy
175 Curtner Avenue, San Jose, CA 95125

FROM: DOC. CONTR. DATE: 10-14-98		
COPIES TO:	PRU	STA
A210	PNSD/RAS H. Hegref	CC300
W220	PNMD/TCU J. WRIGHT	
A250	PNED/PES/RVP D. Phillips	
A250	PNED/PES/ASS J.R. HAYES	
A170	PNED/PES/MU P. Nichols	
W220	ISEG/DER Coordinator J. Johnson	

AGREEMENT

THIS AGREEMENT IS HEREBY ENTERED INTO this first day of January, 2003 by and between the LAKE COUNTY COMMUNITY COLLEGE DISTRICT, hereinafter referred to as the "District" and FIRST ENERGY NUCLEAR OPERATING COMPANY (FENOC), an Ohio Corporation and parent corporation of THE ILLUMINATING COMPANY, hereinafter referred to as the "Company."

WITNESSETH

WHEREAS, the term of this agreement will be in effect for a two year period up to and including December 31, 2004. Any and all agreements entered into between the District and FENOC or the Company prior to the date of this agreement shall be considered null and void.

WHEREAS, the Company is required to provide space for a Joint Public Information Center, hereinafter referred to as "JPIC," for use during scheduled drills and/or emergencies at the Perry Nuclear Power Plant, hereinafter referred to as "PNPP," and

WHEREAS, the District has the facilities, equipment, and services required for use by the Company for the JPIC during scheduled drills and/or emergencies at the PNPP,

NOW, THEREFORE, in consideration of the foregoing premises and of the mutual promises, terms, and conditions hereinafter contained, it is mutually agreed by and between the parties as follows:

1. The District will make available to the Company the following facilities for use as the JPIC during scheduled drills and/or emergencies:
 - a) Performing Arts Center
 - b) Art Gallery
 - c) Board of Trustees Room (divided)
 - d) President's Conference Room
 - e) Second Floor D-Building Study Area
 - f) PAC Dressing Room
2. The Company agrees to reimburse the District the annual facility retainer fee and daily rates for the facilities, equipment, and services used for the JPIC, as shown on Exhibit "A" attached hereto and made a part hereof. The annual facility retainer fee will be billed to the Company on January 1 of each year, and will be payable to the District within thirty (30) days. Daily facility rentals will be billed to the Company subsequent to actual usage, and will be payable to the District within thirty (30) days.
3. The Company will give the District at least four (4) months written notice of the dates for the scheduled drills. The Company will make its best efforts to ensure that said drills will not be held during the first week of any term or the "finals" week of any term. The District will acknowledge the dates of the scheduled drills and make the facilities set forth in paragraph 1.a through 1.f available to the Company, as required.
4. The District will permit the Company to have installed additional communications equipment and lines in the Board of Trustees Room, the President's Conference Room, the Second Floor D-Building Study Area, PAC Dressing Room, and the Art Gallery at the sole expense of the Company for use during scheduled drills and/or emergencies. Prior to the installation of said communications equipment and lines, the Company will submit plans for said work to the District for its approval.

C O P Y

5. The District will provide a lectern and a sufficient number of tables and chairs in accordance with Company needs. Additional chairs, tables, other supplies, and equipment will be provided by the Company and stored at a location determined by the District with the concurrence of the Company. The District will also provide personnel to set up and take down the chairs and tables. The District personnel will also remove the Board of Trustees conference table and will setup the dividing wall within the Board of Trustees room. The District will make its best effort to have its personnel set up the chairs and tables within two (2) hours of notification by the Company in the event of an emergency. The use of the District equipment and personnel is included in the daily rates as shown on Exhibit "A."
6. In accordance with the needs defined by the Company, the District will provide, wherever possible:
 - a) photocopies of documents from its Copy Center;
 - b) supplies and materials from its Bookstore;
 - c) Food Service in Company work areas and/or the District Cafeteria;
 - d) equipment and facilities to meet video and audio requirements;
 - e) personnel to provide security services;
 - f) technical personnel to set up and activate video and audio equipment;
 - g) a qualified technician on an on-call basis to resolve video or audio equipment problems that may occur; and
 - h) access to the District's Internet.

The above will be provided throughout scheduled drills and/or emergencies. Any costs associated with the use of these facilities, equipment, supplies, or personnel will be paid by the Company. The District will submit itemized bills to the Company for each function and applicable expenses as stated above at the end of scheduled drills and on a weekly basis during emergencies.

7. In the case of an emergency, the District will make available the facilities set forth in paragraph 1.a through 1.f regardless of uses that have been scheduled for these facilities prior to the emergency. The District agrees that the emergency use will take precedence over any other scheduled use of the facilities. The Company agrees to reimburse the District for any and all expenses the District may incur resulting from the canceling or shifting of activities from these facilities during an emergency.
8. The following minimum insurance requirements shall be provided by the Company and communicated annually (at January 1 of each year) via a certificate of insurance (or self insurance) that names the District as an additional insured:
 - 1) Comprehensive or Commercial General Liability (including Premises-Operations and Broad Form Property Damage):
 - a) Bodily Injury and Property Damage, Combined Single Limit, CSL:
\$1,000,000 Each occurrence
\$2,000,000 Aggregate
 - b) Property Damage Liability insurance shall provide X, C, and U coverage.
 - c) Contractual Liability:
\$1,000,000 Each occurrence Combined Single Limit (CSL)
\$2,000,000 Aggregate
 - d) Personal Injury, with Employment Exclusion deleted:
\$2,000,000 Aggregate

2) Business Auto Liability (including Owned, Non-Owned, and Hired Vehicles).

- a) Bodily Injury and Property Damage, CSL:
\$1,000,000 each person
\$1,000,000 each occurrence

3) Ohio Stop Gap Liability:
\$500,000 per Incident
\$500,000 Aggregate

4) Certificate from the State of Ohio (or statement of self-insurance) evidencing Ohio Workers' Compensation insurance.

9. All personal property belonging to the Company or to any other person located on or about said facilities shall be at the sole risk of the Company or such other person, and neither the District nor the District's agents or employees shall be liable for the theft or misappropriation thereof, nor for any damage or injury thereto, nor for damage or injury to the Company, to other persons or to property, equipment, and fixtures of any kind, or by an act or neglect of other users of said facilities, or of any other person, or caused in any other manner whatsoever, unless the same shall proximately result from the negligence of the District or District's agents or employees. The Company will protect, indemnify, and save harmless the District from all losses, costs, or damages sustained by reason of any act or other occurrence causing injury to any person and/or property whomsoever or whatsoever due directly or indirectly to the use of said facilities or any part thereof by the Company, except losses, costs, and damages proximately resulting from the negligence of the District or District's agents or employees.
10. District and Company agree that, in the event of loss due to any of the perils for which they have agreed to assume or accept, each party shall look solely to its insurance for recovery. District and Company hereby grant to each other, on behalf of any insurer providing insurance to either of them with respect to the demised premises, a waiver of any right of subrogation which any insurer of one party may acquire against the other by virtue of payment of any loss under such insurance.


IN WITNESS WHEREOF, the parties have hereunto set their hands to duplicate copies hereof the day and year first written.

LAKE COUNTY COMMUNITY COLLEGE DISTRICT

By: 

Dr. Morris W. Beverage, Jr., President
Printed name and title

FIRST ENERGY NUCLEAR OPERATING COMPANY

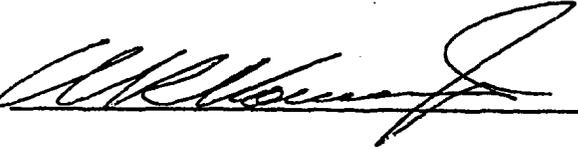By: 

William R. Kanda, FENOC Vice President/Perry
Printed name and title

¹²¹
(CEI-TPIC.02)



METROHEALTH MEDICAL CENTER

2500 METROHEALTH DRIVE CLEVELAND, OHIO 44109-1998 (216) 778-3090
FAX (216) 778-8226

September 4, 2003

PERRY NUCLEAR POWER PLANT
Dan Cleaver - Emergency Planner
Ten Center Road (A240)
North Perry, OH 44081

Dear Mr. Cleaver:

I understand the Perry Nuclear Plant Emergency Plan incorporates information concerning the area's emergency medical treatment and transportation resources, and that this information is updated periodically.

Metro Life Flight is pleased to continue to provide services to the Perry nuclear Power Plant staff and to the neighboring fire departments.

Our capabilities and policies allow us to respond to any trauma or medical emergencies, which are not Haz-Mat related. Any patients experiencing a Haz-Mat exposure, including nuclear contamination should be assessed and treated by the local fire and EMS services in conjunction with a Haz-Mat team.

This agreement shall be for a term of two (2) years unless terminated by either party upon sixty (60) days prior written notice.

Metro Life Flight is able to respond to a local hospital to treat and transport these patients once complete decontamination has been accomplished. If I can provide you with any further information, please feel free to give me a call.

Sincerely,

METROHEALTH MEDICAL CENTER

William F. Fallon, Jr. M.D., FACS
Medical Director
Division of Trauma, Critical Care, Burns, and
Metro Life Flight

WFF /mar



WHERE CARING IS AS CRITICAL AS THE CARE

APPENDIX C

LIST OF EMERGENCY EQUIPMENT AND SUPPLIES

APPENDIX C

LIST OF EMERGENCY EQUIPMENT AND SUPPLIES

A. PORTABLE RADIOLOGICAL MONITORING EQUIPMENT AND SUPPLIES

<u>LOCATION(1)</u>	<u>RMT KITS</u>	<u>PORTABLE RADIACS</u>	<u>DOSIMETRY</u>	<u>PROTECTIVE CLOTHING</u>
1. Emergency Operations Facility	X	X	X	X
2. Backup EOF	X		X	
3. Technical Support Center			X	
4. Alternate TSC (Ashtabula)	X		X	
5. Operations Support Center		X	X	X
6. Primary Access Control Point			X	X
7. Unit 1 Control Room(4)		X		

B. DECONTAMINATION EQUIPMENT AND SUPPLIES ⁽¹⁾ <S00560>

Storage Locations

1. Emergency Operations Facility (EOF)
 - Decontamination Room
2. Backup EOF
 - Backup EOF area
3. Operations Support Center (OSC)
 - Decontamination Room

NOTES:

- (1) Specific area locations are designated in PSI-0018. Detailed listings of equipment types, sizes and amounts are specified in equipment inventory checklists maintained by EPU, with the exception of the OSC (599' CC) Decontamination Room which is maintained under normal Health Physic Program.
- (2) 2 RMT kits are available at the Backup EOF/Alternate TSC in case the plant site is inaccessible.
- (3) Dosimetry is available for RMT personnel at the Backup EOF and alternate TSC at the Ashtabula Service Center.
- (4) Sufficient equipment and supplies shall be stored in or adjacent to the Control Room, or immediately available upon request, to ensure continued manning of the Unit 1 Control Room.

- (5) Decontaminants and supplies approved by HPI-E7, including those required for the removal of radio-iodine contamination, will be maintained at designated decon locations.

APPENDIX D

LIST OF SUPPORTING PLANS

APPENDIX D

LIST OF SUPPORTING PLANS

1. STATE OF OHIO PLAN FOR RESPONSE TO RADIATION EMERGENCIES AT LICENSED NUCLEAR FACILITIES
2. COUNTY RADIATION EMERGENCY PLANS
 - a. ASHTABULA COUNTY RADIOLOGICAL EMERGENCY RESPONSE PLAN
 - b. GEAUGA COUNTY RADIOLOGICAL EMERGENCY RESPONSE PLAN
 - c. LAKE COUNTY RADIOLOGICAL EMERGENCY RESPONSE PLAN FOR THE PERRY NUCLEAR POWER PLANT, ANNEX M, APPENDIX 2-RADIATION PROTECTION.
3. U.S. NUCLEAR REGULATORY COMMISSION
 - a. Response Coordination Manual, 1996 (NUREG/BR-0230)
4. EMERGENCY PUBLIC INFORMATION ORGANIZATION INSTRUCTIONS MANUAL
5. PNPP SECURITY PLAN
6. FENOC QUALITY ASSURANCE PROGRAM MANUAL
7. UNITED STATES COAST GUARD
 - a. Captain of the Port, Cleveland; Contingency Plan for Perry Nuclear Power Plant
8. INSTITUTE OF NUCLEAR POWER OPERATIONS
 - a. Emergency Responses Manual (INPO 86-032)

APPENDIX E

NUREG-0654/FEMA-REP-1 CROSS REFERENCE TO
PERRY PLANT EMERGENCY PLAN INDEX

APPENDIX E

NUREG-0654/FEMA-REP-1 CROSS REFERENCE TO
PERRY PLANT EMERGENCY PLAN INDEX

NUREG-0654 REFERENCE <S00555>

<u>A. Assignment of Responsibility (Organization Control)</u>	<u>Section</u>
1. a) Federal, State, and local response organizations for emergency planning zone	3.2.1, 3.2.2, 3.2.3 5.3, 5.4
b) Organizational and suborganizational concept of operation	5.2
c) Interrelationship (Block Diagram)	Figure 5-1 Figure 5-2 Figure 6-1 Figure 6-3
d) Individual in charge, by title	5.2
e) 24-hour manning of communications	5.2.3
2. Written agreements and legal instruments	5.3 5.4 Appendix B
3. Title of the individual responsible for assuring continuity of resources (technical, administrative, and material) for continuous (24-hour) operations during a protracted period	5.2.2
 <u>B. Onsite Emergency Organization</u>	
1. Onsite emergency organization and relation to responsibilities and duties of normal staff complement	5.1 5.2.1
2. Emergency Coordinator with authority to initiate emergency actions	5.2.1
3. Line of succession for Emergency Coordinator	5.2.2.1 5.2.2.3 5.2.2.4 5.2.3
4. Functional responsibilities assigned to Emergency Coordinator	5.2.2.1 5.2.2.3 5.2.2.4 5.2.3

APPENDIX E (Cont.)

<u>B. Onsite Emergency Organization (Cont.)</u>	<u>Section</u>
5. Emergency functions and minimum staffing for nuclear power plant emergencies	5.2.1 5.2.2 Table 5-1
6. Interfaces between licensee, local services, and State and Local government	5.3 5.4 6.1 Figure 6-3
7. Corporate management, administrative and technical support personnel who will augment plant staff in:	5.2.2 5.2.3 Figure 5-1 Figure 5-2
a) Logistics support	
b) Technical support	
c) Interface with government authorities	
d) Information to news media	
8. Contractor and private organizations who may provide technical assistance	5.4.6 Appendix B
9. Services to be provided by local agencies, police, ambulance, medical, hospital, and firefighting	5.3 Appendix B
<u>C. Emergency Response Support and Resources</u>	
1. a) Person(s) authorized to request Federal assistance	5.2.2, 5.4.3, 5.4.4
b) Federal resources expected	5.4.3
c) Specific licensee resources available to support the Federal response	7.1.3, 7.1.4, 7.2.2.1
2. a) Licensee shall prepare for the dispatch of a representative to the principle offsite governmental emergency operations centers	5.2.3
3. Radiological laboratories that can be used in an emergency	7.5.8
4. Organizations, facilities, and individuals that can be relied upon in an emergency to provide assistance	5.3, 5.4 Appendix B

APPENDIX E (Cont.)

<u>D. Emergency Classification System</u>	<u>Section</u>
1. Instruments, parameters, or equipment status for establishing emergency class	Table 4-1
2. Initiating conditions NUREG-0610 and postulated accidents in USAR	Figure 4-1
<u>E. Notification Methods and Procedures</u>	
1. Procedures for notification of response organizations including means of message verification	6.1
2. Procedures for notifying, alerting, and mobilizing emergency personnel	6.1.1 7.3
3. Contents of initial emergency messages to be sent from plant	6.1
4. Follow-up messages from facility to offsite authorities	6.1
5. Administrative and physical means to notify the public	6.4.2 7.4
6. Provide supporting information for written messages to the public for protective actions	6.1, 6.4.2, 8.6
<u>F. Emergency Communications</u>	
1. a) 24 hour day notification to include 24 hour communication link	5.2.3, 6.1, 7.2.2
b) Communications with contiguous state and local governments	5.4.5
c) Communications with federal agencies	6.1, 7.2.2
d) Communications between near site EOF, State and local EOCs, and RMTs	7.2
e) Alerting and activating emergency personnel	6.1.1, 7.3
f) Communications between operator, NRC headquarters, NRC regional EOC, and site EOF	6.1, 7.2.2

APPENDIX E (Cont.)

<u>F. Emergency Communications (Cont.)</u>	<u>Section</u>
2. Communications for fixed and mobile support	6.4.2 7.2.2.5
3. Periodic testing of communications	8.8.4.2
<u>G. Public Information</u>	
1. Periodic dissemination of information	8.6
2. Public information program	8.6
3. a) Contact and physical location for use by news media	5.2.2.5, 5.2.2.6, 7.1.4
b) Provide space for news media at near site EOF	7.1.3
4. a) Spokesperson for all necessary information	5.2.2.5, 5.2.2.6
b) Arrangements for timely exchange of information	7.1.4 7.2.2.4
c) Arrangements for dealing with rumors	7.1.4
5. Annual program to acquaint news media with Emergency Plan and contact for release of public information	8.7 Table 8-1
<u>H. Emergency Facilities and Equipment</u>	
1. TSC and OSC in accordance with NUREG-0696	7.1.1 7.1.2
2. EOF in accordance with NUREG-0696	7.1.3
3. Means for activating and staffing facilities and centers	5.2.3, 7.3
4. Onsite monitoring systems used to initiate emergency measures and for continuing assessment	
a) Geophysical phenomena monitors	7.5.5, 7.5.6, 7.5.9,

APPENDIX E (Cont.)

<u>H. Emergency Facilities and Equipment (Cont.)</u>	<u>Section</u>
b) Radiological monitors	7.5.3, 7.5.9, Table 4-1
c) Process monitors	7.5.1
d) Fire and combustion products	7.5.4
5. Offsite monitoring equipment	
a) Geophysical phenomena monitors	7.5.9.1
b) Radiological monitors	7.5.3
c) Lab facilities	7.5.8
6. Provide offsite radiological monitoring equipment	6.2, 6.4.2, 7.7
7. Meteorological instrumentation and provision to obtain representative real-time meteorological information from another source	7.5.7
8. Provide onsite OSC (assembly area)	5.2.2 7.1.2
9. Emergency equipment inventory/instrument checks and calibration	7.7, 8.4
10. Inventory of emergency kits (appendix)	Appendix C
11. Central point to collect field monitoring data	6.4.2, 7.1.3
 <u>I. Accident Assessment</u>	
1. Plant parameter values or other information which correspond to initiation conditions of NUREG-0610	Table 4-1 Appendix A
2. Onsite capability and resources to provide initial values and continuing assessment of accident	5.2.3 7.5
3. Methods and techniques for determining:	
a) Source terms of releases of radioactive material	6.4.1, 7.5.10 Figure 6-4

APPENDIX E (Cont.)

<u>I. Accident Assessment (Cont.)</u>	<u>Section</u>
b) Magnitude of release based on plant system parameters and monitors	7.5.10
4. Establish relationship between effluent monitor readings and onsite and offsite exposures for various meteorological conditions	7.5.10
5. Meteorological information at EOF, TSC, Control Room, and offsite NRC center	7.1, 7.2.2.1(c), 7.5.10
6. Methodology for determining the release rate/projected dose if instrumentation is offscale or inoperable	7.5.10.2
7. Field monitoring within the plume exposure Emergency Planning Zone	5.2.3, 6.4.2 7.5.10
8. Methods, equipment and expertise to make rapid assessments of any radiological hazards through liquid or gaseous releases	5.2.3, 6.4.2, 7.5
9. Capability to detect and measure radiiodine concentrations in air as low as 1.0 E-07 uCi/cc under field conditions	5.2.2.2 6.2.5
10. Accident assessment/dose estimating	7.5.10
 <u>J. Protective Response</u>	
1. Means and time required to warn and advise onsite individuals and individuals in areas controlled by operator	6.1.1 6.4.1 7.2.1.2
2. Evacuation routes and transportation for onsite individuals to a suitable offsite location	6.3 Figure 6-2
3. Radiological monitoring of people evacuated from site	6.3, 7.1.3, Appendix C
4. Evacuation of onsite non-essential personnel in the event of a Site Area or General Emergency, provision for decontamination capability at or near offsite location	6.3 7.1.3 Appendix C

APPENDIX E. (Cont.)

<u>J. Protective Response (Cont.)</u>	<u>Section</u>
5. Capability to account for all individuals onsite within 30 minutes	6.3
6. a) Individual respiratory protection	6.6
b) Use of protective clothing	6.5, 6.6
c) Use of radioprotective drugs	6.7
7. Mechanism for recommending protective actions to-state and local authorities	6.1, 6.4, 6.4.2
8. Time estimate for evacuation within plume exposure EPZ	6.4.2 PSI-0013
9. a) Maps showing evacuation routes, relocation centers, hospital, shelter areas, and other medical facilities	PSI-0013
b) Population distribution around facility	2.2 PSI-0013
c) Means for notifying all segments of transient and resident population	6.4.2, 7.4, PSI-0013.
d) Bases for choice of recommended protective actions from plume exposure pathway	6.4.1, 6.4.2, Table 6-2 Figure 6-3
<u>K. Radiological Exposure Control</u>	
1. Exposure guidelines for:	6.5, 6.6
a) Removal of injured persons	
b) Undertaking corrective actions	
c) Performing assessment action	
d) Providing first aid	
e) Performing personnel decontamination	
f) Providing ambulance service	
g) Providing medical treatment services	

APPENDIX E (Cont.)

<u>K. Radiological Exposure Control (Cont.)</u>	<u>Section</u>
2. Onsite radiation protection program for emergencies	6.5, 6.6
3. Emergency worker dosimetry provisions and record-keeping	6.6
4. a) Action levels for determining need for decontamination	6.5.3
b) Radiological decontamination of emergency personnel and waste disposal	6.5 7.6
5. Contamination control for:	
a) Area access control	6.5
b) Drinking water and food supplies	6.5
c) Criteria for permitting return of area and items to normal use	6.5
6. Capability for decontaminating relocated onsite personnel	6.3, 7.6
<u>L. Medical and Public Health Support</u>	
1. Local and backup medical facilities with ability for radiological evaluation of victims; adequate training of medical personnel	5.3.3 Table 8-1
2. Onsite first aid capability	7.6 8.1.2.4
3. Transportation of accident victims	5.3.3 Table 8-1
<u>M. Recovery and Reentry Planning & Postaccident Operations</u>	
1. Procedures for re-entry/recovery	9.0
2. Position/title authority and responsibilities of key positions in recovery organization	9.2

APPENDIX E (Cont.)

<u>M. Recovery and Reentry Planning & Postaccident Operations (Cont.)</u>	<u>Section</u>
3. Means of informing members of the response organizations that recovery operation is to be initiated and of any changes in organizational structure that may occur.	9.3
4. Estimating total population exposure	7.5.10, 9.2
<u>N. Exercises and Drills</u>	
1. a) Initial and annual emergency response exercise	8.8.4.1
b)-1 Mobilization of local and state and resources	8.8.4.1
b)-2 Critique of annual exercise	8.8.3
b)-3 Scenario preparation	8.8.2
b)-4 Drills on back shifts	8.8.4.1
2. a) Communications testing	8.8.4.2
b) Fire drills	8.8
c) Medical emergency drills	8.8.4.4
d) Radiological monitoring drills	8.8.4.5
e) Health Physics drills	8.8.4.3
1) Airborne and liquid sample and direct radiation measurement in environment	
3. Scenarios include:	
a) Basic objective	8.8.1.1
b) Dates, times, places, and participating organizations	8.8.1.2
c) Simulated events	8.8.1.3

APPENDIX E (Cont.)

<u>N. Exercises and Drills (Cont.)</u>	<u>Section</u>
d) Time schedule of real and simulated initiating events	8.8.1.4
e) Narrative summary	8.8.1.5
f) Qualified observers	8.8.1.6
4. State, Federal, and local observers; formal evaluation of exercises	8.8.1.5, 8.8.3
5. Means for corrective action; management control over corrective actions	8.8.3
<u>.O. Radiological Emergency Response Training</u>	
1. a) Provide site specific emergency response training for offsite emergency organizations who provide assistance	8.1.1.6 Table 8-1
2. Onsite training program shall include practical drills and on-the-spot correction of erroneous performance	8.1.2
3. Training for first aid teams shall include courses equivalent to Red Cross Multi-Media	8.1.2.4
4. Training program for:	
a) Directors or coordinators of response organizations	8.1.2.2
b) Personnel responsible for accident assessment	8.1.2.5
c) Radiological monitoring teams	8.1.2.2
d) Police and fire fighting personnel	Table 8-1
e) Repair and damage control teams (onsite)	8.1.2.2
f) First aid and rescue personnel	8.1.2.4 Table 8-1

APPENDIX E (Cont.)

O.	<u>Radiological Emergency Response Training (Cont.)</u>	<u>Section</u>
	g) Local support services personnel including Civil Defense/Emergency Service personnel	8.1.1.6 Table 8-1
	h) Medical support personnel	Table 8-1
	i) Operators headquarters support personnel	8.1.2.2
	j) Communicators	8.1.2.2
5.	Initial and annual retraining of personnel with emergency response responsibilities	8.1.2.1 8.1.2.2
P.	<u>Responsibility for the Planning Effort: Development, Periodic Review and Distribution of Emergency Plan</u>	
1.	Training for planners	8.1.1.8
2.	Person responsible for Radiological Emergency Response Planning	8.1.1
3.	Person responsible for development and updating of Emergency Plan	8.1.1
4.	Annual updating of plans	8.2
5.	Distribution of plans and revisions	8.2
6.	Detailed list of supporting plans	Appendix D
7.	List of procedures to implement the plan	Appendix A
8.	Table of Contents, Index, and cross reference to NUREG-0654	Table of Contents Appendix E
9.	Independent audits of the emergency preparedness program	8.3
10.	Update of emergency telephone numbers quarterly	8.5